

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____



☐ Week 2 _____

☐ Week 3 _____

*** NOTES:**
HIGH FIRE - TIER 3
EAGLE ZONE
ENVIRO POLE - WOODPECKER
BULLETIN 322 AREA
JOINT POLE
JOINT MEET - MULTIPLE RISERS
TRUCK ACCESS
2.5 MILES FROM COAST

NEAREST ADDRESS: N/O 5134 CATHEDRAL OAKS RD
DESIGN/CREW NOTES: REMOVE THE 90° BEND IN PRIMARY RISER AND
EXTEND RISER FOR CLEARANCES

TR: 2/C 4A-4KV (NE)
TR: 3/C 6B-4KV (SE)
TR: 1/O AT-120V (SLACK) (NE)
TR: 1-4/3" PRI RISER
TR: 1-4KV POTHEAD
TR: 1-3" SEC RISER

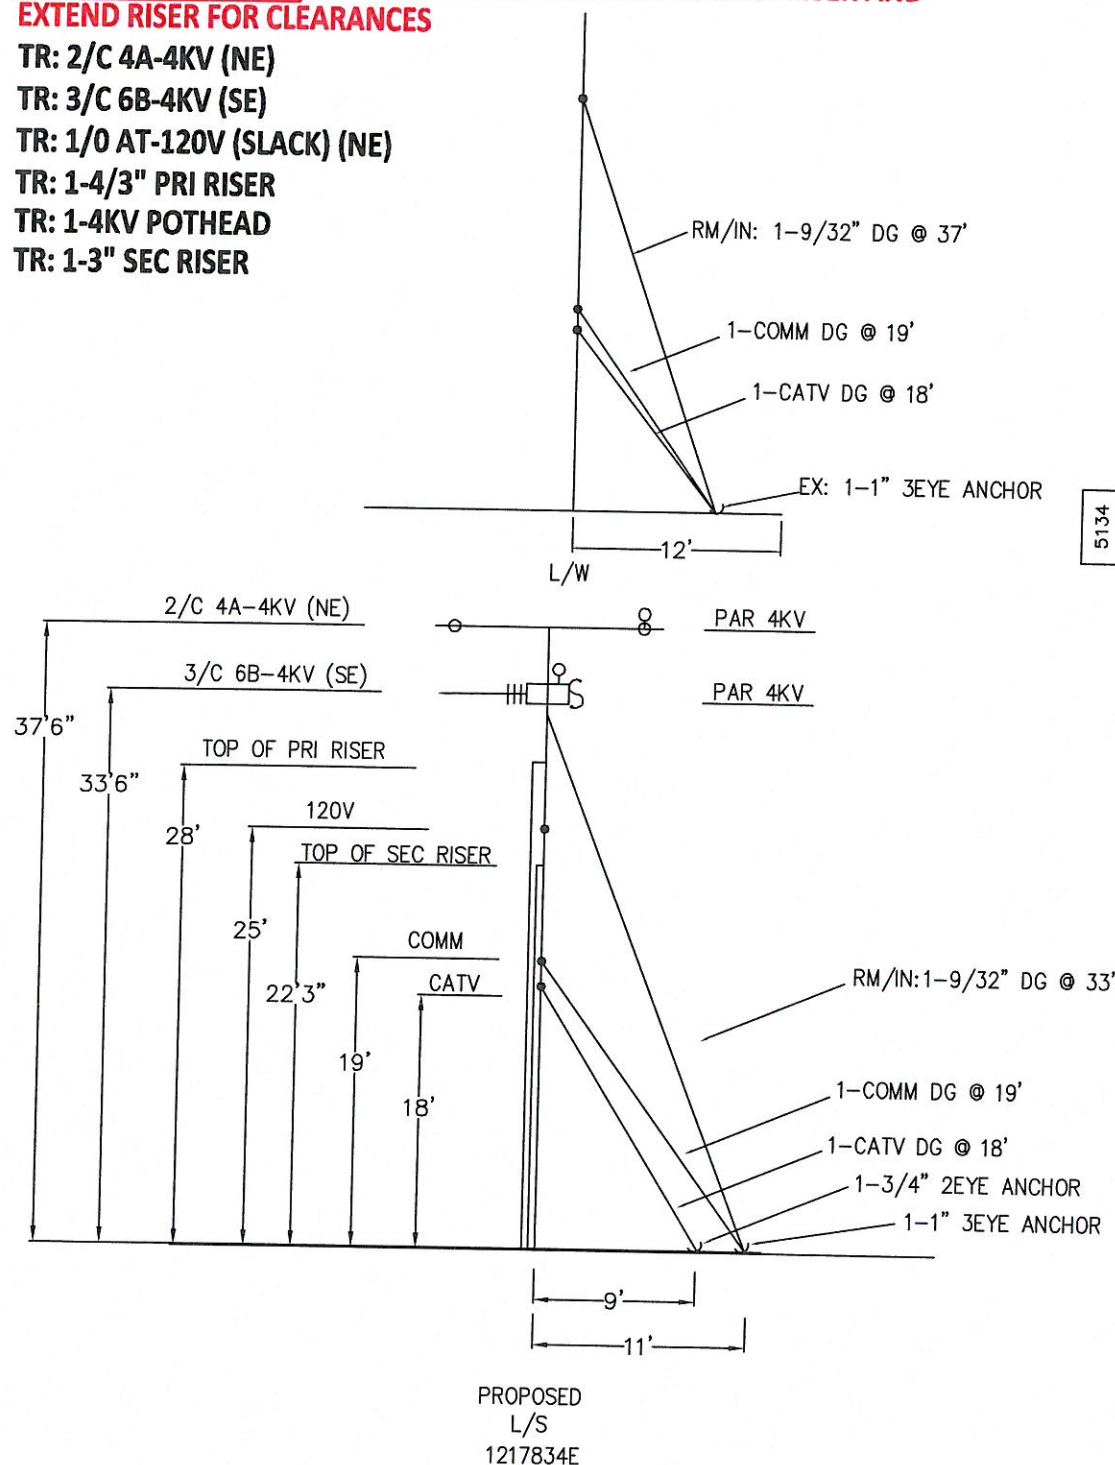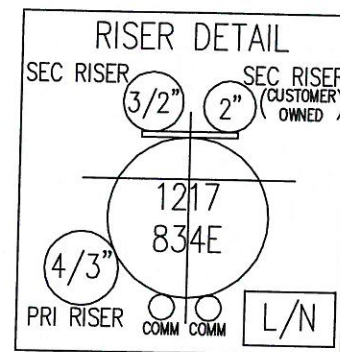

RM 1217834E 1
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- SA PORC 4KV 1-EA
RM: 1- FE CO OPEN 100A 4KV 1-EA
RM: 1- XA SNGL FB 10' STEEL PINS N/BOND
RM: 1- XA DBLE FB 10' STEEL PINS N/BOND
RM: 2- INS GLASS & PIN 4KV
RM: 1- INS NEUT GLASS & PIN 4KV
RM: 3- INS PORC DE 4KV RIG #6
RM: 2- INS PORC DE 4KV RIG #4
RM: 3- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- RSR WOOD BLOCKS

N: 34° 27' 15.72"
W: 119° 48' 04.78"
ELEVATION: 204'

SET SAME HOLE POLE

1217834E 2

45' Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- 4KV HIGH FIRE SURGE ARRESTER
IN: 1- FE CO MNT FOR ELF 100A 2.4KV 1-EA
IN: 1- ELF FUSE 8.3KV, 30 AMP
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 3- INS POLY W/PIN 12KV CLMP #6-4/0 CU
IN: 3- INS POLY DE 4KV RIG #6
IN: 2- INS POLY DE 4KV HOT SHOE #4 & 1/0 ACSR
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653
IN: 5- COVER, WILDLIFE, DEAD END CLAMP KIND HDPE MATERIAL, GREY COLOR
IN: 1- GR OH #6 SOL WP PRIMARY W/ROD
IN: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- AG BLOCK & POLE KEY
IN: 1- RSR PRECUT UNISTRUT W/ HARDWARE NO PVC
IN: 1- COVER, WILDLIFE, TO BE USED ON TERMINATORS/POTHEADS, 4-1/2" X 8"

UNGUYED DE CALC

A. 128' SPAN 1-1/OAT W/50% LIGHT =654.5 LBS
654.5 LBS x 25' =16362 FT-LBS
45' CLASS 4 DF-TB POLE CAN HOLD =17138 FT-LBS
BREAST BLOCK & POLE KEY IN CLASS 4 SOIL=47500 FT-LBS

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED ☐
PWRD 88 REQUIRED ☐
UG CIVIL ONLY WORK ORDER ☐
PERMIT REQUIRED ☒
PERMIT TYPE: _____
OUTAGE REQUIRED ☒
OUTAGE DATE: _____ TIME: _____
TRAFFIC CONTROL REQUIRED ☒
PED. TRAFFIC CONTROL REQ'D ☐
CONVEYANCE LETTER REQ'D ☐
ENVIRONMENTAL CLEARANCE REQ'D ☒
CSD 140 (TLM) REQ'D ☐

DISTRICT 49 - SANTA BARBARA			PROJ. MGR. TOLMASOFF, LAURA M PHONE 909-660-1362			PLANNER HAMPTON TEDDER PHONE 909-628-1253			DESIGNER HAMPTON TEDDER		
PROJECT NO. 1671111		SERVICE REQUEST 2578039		MSR NO.		PRODUCT-1 1460610-INFRA REPLAC - DET POLE REPLACEMENT				ASSOC DESG	
CIRCUIT / VOLTAGE PAR 2.4KV				THOMAS GUIDE		PRODUCT-2				ASSOC DESG	
SUB / PG NO. PAR P.T.				CIRCUIT CODE 13656		PRODUCT-3				ASSOC DESG	
INVENTORY MAP 19-52D			J.P.A. NO. E6049-409697226			PROPOSED CONSTRUCTION (LOCATION) DETERIORATED POLE 1217834E CATHEDRAL OAKS RD P/P 1000' N, 1542' W/O N SAN MARCOS RD GOLETA, CA					
	12/18				JD/HTE						
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET		DESIGN\DRWG NO.			
Southern California Edison Company						1 1		1082408 001			



NOT TO SCALE



1217834E

