

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____


☐ Week 2 _____

☐ Week 3 _____

* NOTES: JOINT POLE
ENVIRO POLE - OPEN & WEEDY
BULLETIN 322 AREA
EAGLE ZONE
JOINT MEET - MULTIPLE RISERS
HAND SET
SET SAME HOLE

- 1 RM 1217836E Class C4
- 40'
- RM: 1- POLE 40' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS N/BOND
RM: 1- INS GLASS & PIN 4KV
RM: 1- INS NEUT GLASS & PIN 4KV
RM: 2- INS GLASS DE ROLLER #4 ACSR
RM: 2- INS GLASS/POLY 35KV & LESS
RM: 1- SEC 3-WIRE (284 RACK)
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- AG SPAN GUY 9/32" - 200'
RM: 1- AG SIDEWALK GUY
RM: 1- AG ANCHOR ROD 3/4" X 8' 2-EYE W/PLATE
RM: 1- RSR 4" ON KICK BLOCK EXTENSION

TRANSFER (S):
2/C 4A-2.4KV
1-1/OAT-120V (N)
1-3"-2" SEC RISER



2/C 4A-2.4KV @ 38'

1/OAT-120V @ 28' (N)
SECONDARY RISER @ 27'


COMM @ 22'
CATV @ 21'

PROPOSED
L/N
1217836E

RM: 2 EYE ANCHOR
IN: 3 EYE ANCHOR


RM/IN: 9/32" SG @ 27'

PROPOSED
L/E
1217836E

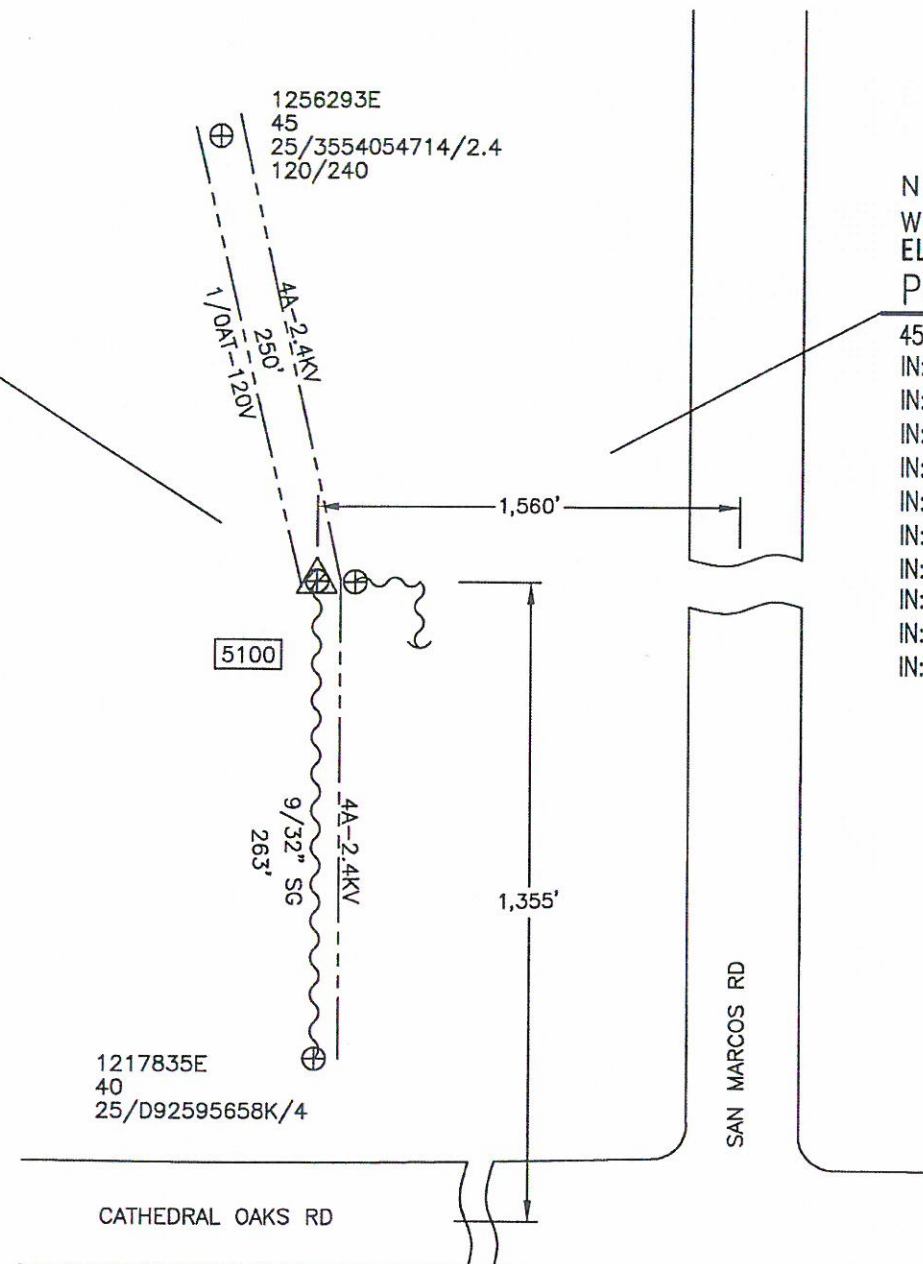

N 34° 27' 19.22"
W 119° 48' 05.06"
ELEVATION: 232'

- POLE 1217836E Class C4 2
- 45'
- IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- XA DBLE FB 10' STEEL PINS N/BOND
IN: 2- INS POLY W/PIN 12KV CLMP #4-653 ACSR
IN: 4- INS POLY DE 4KV HOT SHOE #4 & 1/0 ACSR
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- AG SPAN GUY 9/32" - 200'
IN: 1- AG SIDEWALK GUY
IN: 1- AG ANCHOR ROD 1" X 10' 3-EYE W/PLATE
IN: 1- RSR PRECUT UNISTRUT W/ HARDWARE NO PVC

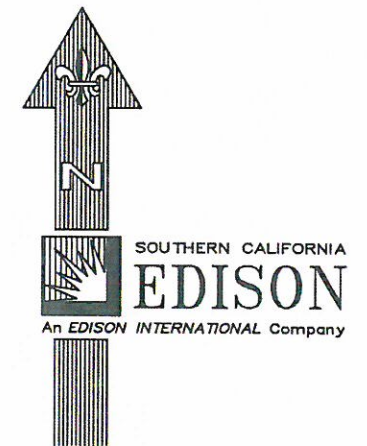

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☐
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 49 — SANTA BARBARA			PROJ. MGR. PARK, JU YOUNG PHONE 909-222-9350			PLANNER ASPLUNDH PHONE 714-893-2405			DESIGNER ASPLUNDH				
PROJECT NO. 1465333		SERVICE REQUEST 2379167		MSR NO.		PRODUCT-1 1296821-INFRA REPLAC — DET POLE REPLACEMENT						ASSOC DESGN	
CIRCUIT / VOLTAGE PAR 2.4KV				THOMAS GUIDE		PRODUCT-2						ASSOC DESGN	
SUB / PG NO. PAR P.T. SUB				CIRCUIT CODE		PRODUCT-3						ASSOC DESGN	
INVENTORY MAP 19-52C			J.P.A. NO. 408725558			PROPOSED CONSTRUCTION (LOCATION) POLE # 1217836E 5100 CATHEDRAL OAKS RD SANTA BARBARA, CA							
					ASP								
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET			DESIGN\DRWG NO.				
Southern California Edison Company						OF			950237 0.01				



1217836E





1217836E

