

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only


Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

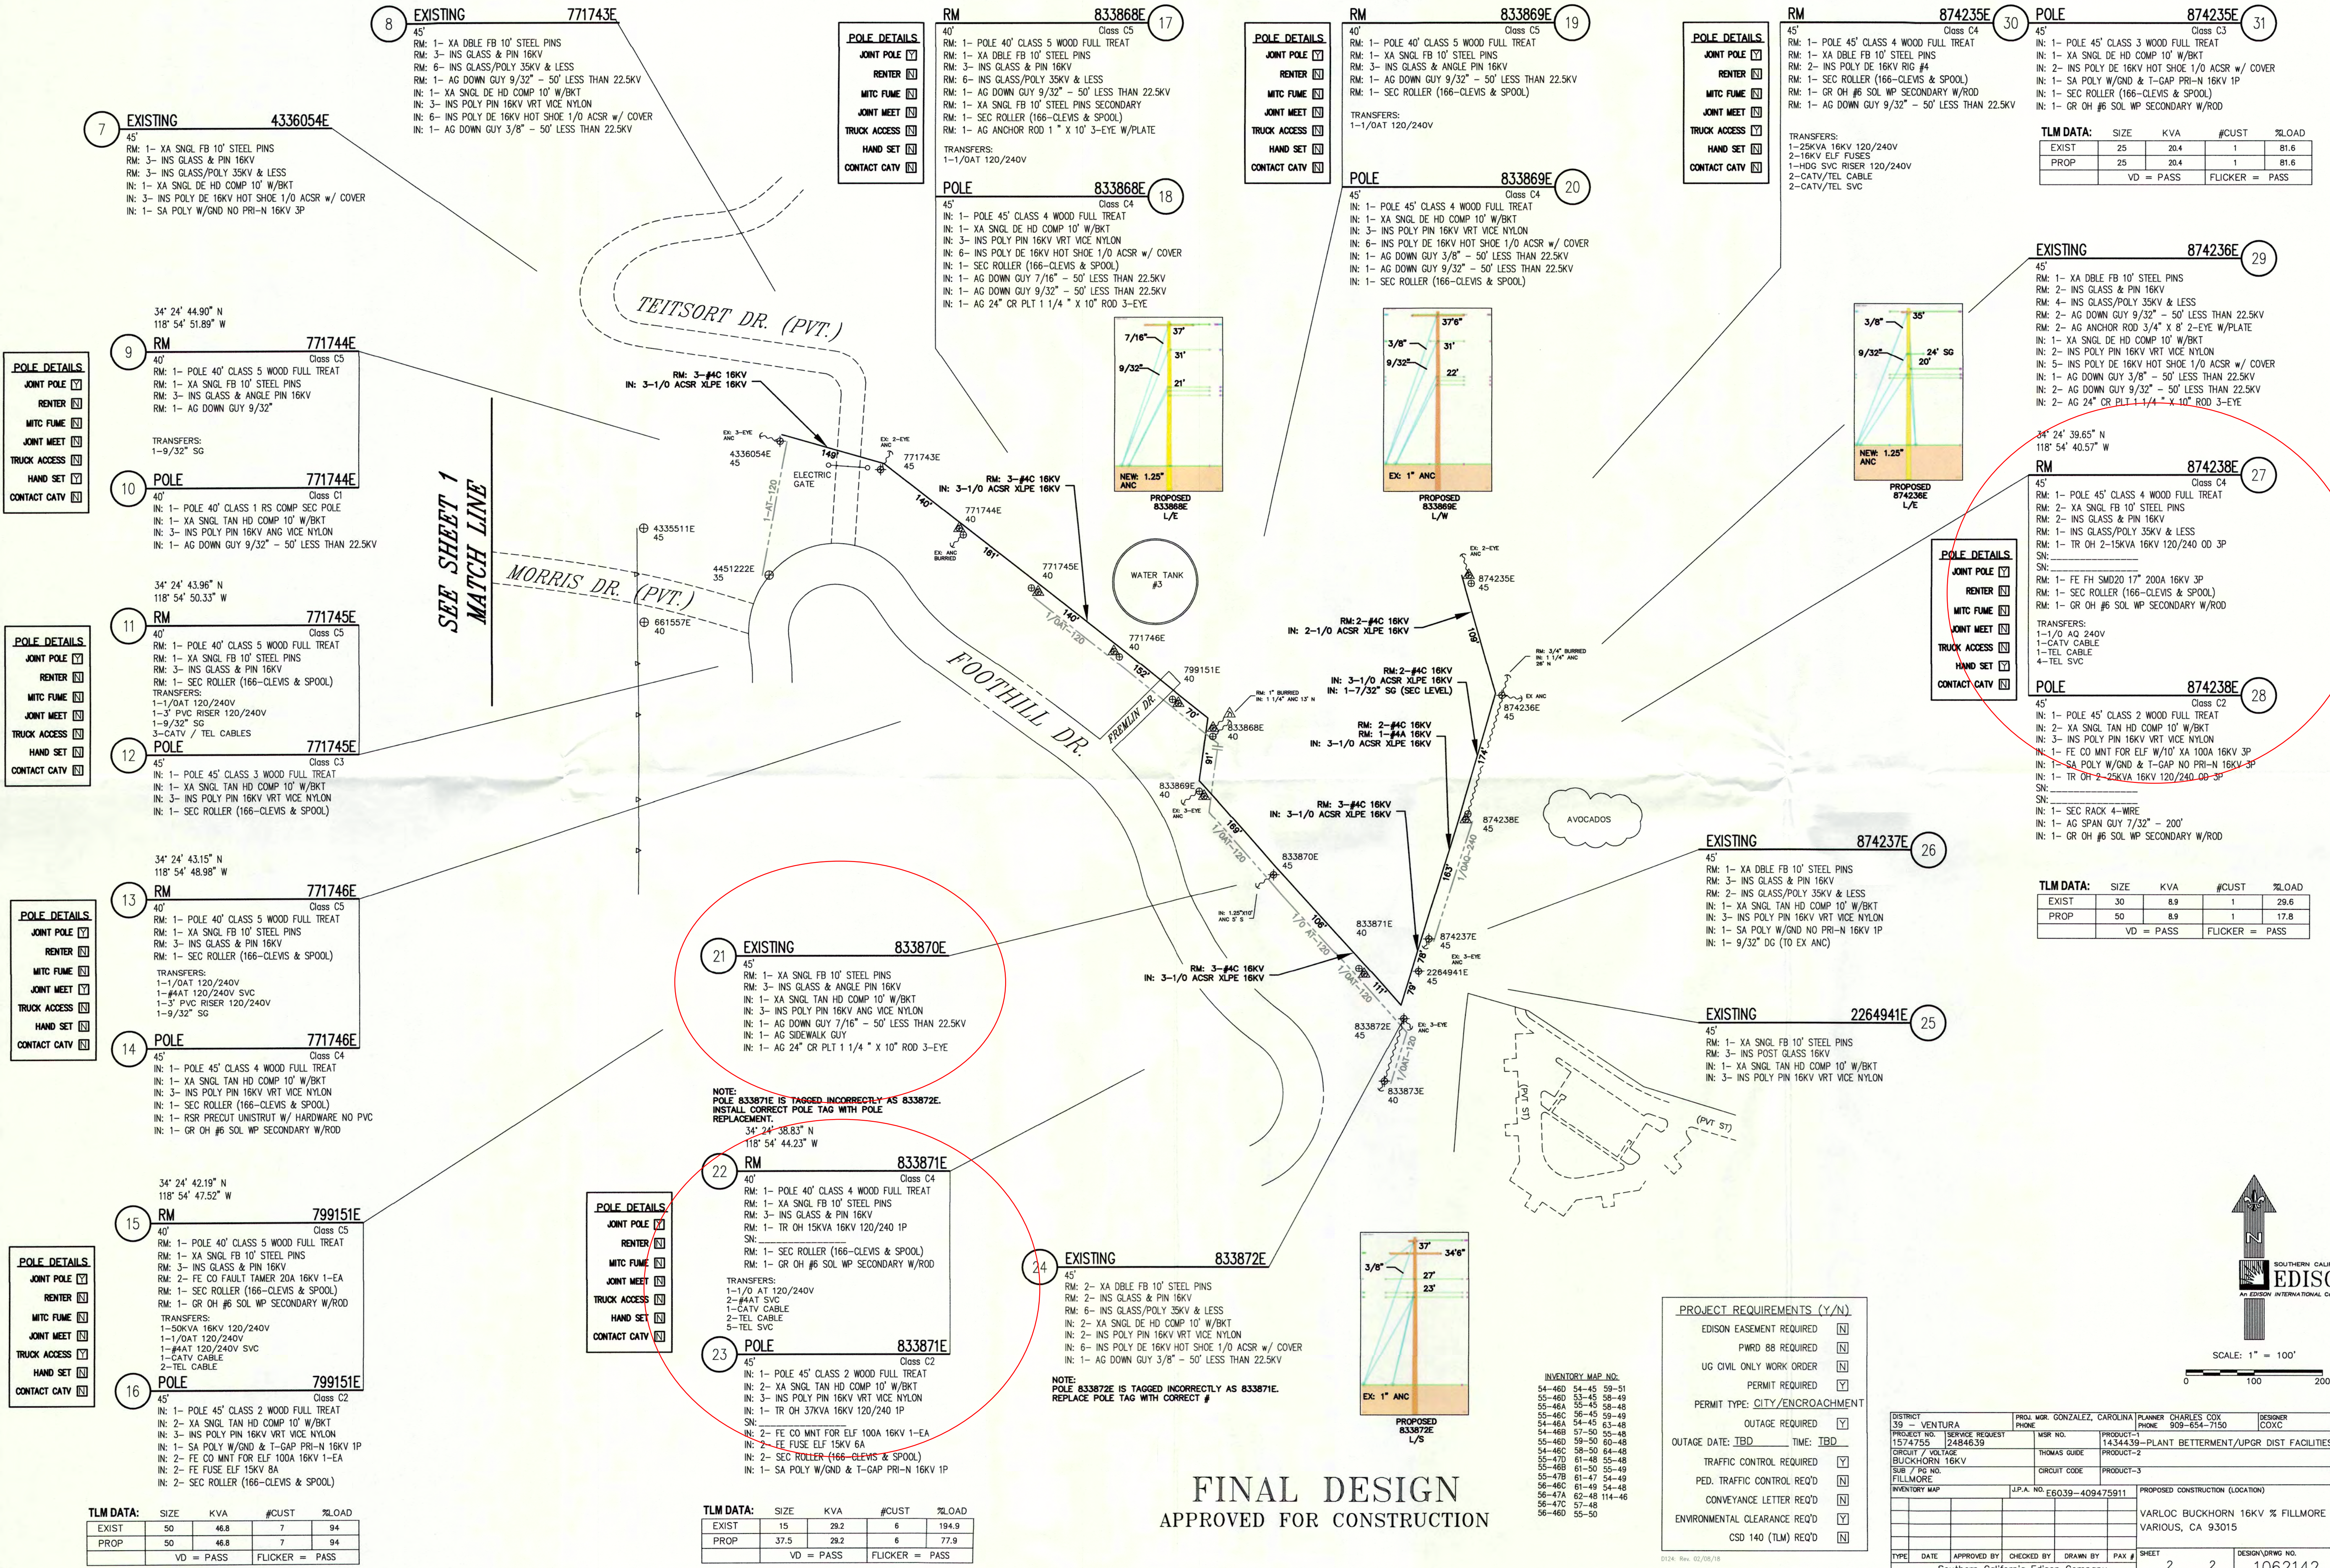

POLE DETAILS
JOINT POLE ☒
RENTER ☐
MITC FUME ☐
JOINT MEET ☐
TRUCK ACCESS ☐
HAND SET ☒
CONTACT CATV ☐

POLE DETAILS
JOINT POLE ☒
RENTER ☐
MITC FUME ☐
JOINT MEET ☐
TRUCK ACCESS ☐
HAND SET ☐
CONTACT CATV ☐

POLE DETAILS
JOINT POLE ☒
RENTER ☐
MITC FUME ☐
JOINT MEET ☒
TRUCK ACCESS ☐
HAND SET ☐
CONTACT CATV ☐

POLE DETAILS
JOINT POLE ☒
RENTER ☐
MITC FUME ☐
JOINT MEET ☒
TRUCK ACCESS ☒
HAND SET ☐
CONTACT CATV ☐

POLE DETAILS
JOINT POLE ☐
RENTER ☐
MITC FUME ☐
JOINT MEET ☐
TRUCK ACCESS ☐
HAND SET ☐
CONTACT CATV ☐

POLE DETAILS
JOINT POLE ☐
RENTER ☐
MITC FUME ☐
JOINT MEET ☐
TRUCK ACCESS ☐
HAND SET ☐
CONTACT CATV ☐

POLE DETAILS
JOINT POLE ☐
RENTER ☐
MITC FUME ☐
JOINT MEET ☐
TRUCK ACCESS ☐
HAND SET ☐
CONTACT CATV ☐

POLE DETAILS
JOINT POLE ☐
RENTER ☐
MITC FUME ☐
JOINT MEET ☐
TRUCK ACCESS ☐
HAND SET ☒
CONTACT CATV ☐

PROJECT REQUIREMENTS (Y/N)
EDISON EASEMENT REQUIRED ☐
PWRD 88 REQUIRED ☐
UG CIVIL ONLY WORK ORDER ☐
PERMIT REQUIRED ☒
PERMIT TYPE: CITY/ENCROACHMENT
OUTAGE REQUIRED ☒
OUTAGE DATE: TBD TIME: TBD
TRAFFIC CONTROL REQUIRED ☒
PED. TRAFFIC CONTROL REQ'D ☐
CONVEYANCE LETTER REQ'D ☐
ENVIRONMENTAL CLEARANCE REQ'D ☒
CSD 140 (TLM) REQ'D ☐

EXISTING 4336054E
45'
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 3- INS GLASS/POLY 35KV & LESS
IN: 1- XA SNGL DE HD COMP 10" W/BKT
IN: 3- INS POLY DE 16KV HOT SHOE 1/0 ACSR w/ COVER
IN: 1- SA POLY W/GND NO PRI-N 16KV 3P

RM 771744E
Class C5
40'
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS GLASS & ANGLE PIN 16KV
RM: 1- AG DOWN GUY 9/32"

POLE 771744E
Class C1
40'
IN: 1- POLE 40' CLASS 1 RS COMP SEC POLE
IN: 1- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV ANG VICE NYLON
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

RM 771745E
Class C5
40'
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
TRANSFERS:
1-1/OAT 120/240V
1-3" PVC RISER 120/240V
1-9/32" SG
3-CATV / TEL CABLES

POLE 771745E
Class C3
45'
IN: 1- POLE 45' CLASS 3 WOOD FULL TREAT
IN: 1- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)

RM 771746E
Class C5
40'
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
TRANSFERS:
1-1/OAT 120/240V
1-#4AT 120/240V SVC
1-3" PVC RISER 120/240V
1-9/32" SG

POLE 771746E
Class C4
45'
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- RSR PRECUT UNISTRUT W/ HARDWARE NO PVC
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD

RM 799151E
Class C5
40'
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 2- FE CO FAULT TAKER 20A 16KV 1-EA
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD

POLE 799151E
Class C2
45'
IN: 1- POLE 45' CLASS 2 WOOD FULL TREAT
IN: 2- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 1- SA POLY W/GND & T-GAP PRI-N 16KV 1P
IN: 2- FE CO MNT FOR ELF 100A 16KV 1-EA
IN: 2- FE FUSE ELF 15KV 8A
IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)

RM 833868E
Class C5
40'
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA DBLE FB 10" STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 6- INS GLASS/POLY 35KV & LESS
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- XA SNGL FB 10" STEEL PINS SECONDARY
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG ANCHOR ROD 1" X 10" 3-EYE W/PLATE
TRANSFERS:
1-1/OAT 120/240V

POLE 833868E
Class C4
45'
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- XA SNGL DE HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 6- INS POLY DE 16KV HOT SHOE 1/0 ACSR w/ COVER
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG DOWN GUY 7/16" - 50' LESS THAN 22.5KV
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- AG 24" CR PLT 1 1/4" X 10" ROD 3-EYE

RM 833869E
Class C5
40'
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS GLASS & ANGLE PIN 16KV
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
TRANSFERS:
1-1/OAT 120/240V

POLE 833869E
Class C4
45'
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- XA SNGL DE HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 6- INS POLY DE 16KV HOT SHOE 1/0 ACSR w/ COVER
IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)

RM 874235E
Class C4
45'
RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA DBLE FB 10" STEEL PINS
RM: 2- INS POLY DE 16KV RIG #4
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
TRANSFERS:
1-25KVA 16KV 120/240V
2-16KV ELF FUSES
1-HDG SVC RISER 120/240V
2-CATV/TEL CABLE
2-CATV/TEL SVC

POLE 874235E
Class C3
45'
IN: 1- POLE 45' CLASS 3 WOOD FULL TREAT
IN: 1- XA SNGL DE HD COMP 10" W/BKT
IN: 2- INS POLY DE 16KV HOT SHOE 1/0 ACSR w/ COVER
IN: 1- SA POLY W/GND & T-GAP PRI-N 16KV 1P
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD

TLM DATA:	SIZE	KVA	#CUST	%LOAD
EXIST	25	20.4	1	81.6
PROP	25	20.4	1	81.6
VD = PASS				FLICKER = PASS

EXISTING 874236E
45'
RM: 1- XA DBLE FB 10" STEEL PINS
RM: 2- INS GLASS & PIN 16KV
RM: 4- INS GLASS/POLY 35KV & LESS
RM: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 2- AG ANCHOR ROD 3/4" X 8" 2-EYE W/PLATE
IN: 1- XA SNGL DE HD COMP 10" W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON
IN: 5- INS POLY DE 16KV HOT SHOE 1/0 ACSR w/ COVER
IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
IN: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 2- AG 24" CR PLT 1 1/4" X 10" ROD 3-EYE

RM 874238E
Class C4
45'
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 2- XA SNGL FB 10" STEEL PINS
RM: 2- INS GLASS & PIN 16KV
RM: 1- INS GLASS/POLY 35KV & LESS
RM: 1- TR OH 2-15KVA 16KV 120/240 OD 3P
SN: _____
RM: 1- FE FH SMD20 17" 200A 16KV 3P
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
TRANSFERS:
1-1/0 AQ 240V
1-CATV CABLE
4-TEL SVC

POLE 874238E
Class C2
45'
IN: 1- POLE 45' CLASS 2 WOOD FULL TREAT
IN: 2- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 1- FE CO MNT FOR ELF W/10" XA 100A 16KV 3P
IN: 1- SA POLY W/GND & T-GAP NO PRI-N 16KV 3P
IN: 1- TR OH 2-25KVA 16KV 120/240 OD 3P
SN: _____
IN: 1- SEC RACK 4-WIRE
IN: 1- AG SPAN GUY 7/32" - 200'
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD

TLM DATA:	SIZE	KVA	#CUST	%LOAD
EXIST	30	8.9	1	29.6
PROP	50	8.9	1	17.8
VD = PASS				FLICKER = PASS

EXISTING 874237E
45'
RM: 1- XA DBLE FB 10" STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 2- INS GLASS/POLY 35KV & LESS
IN: 1- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 1- SA POLY W/GND NO PRI-N 16KV 1P
IN: 1- 9/32" DG (TO EX ANC)

EXISTING 2264941E
45'
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS POST GLASS 16KV
IN: 1- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON

EXISTING 833870E
45'
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS GLASS & ANGLE PIN 16KV
IN: 1- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV ANG VICE NYLON
IN: 1- AG DOWN GUY 7/16" - 50' LESS THAN 22.5KV
IN: 1- AG SIDEWALK GUY
IN: 1- AG 24" CR PLT 1 1/4" X 10" ROD 3-EYE

NOTE:
POLE 833871E IS TAGGED INCORRECTLY AS 833872E.
INSTALL CORRECT POLE TAG WITH POLE REPLACEMENT.

RM 833871E
Class C4
40'
RM: 1- POLE 40' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL FB 10" STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 1- TR OH 15KVA 16KV 120/240 1P
SN: _____
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
TRANSFERS:
1-1/0 AT 120/240V
2-#4AT SVC
1-CATV CABLE
2-TEL CABLE
5-TEL SVC

POLE 833871E
Class C2
45'
IN: 1- POLE 45' CLASS 2 WOOD FULL TREAT
IN: 2- XA SNGL TAN HD COMP 10" W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 1- TR OH 37KVA 16KV 120/240 1P
SN: _____
IN: 2- FE CO MNT FOR ELF 100A 16KV 1-EA
IN: 2- FE FUSE ELF 15KV 8A
IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- SA POLY W/GND & T-GAP PRI-N 16KV 1P


EXISTING 833872E
45'
RM: 2- XA DBLE FB 10" STEEL PINS
RM: 2- INS GLASS & PIN 16KV
RM: 6- INS GLASS/POLY 35KV & LESS
IN: 2- XA SNGL DE HD COMP 10" W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON
IN: 6- INS POLY DE 16KV HOT SHOE 1/0 ACSR w/ COVER
IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
NOTE:
POLE 833872E IS TAGGED INCORRECTLY AS 833871E.
REPLACE POLE TAG WITH CORRECT #

TLM DATA:	SIZE	KVA	#CUST	%LOAD
EXIST	15	28.2	6	194.9
PROP	37.5	28.2	6	77.9
VD = PASS				FLICKER = PASS

FINAL DESIGN
APPROVED FOR CONSTRUCTION



DISTRICT 38 - VENTURA	PROJ. MGR. GONZALEZ, CAROLINA	PLANNER CHARLES COX	DESIGNER COXC
PROJECT NO. 1574755	SERVICE REQUEST 2484639	MSR NO. THOMAS GUIDE	PRODUCT-1 1434439-PLANT BETTERMENT/UPGR DIST FACILITIES
CIRCUIT 7 VOLTAGE BUCKHORN 16KV	CIRCUIT CODE	PRODUCT-2	ASSOC DESIGN
SUB 7 PG NO. FILLMORE	J.P.A. NO. E6039-409475911	PROPOSED CONSTRUCTION (LOCATION)	ASSOC DESIGN
INVENTORY MAP		VARLOC BUCKHORN 16KV % FILLMORE VARIOUS, CA 93015	
TYPE	DATE	APPROVED BY	CHECKED BY
		DRAWN BY	PAX #
Southern California Edison Company			
SHEET 2 OF 2			
DESIGN/DRWG NO. 1062142_0.01			

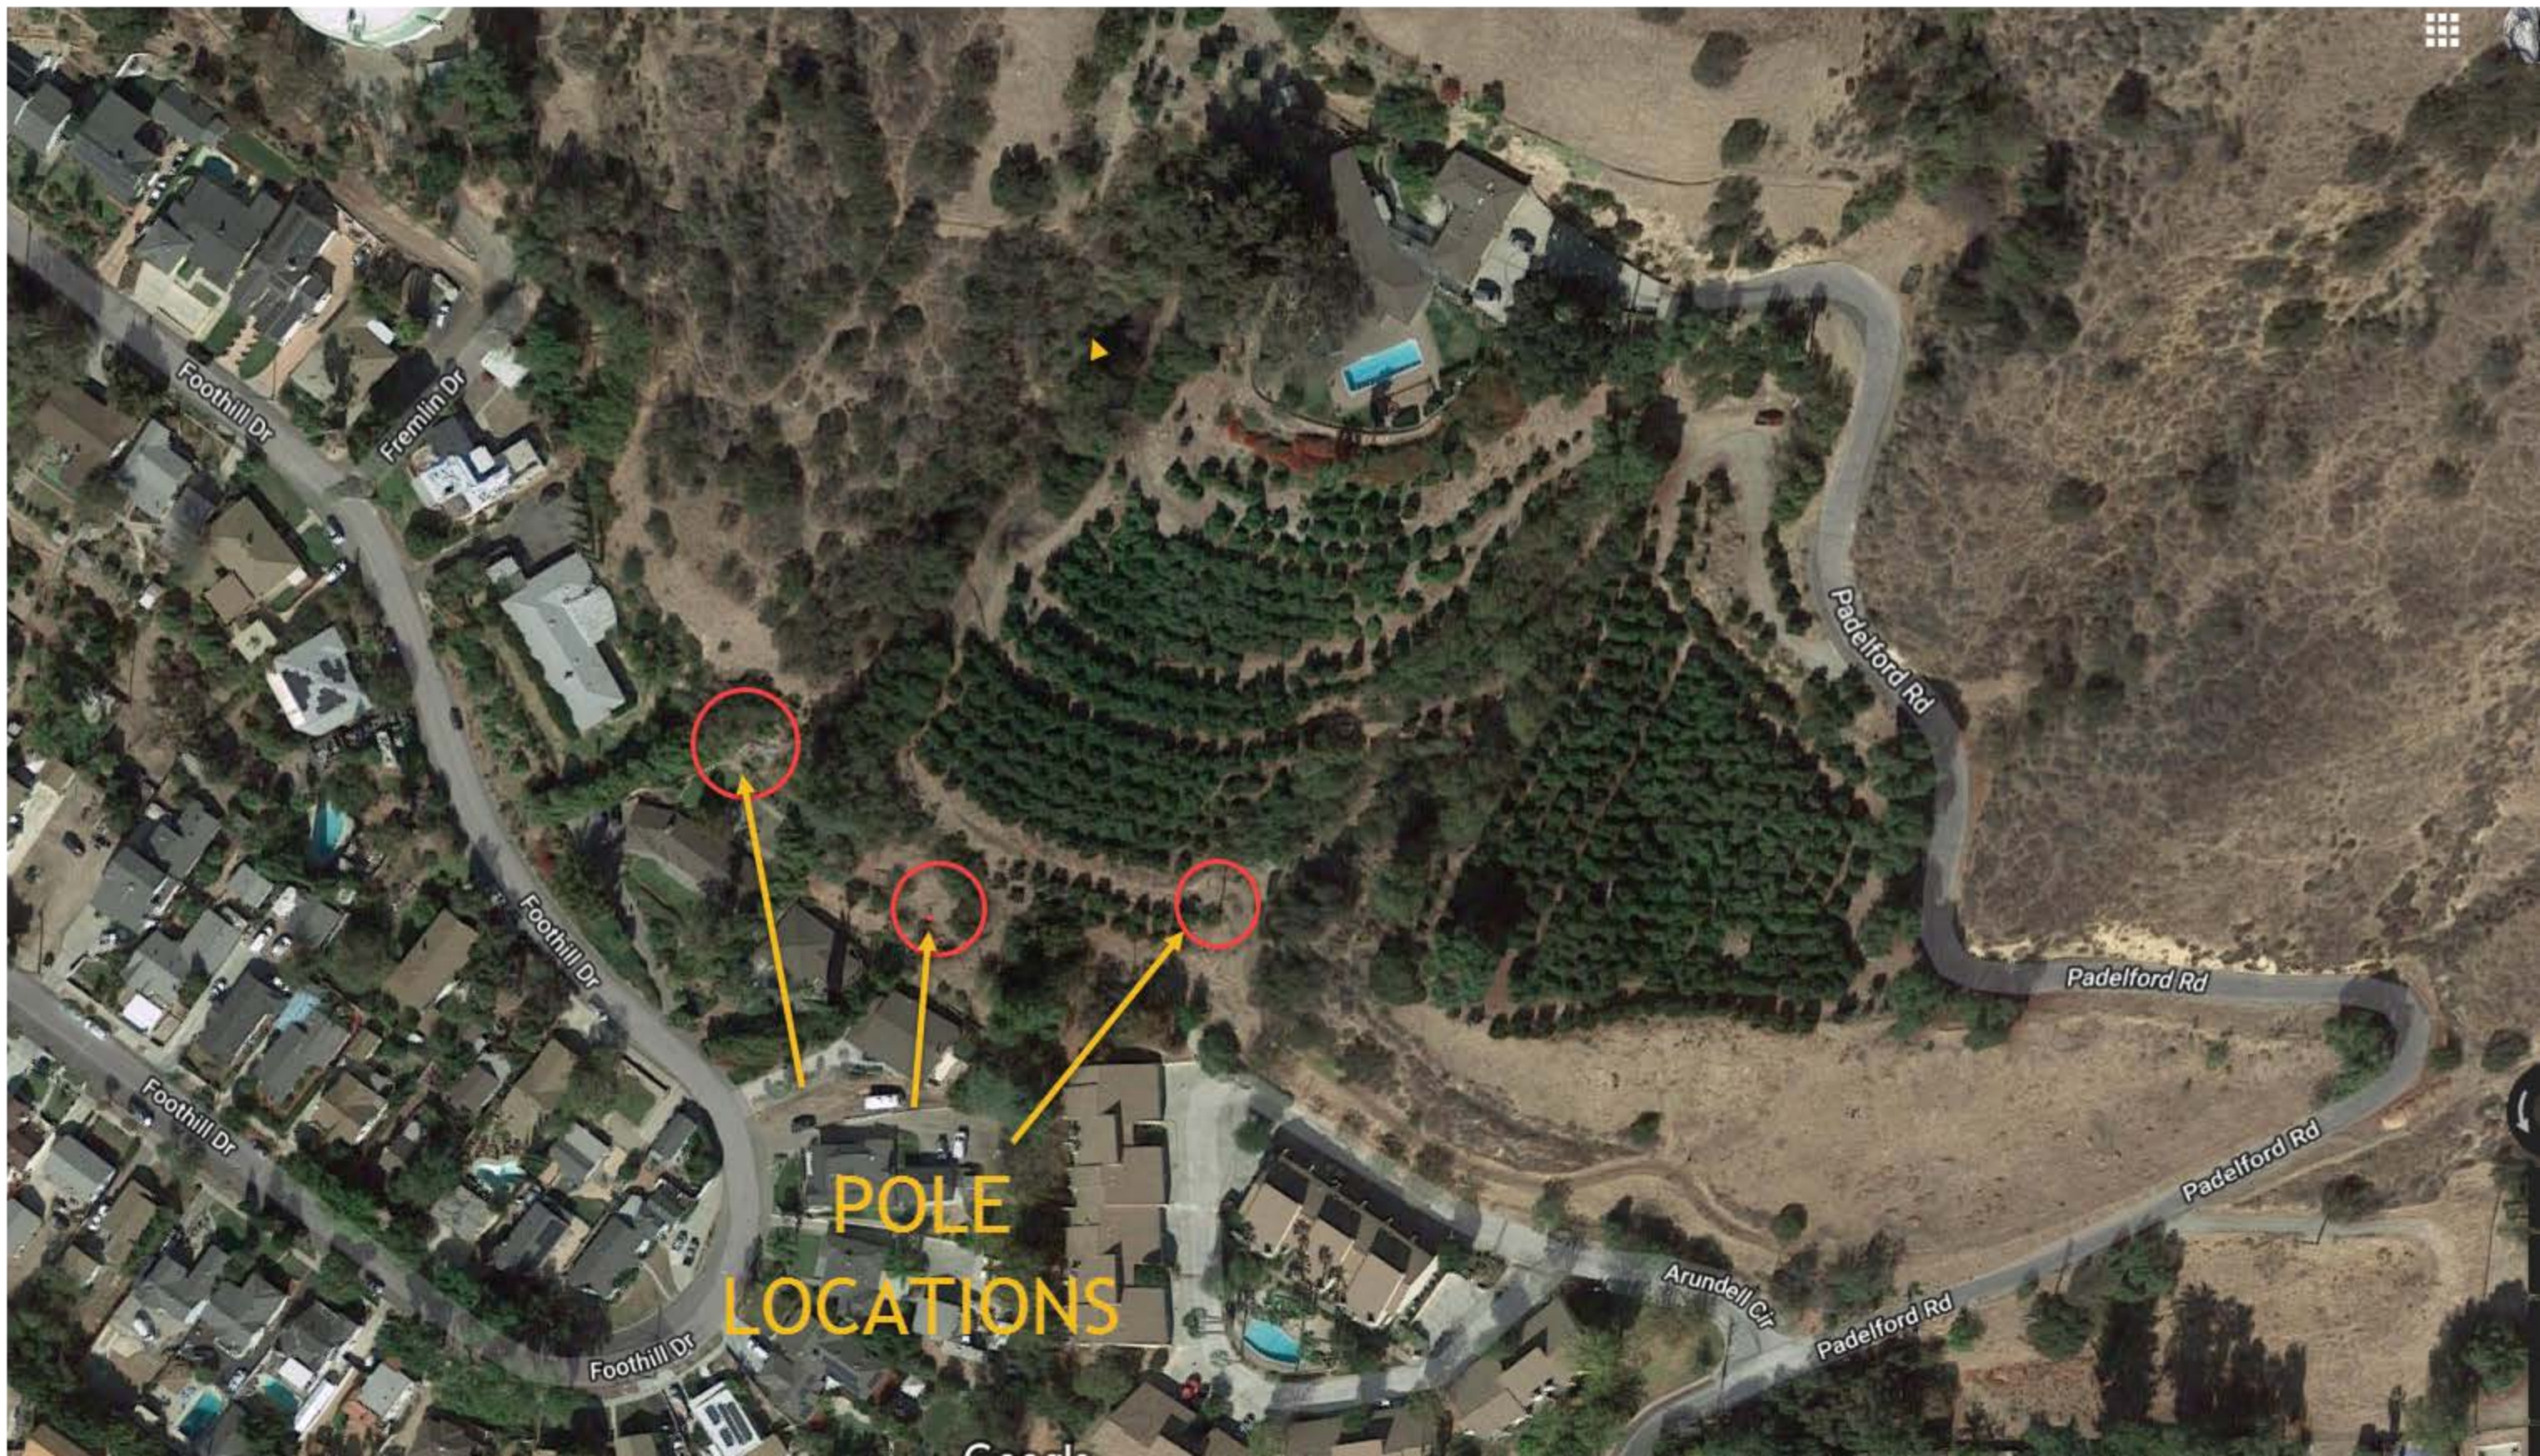

POLE
LOCATIONS