

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____


☐ Week 2 _____

☐ Week 3 _____

* NOTES: JOINT POLE
COMPOSITE POLE
ENVIRO POLE - WOODPECKER DAMAGE
REAR PROPERTY LINE POLE
REPLACE 1 O/W SERVICE(S)
BULLETIN 322 AREA
EAGLE ZONE
+2 MILES FROM SUB
HAND SET
SET 1' NORTH

TRANSFER (S):
2/C 6B-16KV

1 RM 1346234E Class C5
40'
RM: 1- RM POLE 40' CLASS 5 WOOD FULL TREAT
RM: 44- CD ALL SIZES AL/CU 3/C
RM: 1- TR OH 10KVA 16KV 120/240 1P
SN: _____
RM: 1- XA DBLE FB 10' STEEL PINS
RM: 2- INS GLASS/POLY 35KV & LESS
RM: 1- SEC 3-WIRE (284 RACK)
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD

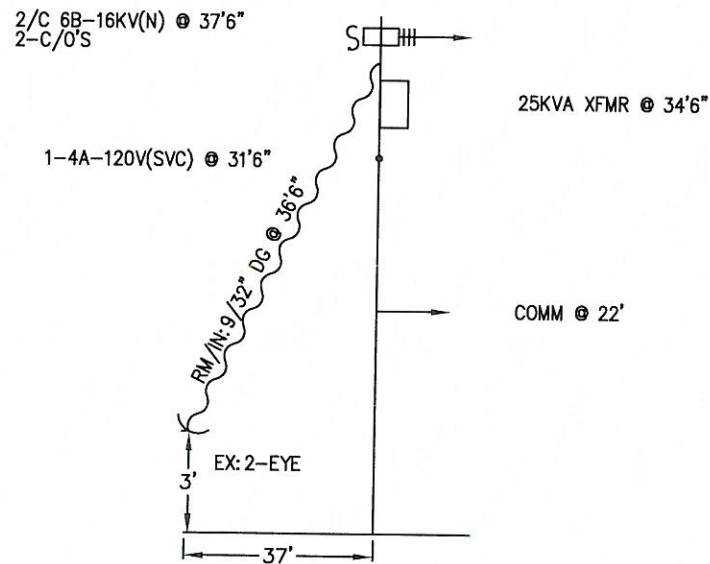

PROPOSED
L/W
1346234E

4041704E
45

W CAMINO CIELO

6B-16KV
682'

3,100'

SAN MARCOS PASS RD

N 34° 30' 04.64"
W 119° 49' 18.46"
ELEVATION: 2,165'

POLE 1346234E 2

45' Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 44- CD #4 STR AL TRIPLEX W/ACSR NEUTRAL
IN: 1- TR OH 25KVA 16KV 120/240 1P
SN: _____
IN: 2- FE CO MNT FOR ELF 100A 16KV 1-EA
IN: 2- FE FUSE ELF 15KV 6A
IN: 1- XA DBL HD DE COMP 10'
IN: 2- INS POLY DE 16KV RIG #6
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD
IN: 1- GUYING TEE

T.L.M. DATA:				
SIZE	KVA	CUST	% LOAD	
EXIST. 10	7.1	1	71	%
PROP. 25	7.1	1	28.40	%
VOLTAGE DROP: _____				
FLICKER FACTOR: _____				
PRI. CIRCUIT: CIR_CACHUMA_16KV				

RM: 3/C 4WAL-120V
IN: 4AT-120V

PROJECT REQUIREMENTS (Y/N)


EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE: _____	
OUTAGE REQUIRED	☒
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 49 – SANTA BARBARA				PROJ. MGR. PARK, JU PHONE 909-222-9350		PLANNER ASP PHONE 714-893-2405		DESIGNER ASP	
PROJECT NO. 1671728		SERVICE REQUEST 2578649		MSR NO.		PRODUCT-1 1461029-INFRA REPLAC – DET POLE REPLACEMENT			ASSOC DESGN
CIRCUIT / VOLTAGE CACHUMA 16KV				THOMAS GUIDE		PRODUCT-2			ASSOC DESGN
SUB / PG NO. VEGAS SUB				CIRCUIT CODE		PRODUCT-3			ASSOC DESGN
INVENTORY MAP 24-51			J.P.A. NO. 409699676			PROPOSED CONSTRUCTION (LOCATION) POLE# 1346234E W CAMINO CIELO PP 650' S, 3,100' SW/O SAN MARCOS PASS RD SANTA BARBARA			



NOT TO SCALE

1346234E

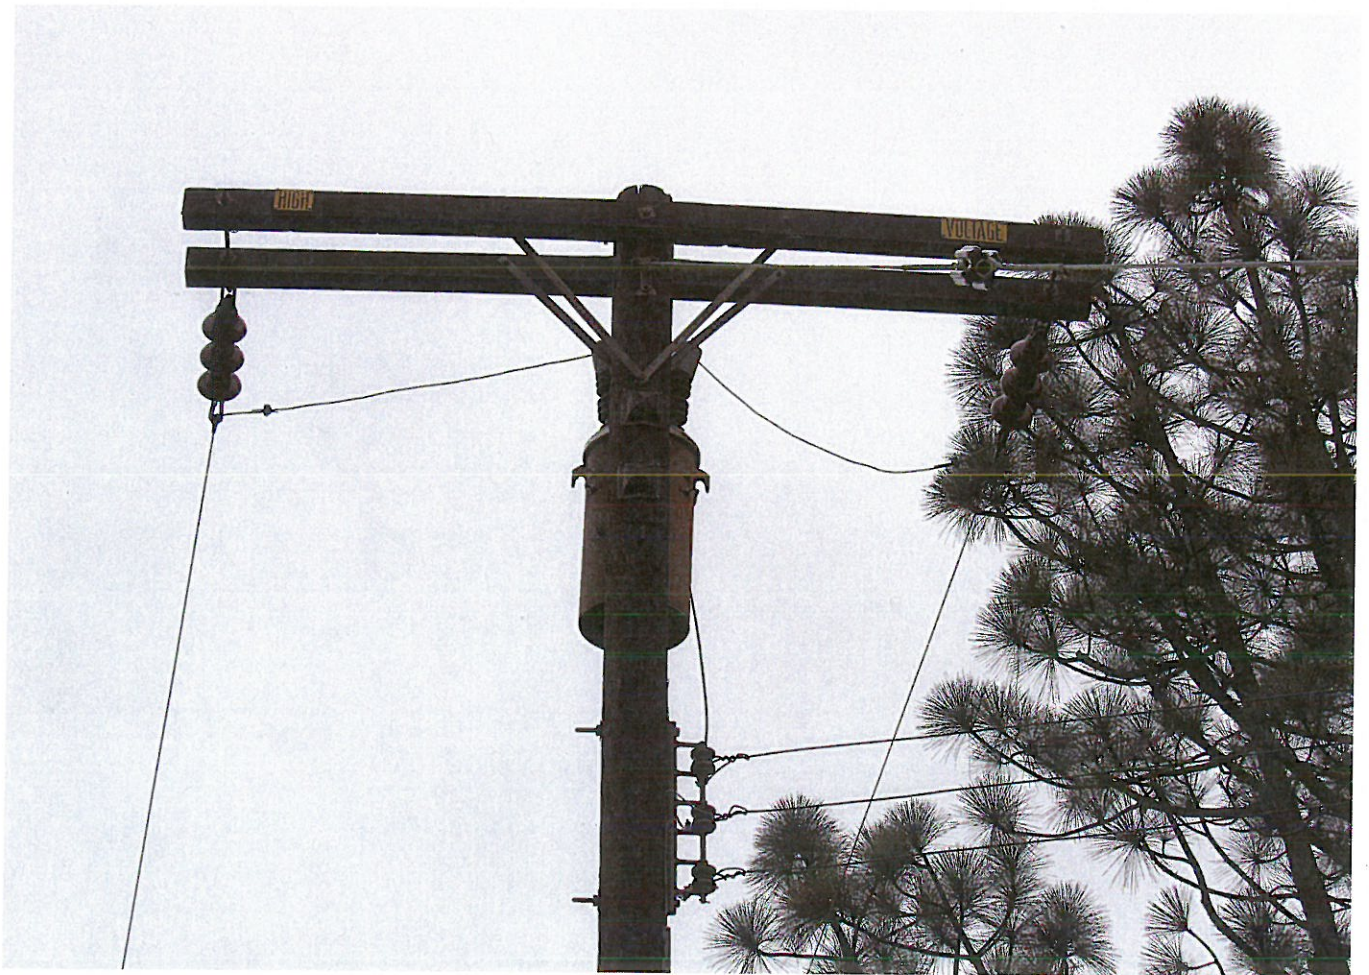

1346234E



Uep1