

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

NOTES:

- SCE TO PTD.
- HARD SET EAST.
- SCE TO TRANSFER FTR.
- TRAFFIC CONTROL REQUIRED.
- TREE TRIMMING AND MAJOR BRUSH CLEARING REQUIRED.
- RIGHTS CHECK REQUIRED; USFS - LOS PADRES NATIONAL FOREST.
- HAND DIG/SET.
- EAGLE ZONE.
- BULLETIN 322 AREA.

TRANSFER:

- 3-#2ACSR 16KV
- 1-1" + 1/4" MESS (FTR RENTER)
- 1.5" + 5/16" MESS (JPA)

TIER 3



60'

PARADISE RD.

UNK

STAGE COACH RD.

37'6"

CATV 24'
TELCO 23'PROPOSED
1324385E
L/N

3

RM

1324385E

45' Class C4
RM: 1- RM POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 3- INS POST GLASS 16KV

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE: USFS	
OUTAGE REQUIRED	☐
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT

49 - SANTA BARBARA

PROJ. MGR. PARK, JU YOUNG
PHONE 909-222-9350PLANNER TIDWELL DESIGN
PHONE 805-647-4707DESIGNER
TIDWELL DESIGNPROJECT NO. 1573708
SERVICE REQUEST 2483600

MSR NO.

PRODUCT-1

1381801-INFRA REPLAC - DET POLE REPLACEMENT

ASSOC DESGN

CIRCUIT / VOLTAGE
CACHUMA 16KVTHOMAS GUIDE
N/A

PRODUCT-2

ASSOC DESGN

SUB / PG NO.
VEGAS

CIRCUIT CODE

PRODUCT-3

ASSOC DESGN

INVENTORY MAP 28-49

J.P.A. NO. E6049-409313704

PROPOSED CONSTRUCTION (LOCATION)

1324385E

1 PARADISE RD.,
SANTA BARBARA

TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

SHEET

OF

DESIGN\DRWG NO.

1020212_0.01

D124: Rev. 02/08/18

34° 32' 8.38"
119° 50' 58.91"
ELEVATION: 1105'

POLE

1324385E

4

45'

Class C1

IN: 1- POLE 45' CLASS 1 INTELLIPOLE COMP SECT


IN: 1- XA SNGL TAN HD COMP 10' W/BKT

IN: 3- INS POLY W/PIN 16KV CLMP #4-653 ACSR

IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653

EX: 3-#2ACSR 16KV
330'EX: 3-#2ACSR 16KV
177'1324386E
45'

60'

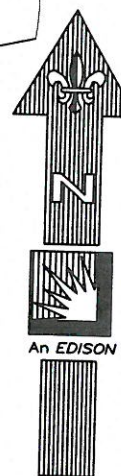SOUTHERN CALIFORNIA
EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

132438SE

L/N

05/09/2018




NOTES:

- SCE TO PTD.
- HARD SET EAST.
- SCE TO TRANSFER FTR.
- TRAFFIC CONTROL REQUIRED.
- TREE TRIMMING AND MAJOR BRUSH CLEARING REQUIRED.
- RIGHTS CHECK REQUIRED; USFS - LOS PADRES NATIONAL FOREST.
- HAND DIG/SET.
- EAGLE ZONE.
- BULLETIN 322 AREA.

TRANSFER:

- 3-#2ACSR 16KV
- 1-1"+1/4" MESS (FTR RENTER)
- 1.5"+5/16" MESS (FTR)

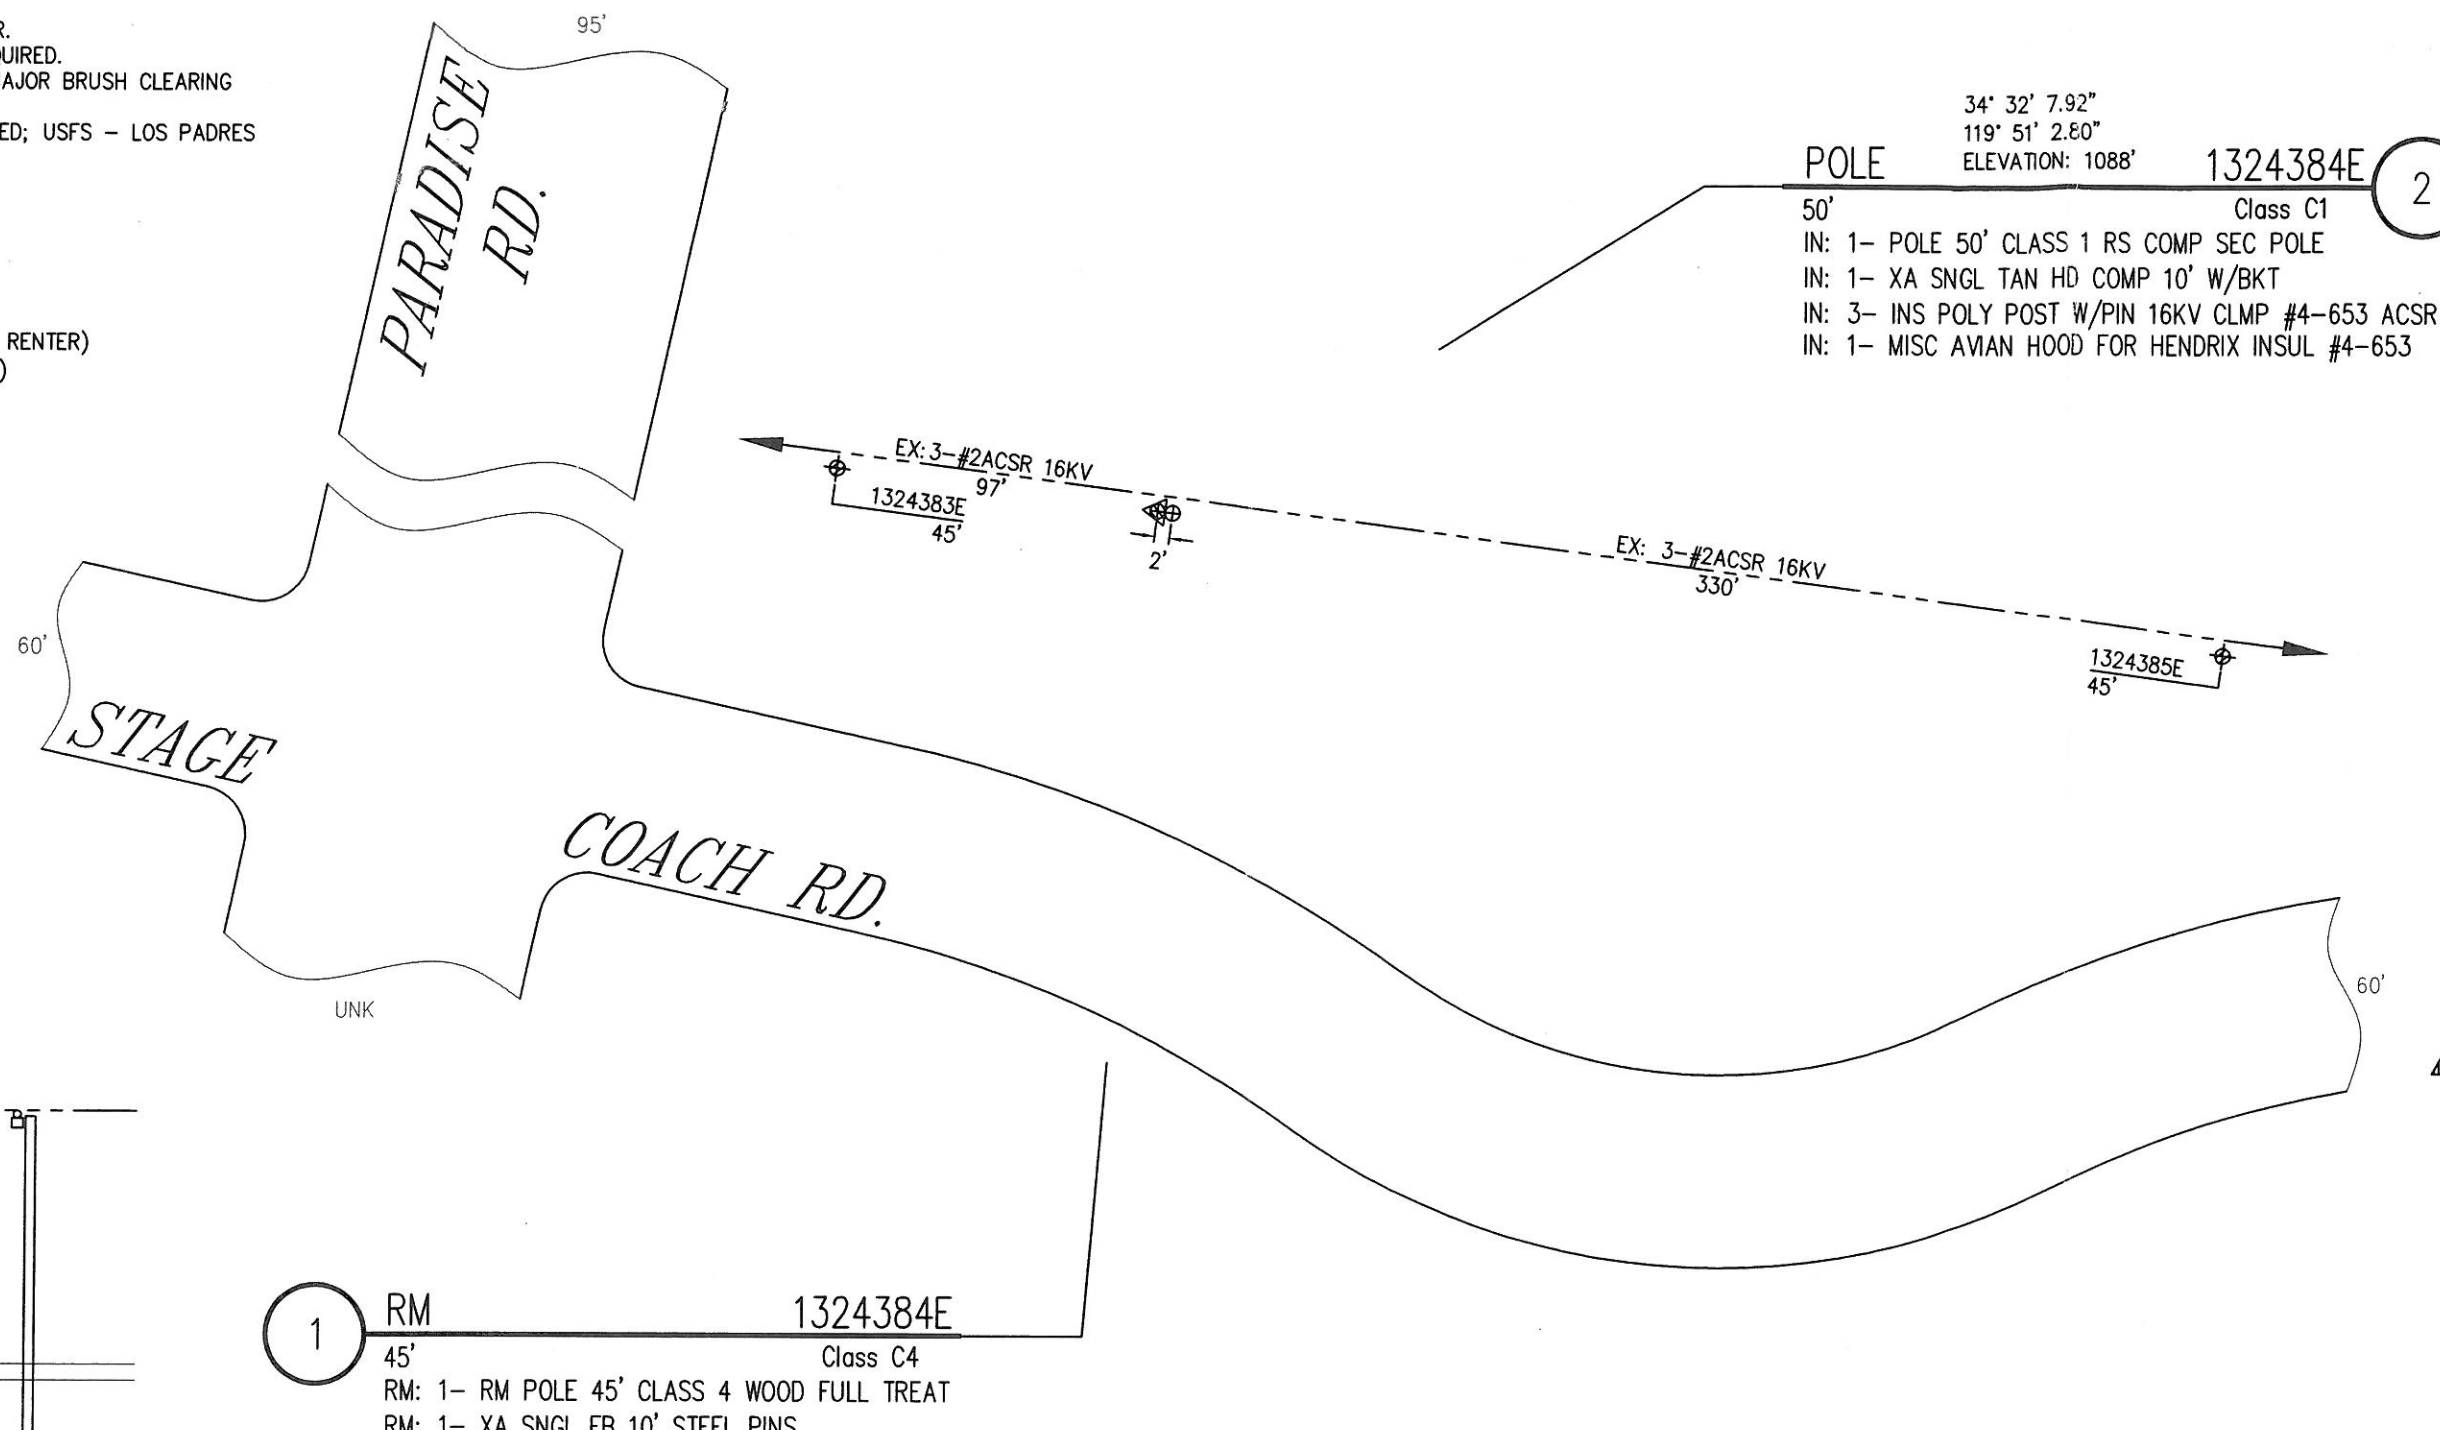

PROJECT REQUIREMENTS (Y/N)				DISTRICT		PROJ. MGR. PARK, JU YOUNG		PLANNER TIDWELL DESIGN		DESIGNER	
EDISON EASEMENT REQUIRED	☒			49 - SANTA BARBARA		PHONE 909-222-9350		PHONE 805-647-4707		TIDWELL DESIGN	
PWRD 88 REQUIRED	☒			PROJECT NO.	SERVICE REQUEST	MSR NO.	PRODUCT-1		ASSOC DESGN		
UG CIVIL ONLY WORK ORDER	☒			1573708	2483600		1381801-INFRA REPLAC - DET POLE REPLACEMENT		ASSOC DESGN		
PERMIT REQUIRED	☒			CIRCUIT / VOLTAGE		THOMAS GUIDE	PRODUCT-2		ASSOC DESGN		
PERMIT TYPE: USFS				CACHUMA 16KV		N/A	PRODUCT-3		ASSOC DESGN		
OUTAGE REQUIRED	☒			SUB / PG NO.		CIRCUIT CODE					
OUTAGE DATE: _____ TIME: _____				VEGAS							
TRAFFIC CONTROL REQUIRED	☒			INVENTORY MAP 28-49		J.P.A. NO. E6049-409313704	PROPOSED CONSTRUCTION (LOCATION)				
PED. TRAFFIC CONTROL REQ'D	☒						1324384E				
CONVEYANCE LETTER REQ'D	☒						1 PARADISE RD.,				
ENVIRONMENTAL CLEARANCE REQ'D	☒						SANTA BARBARA				
CSU 140 (TLM) REQ'D	☒										
				TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET	DESIGN/DRWG NO.
				Southern California Edison Company						_____ OF _____	1020212_0.01

1324384E

LINE

05/09/2018