

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

NOTES:

- SCE TO PTD.
- HARD SET EAST.
- EAGLE ZONE.
- BULLETIN 322 AREA.
- UPDATE GATE CODE ON CIRCUIT MAP TO **4885**. (OLD CODE: 1280)
- CONTACT GARY JUSTICE PRIOR TO ENTERING PROPERTY - (213)-327-8708. (GATE CODE: 4007).
- UPDATE INFO ON CIRCUIT MAP.

TRANSFER:

- 3-#4ACSR 16KV
- 1-1/0A 120/240V SVC



GPS COORDINATES
N: 34° 28' 46.74"
W: 119° 55' 25.35"
ELEVATION: 638'

POLE

2244722E

2

45' Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- XA SNGL DE HD COMP 10' W/BKT
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 1- TR OH 2-25KVA 16KV 120/240 OD 3P
SN: _____
SN: _____
IN: 3- FE CO MNT FOR ELF 100A 16KV 1-EA
IN: 3- FE FUSE ELF 15KV 6A
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD
IN: 3- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

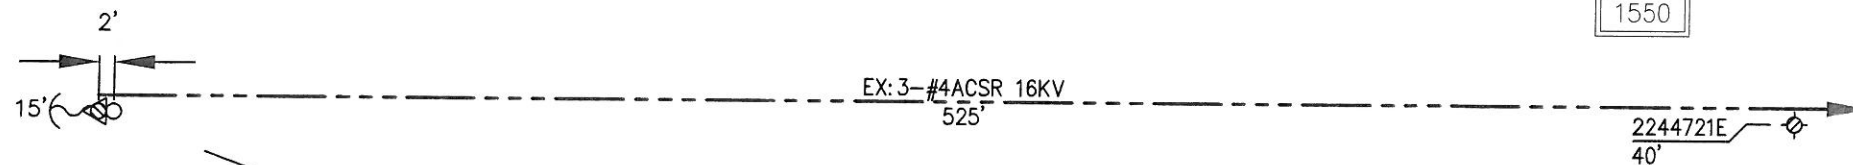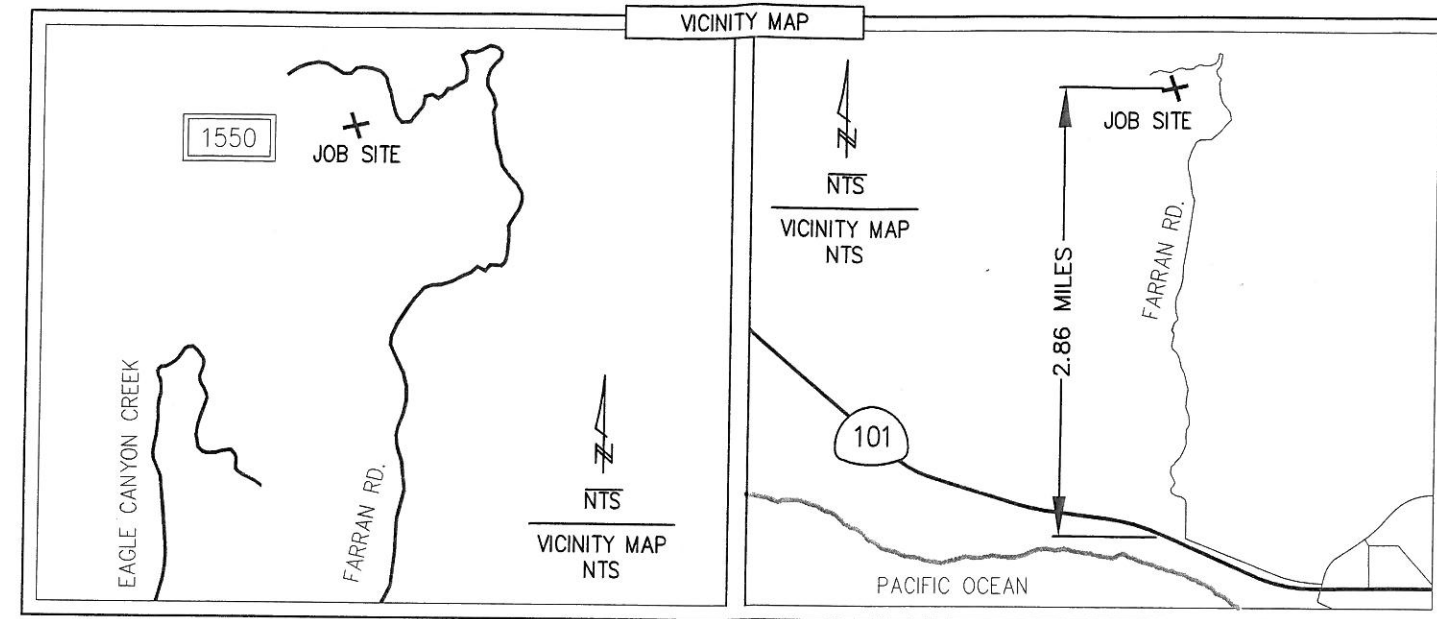


RM

2244722E

1

40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- TR OH 15&10KVA 16KV 120/240 OD 3P
SN: _____
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 3- FE FH CO ALL SIZES 200A OR LESS 16KV
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
RM: 1- XA DBLE FB 10' STEEL PINS
RM: 3- INS GLASS/POLY 35KV & LESS

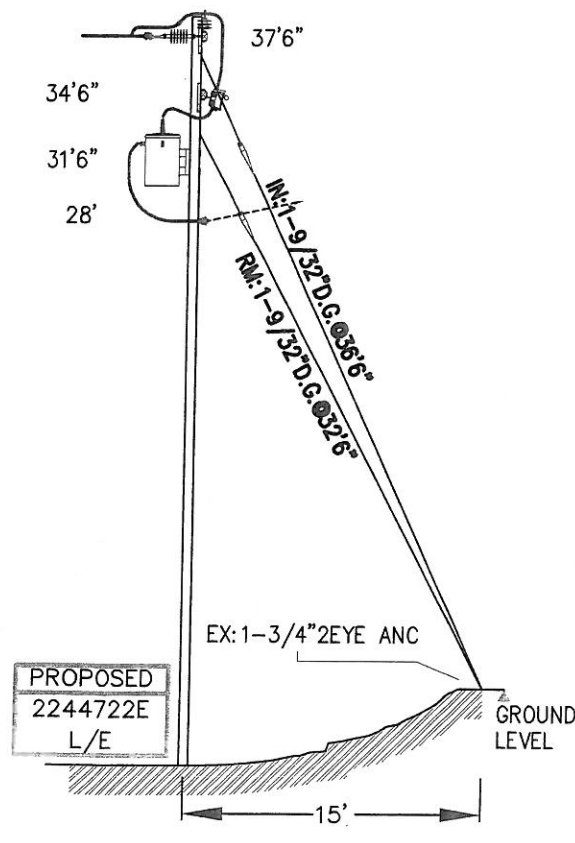


T.L.M. DATA:

	SIZE	KVA	CUST	% LOAD
EXIST.	15	3.3	1	22 %
PROP.	50	3.3	1	6.6 %

VOLTAGE DROP: _____

FLICKER FACTOR: _____

PRI. CIRCUIT: BIDDER 16KV

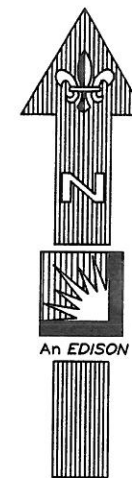

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)		DISTRICT 49 - SANTA BARBARA		PROJ. MGR. TOLMASOFF, LAURA M PHONE 714-796-9811		PLANNER TIDWELL DESIGN PHONE 805-647-4707		DESIGNER TIDWELL DESIGN			
EDISON EASEMENT REQUIRED	☒	PROJECT NO.	1671732	SERVICE REQUEST	2578653	MSR NO.		PRODUCT-1	1461031-INFRA REPLAC - DET POLE REPLACEMENT	ASSOC DESGN	
PWRD 88 REQUIRED	☒	CIRCUIT / VOLTAGE	BIDDER 16KV		THOMAS GUIDE		N/A	PRODUCT-2		ASSOC DESGN	
UG CIVIL ONLY WORK ORDER	☒	SUB / PG NO.	GOLETA		CIRCUIT CODE			PRODUCT-3		ASSOC DESGN	
PERMIT REQUIRED	☒	INVENTORY MAP	21-46A		J.P.A. NO.		N/A	PROPOSED CONSTRUCTION (LOCATION)			
PERMIT TYPE:		2244722E									
OUTAGE REQUIRED	☒	1550 FARRAN RD.,									
OUTAGE DATE: _____ TIME: _____		GOLETA									
TRAFFIC CONTROL REQUIRED	☒										
PED. TRAFFIC CONTROL REQ'D	☒										
CONVEYANCE LETTER REQ'D	☒										
ENVIRONMENTAL CLEARANCE REQ'D	☒										
CSD 140 (TLM) REQ'D	☒										
		TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET	DESIGN\DRWG NO.		
		Southern California Edison Company								1082814_0.01	

LISE

11.27.2018 02:41

