

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only


Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____



☐ Week 2 _____

☐ Week 3 _____

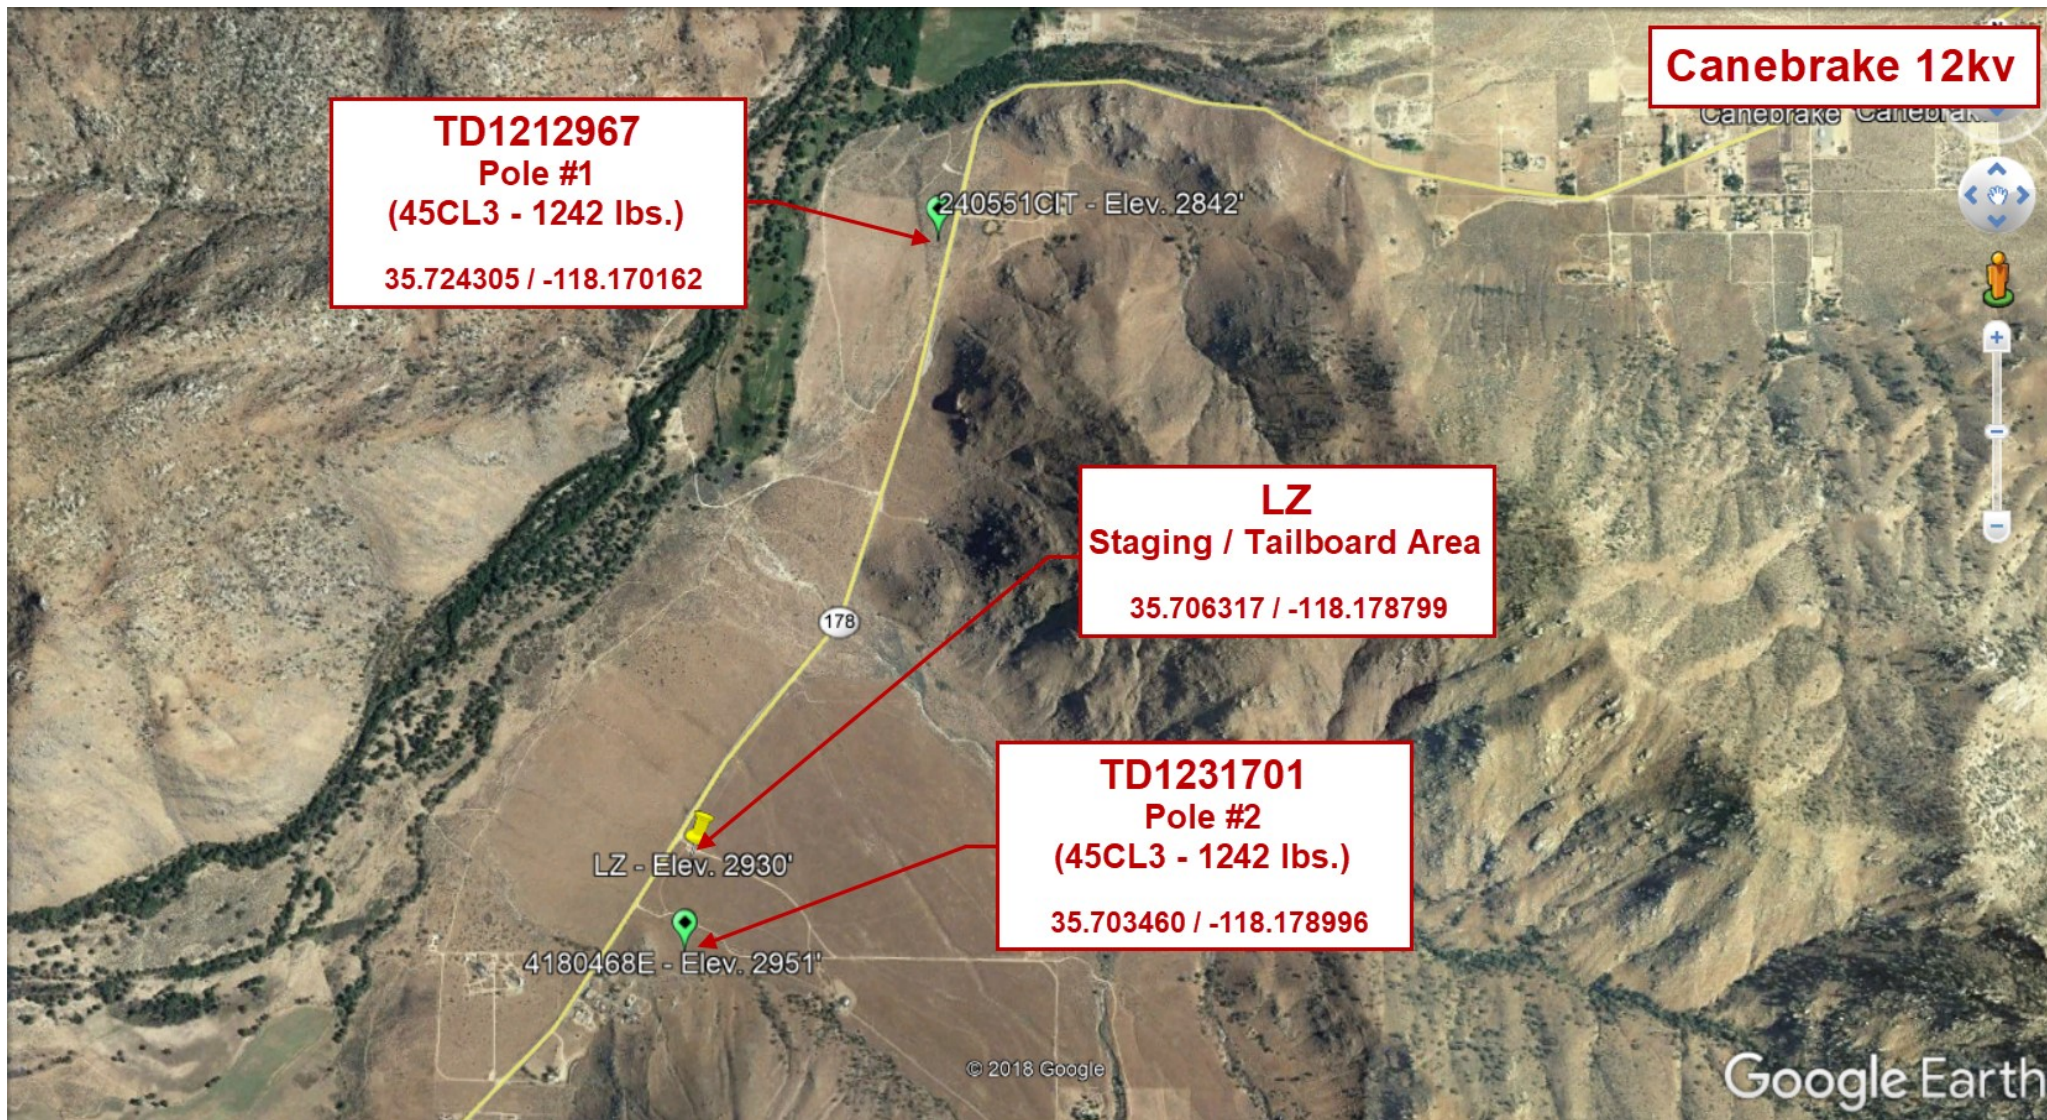

NOTES:
1. SCE TO PTD.
2. HARD SET WEST.
3. EAGLE ZONE.
4. BULL 322 AREA.
5. STATE LAND - DEPT OF F&G (STATE PERMIT REQ'D).
TRANSFER:
6- #4ACSR 12KV

BREAST BLOCK & POLE KEY CALCS
1560 X 10% = 156 LBS
156 X 35' = 5460 LBS
45' CLASS 3 = 28,177 LBS
BB+POLE KEY IN CL4 = 47,500 LBS

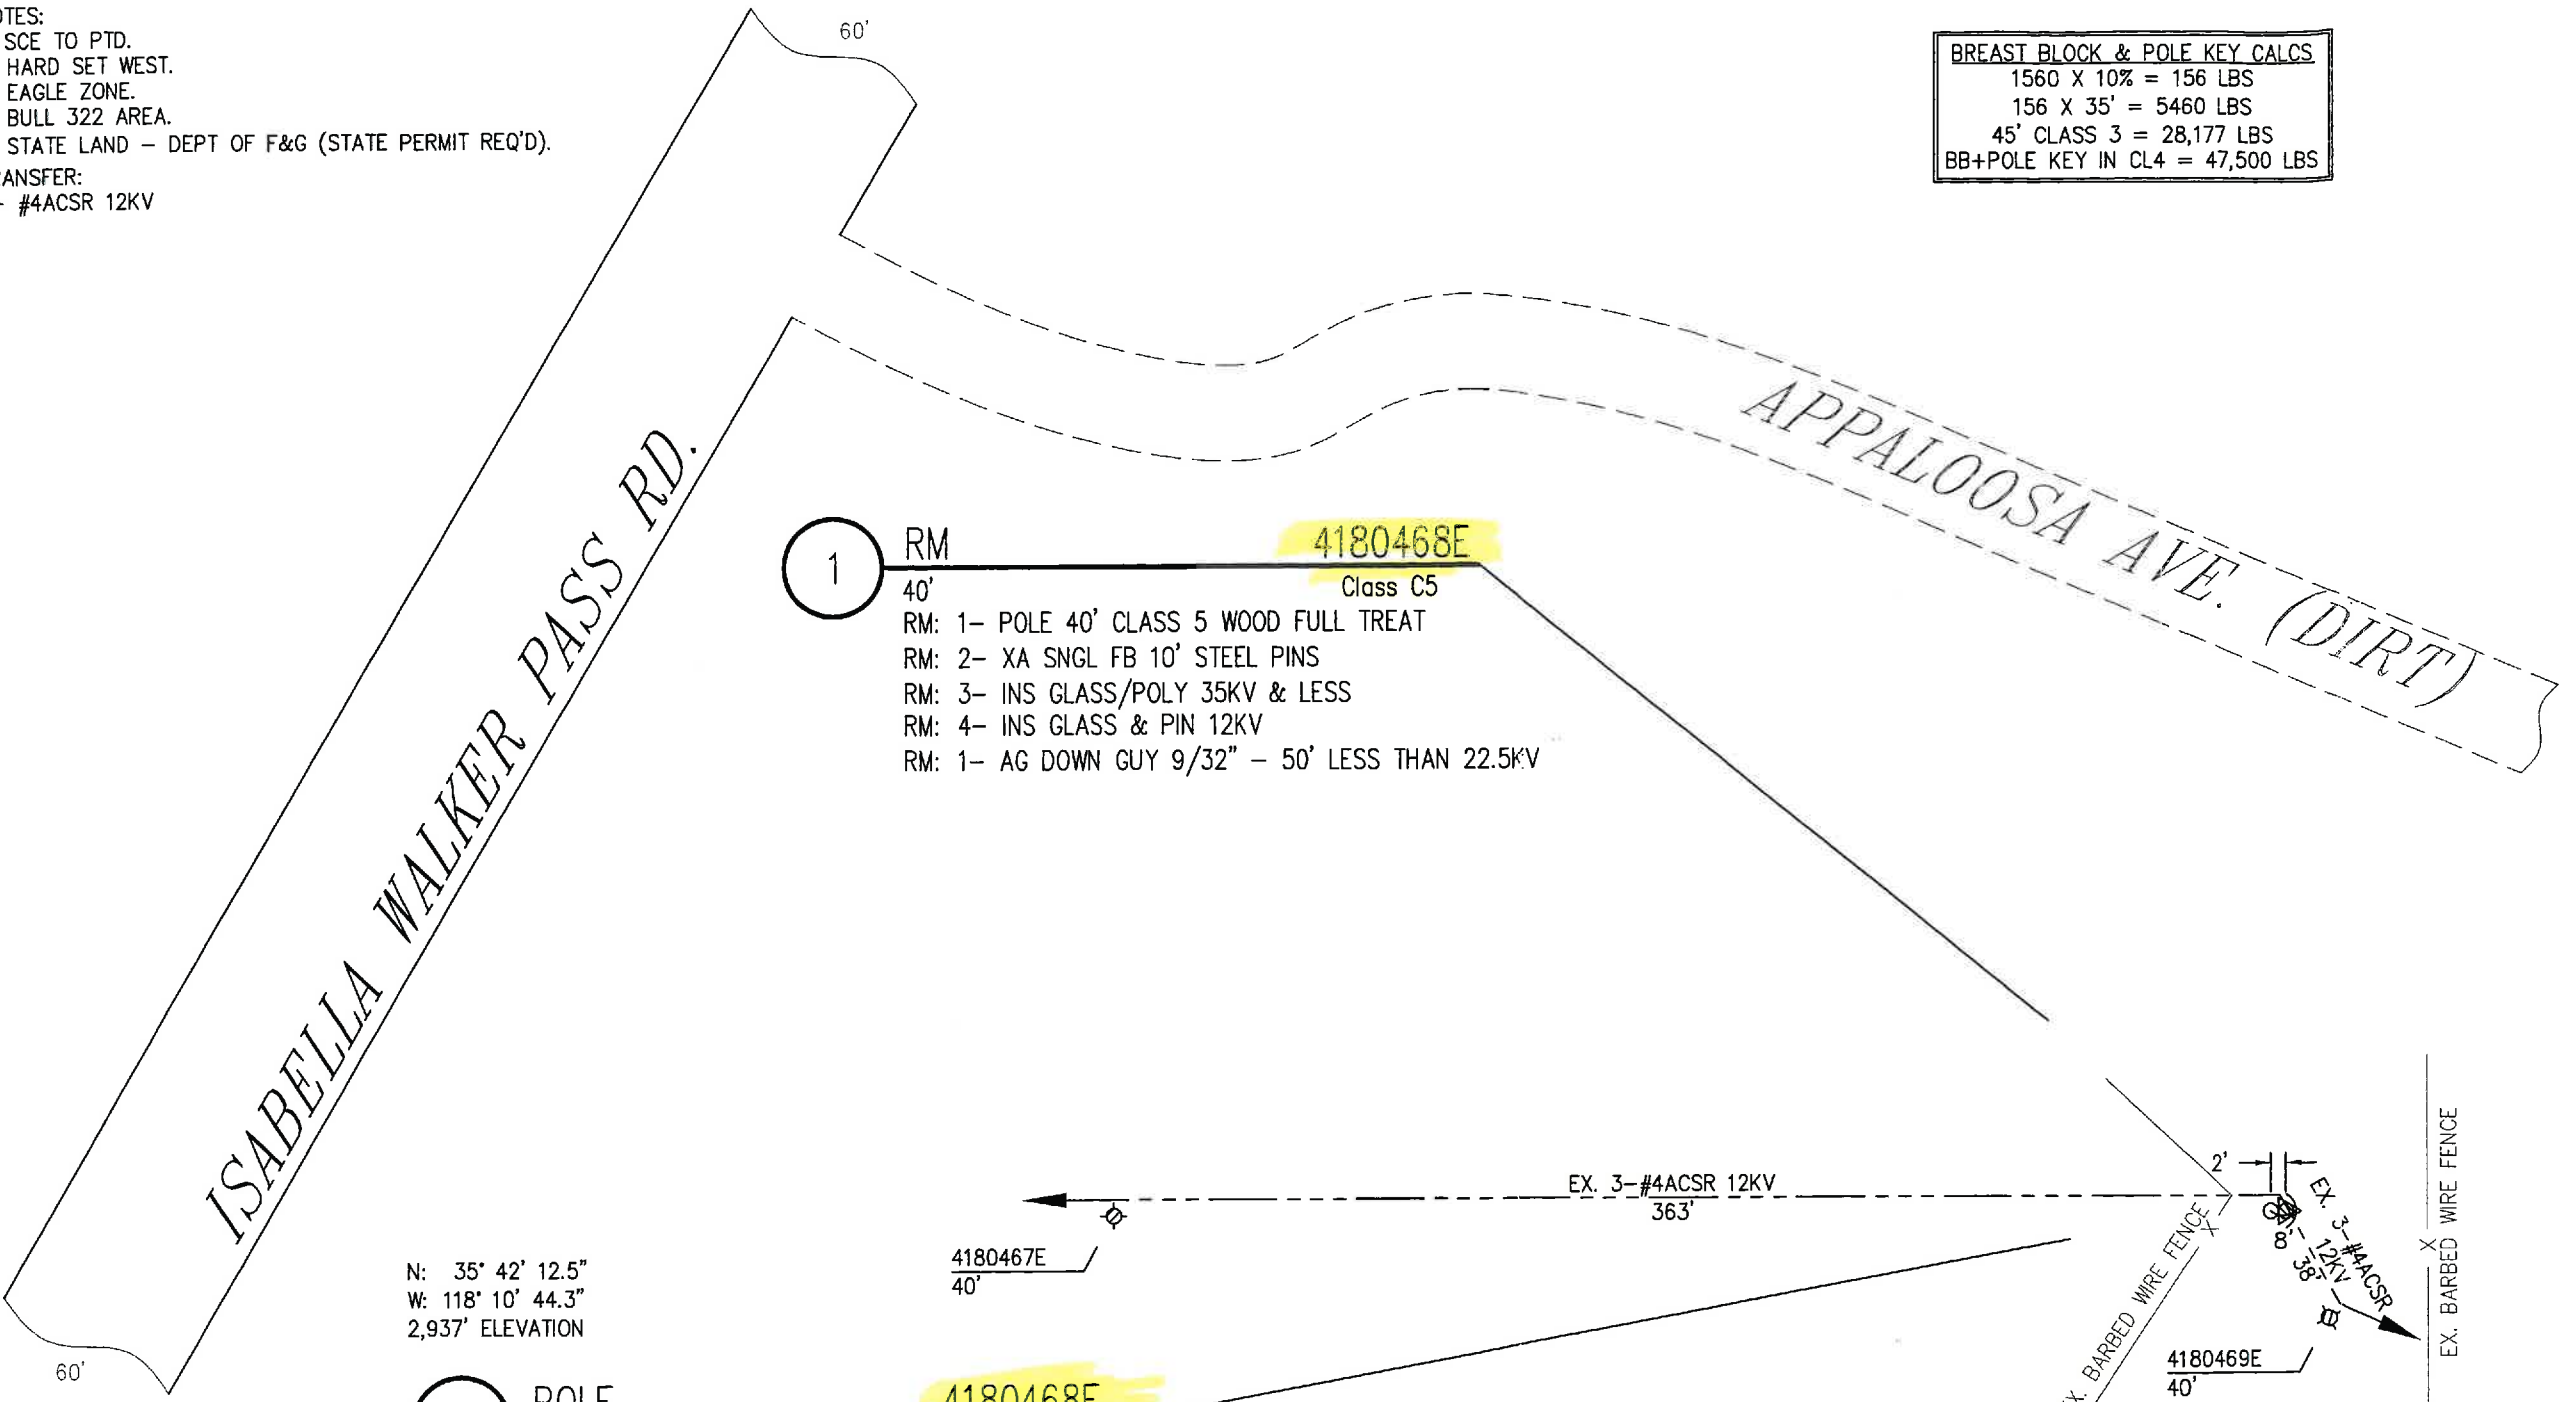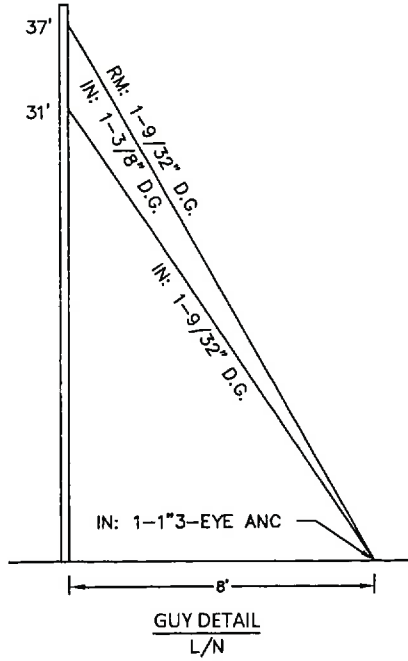

N: 35° 42' 12.5"
W: 118° 10' 44.3"
2,937' ELEVATION



NOT TO SCALE

2 POLE 4180468E Class C3
45'
IN: 1- POLE 45' CLASS 3 WOOD FULL TREAT
IN: 2- XA SNGL FB 10' STEEL PINS
IN: 6- INS POLY DE 12KV HOT SHOE #4 & 1/0
IN: 3- INS POLY W/PIN 12KV CLMP #4-653 ACSR
IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- AG BLOCK & POLE KEY

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
PERMIT REQUIRED	☒
PERMIT TYPE: STATE - DEPT F&G	
OUTAGE REQUIRED	☐
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 53 - KERNVILLE		PROJ. MGR. JU YOUNG, PARK PHONE 909-222-9350		PLANNER TIDWELL DESIGN PHONE 805-647-4707		DESIGNER TIDWELL DESIGN		
PROJECT NO. 1376847	SERVICE REQUEST 2293049	MSR NO.	PRODUCT-1 1231701-INFRA REPLAC - DET POLE REPLACEMENT			ASSOC DESGN		
CIRCUIT / VOLTAGE CANE BRAKE 12KV		THOMAS GUIDE N/A		PRODUCT-2			ASSOC DESGN	
SUB / PG NO. WELDON		CIRCUIT CODE		PRODUCT-3			ASSOC DESGN	
INVENTORY MAP 800-1944-2		J.P.A. NO.		PROPOSED CONSTRUCTION (LOCATION) 4180468E ISABELLA WALKER PASS RD 747' E 335' S/O APPALOOSA AVE TEHACHAPI				
				</				

- 1

RM

240551CIT

40'

Class C5

RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT

RM: 1- XA SNGL FB 10' STEEL PINS

RM: 3- INS GLASS/POLY 35KV & LESS
- 2

POLE

4867502E

45'


Class C3

IN: 1- POLE 45' CLASS 3 WOOD FULL TREAT

IN: 1- XA SNGL FB 10' STEEL PINS

IN: 3- INS POLY W/PIN 12KV CLMP #6-4/0 CU

IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653

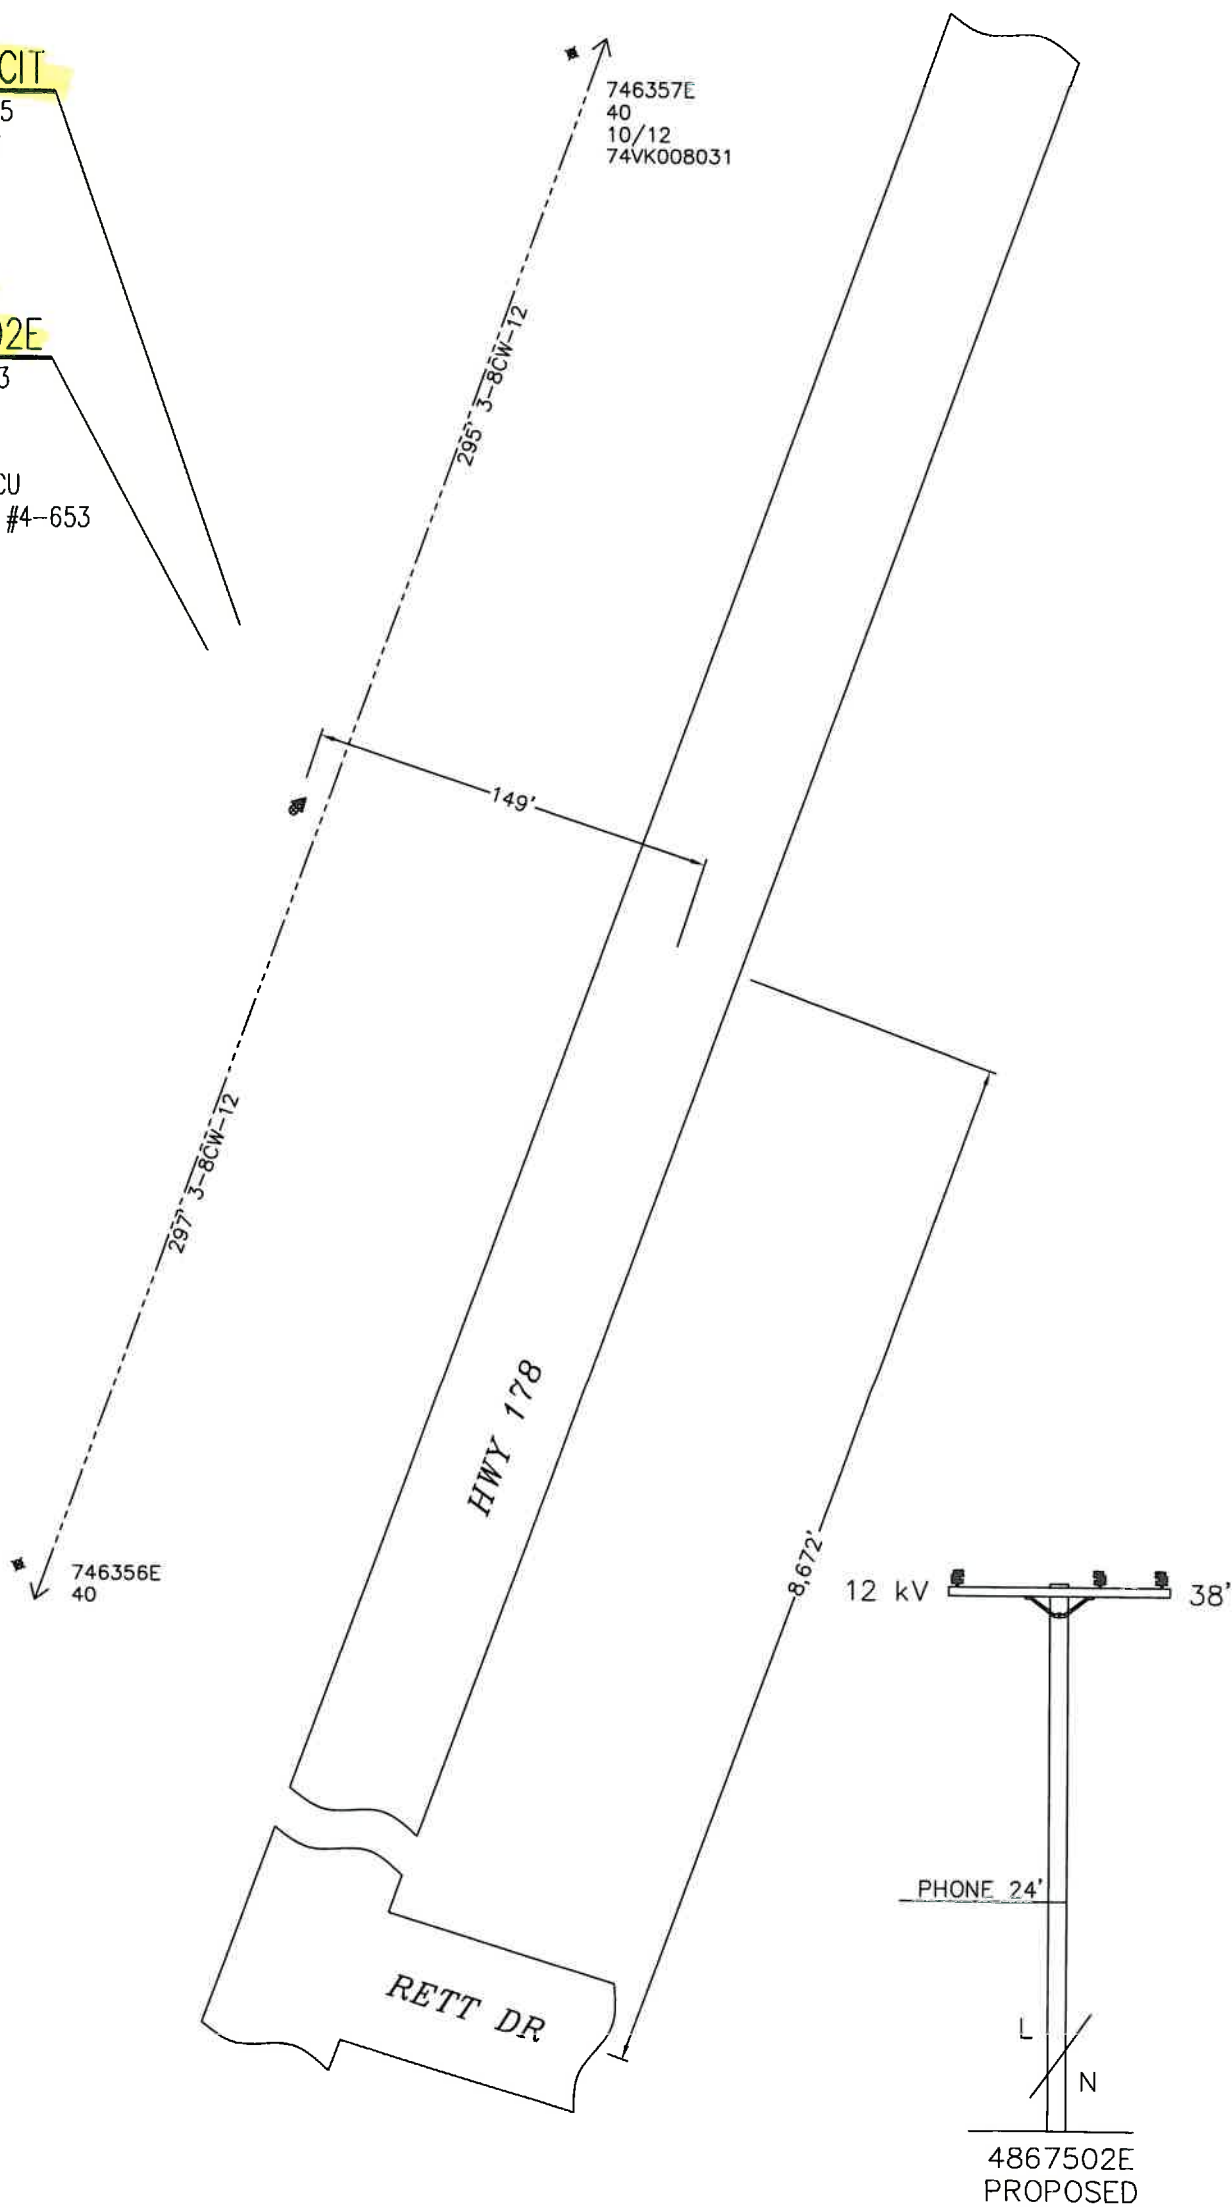

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)		LOCATION:		NOTES:		TRANSFER:	
EDISON EASEMENT REQUIRED ☐		149' W/O HWY 178 8,672'		• TRUCK ACCESS GOOD		• 3-8CW-12	
PWRD 88 REQUIRED ☐		N/O RETT DR		• SET 2' S/W		• PHONE	
PERMIT REQUIRED ☒		GPS:		• ELEV. 2840'			
PERMIT TYPE: CAL-TRANS		35° 43' 27.5" N,		• E-PTD			
OUTAGE REQUIRED ☐		118° 10' 12.5" W					
OUTAGE DATE: _____ TIME: _____		DISTRICT		PROJ. MGR. ANTILLON, FELIPE		PLANNER MIKE HESS	
TRAFFIC CONTROL REQUIRED ☐		53 - KERNVILLE		PHONE		PHONE 661-864-5665	
PED. TRAFFIC CONTROL REQ'D ☐		PROJECT NO.		MSR NO.		DESIGNER LOCKRIDGE, LISA LEE	
CONVEYANCE LETTER REQ'D ☐		1351248		2267935		PRODUCT-1	
ENVIRONMENTAL CLEARANCE REQ'D ☒		CIRCUIT / VOLTAGE		THOMAS GUIDE		1212967-DET POLE REPLACEMENT	
CSD 140 (TLM) REQ'D ☐		CANEBRAKE 12kV		CIRCUIT CODE		PRODUCT-2	
		SUB / PG NO.		PRODUCT-3		ASSOC DESGN	
		% WELDON A6				ASSOC DESGN	
		INVENTORY MAP		J.P.A. NO.		PROPOSED CONSTRUCTION (LOCATION)	
		808-1944-2				STR# 240551CIT	
						HWY 178 & RETT DR	
						CANEBRAKE, CA	
		1/31/2017		DUSI-MW			
		TYPE		DATE		SHEET	
		APPROVED BY		CHECKED BY		DESIGN\DRWG NO.	
		DRAWN BY		PAX #		878477_0.01	
		Southern California Edison Company					