

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____


Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

SEE SHEET 5
MATCH LINE

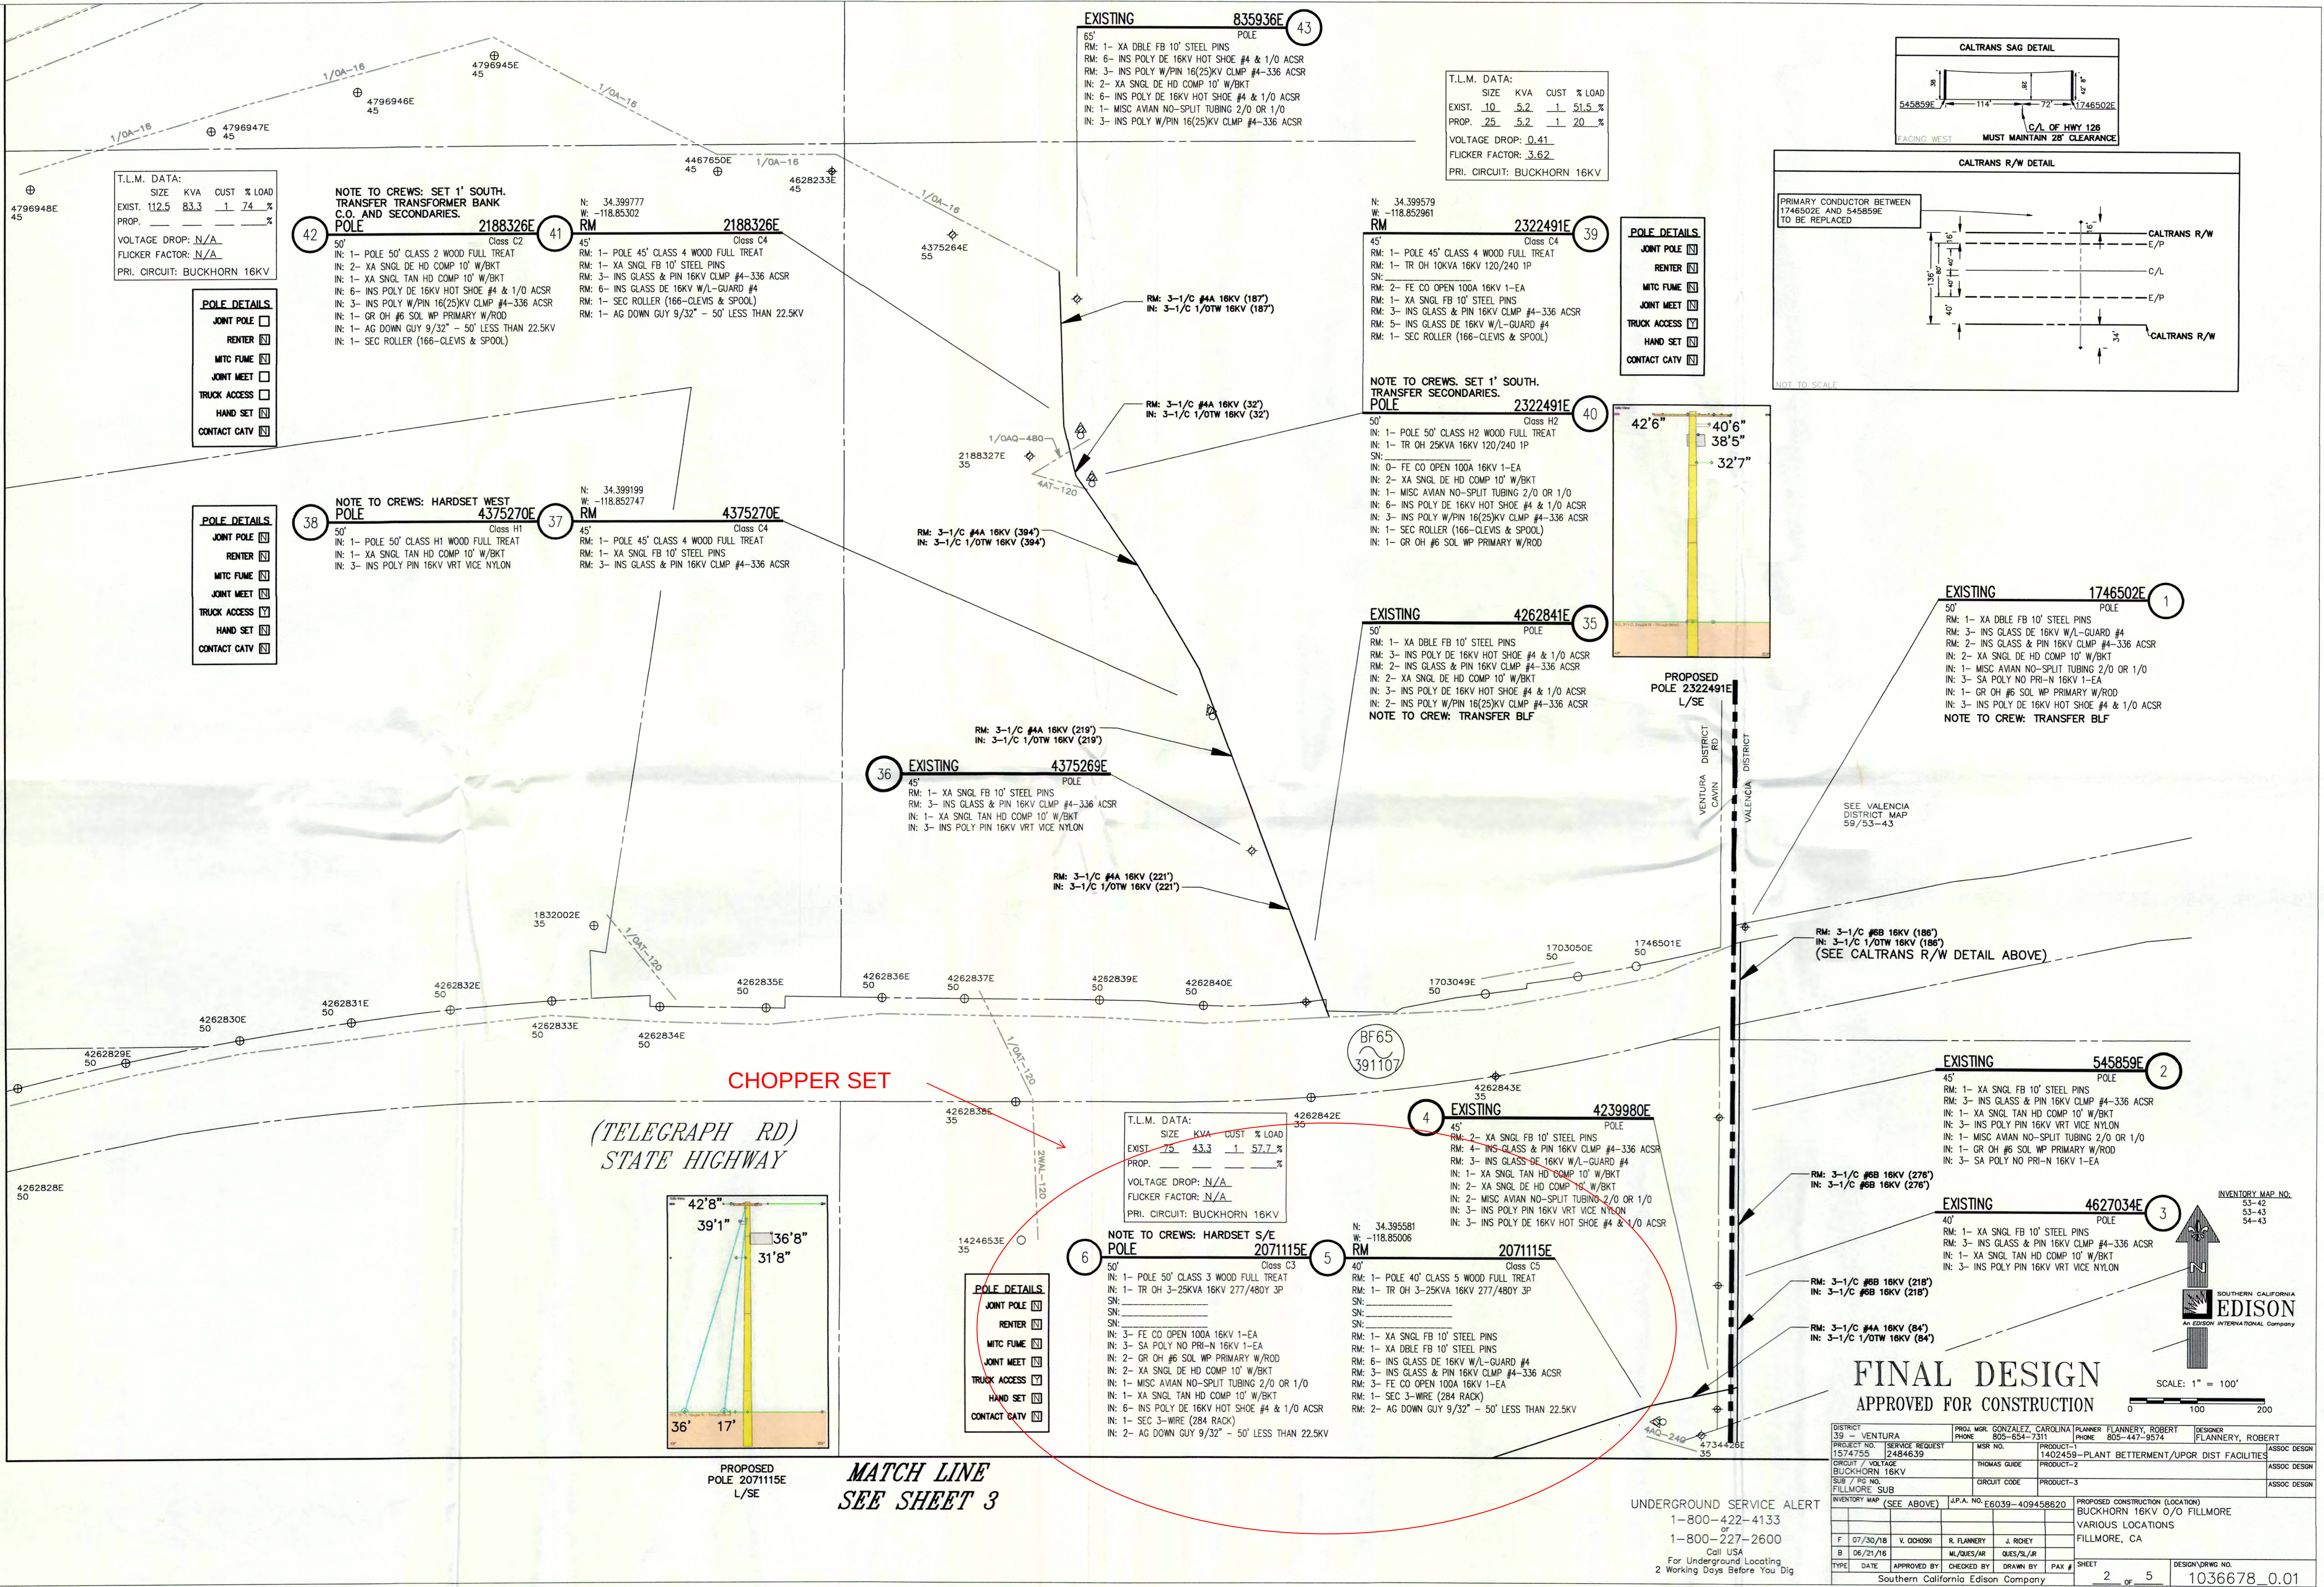

CHOPPER SETS

SEE SHEET 2
MATCH LINE

POLE DETAILS

JOINT POLE ☐

RENTER ☐

MITC FUME ☐

JOINT MEET ☐

TRUCK ACCESS ☐

HAND SET ☐

CONTACT CATV ☐

POLE DETAILS

JOINT POLE ☐

RENTER ☐

MITC FUME ☐

JOINT MEET ☐

TRUCK ACCESS ☐

HAND SET ☐

CONTACT CATV ☐

NOTE TO CREW: HARDSET POLE

2071116E

50' Class C1

IN: 1- POLE 50' CLASS 1 WOOD FULL TREAT

IN: 1- XA SNGL TAN HD COMP 10' W/BKT

IN: 3- INS POLY PIN 16KV VRT VICE NYLON

N: 34.395231
W: -118.851325

RM 2071116E

40' Class C5

RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT

RM: 1- XA SNGL FB 10' STEEL PINS

RM: 3- INS GLASS & PIN 16KV CLMP #4-336 ACSR

NOTE TO CREW: HARDSET POLE

2071117E

50' Class C1

IN: 1- POLE 50' CLASS 1 WOOD FULL TREAT

IN: 1- XA SNGL TAN HD COMP 10' W/BKT

IN: 3- INS POLY PIN 16KV VRT VICE NYLON

N: 34.394736
W: -118.853073

RM 2071117E

40' Class C5

RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT

RM: 1- XA SNGL FB 10' STEEL PINS

RM: 3- INS GLASS & PIN 16KV CLMP #4-336 ACSR

NOTE TO CREW: HARDSET POLE

2071118E

50' Class C1

IN: 1- POLE 50' CLASS 1 WOOD FULL TREAT

IN: 1- TR OH 3-25KVA 16KV 277/480Y 3P

IN: 3- FE CO OPEN 100A 16KV 1-EA

IN: 3- SA POLY NO PRI-N 16KV 1-EA

IN: 1- GR OH #6 SOL WP PRIMARY W/ROD

IN: 2- XA SNGL DE HD COMP 10' W/BKT

IN: 1- MISC AVIAN NO-SPLIT TUBING 2/0 OR 1/0

IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)

IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV

N: 34.394348
W: -118.85444

RM 2071118E

40' Class C5

RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT

RM: 1- TR OH 3-10KVA 16KV 277/480Y 3P

RM: 3- FE CO OPEN 100A 16KV 1-EA

RM: 1- XA SNGL FB 10' STEEL PINS

RM: 1- XA DBLE FB 10' STEEL PINS

RM: 3- INS GLASS DE 16KV W/L-GUARD #4

RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)

RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

T.L.M. DATA:

SIZE	KVA	CUST	% LOAD
EXIST. 30	19.4	1	65 %
PROP. 75	19.4	1	25 %

VOLTAGE DROP: .25

FLICKER FACTOR: N/A

PRI. CIRCUIT: BUCKHORN 16KV

POLE DETAILS

JOINT POLE ☐

RENTER ☐


MITC FUME ☐

JOINT MEET ☐


TRUCK ACCESS ☐

HAND SET ☐

CONTACT CATV ☐

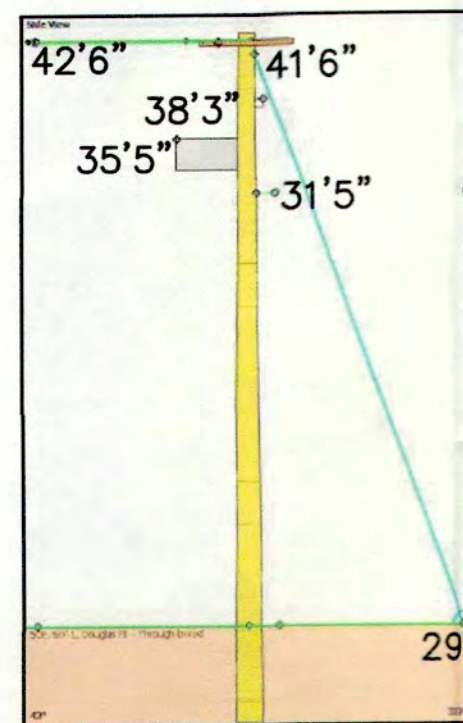

PROPOSED
POLE 2071118E
L/SE

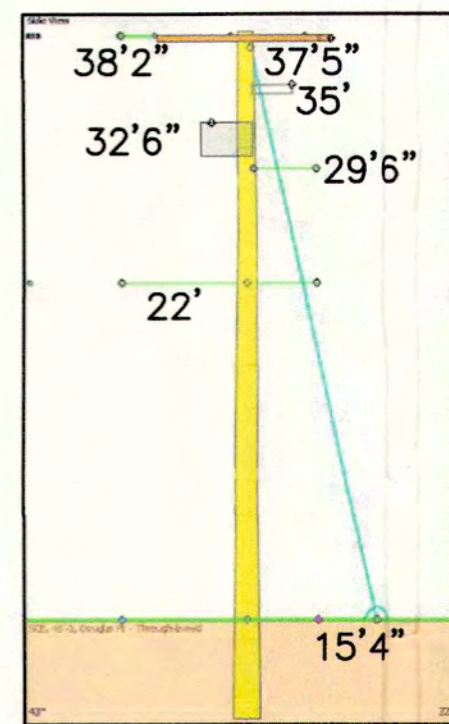

PROPOSED
POLE 2188896E
L/SE

T.L.M. DATA:

SIZE	KVA	CUST	% LOAD
EXIST. 35	25.6	2	73 %
PROP. 50	25.6	2	51 %

VOLTAGE DROP: 0.34

FLICKER FACTOR: N/A

PRI. CIRCUIT: BUCKHORN 16KV

POLE DETAILS

JOINT POLE ☐

RENTER ☐

MITC FUME ☐

JOINT MEET ☐

TRUCK ACCESS ☐

HAND SET ☐

CONTACT CATV ☐

N: 34.392127
W: -118.849779

RM 2188896E

40' Class C5

RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT

RM: 1- TR OH 25&10KVA 16KV 120/240 OD 3P

RM: 1- XA SNGL FB 10' STEEL PINS

RM: 3- INS GLASS DE 16KV W/L-GUARD #4

RM: 3- FE CO OPEN 100A 16KV 1-EA

RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)

RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

NOTE TO CREW: SAME HOLE SET
TRANSFER SERVICE.

POLE 2188896E

45' Class C1

IN: 1- POLE 45' CLASS 1 WOOD FULL TREAT

IN: 1- TR OH 2-25KVA 16KV 120/240 OD 3P

IN: 2- XA SNGL DE HD COMP 10' W/BKT

IN: 3- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR

IN: 1- MISC AVIAN NO-SPLIT TUBING 2/0 OR 1/0

IN: 1- SA POLY NO PRI-N 16KV 1-EA

IN: 2- GR OH #6 SOL WP PRIMARY W/ROD

IN: 3- FE CO OPEN 100A 16KV 1-EA

IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)

IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV

RM: 3-1/C #4A 16KV (403')
IN: 3-1/C 1/0TW 16KV (403')

RM: 3-1/C #4A 16KV (436')
IN: 3-1/C 1/0TW 16KV (436')

RM: 3-1/C #4A 16KV (417')
IN: 3-1/C 1/0TW 16KV (417')

RM: 3-1/C #4A 16KV (284')
IN: 3-1/C 1/0TW 16KV (284')

RM: 3-1/C #4A 16KV (238')
IN: 3-1/C 1/0TW 16KV (238')

RM: 3-1/C #4A 16KV (283')
IN: 3-1/C 1/0TW 16KV (283')

RM: 3-1/C #4A 16KV (289')
IN: 3-1/C 1/0TW 16KV (289')

RM: 3-1/C #6B 16KV (145')
IN: 3-1/C 1/0TW 16KV (145')

RM: 3-1/C #6B 16KV (145')
IN: 3-1/C 1/0TW 16KV (145')

SEE VALENCIA
DISTRICT MAP
59/53-43

N: 34.395237
W: -118.849772

RM 471457E

40' Class C4

RM: 1- POLE 40' CLASS 4 WOOD FULL TREAT

RM: 1- XA DBLE FB 10' STEEL PINS

RM: 3- INS GLASS & PIN 16KV CLMP #4-336 ACSR

RM: 6- INS GLASS DE 16KV W/L-GUARD #4

N: 34.395237
W: -118.849772

RM 471457E

45' Class H1

IN: 1- POLE 45' CLASS H1 WOOD FULL TREAT

IN: 2- XA SNGL DE HD COMP 10' W/BKT

IN: 1- MISC AVIAN NO-SPLIT TUBING 2/0 OR 1/0

IN: 6- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR

IN: 3- SA POLY NO PRI-N 16KV 1-EA

IN: 1- GR OH #6 SOL WP PRIMARY W/ROD

NOTE TO CREW: HARDSET POLE

POLE 471457E

45' Class H1

IN: 1- POLE 45' CLASS H1 WOOD FULL TREAT

IN: 2- XA SNGL DE HD COMP 10' W/BKT

IN: 1- MISC AVIAN NO-SPLIT TUBING 2/0 OR 1/0

IN: 6- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR

IN: 3- SA POLY NO PRI-N 16KV 1-EA

IN: 1- GR OH #6 SOL WP PRIMARY W/ROD

EXISTING 2188893E

50' POLE

RM: 1- XA SNGL FB 10' STEEL PINS

RM: 3- INS GLASS & PIN 16KV CLMP #4-336 ACSR

IN: 1- XA SNGL TAN HD COMP 10' W/BKT

IN: 3- INS POLY PIN 16KV VRT VICE NYLON

EXISTING 2188894E

45' POLE

RM: 1- XA SNGL FB 10' STEEL PINS

RM: 3- INS GLASS & PIN 16KV CLMP #4-336 ACSR

IN: 1- XA SNGL TAN HD COMP 10' W/BKT

IN: 3- INS POLY PIN 16KV VRT VICE NYLON

EXISTING 2188895E

40' POLE

RM: 1- XA SNGL FB 10' STEEL PINS

RM: 3- INS GLASS & PIN 16KV CLMP #4-336 ACSR

IN: 1- XA SNGL TAN HD COMP 10' W/BKT

IN: 3- INS POLY PIN 16KV VRT VICE NYLON


2188897E
35

1/0AT-120

VENTURA
CAVIN


VALENCIA

FINAL DESIGN
APPROVED FOR CONSTRUCTION

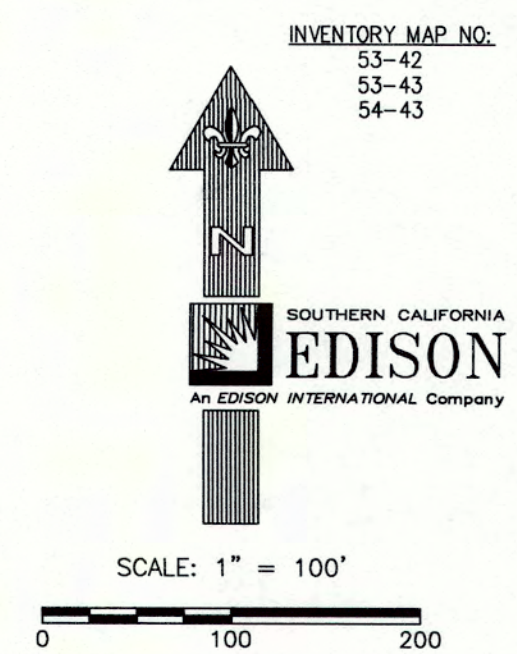

DISTRICT 39 - VENTURA	PROJ. MGR. GONZALEZ, CAROLINA PHONE 805-654-7311	PLANNER FLANNERY, ROBERT PHONE 805-447-9574	DESIGNER FLANNERY, ROBERT
PROJECT NO. SERVICE REQUEST 1574755	MSR NO. 2484639	PRODUCT-1 1402459-PLANT BETTERMENT/UPGR DIST FACILITIES	ASSOC DESIGN
CIRCUIT / VOLTAGE BUCKHORN 16KV	THOMAS GUIDE	PRODUCT-2	ASSOC DESIGN
SUB / PG NO. FILLMORE SUB	CIRCUIT CODE	PRODUCT-3	ASSOC DESIGN
INVENTORY MAP (SEE ABOVE)	J.P.A. NO. E6039-409458620	PROPOSED CONSTRUCTION (LOCATION) BUCKHORN 16KV O/O FILLMORE VARIOUS LOCATIONS FILLMORE, CA	DESIGN/DRWG NO. 1036678_0.01
F 07/30/18 V. OCHOA	R. FLANNERY	J. RICHY	
B 06/21/16 M. QUES/AR	QUES/SL/R		
TYPE DATE APPROVED BY CHECKED BY DRAWN BY PAX #	Southern California Edison Company		

UNDERGROUND SERVICE ALERT
1-800-422-4133
or
1-800-227-2600
Call USA
For Underground Locating
2 Working Days Before You Dig

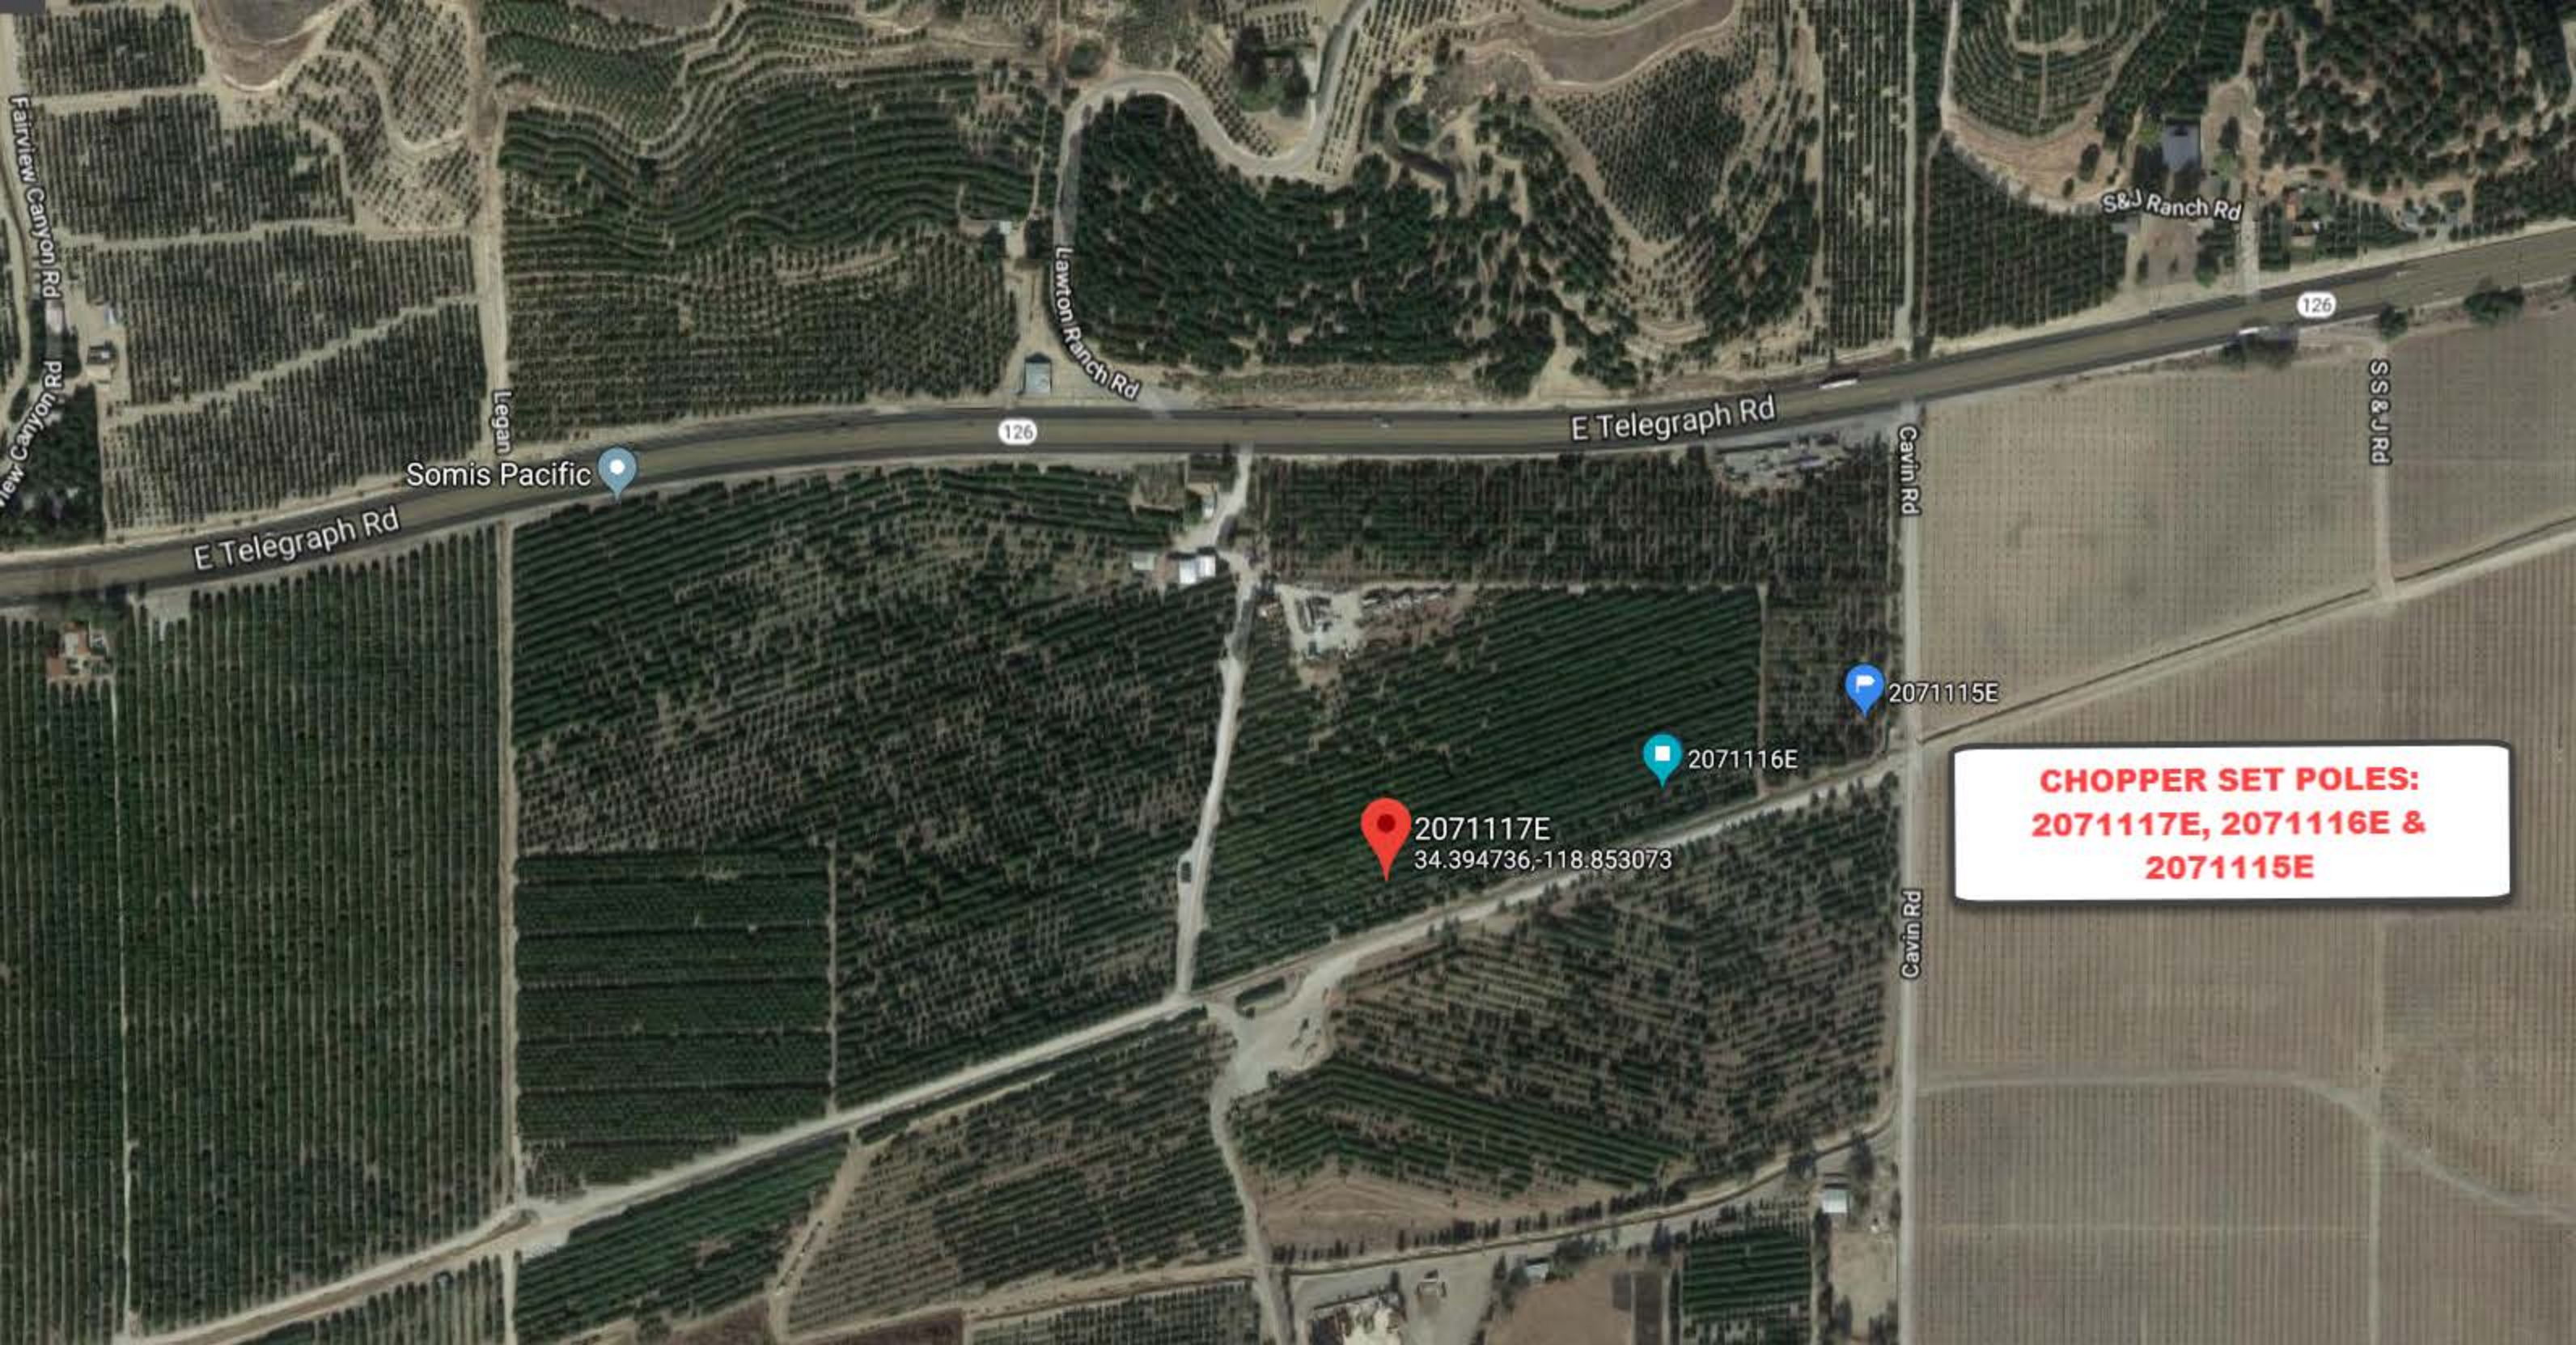

Somis Pacific

E Telegraph Rd

S&J Ranch Rd

126

SS&J Rd

Cavin Rd

2071115E

2071116E

2071117E
34.394736,-118.853073

**CHOPPER SET POLES:
2071117E, 2071116E &
2071115E**