

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

NOTES:
-SC&E TO PTD.
-SET 3' WEST.
-JOINT MEET REQ'D.
-HAND DIG REQ'D.
-HELICOPTER SET REQ'D.
-EAGLE ZONE.
-BULL. 322 AREA.



TRANSFER:
4- #4 ACSR 16KV

2

POLE

- 45' Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- XA DBL HD DE COMP 10'
IN: 4- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
IN: 2- INS POLY W/PIN 16KV CLMP #4-653 ACSR
IN: 1- AG 24" CR PLT 1 1/4" X 10" ROD 3-EYE
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- AG BLOCK & POLE KEY

BBPK CALC
2-#4ACSR SLACKED $520 \times 2 = 1040 \times 10\% = 104$
 $104 \sin(40) = 66.9 \times 37.5 = 2506.9$
MIN 45' DFTB CL 4= 17,138
8# GRADE A

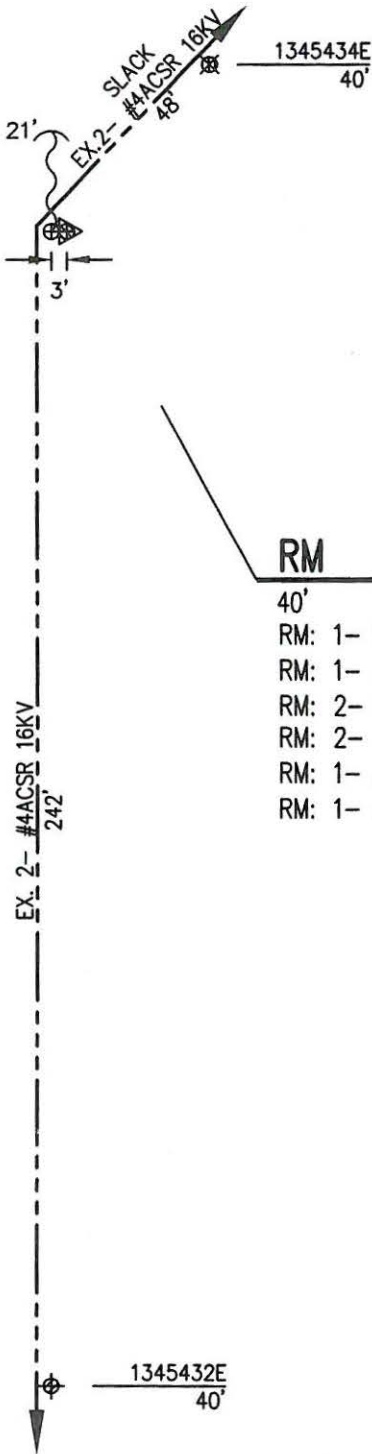
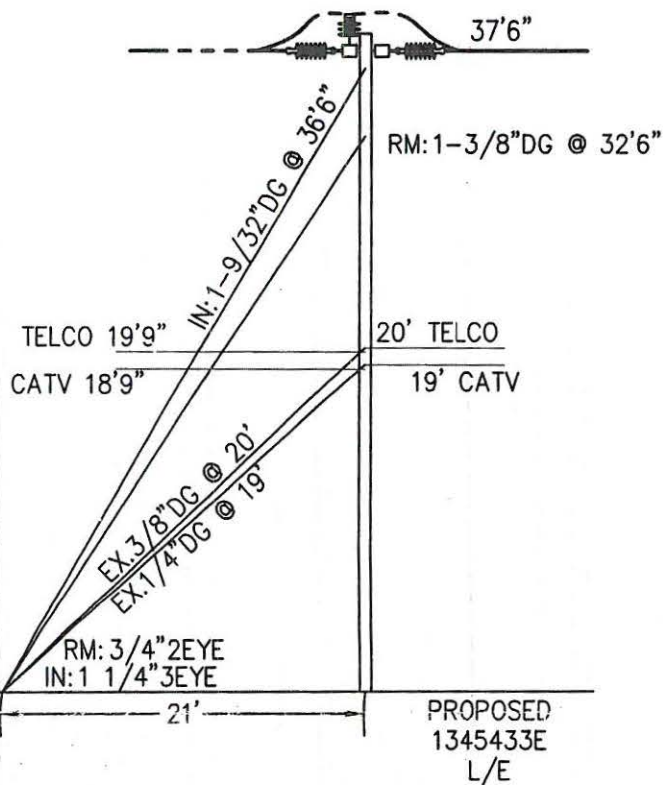


RM

1345433E

1

- 40' Class C5
RM: 1- RM POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 5' STEEL PINS
RM: 2- INS GLASS/POLY 35KV & LESS
RM: 2- INS GLASS & PIN 16KV
RM: 1- AG ANCHOR ROD 3/4" X 8' 2-EYE W/PLATE
RM: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV

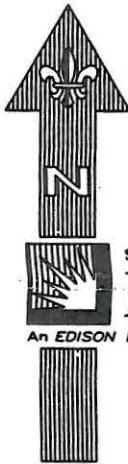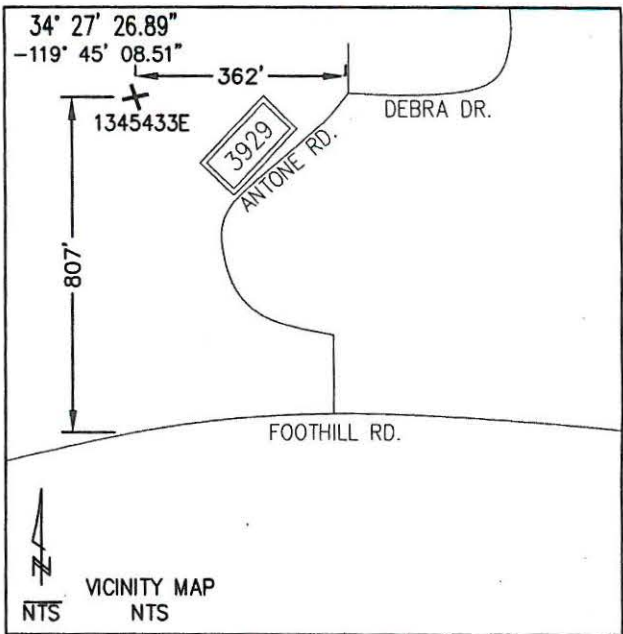

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)

- EDISON EASEMENT REQUIRED ☐
PWRD 88 REQUIRED ☐
UG CIVIL ONLY WORK ORDER ☐
PERMIT REQUIRED ☒
PERMIT TYPE: _____
OUTAGE REQUIRED ☐
OUTAGE DATE: _____ TIME: _____
TRAFFIC CONTROL REQUIRED ☐
PED. TRAFFIC CONTROL REQ'D ☐
CONVEYANCE LETTER REQ'D ☐
ENVIRONMENTAL CLEARANCE REQ'D ☒
CSD 140 (TLM) REQ'D ☐

DISTRICT 49 - SANTA BARBARA			PROJ. MGR. TOLMASOFF, LAURA M PHONE 714-796-9811			PLANNER TIDWELL DESIGN PHONE 805-647-4707			DESIGNER TIDWELL DESIGN		
PROJECT NO. 1670904		SERVICE REQUEST 2577832		MSR NO.		PRODUCT-1 1460471-INFRA REPLAC - DET POLE REPLACEMENT				ASSOC DESGN	
CIRCUIT / VOLTAGE HURST 16KV				THOMAS GUIDE N/A		PRODUCT-2				ASSOC DESGN	
SUB / PG NO. SAN MARCOS				CIRCUIT CODE		PRODUCT-3				ASSOC DESGN	
INVENTORY MAP 19-55C			J.P.A. NO. E6049-409694443			PROPOSED CONSTRUCTION (LOCATION) 1345433E 3929 ANTONE RD., SANTA BARBARA					
				TIDWELL							
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET			DESIGN\DRWG NO. 1082387 0.01		
Southern California Edison Company						OF					

1345433E



Dist.49 Deteriorated Pole
L / E