

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____


Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

Jordan 12kv

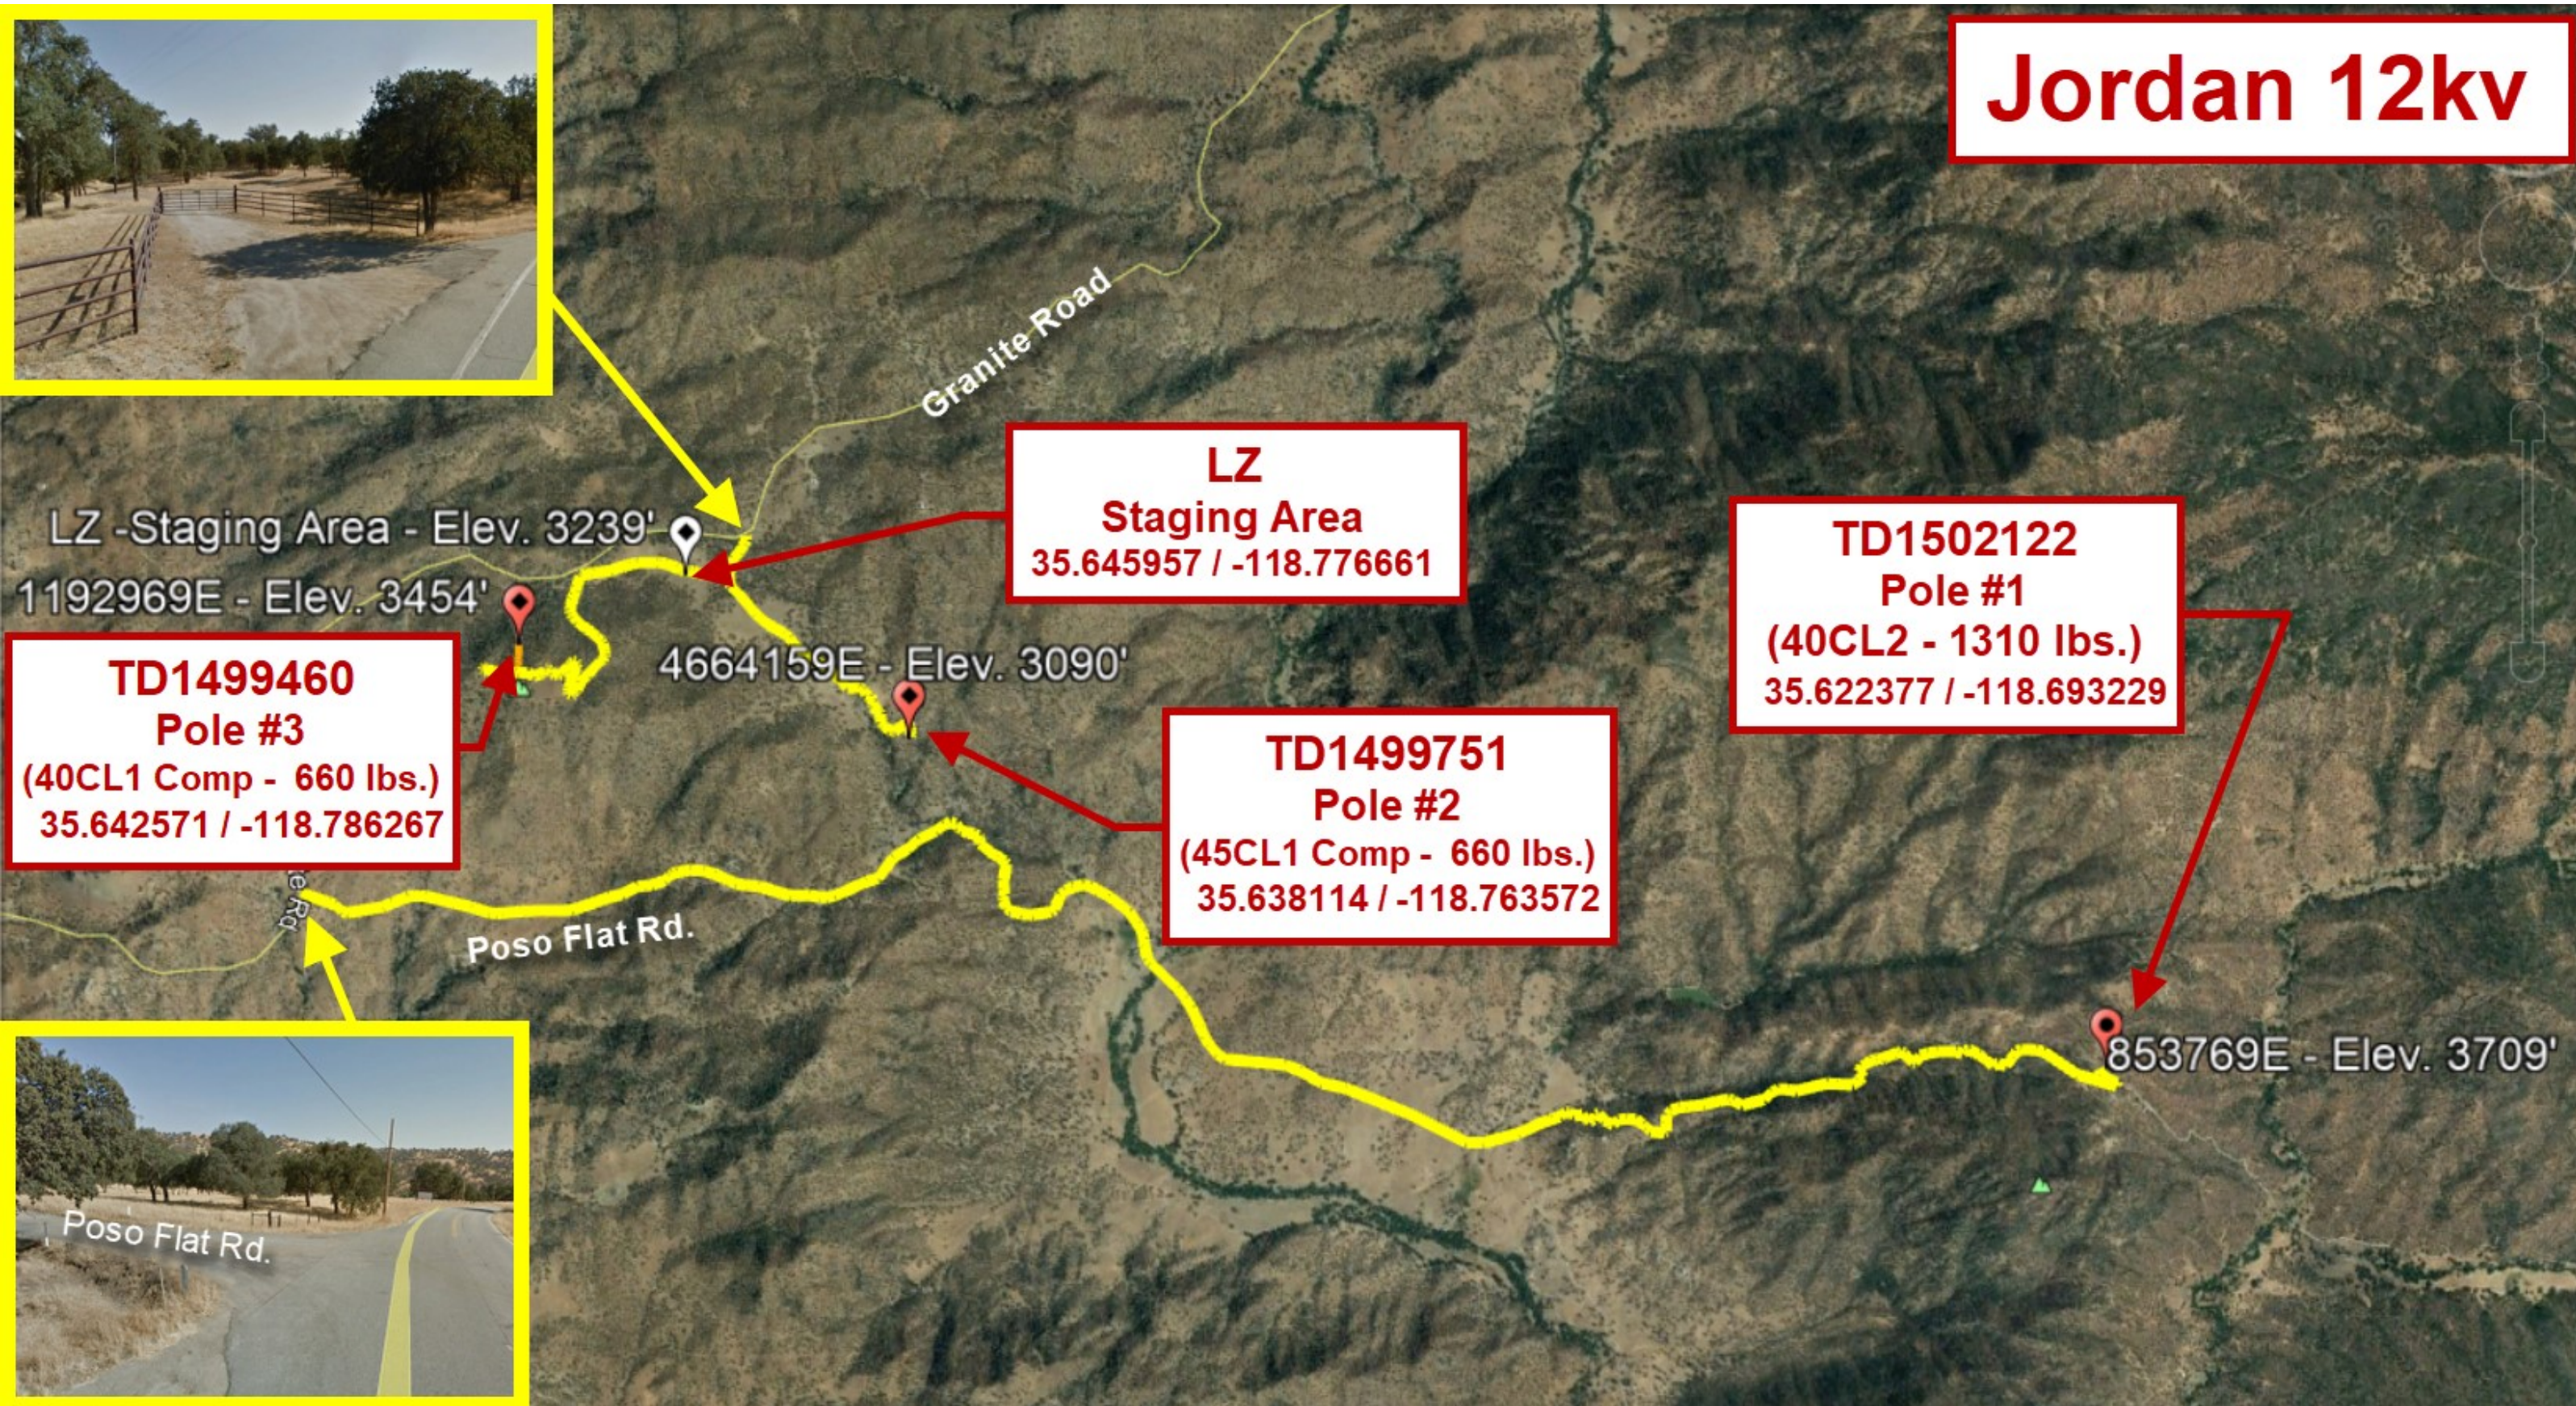

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☒
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☒
UTAGE DATE:	TIME:
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒

Rev 12/03/15

UNDERGROUND SERVICE ALERT

Dial 811
Call USA
For Underground Locating
2 Working Days Before You Dig


NO TRUCK ACCESS
TO POLE

SET NEW POLE
1' NID EXISTING

TRANSFER PRIMARY
CONDUCTOR, COMPOSITE
X-ARM & INSULATORS

TD1499751
REPLACE POLE
2019 OCI JORDAN 12KV
NOT # 409724910

EX: 853206E

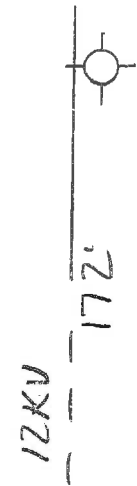

2


4664159E

IN: 45' COMP POLE C1
TR: 10' COMP X-ARM
TR: 3 POLY INS.
IN: RAPTOR COVER


1

4664159E

IN: 45' POLE C4
TR: 10' COMP X-ARM
TR: 3 POLY INS

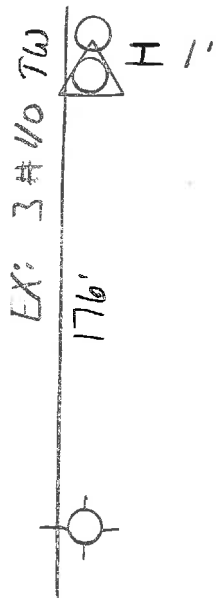

EX: 4556083E

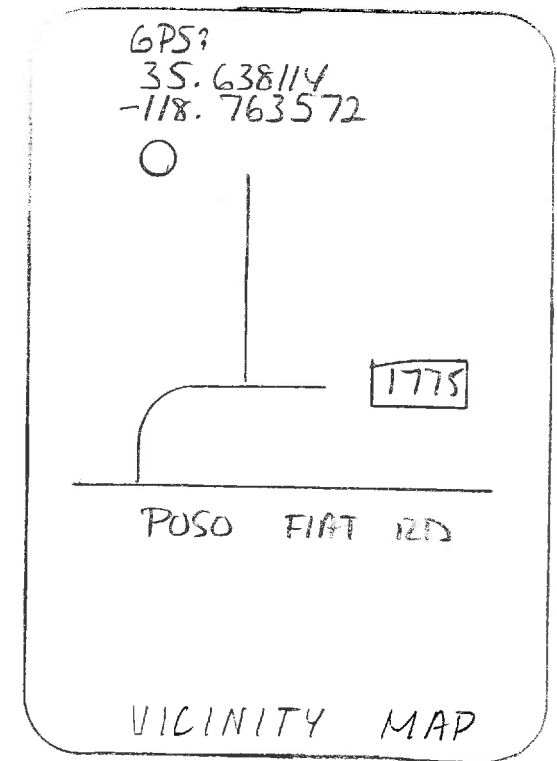

JORDAN 12KV
GLENNVILLE SUB



NTS

PLANNER: ZURN	JOB NAME: SCE	FOREMAN:	DISTRICT: KERNVILLE
DWO: TD1499751	JOB LOCATION: NID 1775 POSO FLAT RD	TRUCK	P/E:
A.I. NO.:	TLM-CSD 140 REQUIRED YES NO	T.L.M. DATA: SIZE KVA CUST. LOAD	DRAWN BY: T. ZURN
J.P.A. NO.:	GRID NO.	THOMAS MAP	WORKED BY:
RELATED W.O.:	EXIST. PROP. VOLTAGE DROP % PRI. CIRC.:		INV. MAP NO.'S VERIFIED: (Y)

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☒
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒

PERMIT TYPE: _____

OUTAGE REQUIRED ☒

TAGE DATE: _____ TIME: _____

TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
NVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒

Rev. 02/08/18

UNDERGROUND SERVICE ALERT
Dial 811
Call USA
For Underground Locating
2 Working Days Before You Dig

NO TRUNK ACCESS


SET NEW POLE
1' MID EXISTING

TRANSFER PRIMARY
CONDUCTOR

TD 1499640
REPLACE POLE
2019 OCI JORDAN 12KV
NOT# 409724211



EX: 1192968E

EX: 1192970E

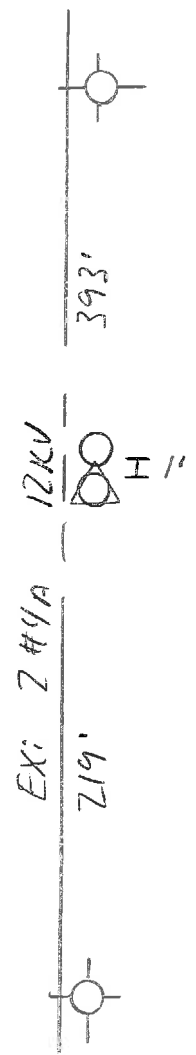

② 1192969E
IN: 40' COMP. POLE C-1
IN: 10' COMP. X-ARM TNGT
IN: 2 POLY INS

① 1192969E
RM: 40' POLE C-1
RM: 8' X-ARM
RM: 2 GLASS INS

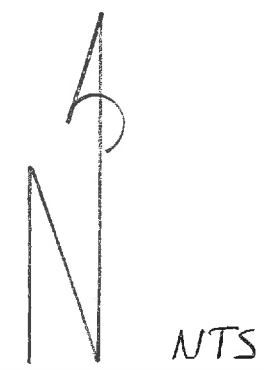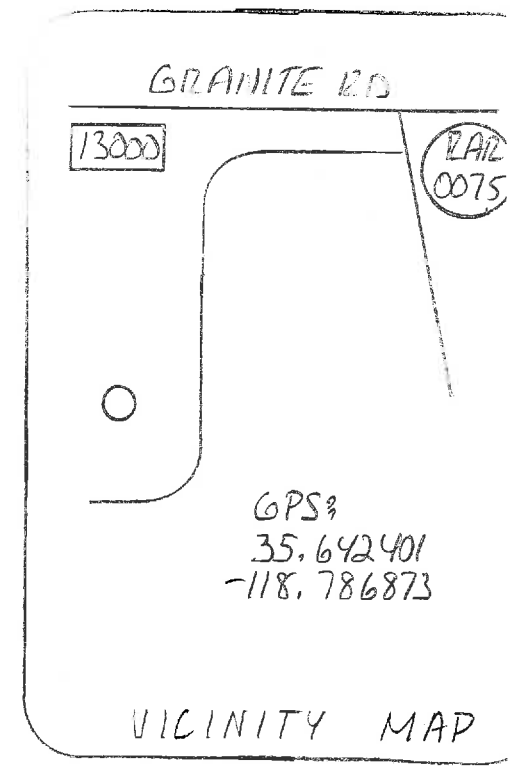

PLANNER: ZURN	JOB NAME: SCE	FOREMAN:	DISTRICT: ICERNVILLE
DWO: TD1499640	JOB LOCATION: SIO 13000 GRANITE RD.	TRUCK	P/E:
A.I. NO.:	TLM-CSD 140 REQUIRED YES ☒ NO ☐	DATE SENT TO RW:	
J.P.A. NO.:	GRID NO. THOMAS MAP	DIST. SKET	
RELATED W.O.:	T.L.M. DATA: SIZE KVA CUST. LOAD EXIST. PROP. VOLTAGE DROP PRI. CIRC.	DRAWN BY: K. ZURN	INV. MAP NO.'S
		WORKED BY:	INV. MAP NO.'S
		INV. MAP NO.'S VERIFIED: (v)	

EDISON EASEMENT REQUIRED	☒
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒

OUTAGE REQUIRED ☒

TRAFFIC CONTROL REQUIRED ☒ N

PED. TRAFFIC CONTROL REQ'D ☒

CONVEYANCE LETTER REQ'D ☒

ENVIRONMENTAL CLEARANCE REQ'D ☒

CSD 140 (TLM) REQ'D ☒

UNDERGROUND SERVICE ALERT

Dial 811

Call USA

For Underground Locating

2 Working Days Before You Dig


GOOD TRUCK ACCESS

SET NEW POLE

1' NW OF EXISTING

TRANSFER PRIMARY
CONDUCTOR

TOP FOLE - CUT 11
ABOVE PHONE

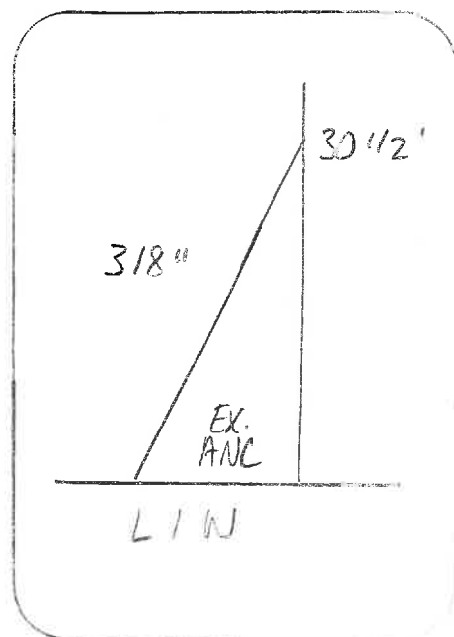

TD150212Z
REPLACE POLE
2019 OCI JORDAN 12KW
NOT# 409725384

GPS:
35.622359
-118.692708

660

POSO FIAT RD

VICINITY MAP

2

853769E

IN: 40' POLE CZ

IN: 10' COMP X-ARM TNGT

IN: 10' COMP X-ARM DIE

IN: 2 POLY INS W/ ANGLE PINS

IN: 1 POLY INS

IN: 2 POLY DIE

IN: 318" AUC

1

853769E

RM: 40' POLE CS

RM: 8' X-ARM

RM: 8' DBL X-ARM

RM: 2 GLASS PINS W/ANGLE PIN

RM: 1 GLASS PINS

RM: 2 DIE BELLS

RM: 9/32" D.G.

853784E EX: 2 #6 @ 490' 1710' EX: 2 #6 @ 278' 1210' 853785E

DRIVE

POSD FLAT RD.

NTS

PLANNER: ZURN	JOB NAME: SCE		FOREMAN:		DISTRICT: ICERNVILLE	
DWO: TD1502122	JOB LOCATION: 6001 POSS FIAT RD.		TRUCK	P/E:	DATE SENT TO R/W:	DIST. SKETCH #
A.I. NO.: ✓	TLM-CSD 140 REQUIRED YES _____ NO _____	T.L.M. DATA: SIZE KVA CUST. LOAD _____ %		DRAWN BY: ICIZURN		INV. MAP NO.'S 772-1794-2
J.P.A. NO.: 6653-409848486	GRID NO. _____ THOMAS MAP _____	EXIST. PROP. _____ VOLTAGE DROP _____ % PRI. CIRC.: _____		WORKED BY:		
RELATED W.O.: _____				INV. MAP NO.'S VERIFIED: (✓)		