




□ Week 3

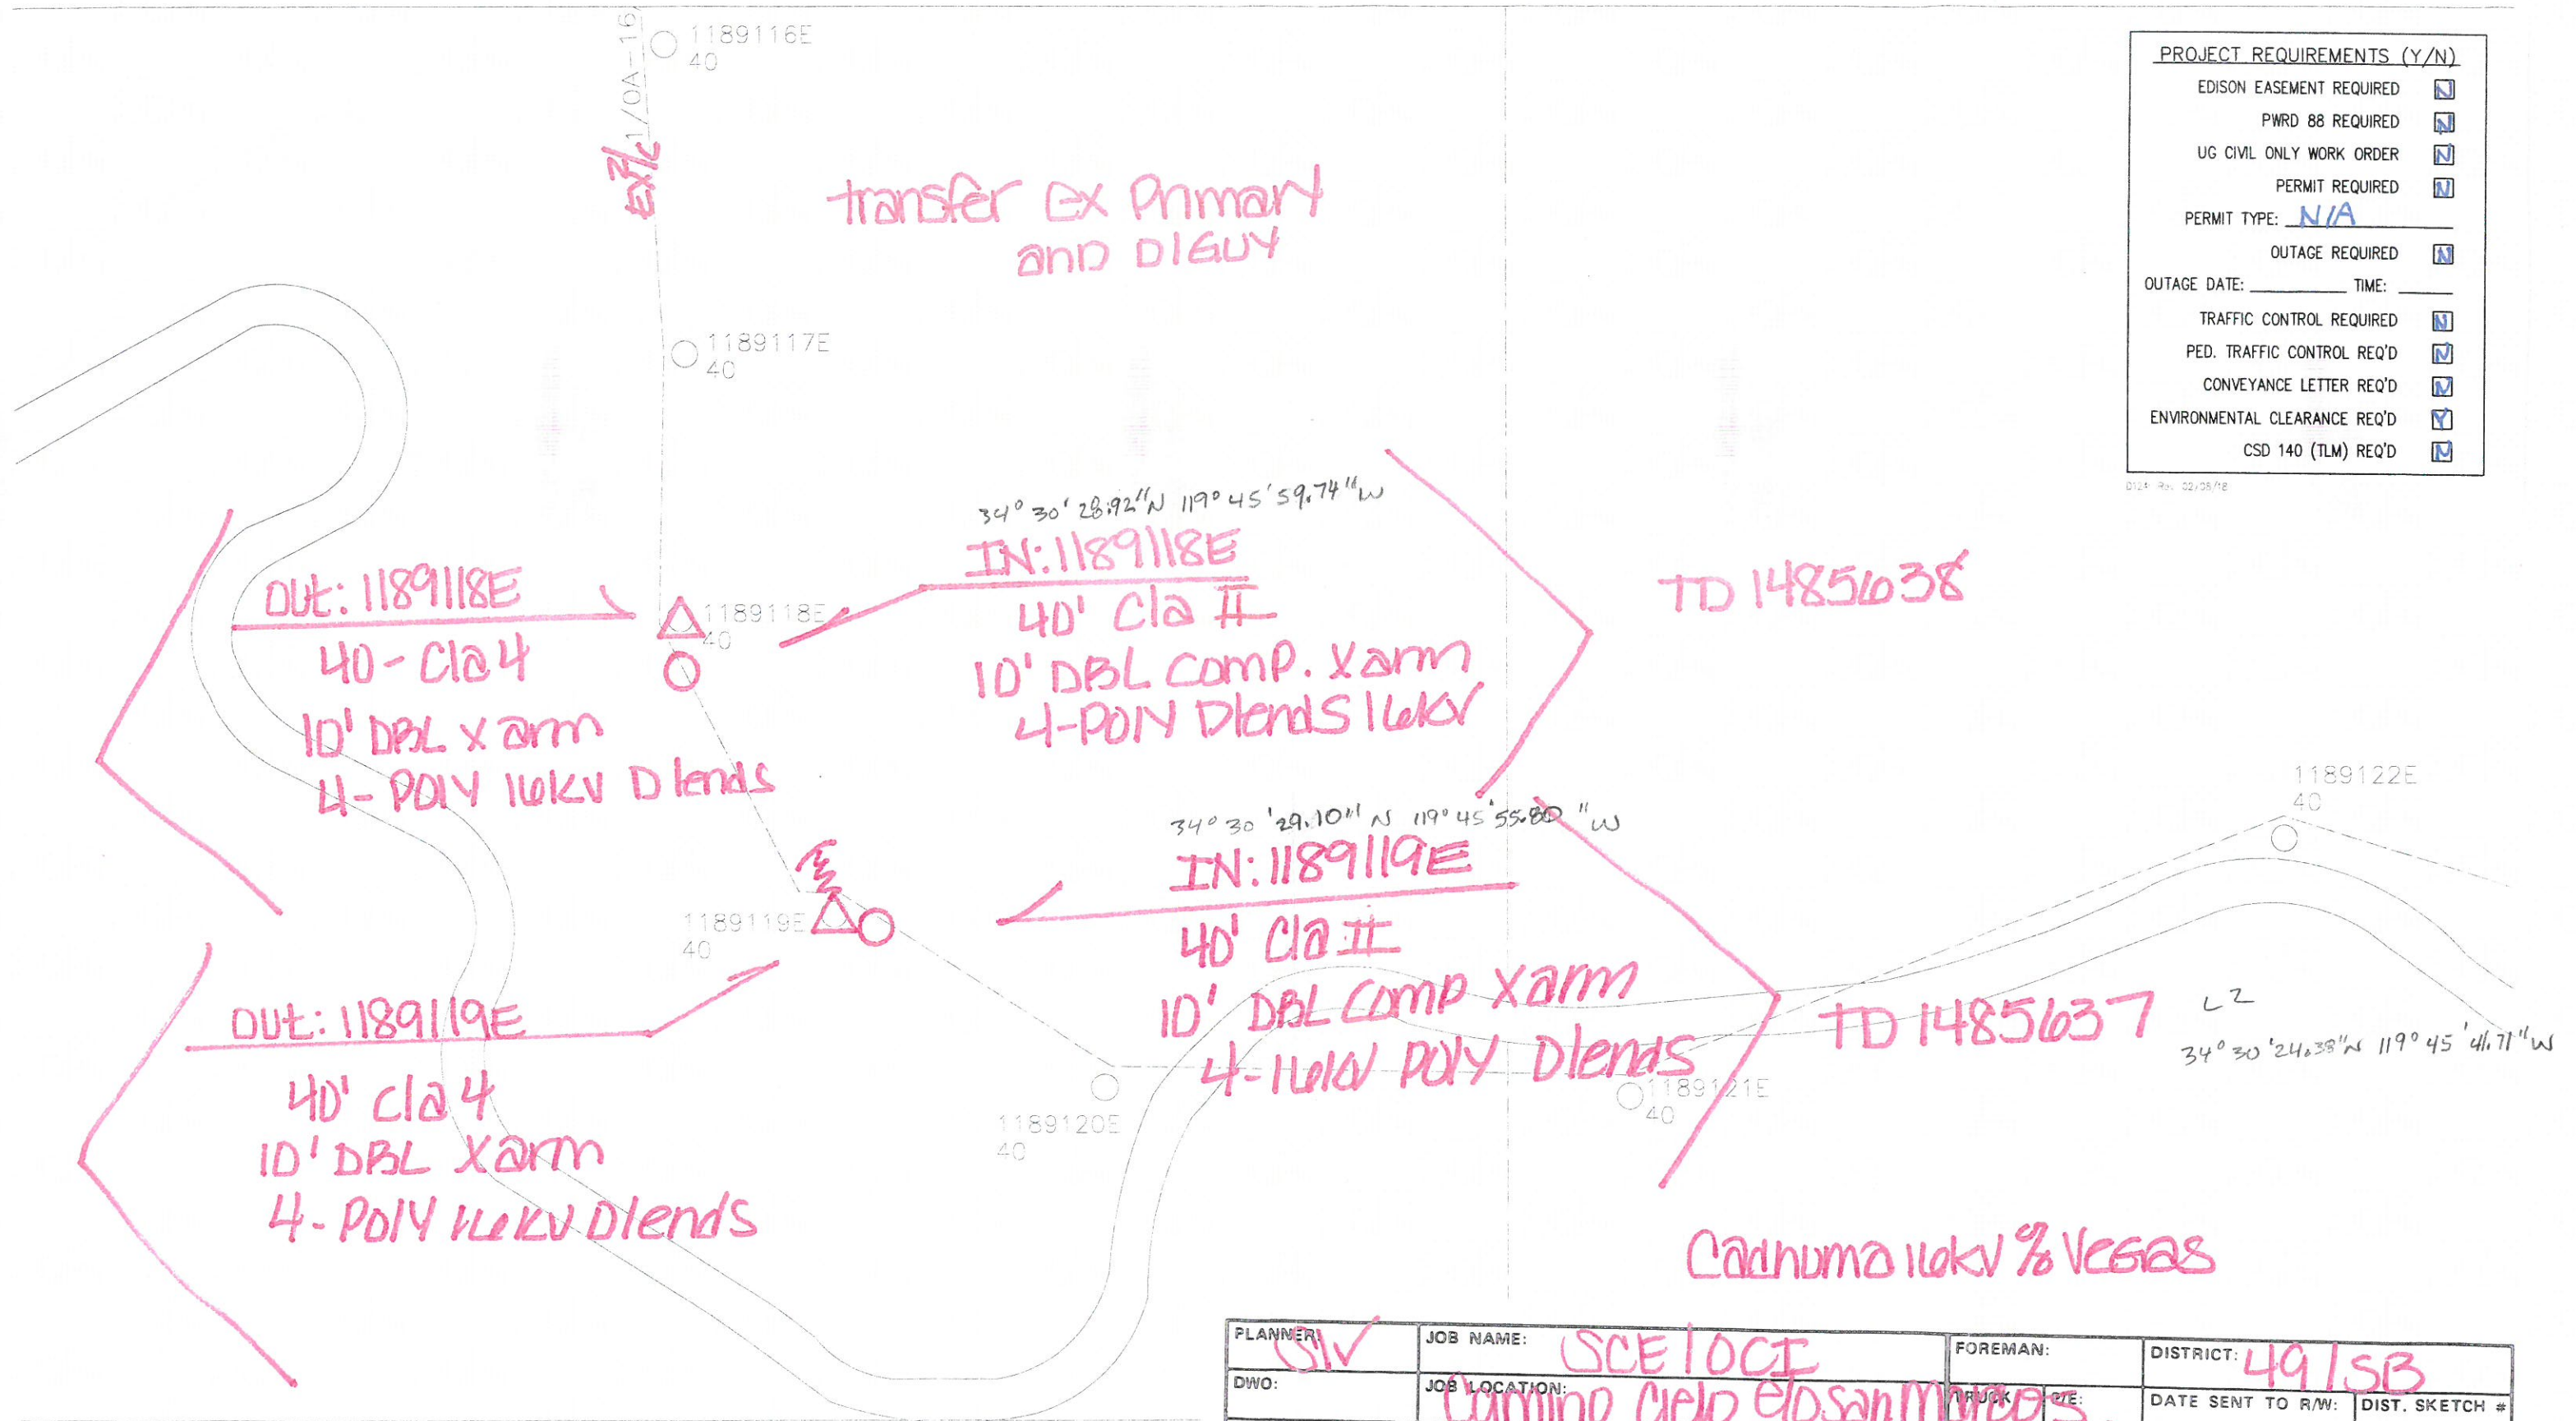

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☒
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒
PERMIT TYPE:	N/A
OUTAGE REQUIRED	☒
OUTAGE DATE:	TIME:
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒

D124 Rev. 02/05/18

PLANNER: SIV	JOB NAME: USCE/OCI	FOREMAN:	DISTRICT: 49/SB
DWO:	JOB LOCATION: Camino Cielo Edison Motors	TRUCK SIZE:	DATE SENT TO R/W: 25-54
A.I. NO.:	TLM-CSD 140 REQUIRED YES ☐ NO ☐	T.L.M. DATA: SIZE KVA CUST. LOAD	WORKED BY: SIV
J.P.A. NO.:	GRID NO. THOMAS MAP	EXIST. PROP.	INV. MAP NO.'S
RELATED W.O.:	VOLTAGE DROP ☐ % PRI. CIRC.:	INV. MAP NO.'S VERIFIED: (✓)	

Pole 1189118E



Pole 1189119E



E Camino Cieo



34 30 24.38N 119 45 41.71W

LZ



26-54

SANTA BARBARA CO. 25-54

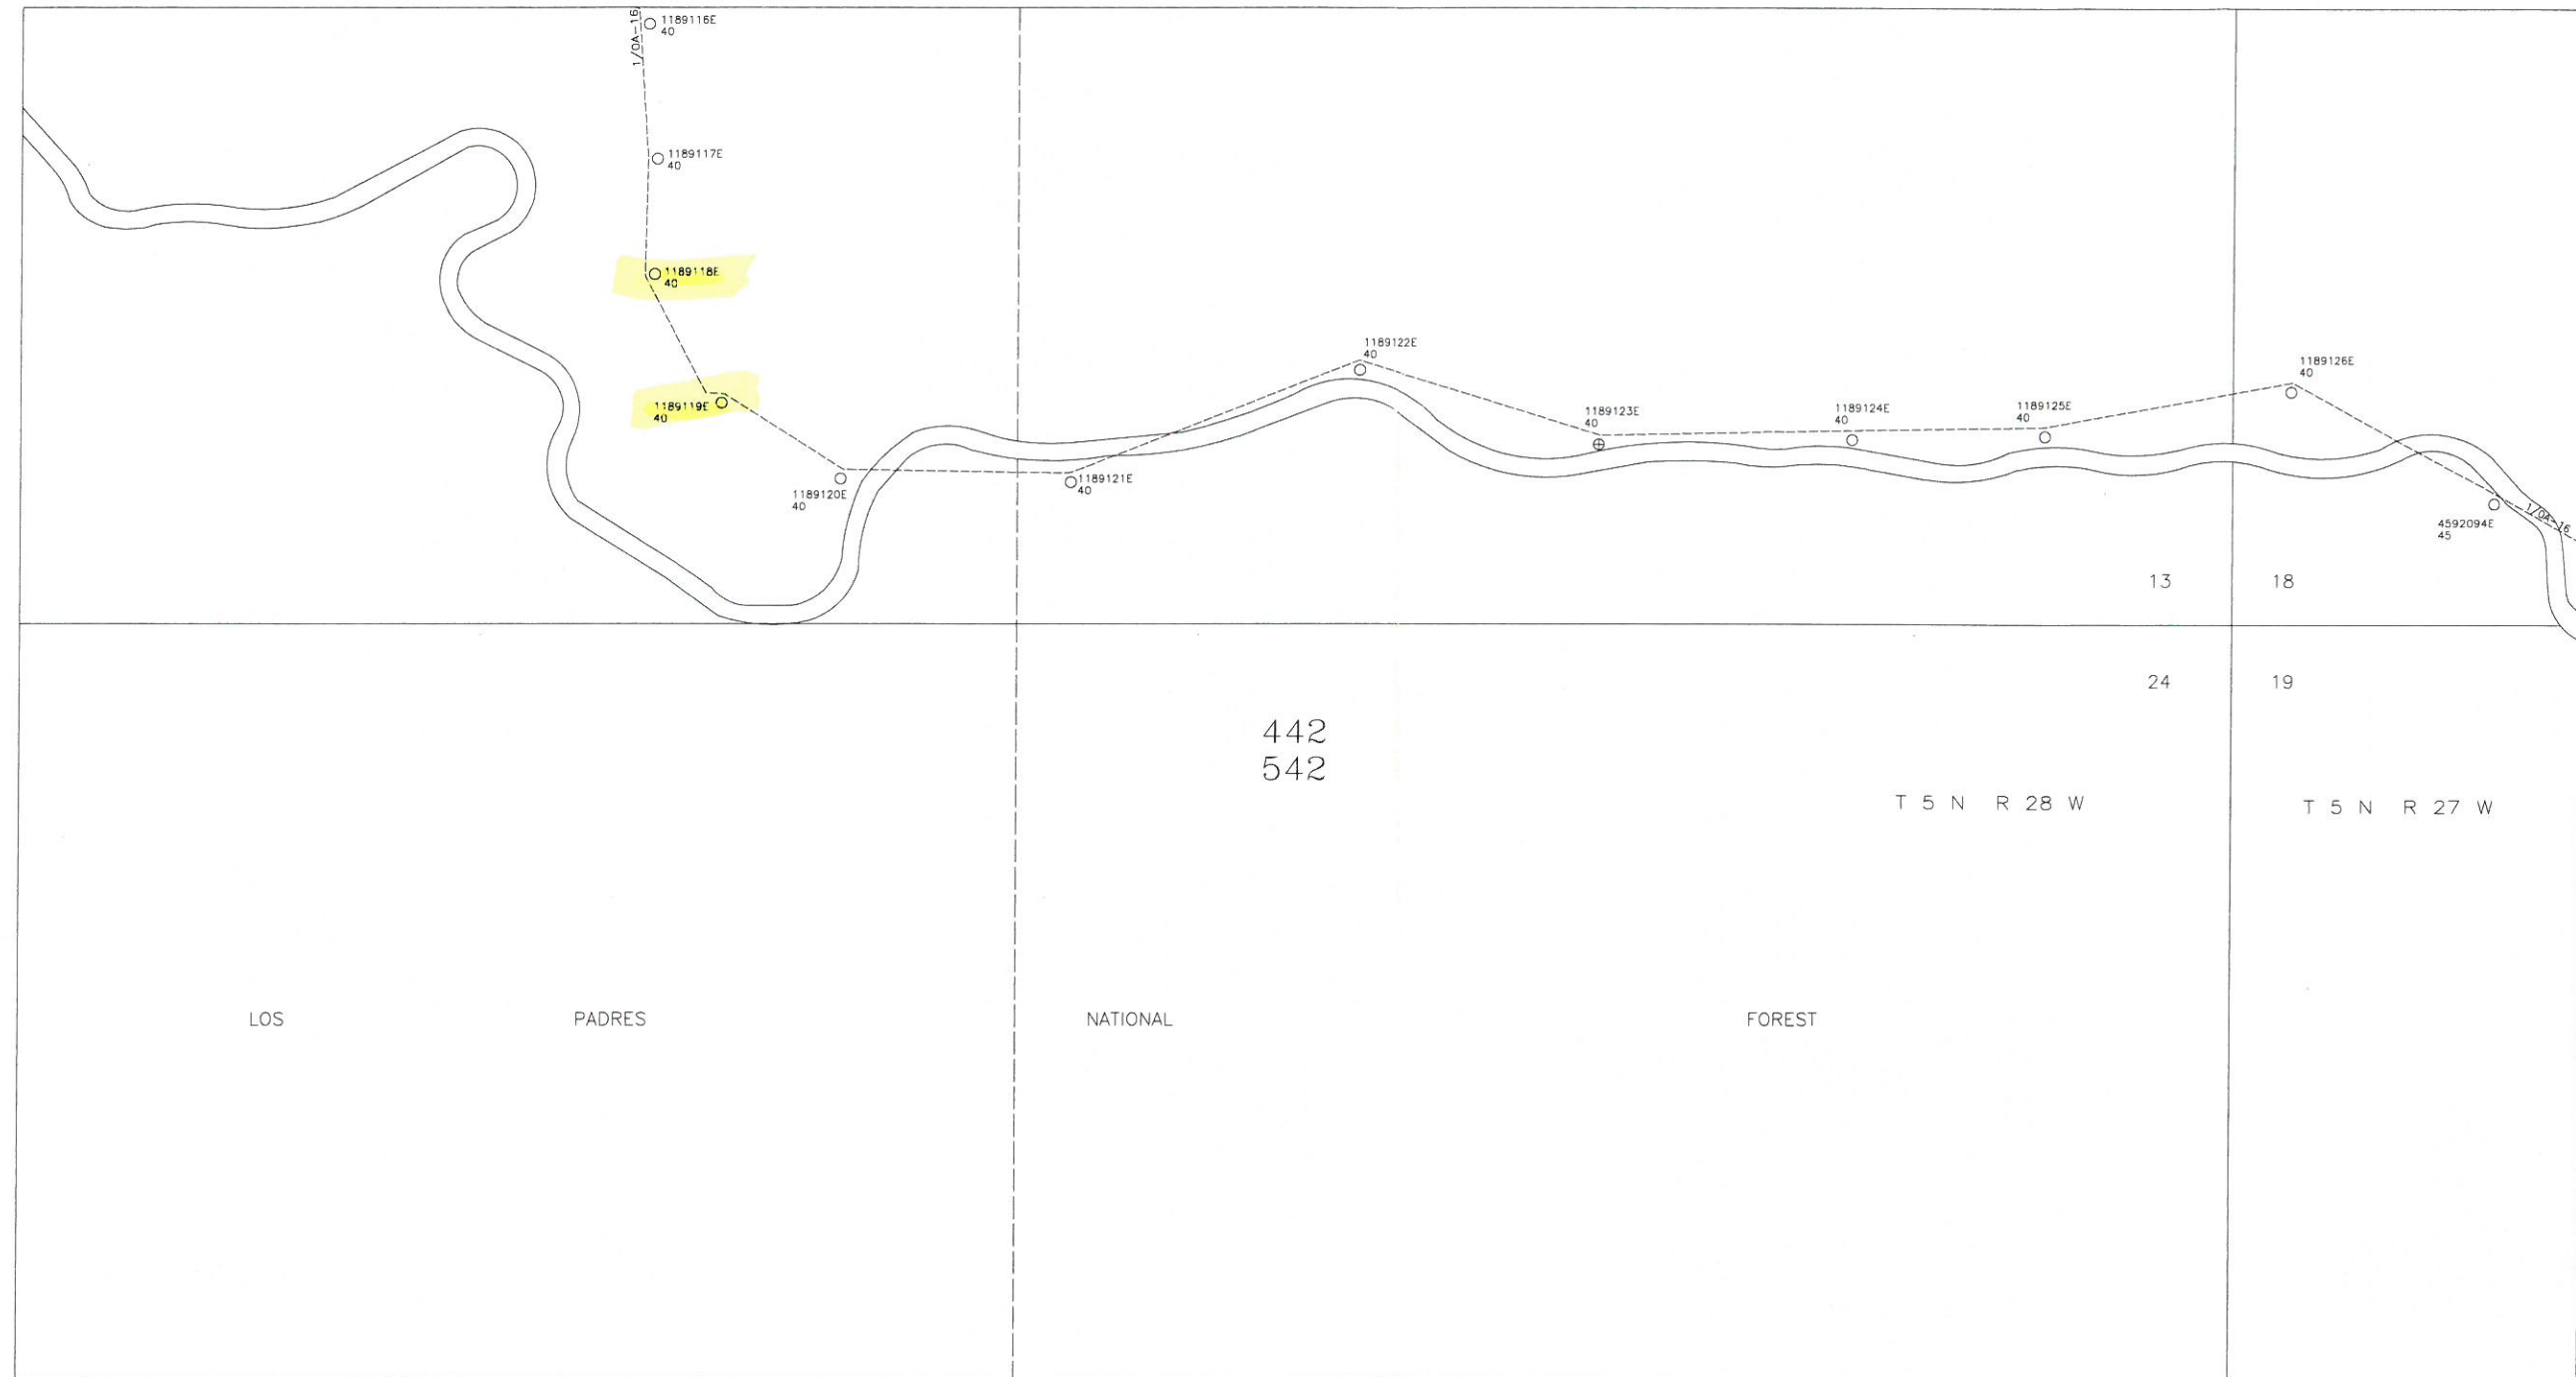

SANTA BARBARA


8-05 LLUND 7-12 TAGLE

25-55



A2
B2

A2

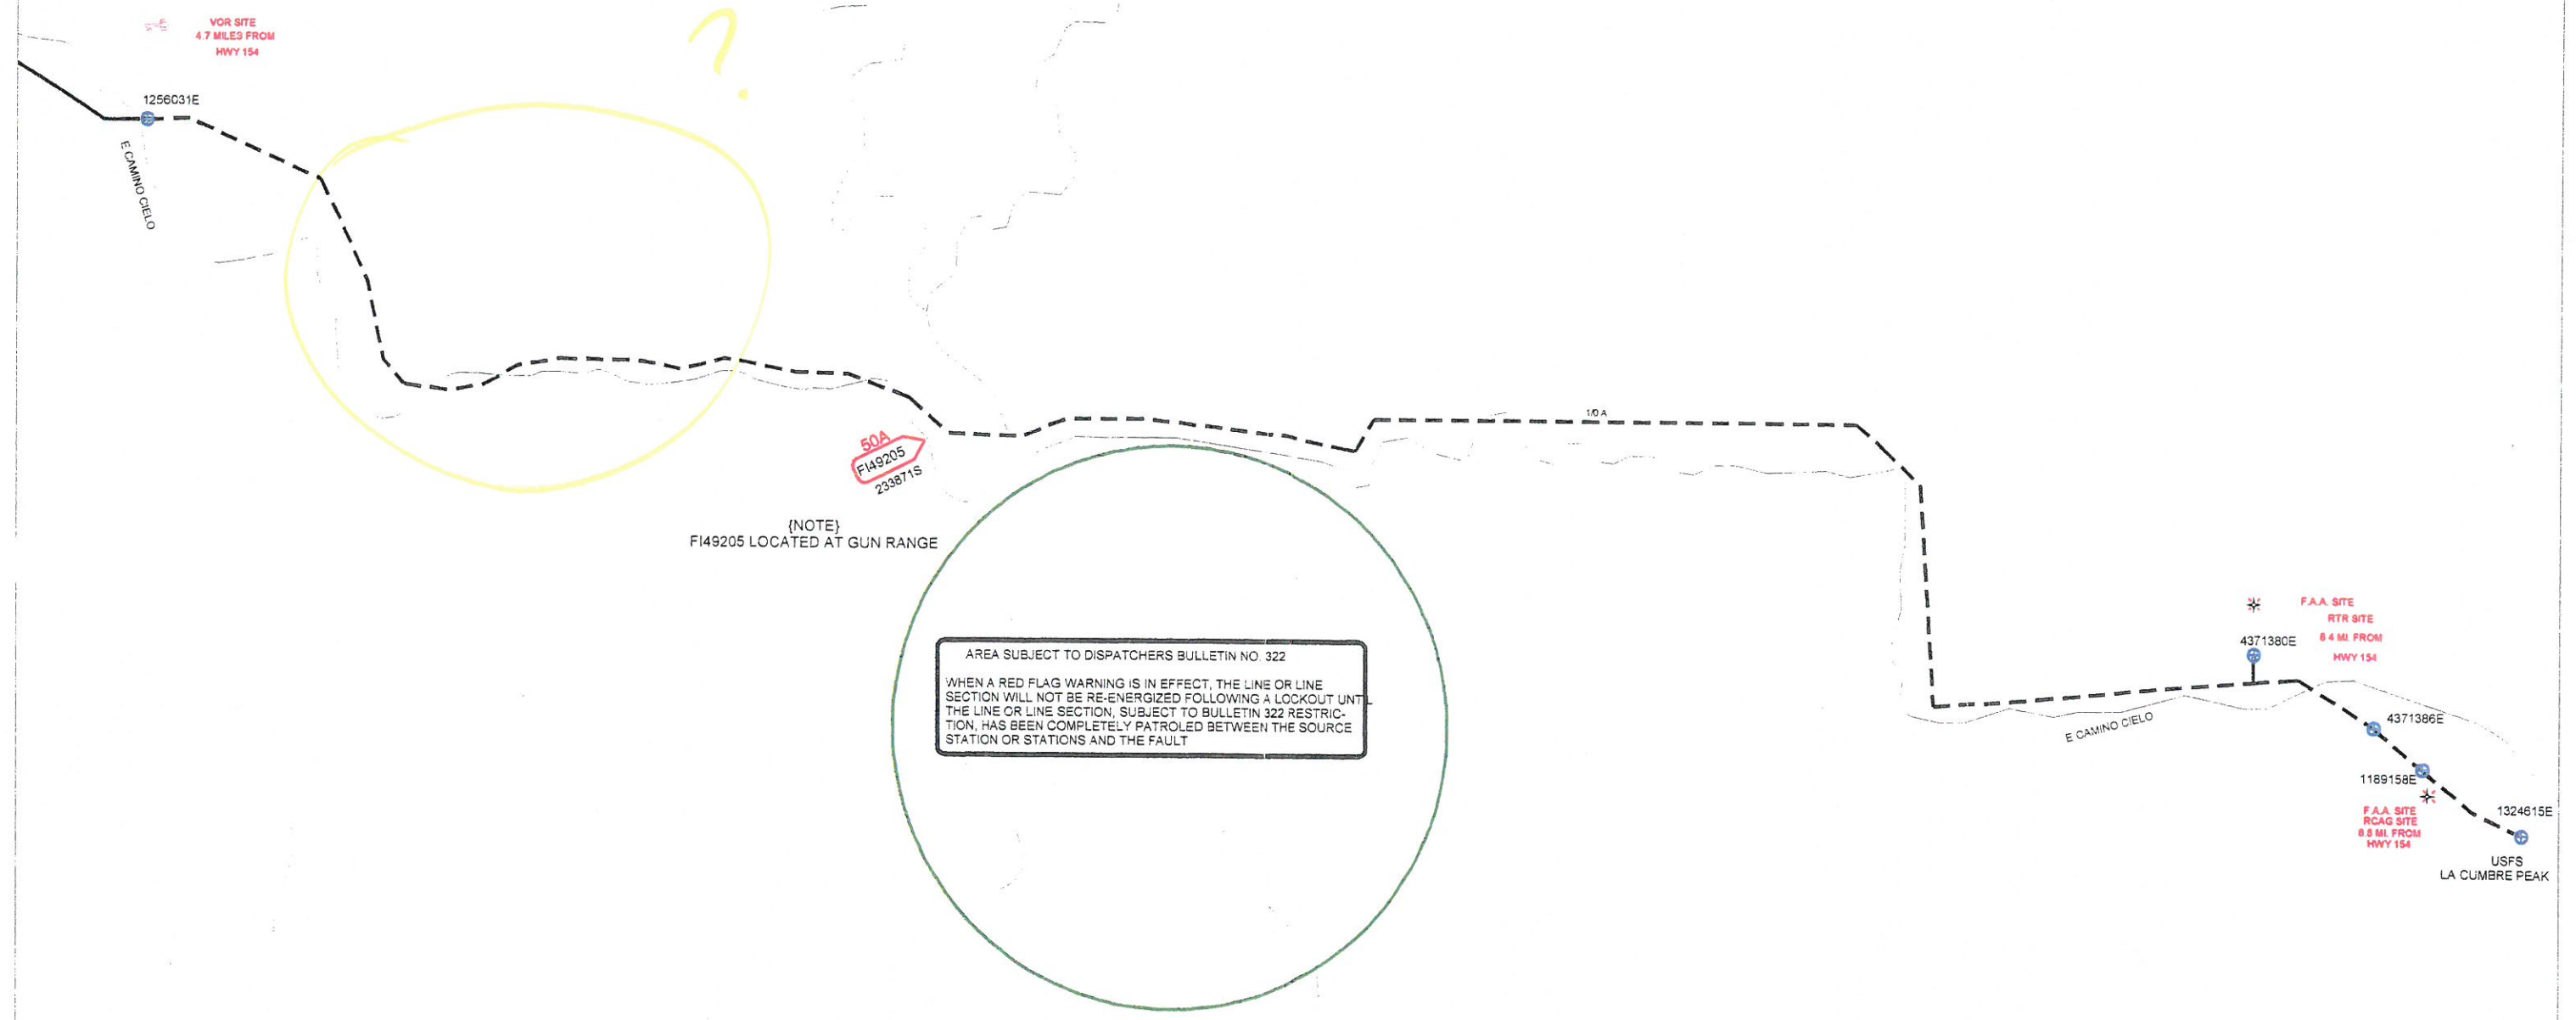

B2

FOREMEN	DATE	SYSTEM: GOLETA
MAPPING	07/29/2010	PRIORITY NOTIFICATION :
MONTANO	02/01/2008	FAULT INDICATORS ON LOOP STATIONS :
STA BARB	49	AUTOMATIC SW. GEAR (SCADA):
EQUIP	550	NETCOMM EQUIPMENT :
UNSET		
UNSET		

SCALE: 1098

CACHUMA 16KV
CODE: 02595
VEGAS SUB (E2)
CODE: 5570

B3