

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

NOTES:
-SCE TO PTD.
-HARD SET NORTH.
-JOINT MEET REQ'D.
-CRANE SET REQ'D.
-TREE TRIMMING REQ'D.
-CREW TO REMOVE EXISTING OLD POLE BUTT.
-POLE IN REAR OF 2743 GLENDESSARY LN.
-NO EAGLE ZONE.
-BULL. 322 AREA.

TRANSFER:
2- #6 BC 4KV
1- 9/32" SPAN GUY
1- 25KVA 4KV 120/240V (2004)
1- 4/O AT 120/240V SEC
1- #4 AT 120/240V SRV

BREAST BLOCK & POLE KEY CALCS
(15° ANGLE 2-#6BC) 2 X 320 = 640
 $2[\sin(7.5) = \frac{X}{640}] X = 167.07$
 $167.07 \times 37'6" = 6,265.13$
(15° ANGLE 1-4/OAT) 2,469

$2[\sin(7.5) = \frac{X}{2,469}] X = 644.54$
 $644.54 \times 31'6" = 20,303.01$
 $20,33.01 + 6,265.13 = 26,568.14$

DF-TB 45' CLASS 3 GRADE A 12LBS = 30,250LBS

GLENDESSARY LN.

2743

N: 34° 26' 40.23"
W: 119° 42' 59.52"
ELEVATION: 323'

POLE

4041807E

45'

Class H3

IN: 1- POLE 45' CLASS H3 WOOD FULL TREAT
IN: 1- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY DE 4KV CNTM RIG #6
IN: 1- FE CO MNT FOR ELF 100A 2.4KV 1-EA
IN: 1- FE FUSE ELF 8KV 25A
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- MISC AVIAN TRANS BUSHING COVER 3.25-4.25
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD
IN: 1- AG BLOCK & POLE KEY

RM

4041807E

3

Class C5

RM: 1- RM POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- MISC POLE TOP EXTENSION 5' STEEL & WOOD
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS GLASS/POLY 35KV & LESS
RM: 1- FE CO OPEN 100A 4KV 1P
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
RM: 1- MISC AVIAN TRANS BUSHING COVER 3.25-4.25

T.L.M. DATA:


	SIZE	KVA	CUST	% LOAD
EXIST.	25	23.73	8	94.92%
PROP.	25	23.73	8	94.92%

VOLTAGE DROP: _____

FLICKER FACTOR: _____

PRI. CIRCUIT: PUESTA 4KV

4041806E
40'

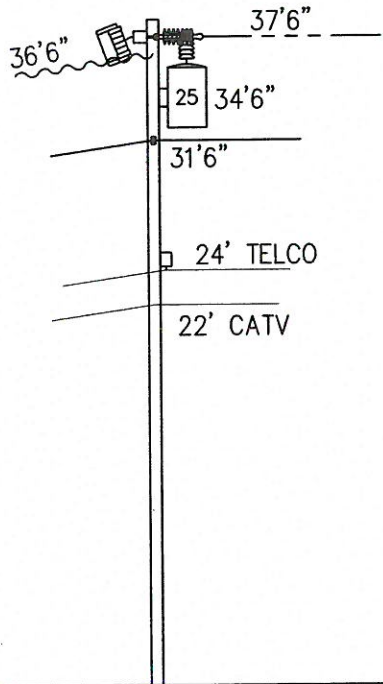

PROPOSED
4041807E
L/N

EX. 1- 9/32" SPAN GUY
EX. 1- 4/OAT 120/240V

EX. 2- #6BC 4KV


EX. 1- 4/OAT 120/240V

4041808E
40'

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE: _____	
OUTAGE REQUIRED	☒
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 49 - SANTA BARBARA		PROJ. MGR. TOLMASOFF, LAURA PHONE 714-796-9811		PLANNER TIDWELL DESIGN PHONE 805-647-4707		DESIGNER TIDWELL DESIGN	
PROJECT NO. 1648393	SERVICE REQUEST 2555918	MSR NO.	PRODUCT-1 1442476-INFRA REPLAC - DET POLE REPLACEMENT				ASSOC DESIGN
CIRCUIT / VOLTAGE PUESTA 4KV		THOMAS GUIDE N/A	PRODUCT-2				ASSOC DESIGN
SUB / PG NO. MODOC		CIRCUIT CODE	PRODUCT-3				ASSOC DESIGN
INVENTORY MAP 17-57A		J.P.A. NO. E6049-409511511		PROPOSED CONSTRUCTION (LOCATION) 4041807E 2743 GLENDESSARY LN., SANTA BARBARA			
TYPE		DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET
Southern California Edison Company							DESIGN\DRWG NO. 1068540_0.01

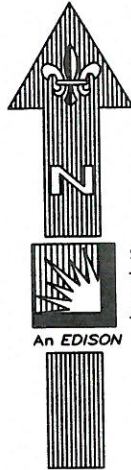

NOT TO SCALE

4041807E



Dist. 49Deteriorated Pole
L / E