

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____



☐ Week 2 _____

☐ Week 3 _____

* **NOTES:** JOINT POLE
 COMPOSITE POLE
 ENVIRO POLE - WOODPECKER DAMAGE
 REAR PROPERTY LINE POLE
 JOINT MEET - MULTIPLE RISERS/COMM RISER
 BULLETIN 322 AREA
 EAGLE ZONE
 +2 MILES FROM SUB
 HAND SET
 SET SAME HOLE

5 RM 1413406E Class C4
 45'
 RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
 RM: 1- TR OH 10KVA 16KV 120/240 1P
 SN: _____
 RM: 2- XA SNGL FB 10' STEEL PINS
 RM: 2- INS GLASS & PIN 16KV
 RM: 1- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
 RM: 2- INS GLASS/POLY 35KV & LESS
 RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
 RM: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
 RM: 1- AG ANCHOR ROD 3/4" X 8' 2-EYE W/PLATE
 RM: 1- GR OH #6 SOL WP SECONDARY W/ROD

TRANSFER (S):
 2/C 4A-16KV (W)
 2/C 4A-16KV (S)
 1-1/0AT-120V
 1-3" SEC RISER

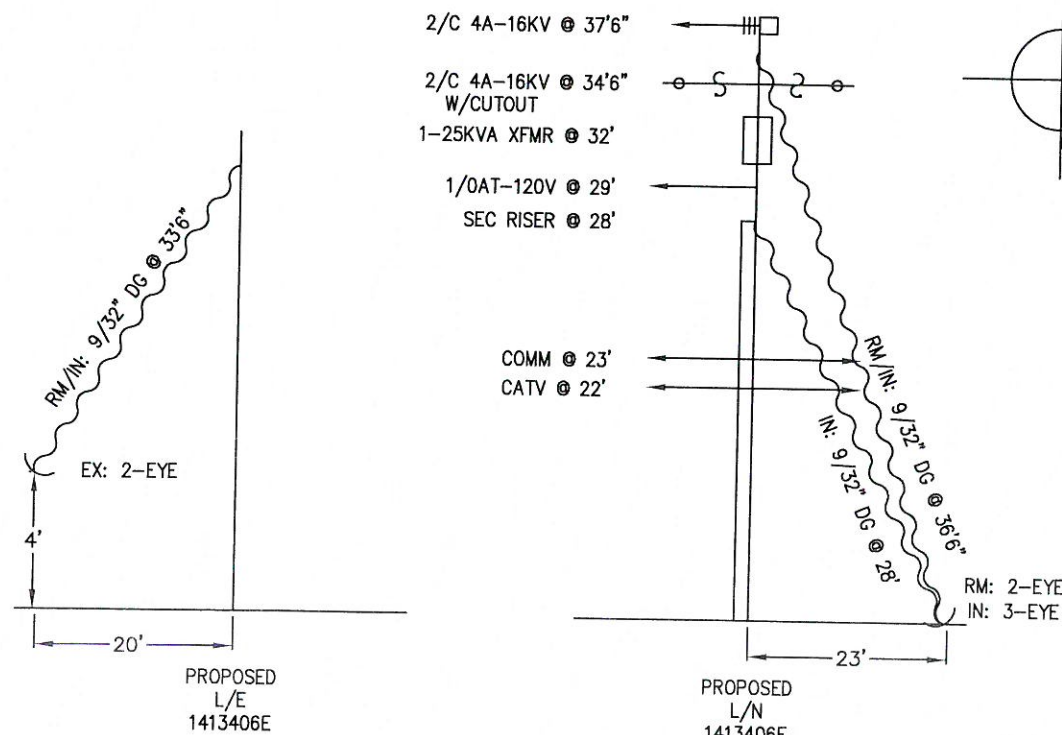


PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☒
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 49 - SANTA BARBARA		PROJ. MGR. PARK, JU PHONE 909-222-9350		PLANNER ASP PHONE 714-893-2405	DESIGNER ASP
PROJECT NO. 1665466	SERVICE REQUEST 2572593	MSR NO.	PRODUCT-1 1456280-INFRA REPLAC - DET POLE REPLACEMENT		
CIRCUIT / VOLTAGE HURST 16KV		THOMAS GUIDE	PRODUCT-2		
SUB / PG NO. SAN MARCOS SUB		CIRCUIT CODE	PRODUCT-3		
INVENTORY MAP 19-57A		J.P.A. NO. 409694913	PROPOSED CONSTRUCTION (LOCATION) POLE # 1413406E 2680 HOLLY RD SANTA BARBARA, CA		
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
Southern California Edison Company					SHEET _____ OF _____
					DESIGN\DRWG NO. 1079424_0.01

N 34° 27' 36.80"
 W 119° 42' 46.66"
 ELEVATION: 888'

POLE 1413406E Class C1
 45'
 IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
 IN: 1- TR OH 25KVA 16KV 120/240 1P
 SN: _____
 IN: 2- FE CO MNT FOR ELF 100A 16KV 1-EA
 IN: 2- FE FUSE ELF 15KV 6A
 IN: 1- XA DBL HD DE COMP 10'
 IN: 1- XA SNGL DE HD COMP 10' W/BKT
 IN: 2- INS POLY W/PIN 16KV CLMP #4-653 ACSR
 IN: 4- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
 IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
 IN: 3- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
 IN: 1- AG ANCHOR ROD 1" X 10' 3-EYE W/PLATE
 IN: 1- GR OH #6 SOL WP SECONDARY W/ROD
 IN: 3- GUYING TEE


T.L.M. DATA:				
SIZE	KVA	CUST	%	LOAD
EXIST. 10	5.7	2	57	%
PROP. 25	5.7	2	22.8	%
VOLTAGE DROP: _____				
FLICKER FACTOR: _____				
PRI. CIRCUIT: HURST 16KV				

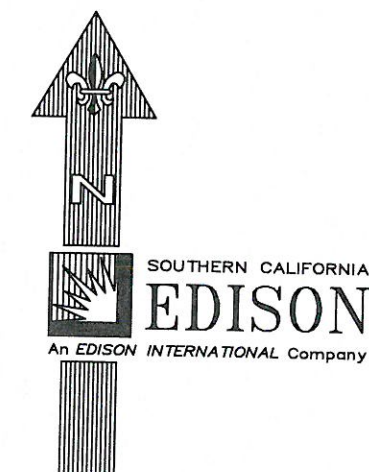

NOT TO SCALE



1413406E

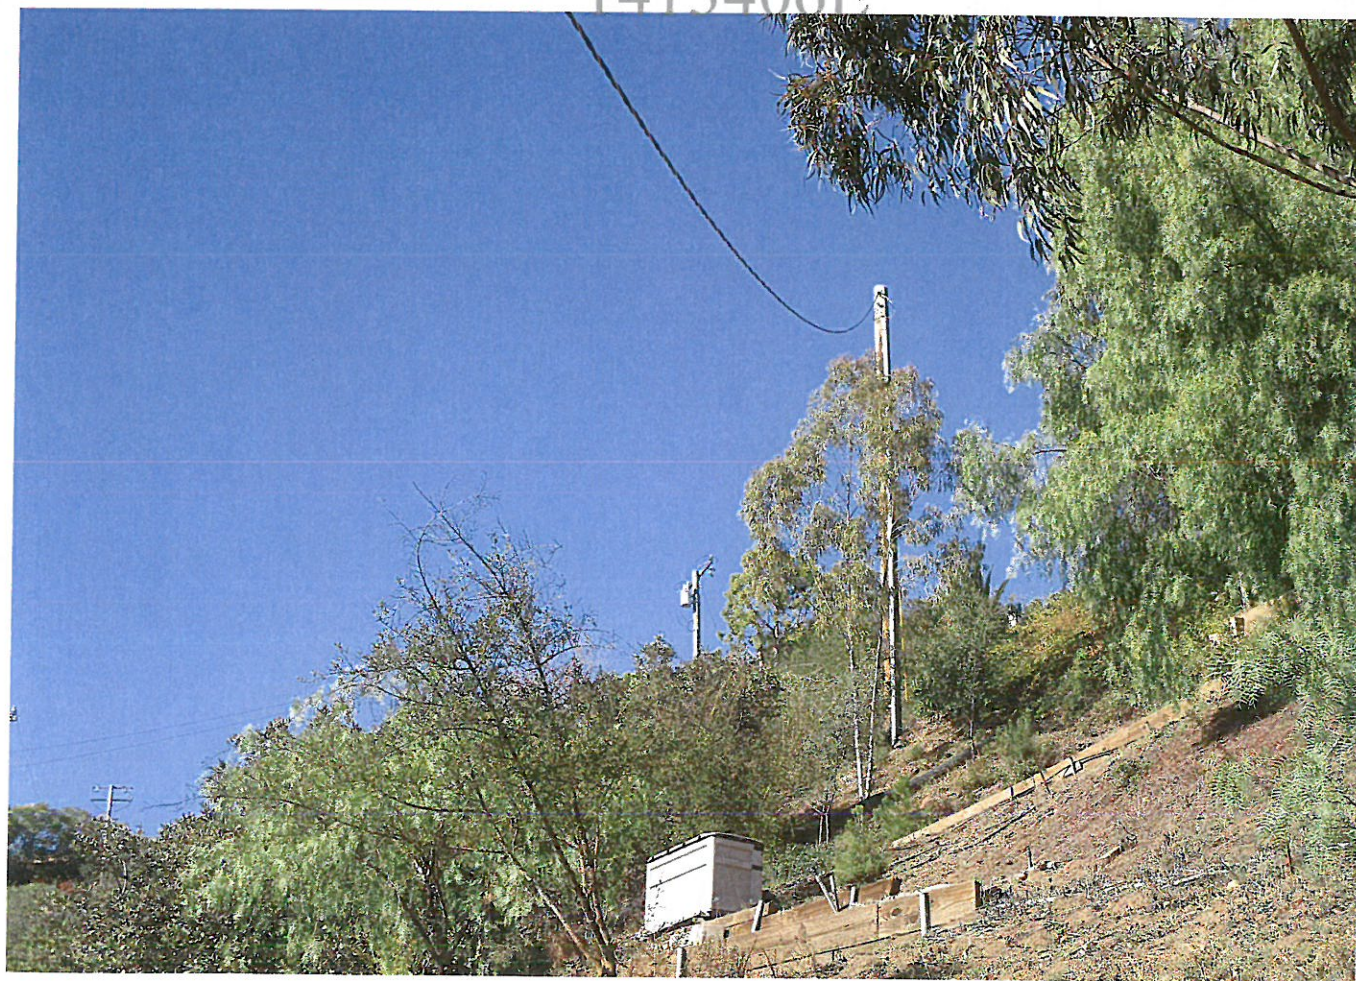

WEP
#3