NOTES:
- NO TRUCK ACCESS
- BACK YARD MACHINE POSSIBLE
- SET HARD NORTH EAST
- E-PTD
- LOCATED IN CAMP PONDO

TRANSFER:
- 3-4B-2.4
- PHONE
- 7/32" SPAN GUY

34° 13' 14.7" N,
117° 4' 39.1" W
ELEV: 6,495'

5 RM 19271CIT
35' Class C5
RM: 1- POLE 35' CLASS 5 WOOD FULL TREAT
RM: 3- INS GLASS/POLY 35KV & LESS
RM: 1- XA SNGL FB 8' STEEL PINS N/BOND

BULLETIN 322 AREA

POLE 4917202E 6
45' Class H1
IN: 1- POLE 45' CLASS H1 WOOD FULL TREAT
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY POST W/PIN 12KV CLMP #4-336
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653
IN: 1- AG BLOCK & POLE KEY

74' 3-4B-2.4
TR: 74' 7/32" S.G
487122E
45

165' 3-4B-2.4
487121E
40

.36 MI

838'

GREEN VALLEY LAKE BLVD

HWY 18

2.4 kV 37'6"
POINT LOAD
TR: 7/32" SG @ 23'
PHONE 22"
PHONE 21'
L/NW
4917202E
PROPOSED

UNGUYED DE CALC 19271CIT
7/32" SG = 1,806 x 23'=41,538

TOTAL	=41,538 FT-LBS
CLASS 4 BBK	=47,500 FT-LBS
45' CLH1 GRADE A 6#	=42,507 FT-LBS

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE: _____	
OUTAGE REQUIRED	N
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 02/08/18

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

DISTRICT: 40 – ARROWHEAD	PROJ. MGR. GALLARDO, ANTHONY PHONE		PLANNER DIVERSIFIED UTILITIES PHONE 661-325-3212		DESIGNER DIVERSIFIED UTILITIES
PROJECT NO. 1622955	SERVICE REQUEST 2531333	MSR NO.	PRODUCT-1 1421951- DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE GREEN BEAR 2.4kV		THOMAS GUIDE	PRODUCT-2		ASSOC DESGN
SUB / PG NO. % GREEN BEAR P.T. A2		CIRCUIT CODE	PRODUCT-3		ASSOC DESGN
INVENTORY MAP 262-2277-1		J.P.A. NO.			

PROPOSED CONSTRUCTION (LOCATION)
STR# 19271CIT
838' N/O GREEN VALLEY LAKE BLVD .36 MI W/O HWY 18
GREEN VALLEY LAKE, CA

TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
	9/19/2018			DUSI-AA	

Southern California Edison Company

SHEET _____ OF _____

DESIGN\DRWG NO. 1052331_0.01

NOTES:
- NO TRUCK ACCESS
- BYM POSSIBLE FROM HWY 18
- SET HARD NORTH
- E-PTD
- OFFSET W/S PHASE TO CLEAR TREE
- 1600049E REPLACED ON TD 1383142
- RIGHTS CHECK (FEDERAL LAND)

TRANSFER:
- 3-1/0A-12
- 9/32" SPAN GUY
- PHONE

BULLETIN 322 AREA

VICINITY MAPS

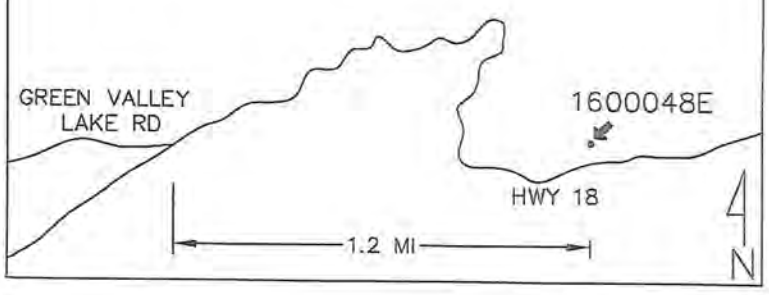

1 RM 1600048E
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL VB 10' STEEL PINS
RM: 3- INS GLASS/POLY 35KV & LESS

34° 13' 17.7" N,
117° 3' 3.4" W
ELEV: 6,685'

2 POLE 1600048E
45' Class C2
IN: 1- POLE 45' CLASS 2 WOOD FULL TREAT
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY POST W/PIN 12KV CLMP #4-336
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653
IN: 1- AG BLOCK & POLE KEY

1600047E
40

172' 3-1/0A-12

175' 3-1/0A-12
175' 9/32" S.G.

261'

1600049E
40
3/25/12

12 kV 37'6"

TP: 9/32" SG @ 27'

PHONE 24'

HWY 18

L/E
1600048E
PROPOSED

SUP
Environmental Special Use Permit

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE: USFS	
OUTAGE REQUIRED	N
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 02/08/18

BREAST BLOCK CALCS (SPAN GUY):

9/32" SG = 413 x 27' = 11,151 LBS
CLASS 3 PKRM = 47,500 LBS
45' C2 DFTB 6LB GRADE A = 29,265 LBS

DISTRICT: 40 - ARROWHEAD	PROJ. MGR. GALLARDO, ANTHONY PHONE		PLANNER DIVERSIFIED UTILITIES PHONE 661-325-3212	DESIGNER DIVERSIFIED UTILITIES	
PROJECT NO. 1622917	SERVICE REQUEST 2531296	MSR NO.	PRODUCT-1 1421929- DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE SNOW VALLEY 12kV		THOMAS GUIDE	PRODUCT-2		ASSOC DESGN
SUB / PG NO. % RUNNING SPRINGS B4		CIRCUIT CODE	PRODUCT-3		ASSOC DESGN
INVENTORY MAP 260-2286-2		J.P.A. NO.			

TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
	9/17/2018			DUSI-AA	

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
STR# 1600048E
1.2 MI E/O GREEN VALLEY LAKE RD 261' N/O HWY 18
ARROWBEAR LAKE, CA

SHEET _____ OF _____

DESIGN\DRWG NO. 1052310_0.01

NOTES:
- NO TRUCK ACCESS
- SET 1' NORTH WEST
- E-PTD
- LINE ANGLE 91°
- GATE ACCESS @ 34° 15' 27.27"N 117° 5' 30.68"W

TRANSFER:
- 2-1/0A-12
- 3/4" ANCHOR
- PHONE
- CATV

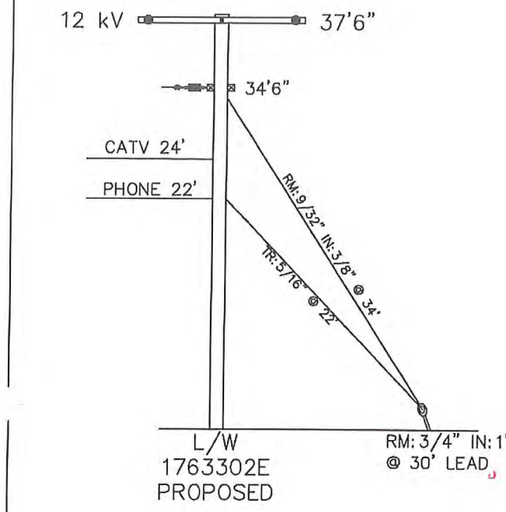

ANCHOR CALC:
GUY#1 3/8"=6,118lbf
GUY#2 5/16=5,462lbf
TOTAL=11,580lbf
1" ALLOWABLE NEW=18,000lbf

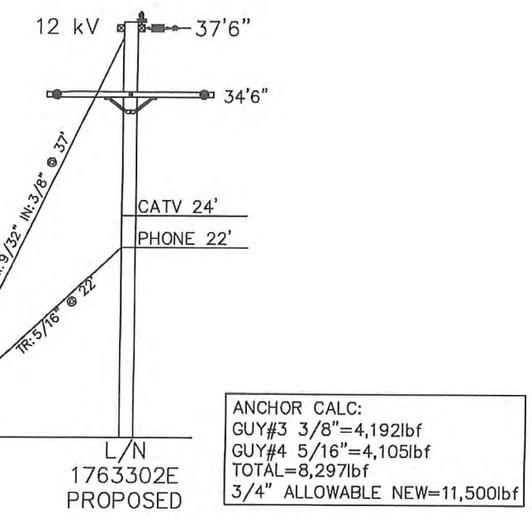

ANCHOR CALC:
GUY#3 3/8"=4,192lbf
GUY#4 5/16"=4,105lbf
TOTAL=8,297lbf
3/4" ALLOWABLE NEW=11,500lbf

RM 1763302E (1)
45' Class C4
RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 2- XA DBLE FB 10' STEEL PINS
RM: 4- INS GLASS/POLY 35KV & LESS
RM: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- AG ANCHOR ROD 3/4" X 8' 2-EYE W/PLATE

34° 15' 24.50" N,
117° 05' 47.99" W
ELEV: 6,211'

POLE 1763302E (2)
45' Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 4- XA SNGL TAN HD COMP 10' W/BKT
IN: 4- INS POLY DE 12KV HVY LOAD #4 & 1/0
IN: 2- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
IN: 1- AG ANCHOR ROD 1 " X 10' 3-EYE W/PLATE

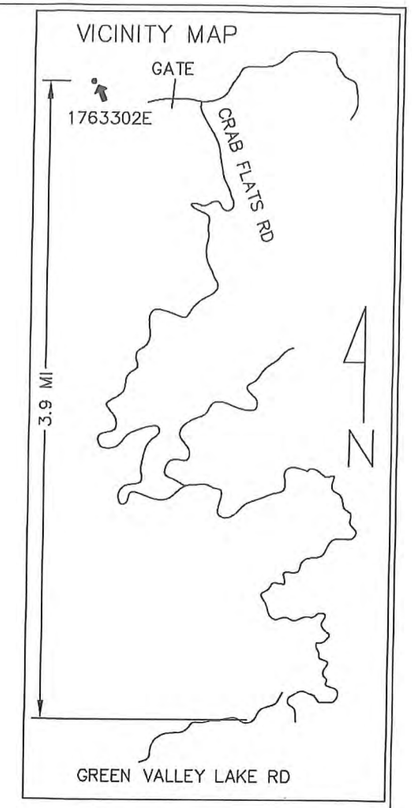

NOT TO SCALE

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE:	
OUTAGE REQUIRED	N
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 02/08/18

DISTRICT: 40 – ARROWHEAD	PROJ. MGR. GALLARDO, ANTHONY PHONE		PLANNER DIVERSIFIED UTILITIES PHONE 661-325-3212	DESIGNER DIVERSIFIED UTILITIES	
PROJECT NO. 1581063	SERVICE REQUEST 2490832	MSR NO.	PRODUCT-1 1387752- DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE TAGGERT 12kV		THOMAS GUIDE	PRODUCT-2		ASSOC DESGN
SUB / PG NO. % RUNNING SPRINGS A1		CIRCUIT CODE	PRODUCT-3		ASSOC DESGN
INVENTORY MAP 276-2268-2		J.P.A. NO.	PROPOSED CONSTRUCTION (LOCATION) STR# 1763302E 263' N/O 3N16Q 3.9 MI N/O GREEN VALLEY LAKE DR GREEN VALLEY LAKE, CA		
	8/3/2018			DUSI-AA	
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
Southern California Edison Company				SHEET ____ OF ____	DESIGN\DRWG NO. 1024797_0.01

NOTES:
- NO TRUCK ACCESS
- HARD SET NORTH
- E TO PTD
- TIER 3
- CIRCUIT AND FIM CORRECTION 4B IN FIELD NOT 4A

TRANSFER:
- 3-4B-12
- 1-1/0AT-120
- PHONE

SECTIONAL COMPOSITE

BULLETIN 322 AREA

1 RM 749278E
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA DBLE FB 8' STEEL PINS
RM: 3- INS GLASS/POLY 35KV & LESS
RM: 2- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD

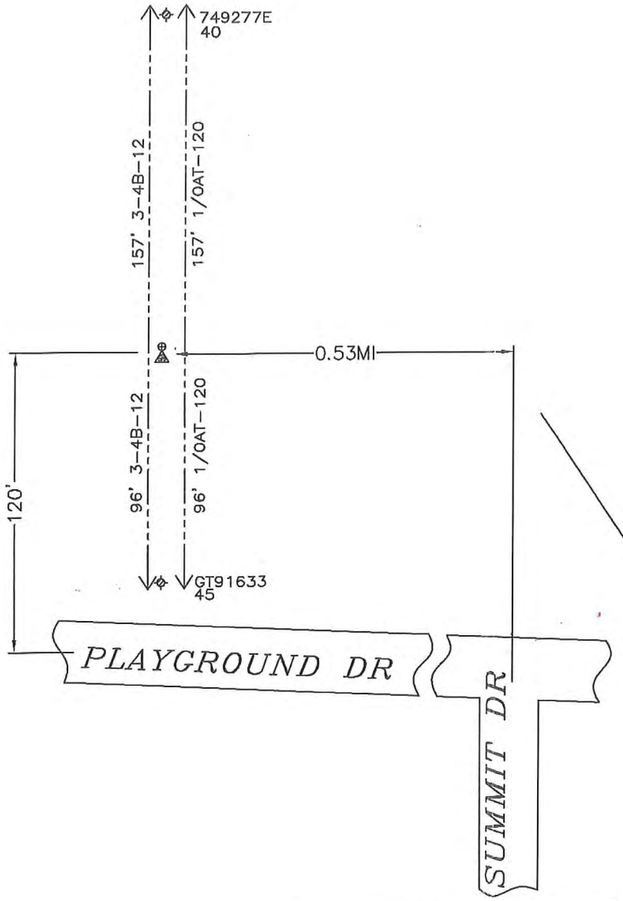

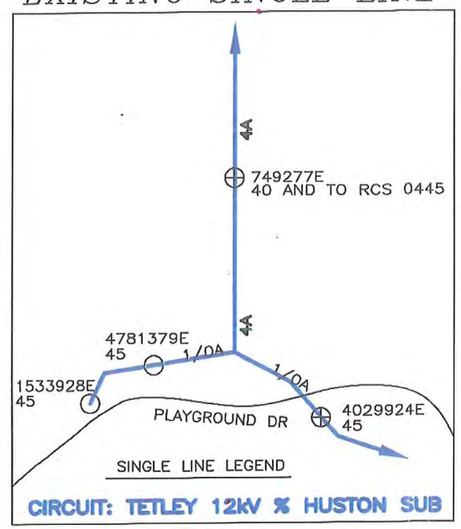

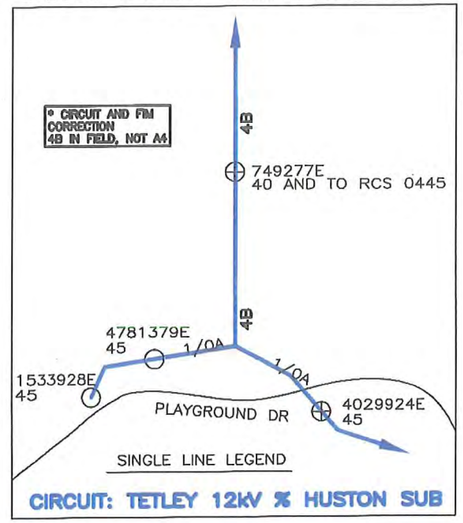

34° 14' 14.64" N,
117° 19' 15.63" W
ELEV: 5,327'

POLE 749278E 2
45' Class C1
IN: 1- POLE 45' CLASS 1 COMP SEC POLE
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY POST W/PIN 12KV CLMP #4-336
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653
IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD

SUP
Environmental Special Use Permit

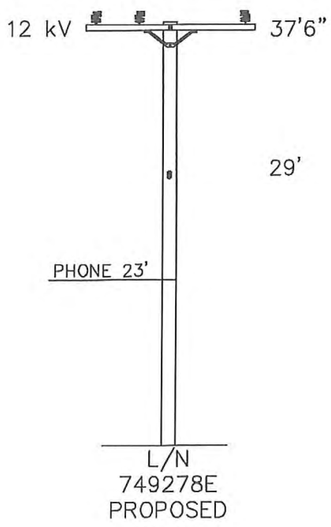

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE:	
OUTAGE REQUIRED	N
OUTAGE DATE: ____ TIME: ____	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 02/08/18

NOT TO SCALE

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

DISTRICT: 40 – ARROWHEAD	PROJ. MGR. GALLARDO, ANTHONY PHONE		PLANNER DIVERSIFIED UTILITIES PHONE 661-325-3212		DESIGNER DIVERSIFIED UTILITIES
PROJECT NO. 1676341	SERVICE REQUEST 2583191	MSR NO.	PRODUCT-1 1464880- DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE TETLEY 12kV		THOMAS GUIDE	PRODUCT-2		ASSOC DESGN
SUB / PG NO. % HUSTON E3		CIRCUIT CODE	PRODUCT-3		ASSOC DESGN
INVENTORY MAP 268-2205-1		J.P.A. NO. E6040-409718697	PROPOSED CONSTRUCTION (LOCATION) STR# 749278E 120' N/O PLAYGROUND DR 0.53MI W/O SUMMIT DR ARROWHEAD, CA		
12/28/2018			DUSI-TC		
TYPE / DATE / APPROVED BY / CHECKED BY / DRAWN BY / PAX #					
Southern California Edison Company			SHEET ____ OF ____		DESIGN\DRWG NO. 1085781_0.01

NOTES:
- NO TRUCK ACCESS
- SET 3' SOUTH
- E TO PTD
- TIER 3
- CIRCUIT AND FIM CORRECTION 4B IN FIELD NOT 4A

TRANSFER:
- 3–4B–12

SECTIONAL COMPOSITE

BULLETIN 322 AREA

3 RM 749274E
35' Class C5
RM: 1– POLE 35' CLASS 5 WOOD FULL TREAT
RM: 1– XA SNGL FB 8' STEEL PINS
RM: 3– INS GLASS/POLY 35KV & LESS

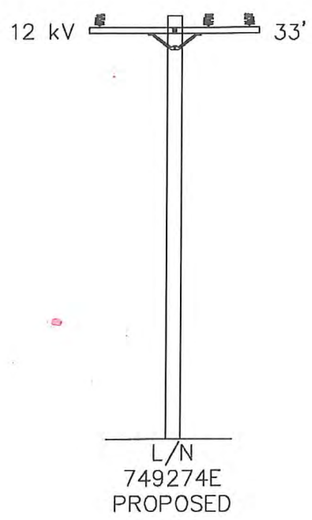

34° 14' 20.64" N,
117° 19' 15.72" W
ELEV: 5,210'

POLE 749274E 4
40' Class C1
IN: 1– POLE 40' CLASS 1 RS COMP SEC POLE
IN: 1– XA SNGL TAN HD COMP 10' W/BKT
IN: 3– INS POLY POST W/PIN 12KV CLMP #4–336
IN: 1– MISC AVIAN HOOD FOR HENDRIX INSUL #4–653

EXISTING SINGLE LINE

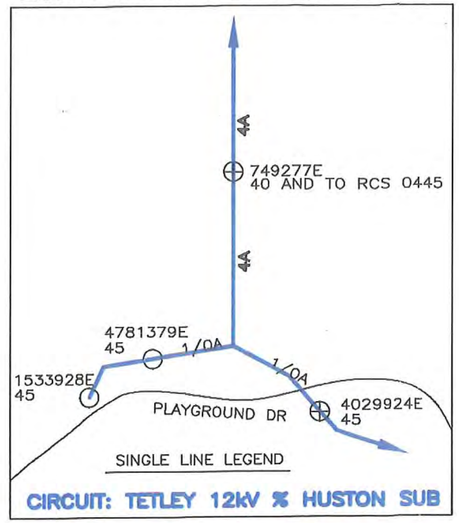

PROPOSED SINGLE LINE

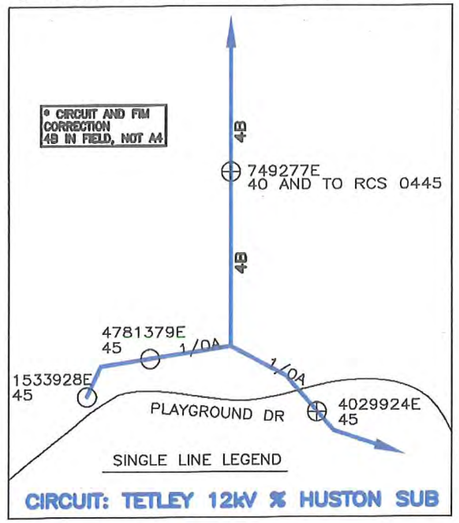

SUP
Environmental Special Use Permit

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE:	
OUTAGE REQUIRED	N
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 02/08/18

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

DISTRICT: 40 – ARROWHEAD	PROJ. MGR. GALLARDO, ANTHONY PHONE		PLANNER DIVERSIFIED UTILITIES PHONE 661–325–3212	DESIGNER DIVERSIFIED UTILITIES	
PROJECT NO. 1676341	SERVICE REQUEST 2583191	MSR NO.	PRODUCT–1 1464880– DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE TETLEY 12kV		THOMAS GUIDE	PRODUCT–2		ASSOC DESGN
SUB / PG NO. % HUSTON E3		CIRCUIT CODE	PRODUCT–3		ASSOC DESGN
INVENTORY MAP 268–2205–1		J.P.A. NO.	PROPOSED CONSTRUCTION (LOCATION) STR# 749274E 745' N/O PLAYGROUNG DR 0.53MI W/O SUMMIT DR ARROWHEAD, CA		
	12/28/2018			DUSI–TC	
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
Southern California Edison Company				SHEET ____ OF ____	DESIGN\DRWG NO. 1085781_0.01

NOTES:
- NO TRUCK ACCESS
- SET 3' SOUTH
- TIER 3
- CIRCUIT AND FIM CORRECTION 4B IN FIELD NOT 4A

TRANSFER:
- 3–4B–12

SECTION: [illegible]OSITE

BULLETIN 322 AREA

749271E
35

141' 3– 4B–12

.21MI

0.53MI

144' 3– 4B–12

749273E
35

PLAYGROUND DR

SUMMIT DR

5 RM 749272E
35' Class C5
RM: 1– POLE 35' CLASS 5 WOOD FULL TREAT
RM: 1– XA SNGL VB 10' STEEL PINS
RM: 3– INS GLASS/POLY 35KV & LESS
RM: 1– MISC AVIAN HOOD FOR HENDRIX INSUL #4–653

34° 14' 23.56" N,
117° 19' 15.73" W
ELEV: 5,143'

POLE 749272E 6
40' Class C1
IN: 1– POLE 40' CLASS 1 RS COMP SEC POLE
IN: 1– XA SNGL TAN HD COMP 10' W/BKT
IN: 3– INS POLY POST W/PIN 12KV CLMP #4–336
IN: 1– MISC AVIAN HOOD FOR HENDRIX INSUL #4–653

12 kV 33'

L/N
749272E
PROPOSED

EXISTING SINGLE LINE

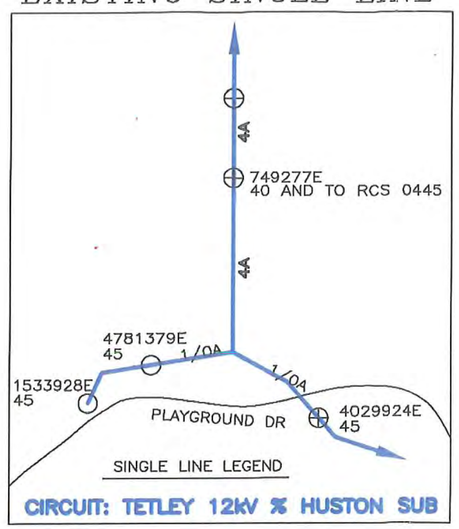

PROPOSED SINGLE LINE

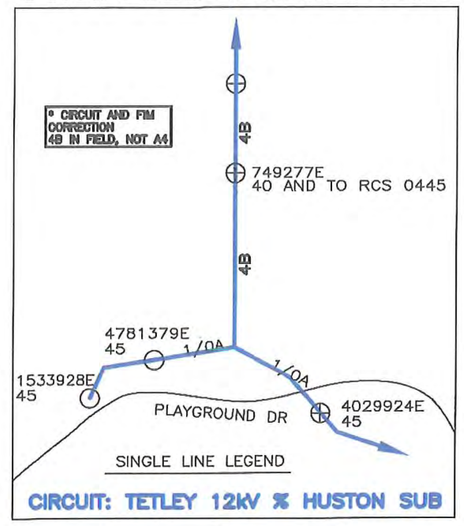

SUP
Environmental Special Use Permit

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE:	
OUTAGE REQUIRED	N
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 02/08/18

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

DISTRICT: 40 – ARROWHEAD	PROJ. MGR. GALLARDO, ANTHONY PHONE		PLANNER DIVERSIFIED UTILITIES PHONE 661–325–3212		DESIGNER DIVERSIFIED UTILITIES
PROJECT NO. 1676341	SERVICE REQUEST 2583191	MSR NO.	PRODUCT–1 1464880– DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE TETLEY 12kV		THOMAS GUIDE	PRODUCT–2		ASSOC DESGN
SUB / PG NO. % HUSTON E3		CIRCUIT CODE	PRODUCT–3		ASSOC DESGN
INVENTORY MAP 268–2205–1		J.P.A. NO.	PROPOSED CONSTRUCTION (LOCATION) STR# 749272E .21MI N/O PLAYGROUND DR 0.53MI W/O SUMIT DR ARROWHEAD, CA		
	1/2/2019			DUSI–TC	
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
Southern California Edison Company					

SHEET _____ OF _____

DESIGN\DRWG NO. 1085781_0.01

*** NOTES: JOINT POLE**
ENVIRO POLE - NATIONAL FOREST/WOODPECKER DAMAGE
BULLETIN 322 AREA
EAGLE ZONE
HAND SET
RIGHTS CHECK REQ'D
REAL PROP. REVIEW
HELICOPTER SET
SET 1' NW

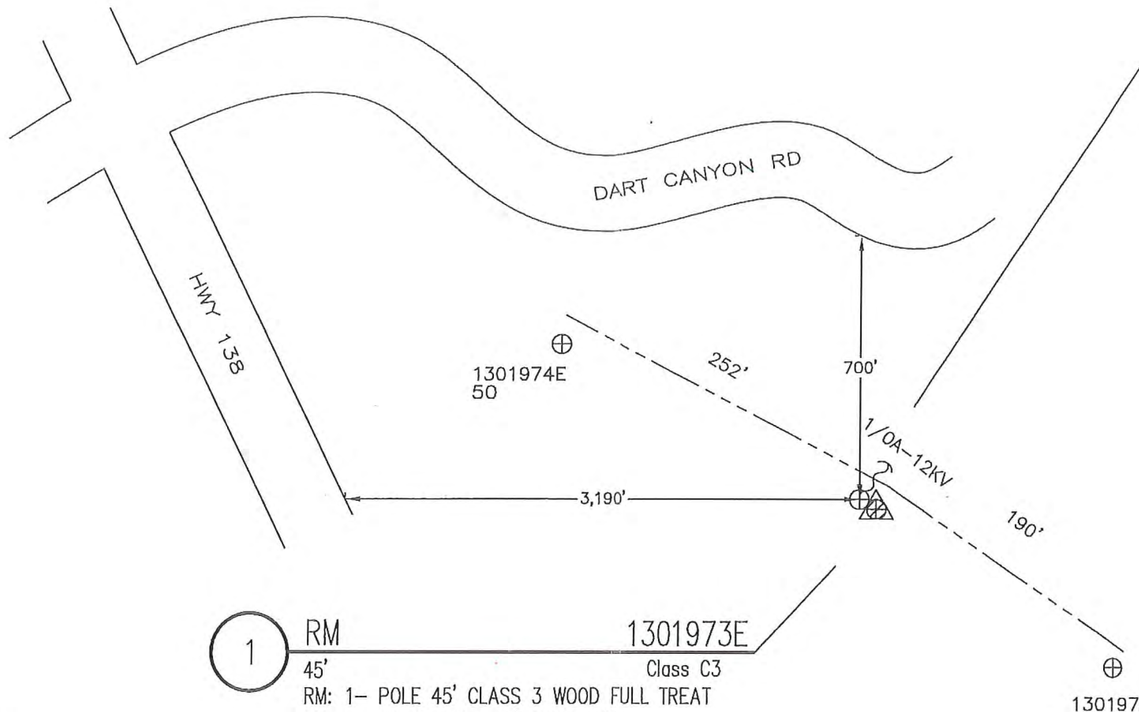

N 34° 15' 59.38"
W 117° 16' 37.81"
ELEVATION: 3,749'

POLE 1301973E (2)
45' Class H2
IN: 1- POLE 45' CLASS H2 WOOD FULL TREAT
IN: 1- XA DBL HD TAN COMP 10'
IN: 6- INS POLY W/PIN 12KV CLMP #4-653 ACSR (W/ANGLE)
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 2- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653
IN: 1- GUYING TEE

(1) RM 1301973E
45' Class C3
RM: 1- POLE 45' CLASS 3 WOOD FULL TREAT
RM: 1- XA DBLE VB 10' STEEL PINS
RM: 6- INS GLASS & PIN 12KV
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

TRANSFER (S):
3/C 1/0A-12KV

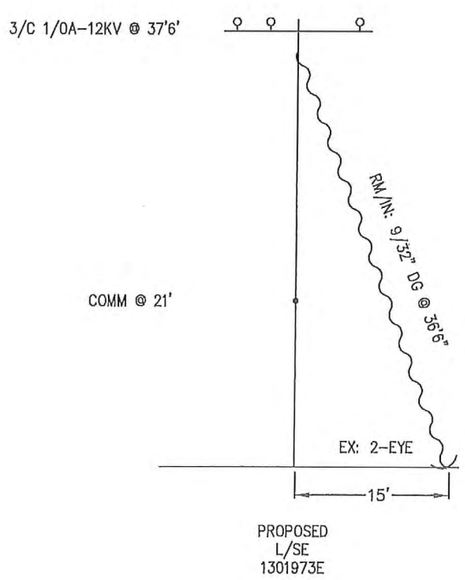

NOT TO SCALE

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE:	
OUTAGE REQUIRED	N
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 02/09/18

DISTRICT: 40 – ARROWHEAD		PROJ. MGR.: ANTILLON, FELIPE PHONE 909-644-6430		PLANNER: ASP PHONE 714-893-2405	DESIGNER: ASP
PROJECT NO.: 1683884	SERVICE REQUEST: 2590504	MSR NO.	PRODUCT-1: 1470505-INFRA REPLAC – DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE: MORITZ 12KV		THOMAS GUIDE	PRODUCT-2		ASSOC DESGN
SUB / PG NO.: HUSTON SUB		CIRCUIT CODE	PRODUCT-3		ASSOC DESGN
INVENTORY MAP: 278-2271-1		J.P.A. NO.: 409666326			
				ASP	
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #

PROPOSED CONSTRUCTION (LOCATION)
POLE # 1301973E
DART CANYON RD 700' S, 3190' W/O HWY 138
LAKE ARROWHEAD, CA

Southern California Edison Company

SHEET _____ OF _____

DESIGN\DRWG NO. 1090265_0.01

REPLACE DETERIORATED POLE

NOTIFICATION #408927832, #400716780, #400931982, #400962592 DUE: 10/20/2020

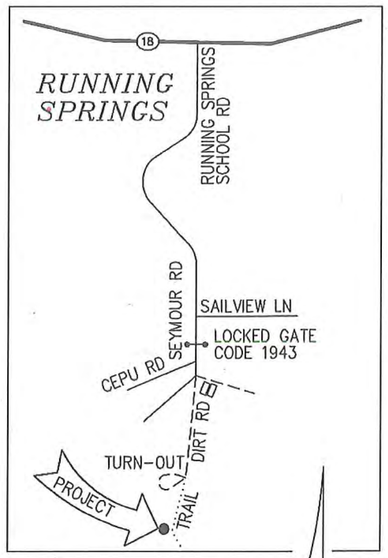

VICINITY MAP
NTS

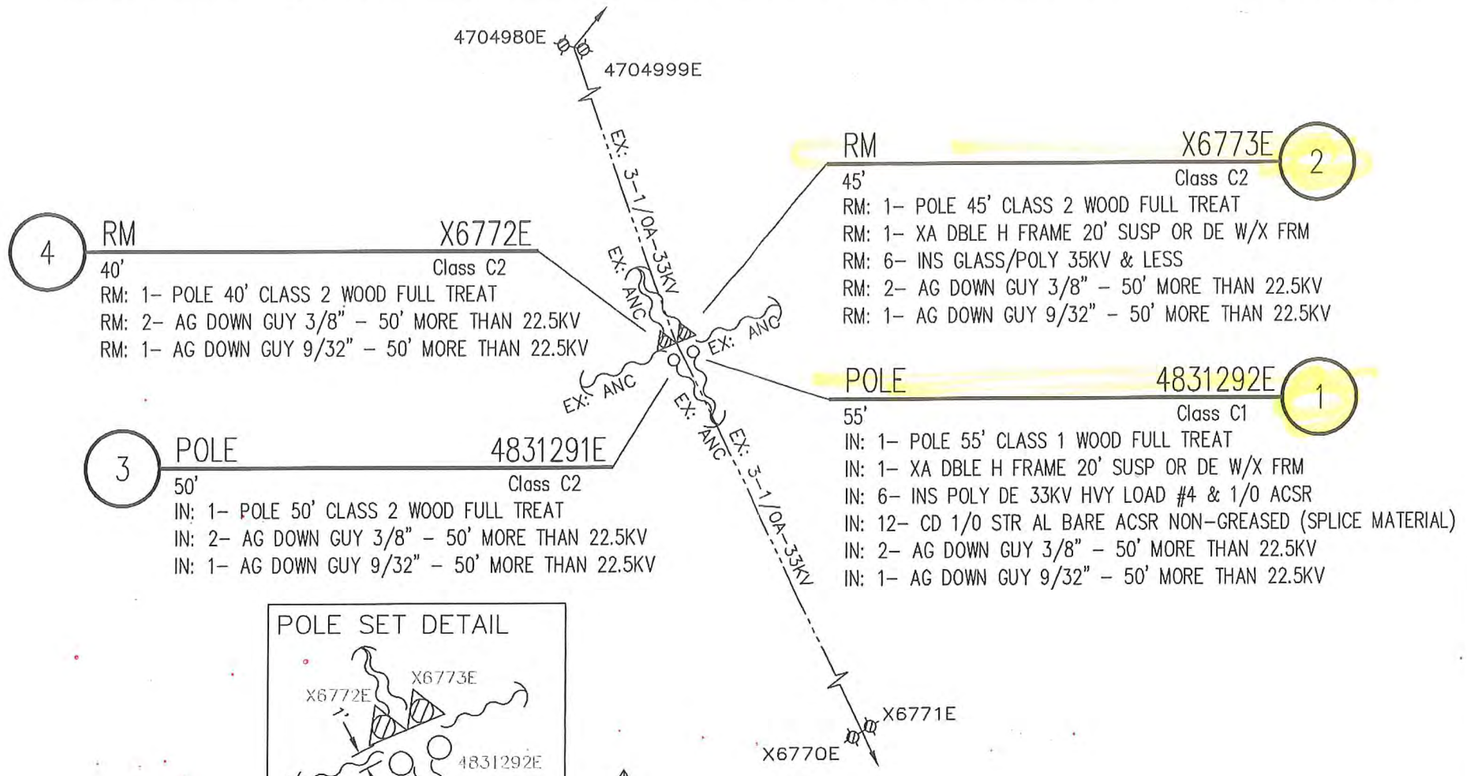

POLE SET DETAIL

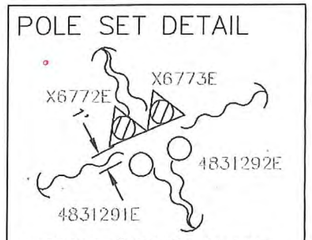

HARDSET 1' SOUTH IN-LINE

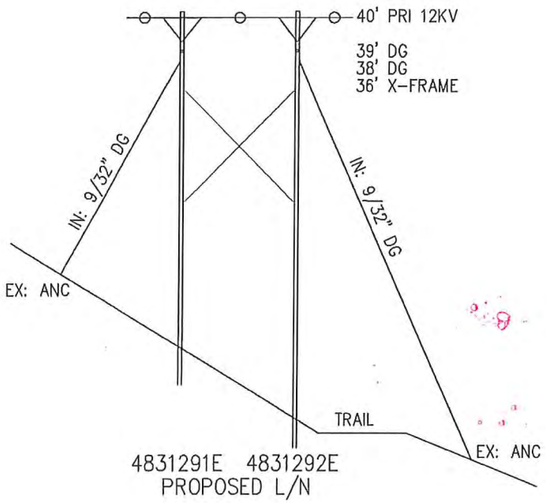

SCALE: 1" = 40'

0 40 80

CREW NOTES:

ACCESS ROAD BEYOND LOCKED GATE. GATE CODE 1943. BE PATIENT, GATE SLOW TO RESPOND.

ACCESS ROAD TO RIGHT OF STORAGE CONTAINERS.

NO BUCKET TRUCK ACCESS.

TRUCK ACCESS PARTWAY DOWN ACCESS ROAD TO TURN-OUT. FOOT ACCESS ALONG OVERGROWN TRAIL.

CIVIL TO DIG NEW POLE HOLES AND INSTALL SONO TUBES.

HELICOPTER SET POLES.

TRANSFER PRIMARY CONDUCTORS

CREW TO SPLICE AS NEEDED

GPS COORDINATES:

34.184569°, -117.095331°

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	Y
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE: BLANKET	
OUTAGE REQUIRED	N
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

SUP
Environmental Special Use Permit

D124: Rev. 02/08/18

SNOW VALLEY 12kV
RUNNING SPRINGS SUB E1

UNDERGROUND SERVICE ALERT
Dial 811
Call USA
For Underground Locating
2 Working Days Before You Dig

DISTRICT: 40 – ARROWHEAD	PROJ. MGR.: GALLARDO, ANTHONY PHONE 909-274-3624		PLANNER: SMITH, TERENCE J. PHONE 909-336-4228		DESIGNER: CUMMING, JAMES
PROJECT NO.: 1592779	SERVICE REQUEST: 2502135	MSR NO.: N/A	PRODUCT-1: 1397384-INFRA REPLAC – DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE: SNOW VALLEY 12KV		THOMAS GUIDE: N/A	PRODUCT-2		ASSOC DESGN
SUB / PG NO.: RUNNING SPRINGS E1		CIRCUIT CODE: 16595	PRODUCT-3		ASSOC DESGN
INVENTORY MAP: 250-2271-1		J.P.A. NO.: E6040-409277229	PROPOSED CONSTRUCTION (LOCATION): REPLACE DETERIORATED H-POLE STR X6772E & X6773E RUNNING SPRINGS, CA 92382		
F	5/17/18	J. IBARRA	T. SMITH	J. CUMMING	17703
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
Southern California Edison Company					SHEET 1 OF 1
					DESIGN\DRWG NO. 1032436_0.01

REPLACE DETERIORATED POLE

NOTIFICATION #408927832, #400716780, #400931982, #400962592 DUE: 10/20/2020

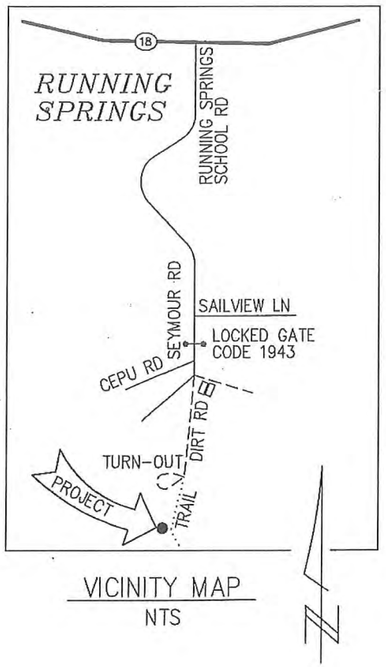

VICINITY MAP
NTS

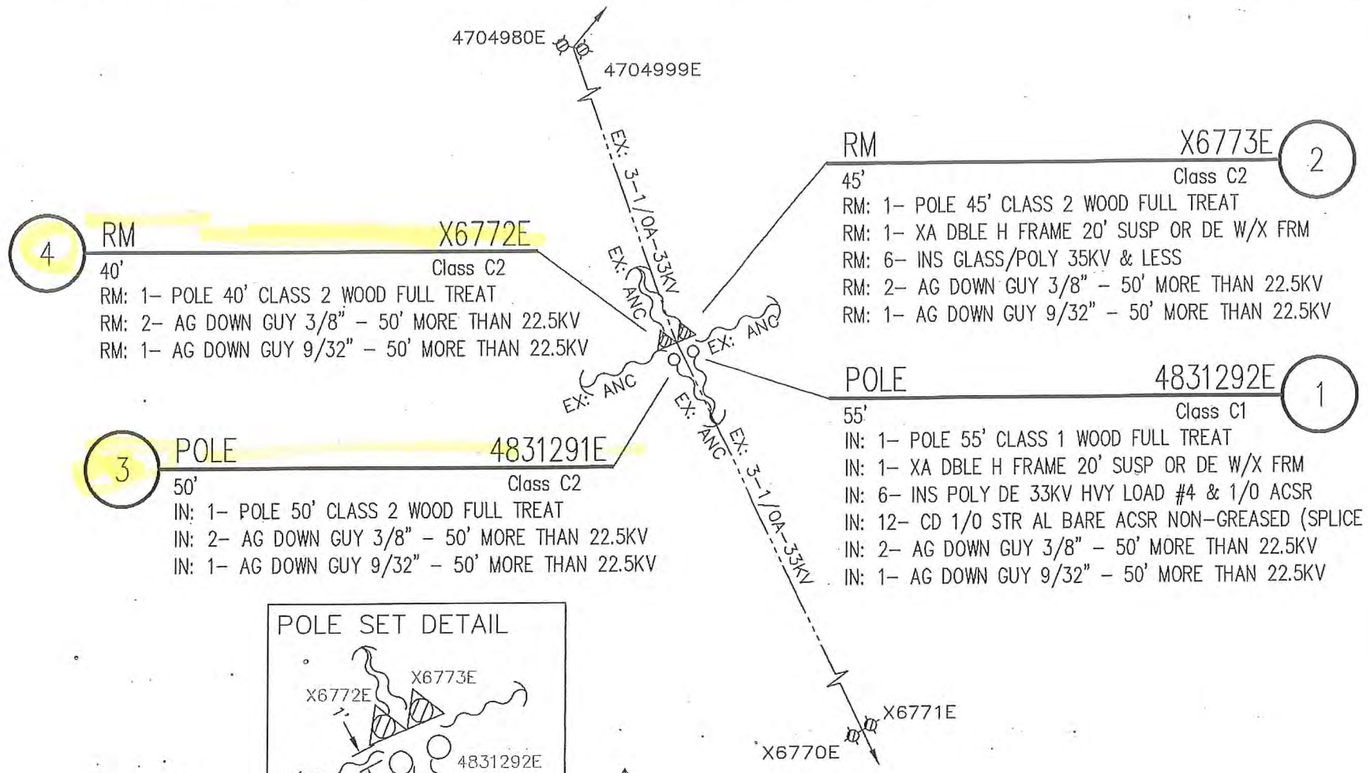

4 RM X6772E Class C2
40'
RM: 1- POLE 40' CLASS 2 WOOD FULL TREAT
RM: 2- AG DOWN GUY 3/8" - 50' MORE THAN 22.5KV
RM: 1- AG DOWN GUY 9/32" - 50' MORE THAN 22.5KV

2 RM X6773E Class C2
45'
RM: 1- POLE 45' CLASS 2 WOOD FULL TREAT
RM: 1- XA DBLE H FRAME 20' SUSP OR DE W/X FRM
RM: 6- INS GLASS/POLY 35KV & LESS
RM: 2- AG DOWN GUY 3/8" - 50' MORE THAN 22.5KV
RM: 1- AG DOWN GUY 9/32" - 50' MORE THAN 22.5KV

3 POLE 4831291E Class C2
50'
IN: 1- POLE 50' CLASS 2 WOOD FULL TREAT
IN: 2- AG DOWN GUY 3/8" - 50' MORE THAN 22.5KV
IN: 1- AG DOWN GUY 9/32" - 50' MORE THAN 22.5KV

1 POLE 4831292E Class C1
55'
IN: 1- POLE 55' CLASS 1 WOOD FULL TREAT
IN: 1- XA DBLE H FRAME 20' SUSP OR DE W/X FRM
IN: 6- INS POLY DE 33KV HVY LOAD #4 & 1/0 ACSR
IN: 12- CD 1/0 STR AL BARE ACSR NON-GREASED (SPLICE MATERIAL)
IN: 2- AG DOWN GUY 3/8" - 50' MORE THAN 22.5KV
IN: 1- AG DOWN GUY 9/32" - 50' MORE THAN 22.5KV

POLE SET DETAIL

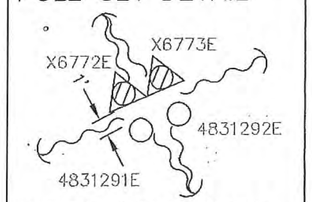

HARDSET 1' SOUTH IN-LINE

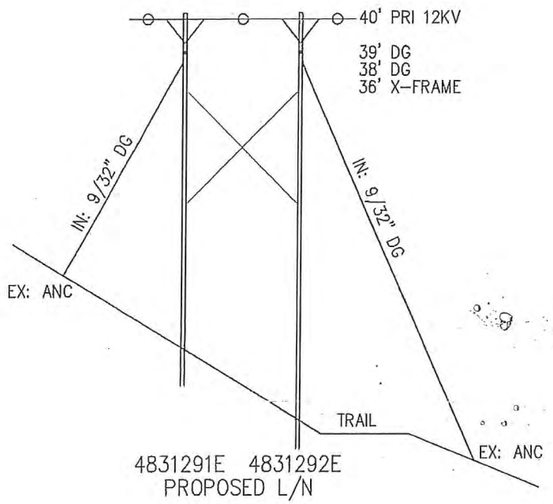

4831291E 4831292E
PROPOSED L/N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 40'

0 40 80



CREW NOTES:

ACCESS ROAD BEYOND LOCKED GATE. GATE CODE 1943. BE PATIENT, GATE SLOW TO RESPOND.

ACCESS ROAD TO RIGHT OF STORAGE CONTAINERS.

NO BUCKET TRUCK ACCESS.

TRUCK ACCESS PARTWAY DOWN ACCESS ROAD TO TURN-OUT. FOOT ACCESS ALONG OVERGROWN TRAIL.

CIVIL TO DIG NEW POLE HOLES AND INSTALL SONO TUBES.

HELICOPTER SET POLES.

TRANSFER PRIMARY CONDUCTORS

CREW TO SPLICE AS NEEDED

GPS COORDINATES:

34.184569°, -117.095331°

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	Y
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE: BLANKET	
OUTAGE REQUIRED	N
OUTAGE DATE: ____ TIME: ____	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

SUP
Environmental Special Use Permit

D124: Rev. 02/08/18

SNOW VALLEY 12kV
RUNNING SPRINGS SUB E1

UNDERGROUND SERVICE ALERT
Dial 811
Call USA
For Underground Locating
2 Working Days Before You Dig

DISTRICT: 40 – ARROWHEAD		PROJ. MGR.: GALLARDO, ANTHONY PHONE 909-274-3624		PLANNER: SMITH, TERENCE J. PHONE 909-336-4228	DESIGNER: CUMMING, JAMES
PROJECT NO.: 1592779	SERVICE REQUEST: 2502135	MSR NO.: N/A	PRODUCT-1: 1397384-INFRA REPLAC – DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE: SNOW VALLEY 12KV		THOMAS GUIDE: N/A	PRODUCT-2		ASSOC DESGN
SUB / PG NO.: RUNNING SPRINGS E1		CIRCUIT CODE: 16595	PRODUCT-3		ASSOC DESGN
INVENTORY MAP: 250-2271-1		J.P.A. NO.: E6040-409277229	PROPOSED CONSTRUCTION (LOCATION): REPLACE DETERIORATED H-POLE STR X6772E & X6773E RUNNING SPRINGS, CA 92382		
F	5/17/18	J. IBARRA	T. SMITH	J. CUMMING	17703
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

SHEET 1 OF 1

DESIGN\DRWG NO. 1032436_0.01

NOTES:
- NO TRUCK ACCESS
- HARD SET NORTH
- E TO C-5/PTD
- FTR TO SOP
- RIGHTS CHECK FED LAND
- OCP TD1500674 CREATED TO REMOVE SPLICE AND RE-CONDUCTOR LINE TO 1/0ATW

TRANSFER:
- 3-4B-2.4kV

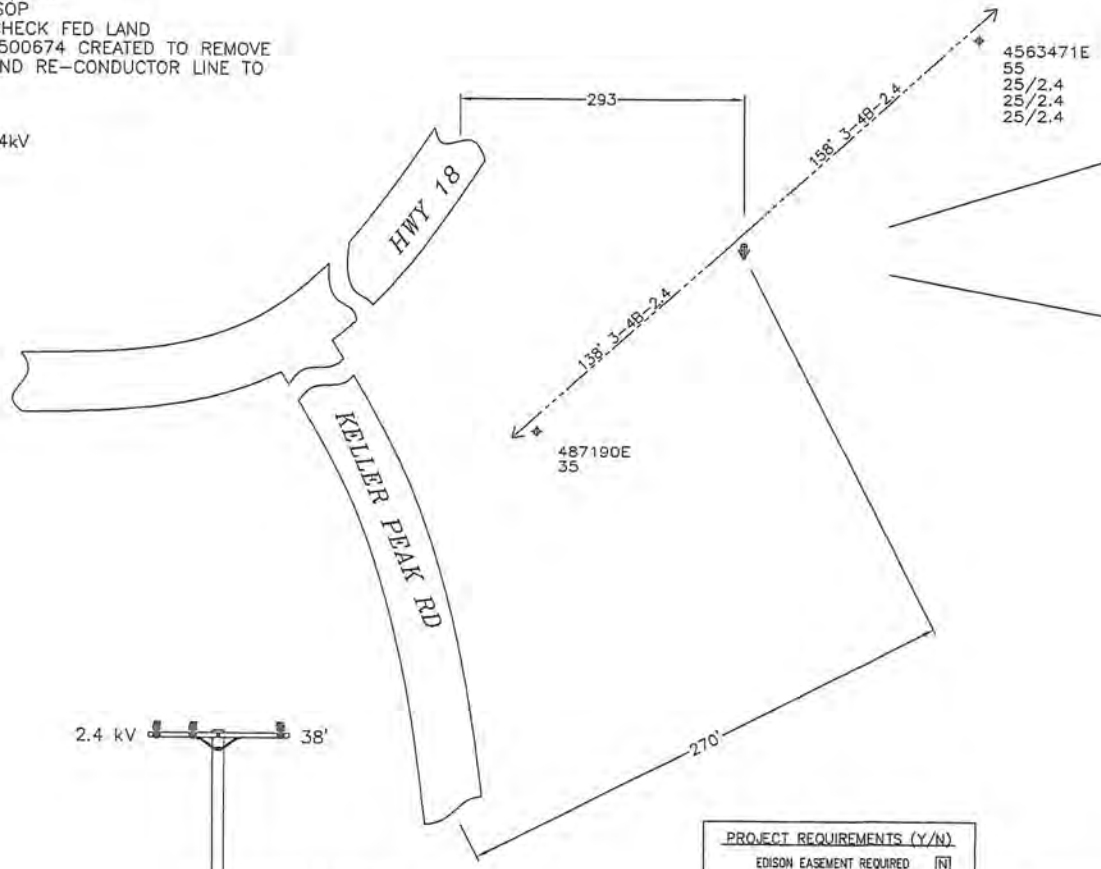

RM 487189E (1)
35' Class C5
RM: 1- POLE 35' CLASS 5 WOOD FULL TREAT
RM: 1- XA DBLE FB 8' STEEL PINS N/BOND
RM: 6- INS GLASS/POLY 35KV & LESS

34° 12' 12.9" N,
117° 5' 13.2" W
ELEV: 6,020'

POLE 487189E (2)
45' Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 2- XA SNGL TAN HD COMP 10' W/BKT
IN: 6- INS POLY DE 4KV RIG #4
IN: 3- INS POLY W/PIN 12KV CLMP #6-4/0 CU
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653

SUP
Environmental Services Project Portal

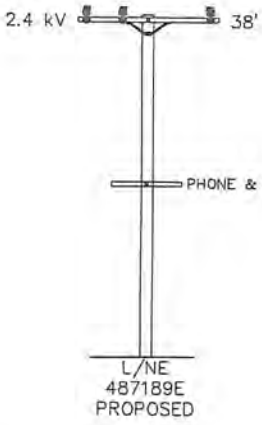

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD BB REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE: USFS	
OUTAGE REQUIRED	Y
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

M124 Rev: 02/09/18

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

DISTRICT: 40 – ARROWHEAD	PROJ. MGR. PHONE: GALLARDO, ANTHONY	PLANNER PHONE: DIVERSIFIED UTILITIES 661-325-3212	DESIGNER: DIVERSIFIED UTILITIES		
PROJECT NO.: 1578820	SERVICE REQUEST: 2488638	MSR NO.	PRODUCT-1: 1385960-INFRASTRUCTURE REPLACEMENT PLP		ASSOC DESGN
CIRCUIT / VOLTAGE: GREENBEAR 2.4kV		THOMAS GUIDE	PRODUCT-2: RELATED OCP TD1500674		ASSOC DESGN
SUB / PG NO.: % GREENBEAR P.T. A1		CIRCUIT CODE	PRODUCT-3		ASSOC DESGN
INVENTORY MAP: 256-2274-1	J.P.A. NO.: 409298532				
5/22/2018			DUSI-AA-LF		
TYPE / DATE / APPROVED BY / CHECKED BY / DRAWN BY / PAX #					

PROPOSED CONSTRUCTION (LOCATION)
STR# 487189E
293' S/E OF HWY 18 270' E/O KELLER PEAK RD
RUNNING SPRINGS, CA

Southern California Edison Company

SHEET _____ OF _____

DESIGN\DRWG NO. 1023387_0.01

NOTES:
- SET LOCATION: HARD NORTH EAST.
- SCE TO PTD.
- GOVERNMENT LAND (SRA).
- EAGLE ZONE.
- HAND SET/DIG.
- BULLETIN 322 AREA.

TRANSFER:
3-1/0ACSR 12KV
1-1/2"+1/4" CATV
1-3/4"+5/16" TELCO
2-1.5"+5/16" TELCO

SECTIONAL COMPOSITE

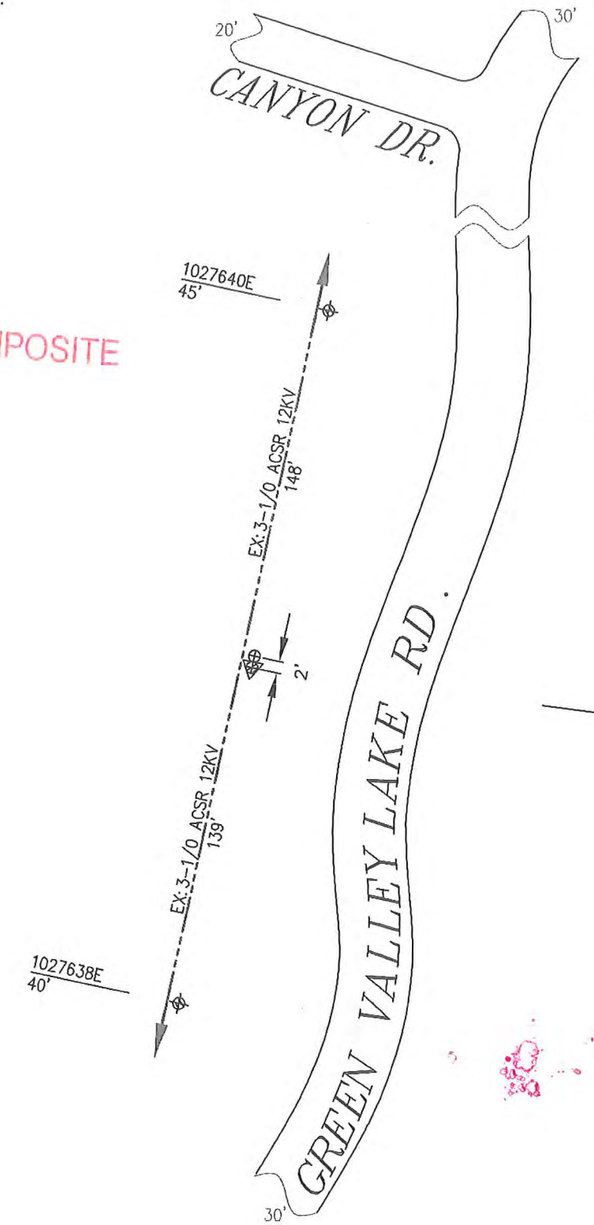

GPS COORDINATES
N: 35° 14' 11.25"
W: 117° 5' 3.43"
ELEVATION: 6765'

POLE 1027639E (4)
45' Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY POST C/TOP 4/12KV
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653
IN: 1- SPLIT BOLT

RM 1027639E (3)
45' Class C4
RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA DBLE VB 10' STEEL PINS
RM: 6- INS GLASS & PIN 12KV

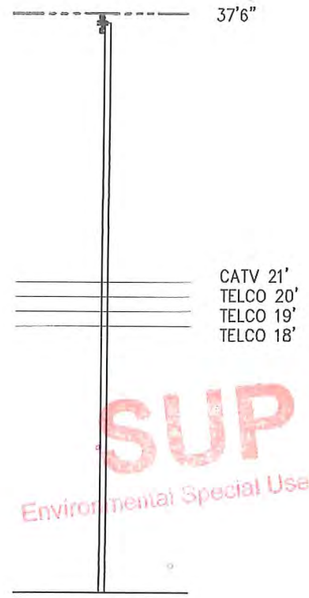

SUP
Environmental Special Use Permit

PROPOSED
1027639E
L/NW

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	Y
PERMIT TYPE: GOV. LAND	
OUTAGE REQUIRED	N
OUTAGE DATE: _____ TIME: ____	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

0124: Rev. 04/19/16

DISTRICT: 40 – ARROWHEAD		PROJ. MGR. GALLARDO, ANTHONY PHONE 909-274-3624		PLANNER TIDWELL DESIGN PHONE 805-647-4707	DESIGNER TIDWELL DESIGN
PROJECT NO. 1528728	SERVICE REQUEST 2439942	MSR NO.	PRODUCT-1 1345517-INFRA REPLAC – DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE TAGGERT 12KV		THOMAS GUIDE N/A	PRODUCT-2		ASSOC DESGN
SUB / PG NO. RUNNING SPRINGS		CIRCUIT CODE	PRODUCT-3		ASSOC DESGN
INVENTORY MAP 268-2277-1		J.P.A. NO. E6040-409090383	PROPOSED CONSTRUCTION (LOCATION) 1027639E GREEN VLY LAKE RD P/P 146' E 557' S/O CANYON DR GREEN VALLEY		

TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
				TIDWELL	

Southern California Edison Company

SHEET _____ OF _____

DESIGN\DRWG NO. 990395_0.01

NOTES:
- SET LOCATION: NORTH EAST.
- SCE TO PTD.
- GOVERNMENT LAND (SRA).
- EAGLE ZONE.
- HAND DIG.
- CRANE SET REQ'D.
- TRAFFIC CONTROL REQ'D.
- BULLETIN 322 AREA.

TRANSFER:
3-1/0ACSR 12KV
1-1/2"+1/4" CATV
1-3/4"+1/4" CATV
1-1"+5/16" TELCO
1-1.5"+5/16" TELCO

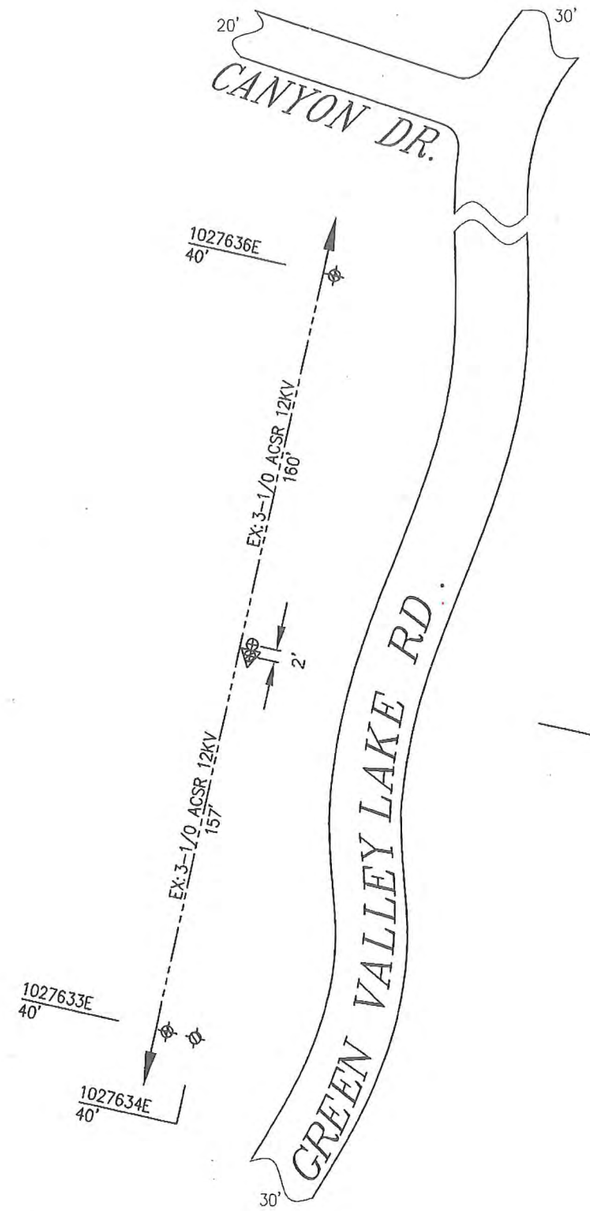

GPS COORDINATES
N: 35° 14' 5.5"
W: 117° 5' 7.3"
ELEVATION: 6752'

POLE 1027635E 6
45' Class H1
IN: 1- POLE 45' CLASS H1 WOOD FULL TREAT
IN: 1- XA DBLE VB 10' STEEL PINS
IN: 3- INS POLY POST C/TOP 4/12KV
IN: 1- SPLIT BOLT
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653

RM 1027635E 5
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA DBLE VB 10' STEEL PINS
RM: 6- INS GLASS & PIN 12KV

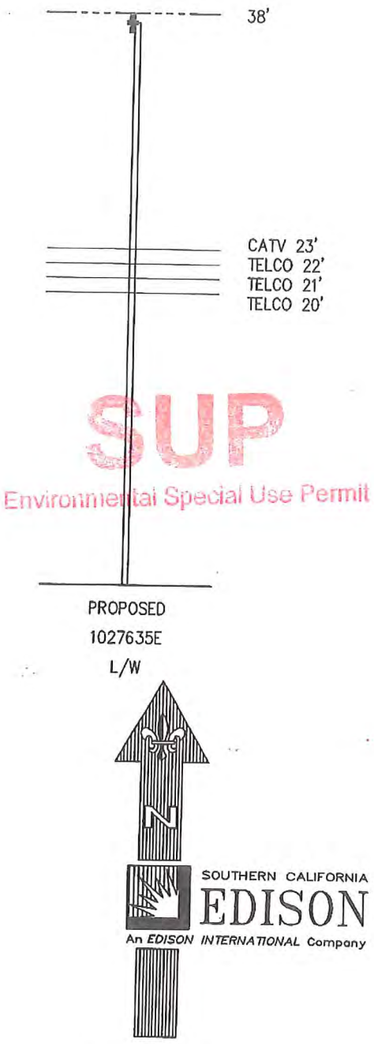

NOT TO SCALE

SUP
Environmental Special Use Permit

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	Y
PERMIT TYPE: GOV. LAND	
OUTAGE REQUIRED	N
OUTAGE DATE: _____ TIME: ____	
TRAFFIC CONTROL REQUIRED	Y
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 04/19/16

DISTRICT: 40 – ARROWHEAD	PROJ. MGR.: GALLARDO, ANTHONY PHONE 909-274-3624	PLANNER: TIDWELL DESIGN PHONE 805-647-4707	DESIGNER: TIDWELL DESIGN		
PROJECT NO.: 1528728	SERVICE REQUEST: 2439942	MSR NO.:	PRODUCT-1: 1345517-INFRA REPLAC – DET POLE REPLACEMENT	ASSOC DESGN	
CIRCUIT / VOLTAGE: TAGGERT 12KV		THOMAS GUIDE: N/A	PRODUCT-2:	ASSOC DESGN	
SUB / PG NO.: RUNNING SPRINGS		CIRCUIT CODE:	PRODUCT-3:	ASSOC DESGN	
INVENTORY MAP: 268-2274-1		J.P.A. NO.: E6040-409090383	PROPOSED CONSTRUCTION (LOCATION): 1027635E GREEN VLY LAKE RD P/P 188' W 1457' S/O CANYON DR GREEN VALLEY		
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY: TIDWELL	PAX #
Southern California Edison Company				SHEET: ____ OF ____	DESIGN\DRWG NO.: 990395_0.01

NOTES:
- SET LOCATION: HARD NORTH EAST.
- SCE TO PTD.
- GOVERNMENT LAND (SRA).
- EAGLE ZONE.
- HAND SET/DIG.
- BULLETIN 322 AREA.

TRANSFER:
3-1/0ACSR 12KV
1-1/2"+1/4" CATV
1-3/4"+5/16" CATV
1-1"+5/16" TELCO
1-1.5"+5/16" TELCO

SECTIONAL COMPOSITE

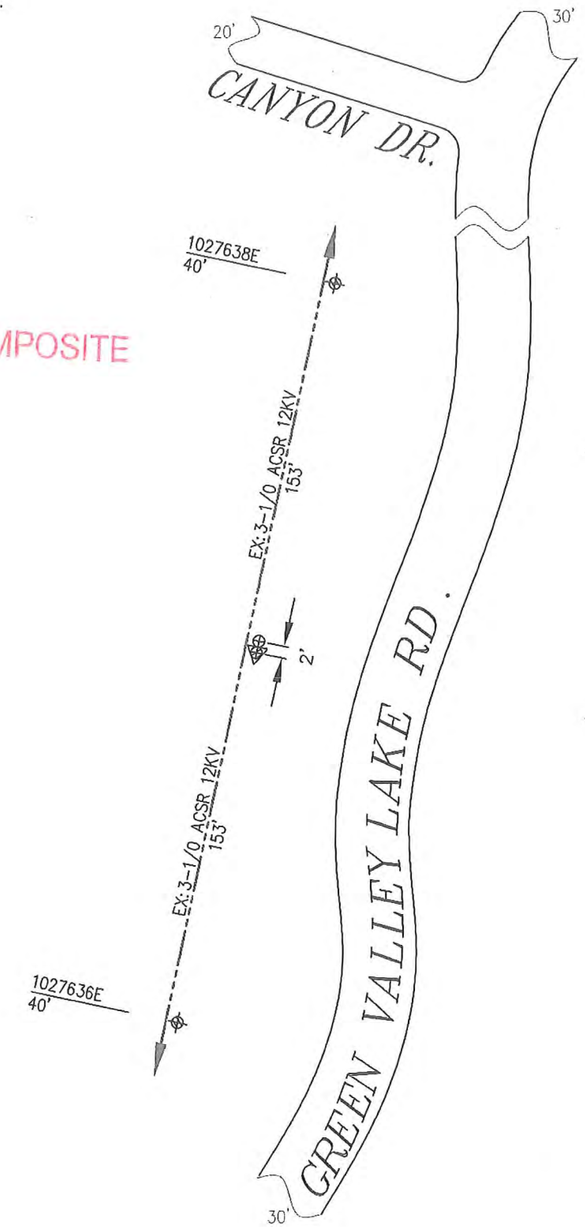

GPS COORDINATES
N: 35° 14' 8.10"
W: 117° 5' 5.30"
ELEVATION: 6743'

POLE 1027637E (8)
45' Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 3- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY POST C/TOP 4/12KV
IN: 1- SPLIT BOLT
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653

RM 1027637E (7)
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA DBLE VB 10' STEEL PINS
RM: 1- INS GLASS & PIN 12KV

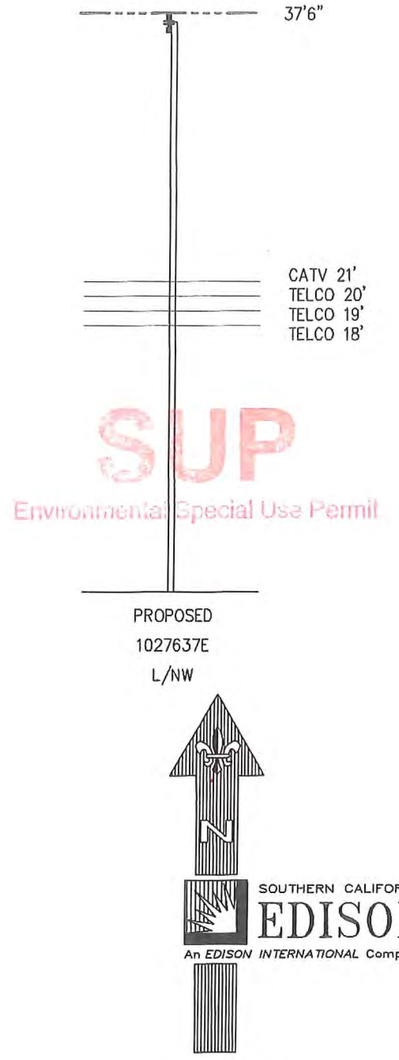

SUP
Environmental Special Use Permit

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	Y
PERMIT TYPE: GOV. LAND	
OUTAGE REQUIRED	N
OUTAGE DATE: _____ TIME: ____	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

D124: Rev. 04/19/16

DISTRICT	PROJ. MGR.	PLANNER	DESIGNER
40 – ARROWHEAD	GALLARDO, ANTHONY PHONE 909-274-3624	TIDWELL DESIGN PHONE 805-647-4707	TIDWELL DESIGN

PROJECT NO.	SERVICE REQUEST	MSR NO.	PRODUCT-1	ASSOC DESGN
1528728	2439942		1345517-INFRA REPLAC – DET POLE REPLACEMENT	
CIRCUIT / VOLTAGE		THOMAS GUIDE	PRODUCT-2	ASSOC DESGN
TAGGERT 12KV		N/A		
SUB / PG NO.		CIRCUIT CODE	PRODUCT-3	ASSOC DESGN
RUNNING SPRINGS				
INVENTORY MAP 268-2274-1		J.P.A. NO. E6040-409090383		

TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
				TIDWELL	

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
1027637E
GREEN VALLEY LAKE RD P/P 230' E 917' S/O
CANYON DR
GREEN VALLEY

SHEET _____ OF _____

DESIGN\DRWG NO.
990395_0.01

NOTES:
- NO TRUCK ACCESS
- SET HARD WEST
- E-PTD
- TIER 3

TRANSFER:
- 4AT-120V
- 3-4AT-SRV

BULLETIN 322 AREA

1 RM 1884949E
35' Class C5
RM: 1- POLE 35' CLASS 5 WOOD FULL TREAT
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- AG ANCHOR ROD 5/8" X 8' 2-EYE W/PLATE

SECTIONAL COMPOSITE

34° 14' 25.72" N,
117° 17' 40.73" W
ELEV: 4,869'

2 POLE 1884949E
35' Class C2
IN: 1- POLE 35' CLASS 2 RS COMP SEC POLE
IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- AG ANCHOR ROD 1 " X 10' 3-EYE W/PLATE
IN: 1- OH GUYING TEE W/HARDWARE CMP & WOOD

NOT TO SCALE

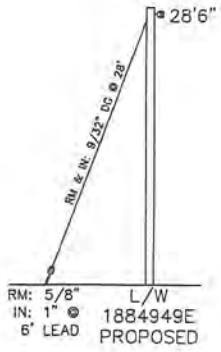

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE:	
OUTAGE REQUIRED	N
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

0124, Rev. 02/08/16

DISTRICT: 40 – ARROWHEAD	PROJ. MGR. PHONE: GALLARDO, ANTHONY	PLANNER PHONE: DIVERSIFIED UTILITIES 661-325-3212	DESIGNER: DIVERSIFIED UTILITIES		
PROJECT NO.: 1676979	SERVICE REQUEST: 2583813	MSR NO.	PRODUCT-1: 1465284 – DET POLE REPLACEMENT		ASSOC DESGN
CIRCUIT / VOLTAGE: MORITZ 12kV		THOMAS GUIDE	PRODUCT-2		ASSOC DESGN
SUB / PG NO.: % HUSTON D1		CIRCUIT CODE	PRODUCT-3		ASSOC DESGN
INVENTORY MAP: 270-2211-1		J.P.A. NO.: E6040-409717593	PROPOSED CONSTRUCTION (LOCATION): STR# 1884949E 260' E/O SEELEY WAY 90' S/O WOODLAND RD CRESTLINE, CA		
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
	12/24/2018			DUSI - DC	
Southern California Edison Company				SHEET: ____ OF ____	DESIGN\DRWG NO.: 1086138_0.01

* NOTES: JOINT POLE
ENVIRO POLE - WOODPECKER DAMAGE
REAR PROPERTY LINE POLE
TREE TRIMMING REQ'D
BULLETIN 322 AREA
EAGLE ZONE
HAND SET
SET 1' NORTH WEST

N 34° 14' 16.6"
W 117° 16' 53.00"
ELEVATION: 4,886'

POLE 1056813E (4)
35' Class C4
IN: 1- POLE 35' CLASS 4 WOOD FULL TREAT
IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG BLOCK & POLE KEY

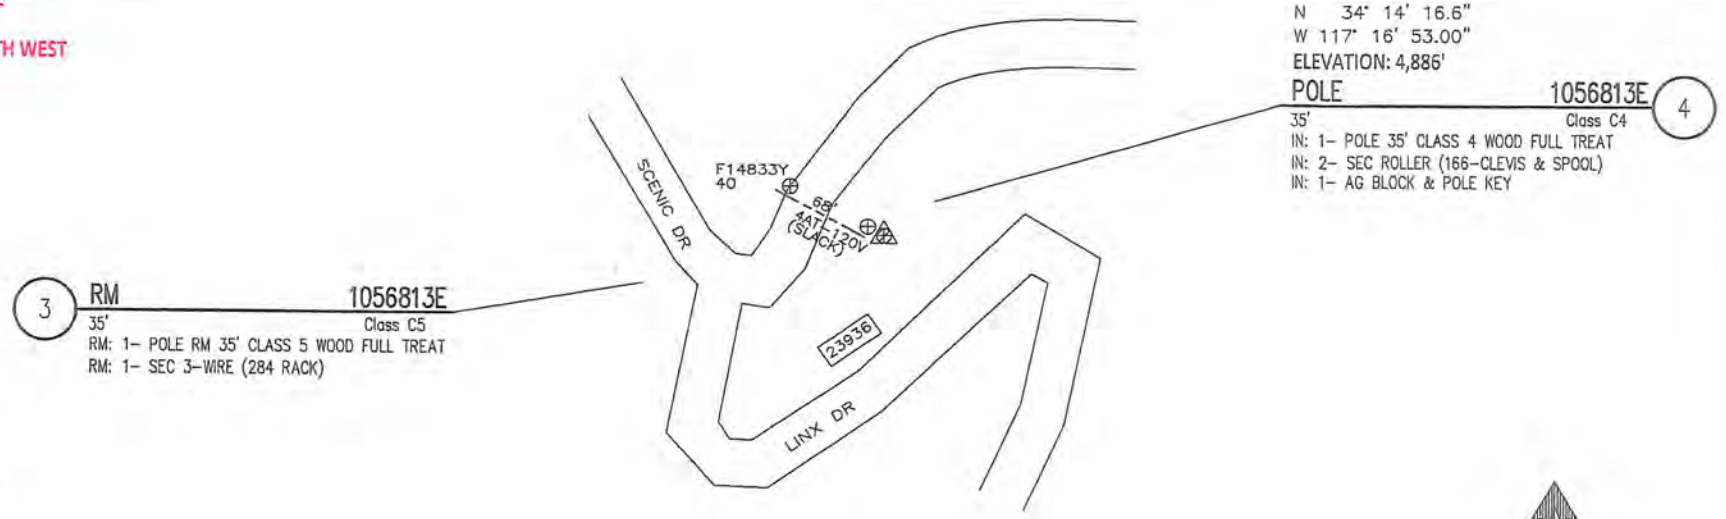

3 RM 1056813E
35' Class C5
RM: 1- POLE RM 35' CLASS 5 WOOD FULL TREAT
RM: 1- SEC 3-WIRE (284 RACK)

TRANSFER (S):
1-4AT-120V (SLACK)
1-4AT-120V (SVC)

UN-GUYED DE CALC (6813E)	
1-4AT @ 75%	= 446
28.6 X 446	= 12,783
35' CLASS 4 DF POLE CAN HOLD	= 14,855 FT-LBS
BREAST BLOCK & POLE KEY IN CLASS 4 SOIL	= 47,500 FT-LBS

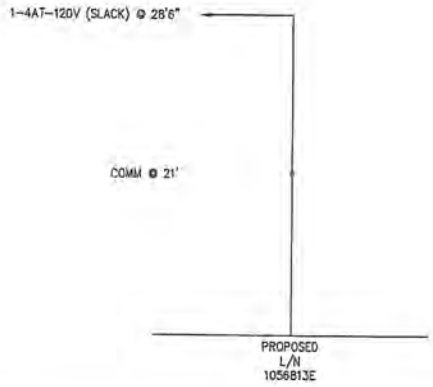

SPEED LIMIT 25

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
UG CIVIL ONLY WORK ORDER	N
PERMIT REQUIRED	Y
PERMIT TYPE:	
OUTAGE REQUIRED	N
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N
ENVIRONMENTAL CLEARANCE REQ'D	Y
CSD 140 (TLM) REQ'D	N

DISTRICT: 40 – ARROWHEAD	PROJ. MGR.: ANTILLON, FELIPE PHONE 909-644-6430	PLANNER: ASP PHONE 714-893-2405	DESIGNER: ASP		
PROJECT NO.: 1665722	SERVICE REQUEST: 2572847	MSR NO.:	PRODUCT-1: 1456409-INFRA REPLAC – DET POLE REPLACEMENT	ASSOC DESGN	
CIRCUIT / VOLTAGE: MORITZ 12KV		THOMAS GUIDE:	PRODUCT-2:	ASSOC DESGN	
SUB / PG NO.: HUSTON SUB		CIRCUIT CODE:	PRODUCT-3:	ASSOC DESGN	
INVENTORY MAP: 268-2217-1		J.P.A. NO.: 409693932			

TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #
				ASP.	

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
POLE# 1056813E
23936 LINX DR
CRESTLINE, CA

SHEET ____ OF ____

DESIGN\DRWG NO.: 1079530_0.01