

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____


Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

TD1556867 HURST 16KV SAN MARCOS SUB

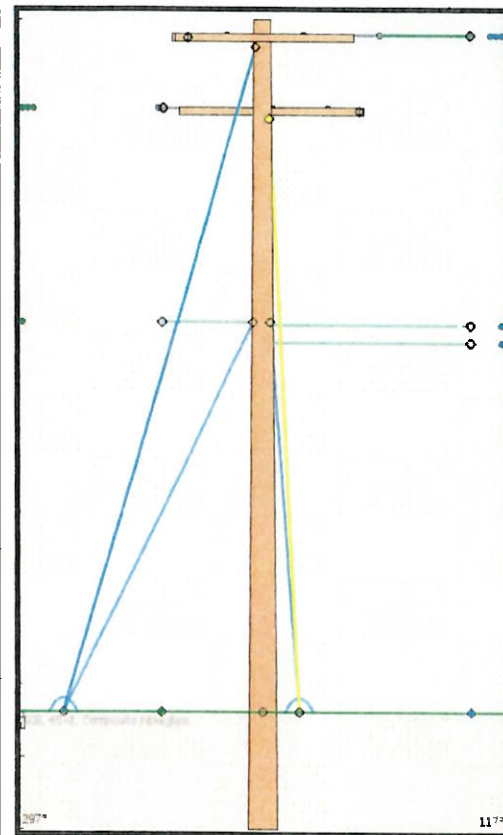

1 RM: 2143952E
45 FT CL 5
RM: 1- 45 FT FT CL 5 POLE
1- 20 FT DBL XARM
1- 10 FT XARM
3-16KV DE
3-16KV PINS
1- 9/32 DG
2-3/4" DBL EYE

IN: 2143952E

45 FT CL 1 (2019)


IN: 1- 45 FT CL 1 POLE - COMPOSITE
1- 20 FT XARM
1- 10 FT XARM
3-16KV DE
3-16KV PINS
1- 3/8 DG
2-1" TRI EYE

IN: 2143951E
45 FT. CL 1 (2019)
IN: 1- 45 FT CL 1 POLE - COMPOSITE
1-10 FT XARM
3-16KV DE
2- 3/8 DG
2-16KV PINS

3 RM: 2143951E
45 FT CL 5
RM: 1- 45 FT FT CL 5 POLE
1-10 FT XARM
3-16KV DE
1- 9/32 DG
2-16KV PINS

409595266
400442063

409 595 245

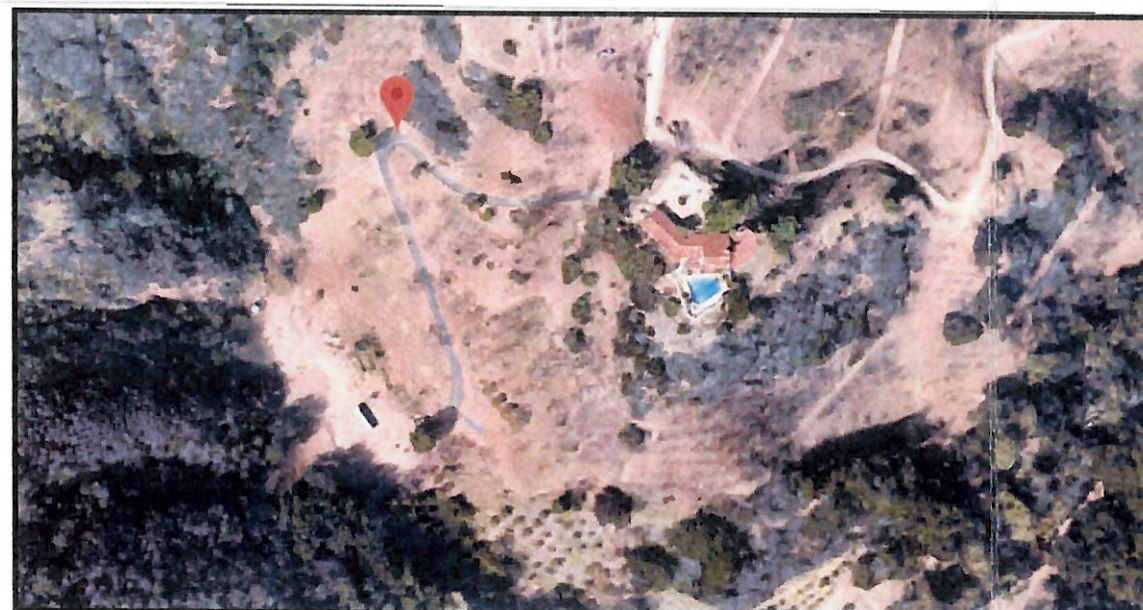

NOTES:
TRUCK ACCESS - YES
SET POLE 1 FT EAST
ACCESS POLE BY GOING SOUTH FROM-
1900 N SAN MARCOS RD
USE EX LOCATION FOR NEW ANCHOR

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED ☐

PWRD 88 REQUIRED ☐

UG CIVIL ONLY WORK ORDER ☐

PERMIT REQUIRED ☐

PERMIT TYPE: N/A

OUTAGE REQUIRED ☒

WORK DATE: _____ TIME: _____

TRAFFIC CONTROL REQUIRED ☐

PED. TRAFFIC CONTROL REQ'D ☐

CONVEYANCE LETTER REQ'D ☐

ENVIRONMENTAL CLEARANCE REQ'D ☒

CSD 140 (TLM) REQ'D ☐

U124 Rev 5/98/18

T.L.M. DATA:

	SIZE	KVA	CUST	% LOAD
EXIST.	—	—	—	—%
PROP.	—	—	—	—%

VOLTAGE DROP: N/A

FLICKER FACTOR: N/A

PRI. CIRCUIT: HURST 16KV



NOT TO SCALE

DISTRICT 49-SANTA BARBARA		PROJ. MGR. PHONE		PLANNER PHONE HONEY JORDAN		DESIGNER	
PROJECT NO.		SERVICE REQUEST		MSR NO.		PRODUCT-1 TD1556867	
CIRCUIT / VOLTAGE HURST 16KV		THOMAS GUIDE		PRODUCT-2		ASSOC DESGN	
SUB / PG NO. SAN MARCOS SUB		CIRCUIT CODE		PRODUCT-3		ASSOC DESGN	
INVENTORY MAP 21-52D		J.P.A. NO.		PROPOSED CONSTRUCTION (LOCATION) 1900 N SAN MARCOS RD SANTA BARBARA			
		M.DIAZ	H.JORDAN	H.JORDAN			
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET 1 OF 1	DESIGN\DRWG NO.
Southern California Edison Company							

2145950E
2145952E

