

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____



☐ Week 3 _____

* NOTES:
HIGH FIRE - TIER 3
EAGLE ZONE
BULLETIN 322 AREA
JOINT POLE
TRUCK ACCESS
2+ MILES FROM SUBSTATION
TR: 2/C 4A-12KV
TR: 1-4AT-120V (SLACK W)
TR: 1-4AT-120V (SVC)
TR: 1-9'6" QP

- 7
- RM
- 1897400E
- 45'
- Class C4
- RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
- RM: 2- SA POLY NO PRI-N 12KV 1-EA
- RM: 1- TR OH 10KVA 12KV 120/240 1P
- SN:
- RM: 2- FE CO FAULT TAME 20A 12KV 1-EA
- RM: 1- XA DBLE FB 10' STEEL PINS
- RM: 2- INS GLASS & PIN 12KV
- RM: 2- INS PORC DE 12KV HOT SHOE #4 & 1/0
- RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
- RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
- RM: 1- GR OH #6 SOL WP PRIMARY W/ROD
- RM: 1- SEC 1" PVC FOR UNDER ARM W/#8 TW WIRE
- RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
- RM: 1- SEC 3-WIRE (284 RACK)

SET SAME HOLE

- 8
- POLE
- 1897400E
- 45'
- Class C2
- IN: 1- POLE 45' CLASS 2 WOOD FULL TREAT
- IN: 1- SA HFA POLY W/GND & T-GAP NO PRI-N 12KV
- IN: 1- TR OH 25KVA 12KV 120/240 1P
- SN:
- IN: 2- FE CO OPEN 100A 12KV 1-EA
- IN: 2- FE FUSE ELF 15KV 6A
- IN: 1- XA SNGL DE HD COMP 10' W/BKT
- IN: 2- INS POLY W/PIN 12KV CLMP #4-653 ACSR
- IN: 2- INS POLY DE 12KV HOT SHOE #4 & 1/0
- IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)
- IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
- IN: 2- COVER, WILDLIFE, DEAD END CLAMP KIND HDPE MATERIAL, GREY COLOR
- IN: 1- GR OH #6 SOL WP SECONDARY W/ROD

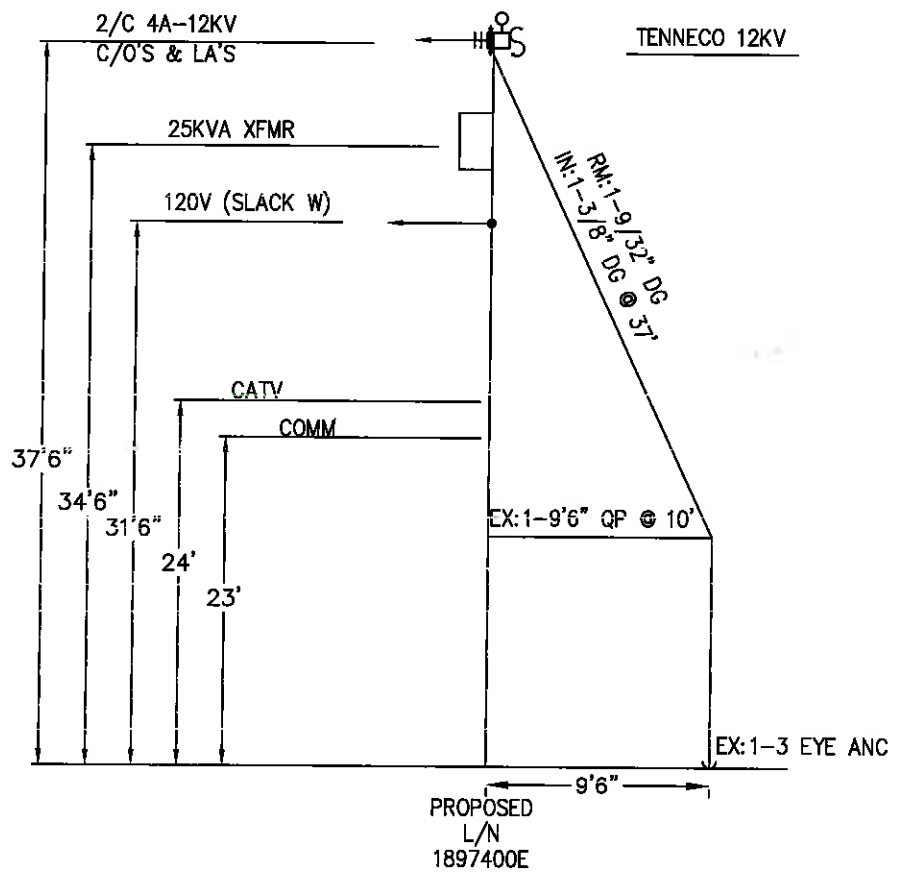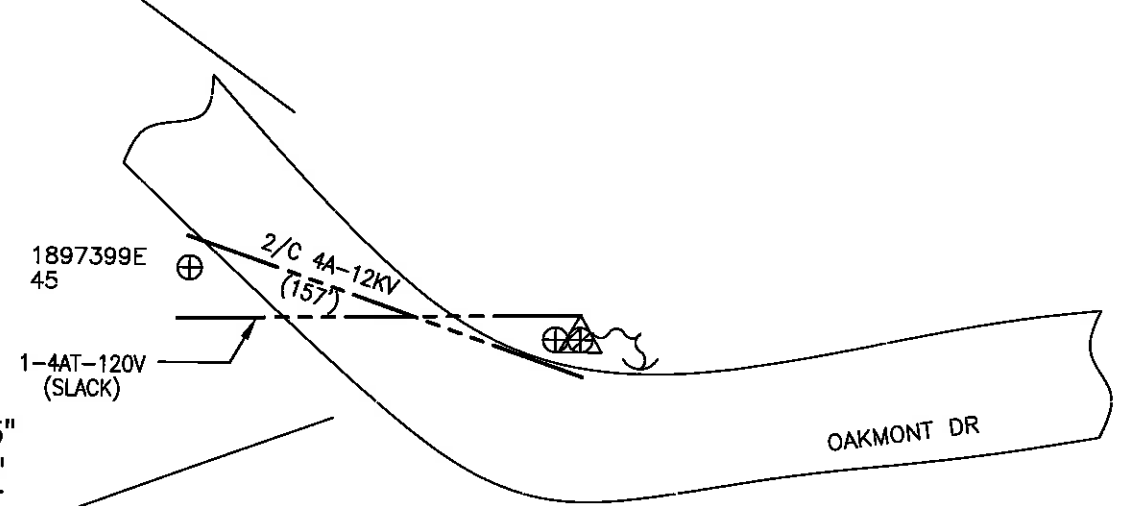

TLM DATA:

	SIZE	KVA	CUST.	% LOAD
EXIST	10	13.3	2	133
PROP.	25	13.3	2	53.2

VOLTAGE DROP: _____
FLICKER FACTOR: _____
PRI. CIRC. TENNECO 12KV

There are 6 on 10 ATW

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☒
OUTAGE DATE:	
TIME:	
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒

DISTRICT 36 - ANTELOPE VALLEY	PROJ. MGR. TOLMASOFF, LAURA M PHONE 714-796-9811	PLANNER HAMPTON TEDDER PHONE 909-628-1253	DESIGNER HAMPTON TEDDER
PROJECT NO. 1684854	SERVICE REQUEST 2591466	MSR NO.	PRODUCT-1 1471173-INFRASTRUCTURE REPLACEMENT PLP
CIRCUIT / VOLTAGE TENNECO 12KV	THOMAS GUIDE	PRODUCT-2	ASSOC DESGN
SUB / PG NO. FRAZIER PARK SUB	CIRCUIT CODE 17663	PRODUCT-3	ASSOC DESGN
INVENTORY MAP 11-66D	J.P.A. NO. E6036-409750499	PROPOSED CONSTRUCTION (LOCATION) 1897400E OAKMONT DR N/S, 1020' W/O PINE CANYON DR FRAZIER PARK, CA	
1/18/19	MN/HTE		
TYPE	DATE	APPROVED BY	CHECKED BY
Southern California Edison Company			
SHEET 1 of 1		DESIGN\DRWG NO. 1090809_0.01	





1897400E





1897400E





1897400E

