



An *EDISON INTERNATIONAL*® Company

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | | | | |
|--------------------------|-----------------------|--------------------------|--------------------|--------------------------|---------------------------------------|
| ☐ | Camera – HD/IR | ☐ | Line String | ☐ | Pole-set |
| ☐ | Crew support | ☐ | Passenger | ☐ | Recon |
| ☐ | External Load | ☐ | Patrol | ☐ | Training |
| ☐ | HEC | ☐ | Photo | ☐ | Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____


Follow up status: ☐ Week 1

□ Week 2

□ Week 3

POLE DETAILS

JOINT POLE	☒
RENTER	☐
MITC FUME	☐
JOINT MEET	☐
TRUCK ACCESS	☐
HAND SET	☐
CONTACT CATV	☐

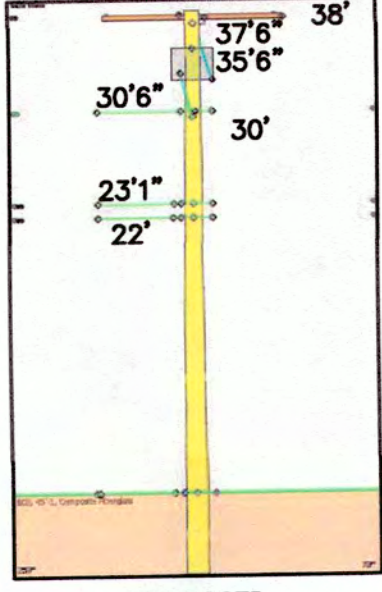

T.L.M. DATA: 1255851E

SIZE	KVA	CUST	% LOAD
EXIST. 25	34.4	6	138
PROP. 25	34.4	6	138


3 RM 1255851E Class C4
RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL VB 10' STEEL PINS
RM: 2- INS POLY DE 16KV RIG #6
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
RM: 2- SEC 3-WIRE (284 RACK)
RM: 264- CD 1/0 AL 1/C WR
TR: 1-25KVA 16KV 120/240V
TR: 2-16KV ELF'S
TR: 2-9/32" SG
TR: 1-1/0AT 120/240V
TR: 1-#4AT 120/240V SVC
TR: 2- AT&T TEL

4 POLE 1255851E Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 10- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON
IN: 2- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
IN: 1- SA POLY W/GND & T-GAP PRI-N 16KV 1P
IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- GR CMP OH #6 SOL WP SECONDARY W/ROD
IN: 88- CD 1/0 STR AL TRIPLEX W/ACSR NEUTRAL

2 EXISTING 4619664E
50'
EX: 2-16KV SMU 20 (BF391716)
RM: 1- XA SNGL VB 10' STEEL PINS
RM: 1- INS POLY W/PIN 16KV CLMP #6-4/0 CU
RM: 2- INS POLY DE 16KV RIG #6
IN: 1- XA SNGL DE HD COMP 10' W/BKT
IN: 1- INS POLY PIN 16KV VRT VICE NYLON
IN: 2- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR

1 EXISTING 2359456E
35'
RM: 1- AG ANCHOR ROD 3/4" X 8' 2-EYE W/PLATE
IN: 1- AG 24" CR PLT 1 1/4" X 10" ROD 3-EYE
IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
IN: 1- AG SPAN GUY 9/32" - 200'

NOTE:
-LOWER EX SCE SG 1 FOOT
-INSTALL NEW SG TO BACK UP PRIMARY
BUCK @ POLE 9664E
-TRANSFER EX COMM DG's TO NEW ANCHOR

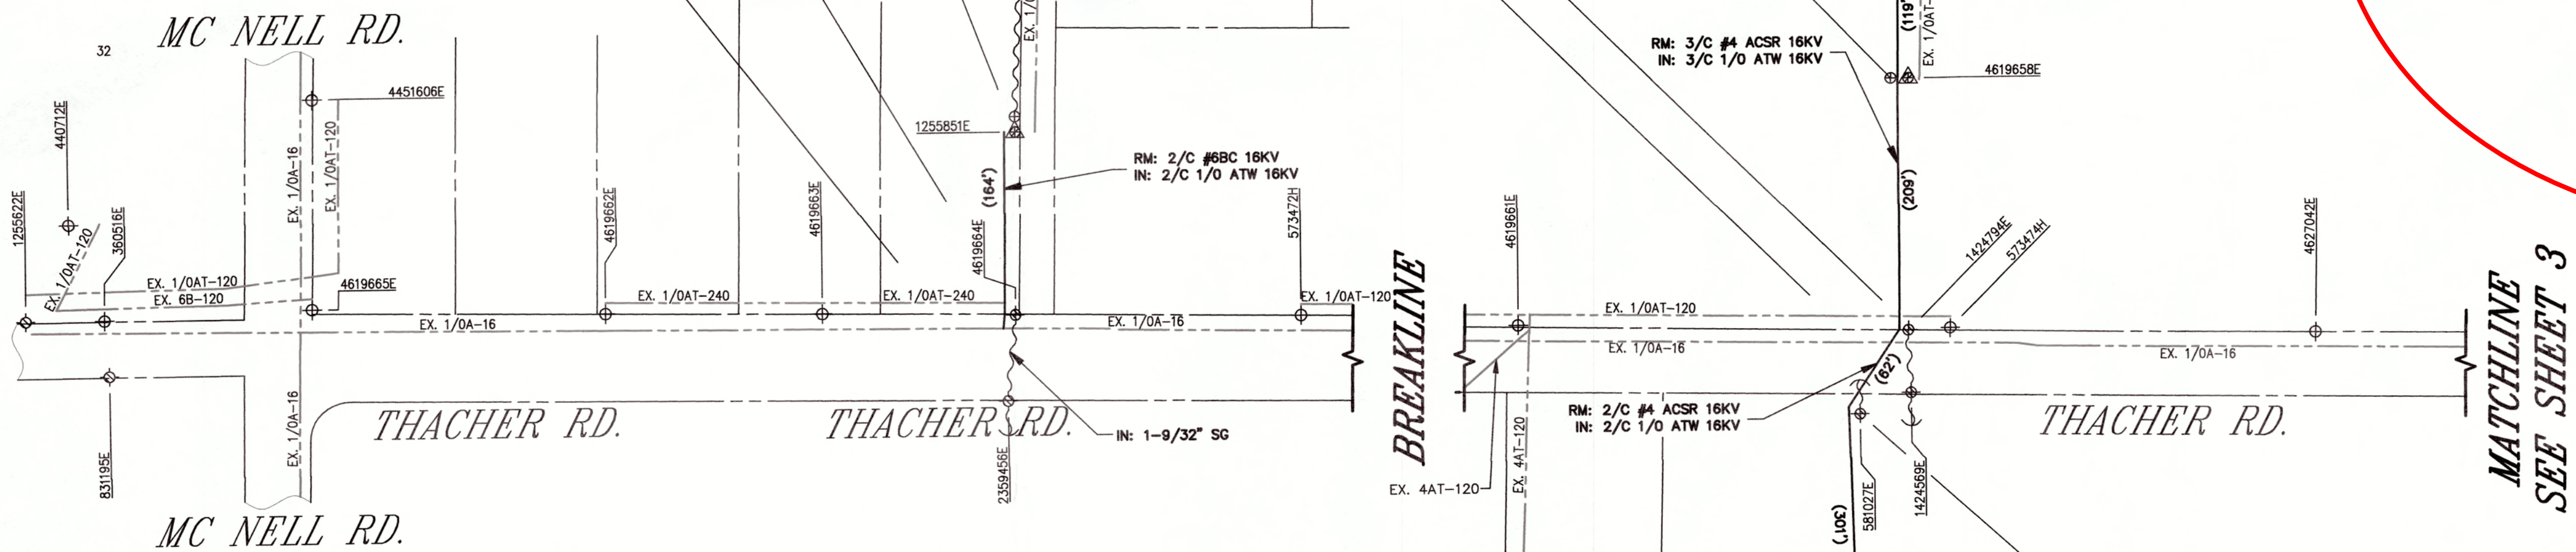

NOTE:
ALL POLES TO BE CONSTRUCTED WITH
WILDLIFE PROTECTIVE COVERS
INSTALL SAP #10211487 ON ALL DE INS

PROJECT REQUIREMENTS (Y/N)


EDISON EASEMENT REQUIRED	☒
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒
PERMIT TYPE: ENCROACHMENT	
OUTAGE REQUIRED	☒
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒



UNDERGROUND SERVICE ALERT
1-800-422-4133
or
1-800-227-2600
Call USA
For Underground Locating
2 Working Days Before You Dig

POLE DETAILS

JOINT POLE	☒
RENTER	☐
MITC FUME	☐
JOINT MEET	☐
TRUCK ACCESS	☐
HAND SET	☐
CONTACT CATV	☐

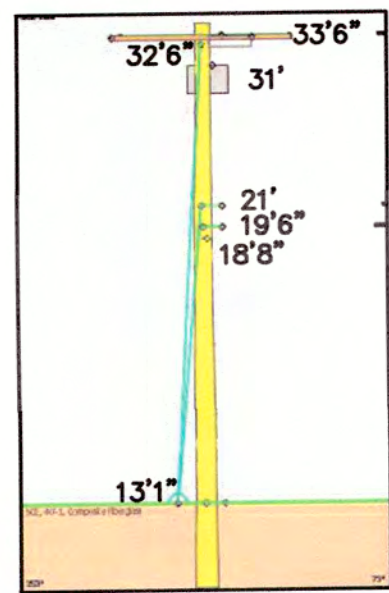

PROPOSED 581028E L/S

15 RM 581028E Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS POLY W/PIN 16KV CLMP #6-4/0 CU
RM: 2- INS POLY PIN 16KV VRT VICE NYLON
RM: 1- TR OH 15KVA 16KV 120/240 1P
SN:
RM: 2- FE FH CO ALL SIZES 200A OR LESS 16KV
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG ANCHOR ROD 3/4" X 8' 2-EYE W/PLATE
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
TR: 1-3"X2" PVC SVC RISER

T.L.M. DATA: 581028E

SIZE	KVA	CUST	% LOAD
EXIST. 15	28.8	1	192
PROP. 37.5	28.8	1	77

16 POLE 581028E Class C1
IN: 1- POLE 40' CLASS 1 RS COMP SEC POLE
IN: 1- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON
IN: 2- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
IN: 1- TR OH 37KVA 16KV 120/240 1P
SN:
IN: 2- FE CO MNT FOR ELF 100A 16KV 1-EA
IN: 2- FE FUSE ELF 15KV 6A
IN: 1- SA POLY W/GND & T-GAP PRI-N 16KV 1P
IN: 1- RISER SUPPORT KIT FOR CMP LWS WD POLES
IN: 1- AG ANCHOR ROD 1" X 10' 3-EYE W/PLATE
IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV

NOTE:
-JOINT MEET HLA * RISERS / DE'S
-TOP GRADE COMM TO BE 21'


7 RM 4619658E Class C4
RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 1- INS POLY W/PIN 16KV CLMP #4-653 ACSR
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
TR: 1-1/0AT 120/240V
TR: 1-#4AT 120/240V SVC
TR: 1-7/32" SG
TR: 2-AT&T TEL
TR: 1-AT&T DG
HARDSET WEST
8 POLE 4619658E Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY PIN 16KV ANG VICE NYLON
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- OH GUYING TEE W/HARDWARE CMP & WOOD

RM 1424572E Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- AG SPAN GUY 9/32" - 200'
RM: 2- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG ANCHOR ROD 3/4" X 8' 2-EYE W/PLATE
TR: 1-1/0AQ 240V (VERIFY VOLTAGE)
TR: 1-1/0AT 120/240V (RE-SAG OUT OF COMM)
HARDSET NORTH
POLE 1424572E Class C1
IN: 1- POLE 40' CLASS 1 RS COMP SEC POLE
IN: 3- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG 24" CR PLT 1 1/4" X 10" ROD 3-EYE
IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
IN: 1- OH GUYING TEE W/HARDWARE CMP & WOOD

NOTE:
-JOINT MEET AT&T * DG'S / SVC'S
-REPLACE EX COMM ANC AND BUY INTEREST IN
NEW ANC (.33 E / .66 HLA)

POLE DETAILS

JOINT POLE	☒
RENTER	☐
MITC FUME	☐
JOINT MEET	☐
TRUCK ACCESS	☐
HAND SET	☐
CONTACT CATV	☐

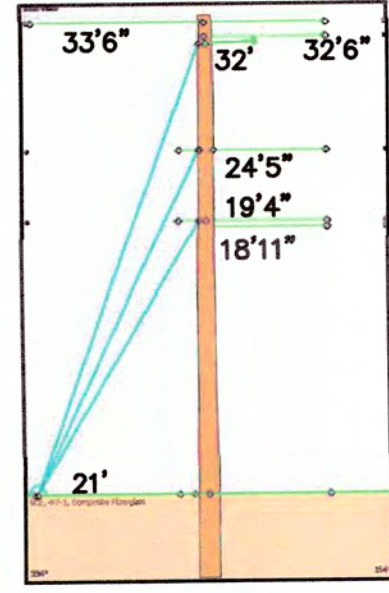

PROPOSED 1424572E L/E

EXISTING 1424571E 11
50'
EX: 3-25KVA 16KV 120/240V BANK
RM: 1- XA DBLE VB 10' STEEL PINS
RM: 3- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
RM: 1- AG SPAN GUY 9/32" - 200'
IN: 1- XA SNGL DE HD COMP 10' W/BKT
IN: 3- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
IN: 1- SA POLY W/GND & T-GAP NO PRI-N 16KV 3P
IN: 1- AG SPAN GUY 3/8" - 200'

NOTE:
-CAUTION: VERIFY TRANSFORMER VOLTAGE
-BANK IS WIRED AS DELTA (VERIFY 240V 3PHASE-3WIRE SVC)
-BANK IS LABELLED AS 120/208V
-RE-SAG SECONDARIES NORTH


RM 1424570E Class C4
RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 1- TR OH 37KVA 16KV 120/240 1P
SN:
RM: 2- FE FH CO ALL SIZES 200A OR LESS 16KV
RM: 1- SEC 3-WIRE (284 RACK)
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
TR: 1-1/0AT 120/240V
TR: 1-7/32" SG
TR: 2-AT&T TEL
HARDSET NORTH
POLE 1424570E Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 1- TR OH 50KVA 16KV 120/240 1P
SN:
IN: 2- FE CO MNT FOR ELF 100A 16KV 1-EA
IN: 2- FE FUSE ELF 15KV 8A
IN: 1- SA POLY W/GND & T-GAP PRI-N 16KV 1P
IN: 1- GR CMP OH #6 SOL WP SECONDARY W/ROD
IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)

T.L.M. DATA: 1424570E

SIZE	KVA	CUST	% LOAD
EXIST. 37.5	41.1	2	109.7
PROP. 50	41.1	2	82.2

POLE DETAILS

JOINT POLE	☒
RENTER	☐
MITC FUME	☐
JOINT MEET	☐
TRUCK ACCESS	☐
HAND SET	☐
CONTACT CATV	☐

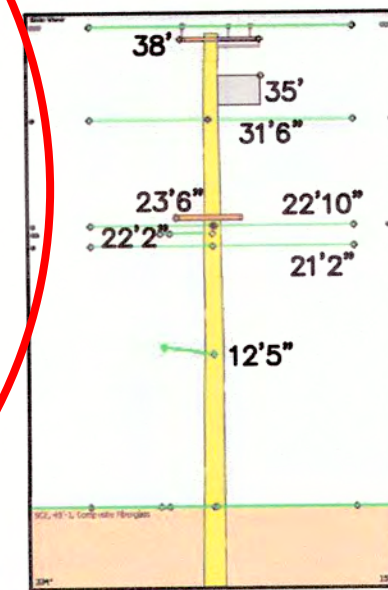

PROPOSED 1424570E L/E

INVENTORY MAP NUMBERS
60-25; 60-26; 61-25A,B,D; 62-25C,D


FINAL DESIGN
APPROVED FOR CONSTRUCTION

DISTRICT 39 - VENTURA	PROJ. MGR. GONZALEZ, CAROLINA	PLANNER COX, CHARLES	DESIGNER JIMENEZ, MYRNA
PROJECT NO. 1574756	SERVICE REQUEST 2484640	MSR NO. 1516593	INFRA REPLACEMENT (CONDUCTOR)
CIRCUIT / VOLTAGE THACHER 16KV	THOMAS GUIDE	PRODUCT-2	ASSOC DESIGN
SUB / PG NO. OJAI SUB	CIRCUIT CODE	PRODUCT-3	ASSOC DESIGN
INVENTORY MAP (SEE ABOVE)	J.P.A. NO. E6039-409931103	PROPOSED CONSTRUCTION (LOCATION)	PIF#939221 2019 BUNDLED PROJECT
		OH HFA RECONDUCTOR	OJAI, CA 93023
F 3/12/2019	V. OCHOA	J. OUREL	M. JIMENEZ
B 02/11/19	-	C. COX	UO005/L RICHY
TYPE	DATE	APPROVED BY	CHECKED BY
		Southern California Edison Company	

SENSITIVE ENVIRONMENTAL RESOURCE AREA (SERA)

Malibu Canyon Poles

- H1 HABITAT
- H2 HABITAT
- H3 HABITAT
- To Remain
- Malibu Canyon Project Lines

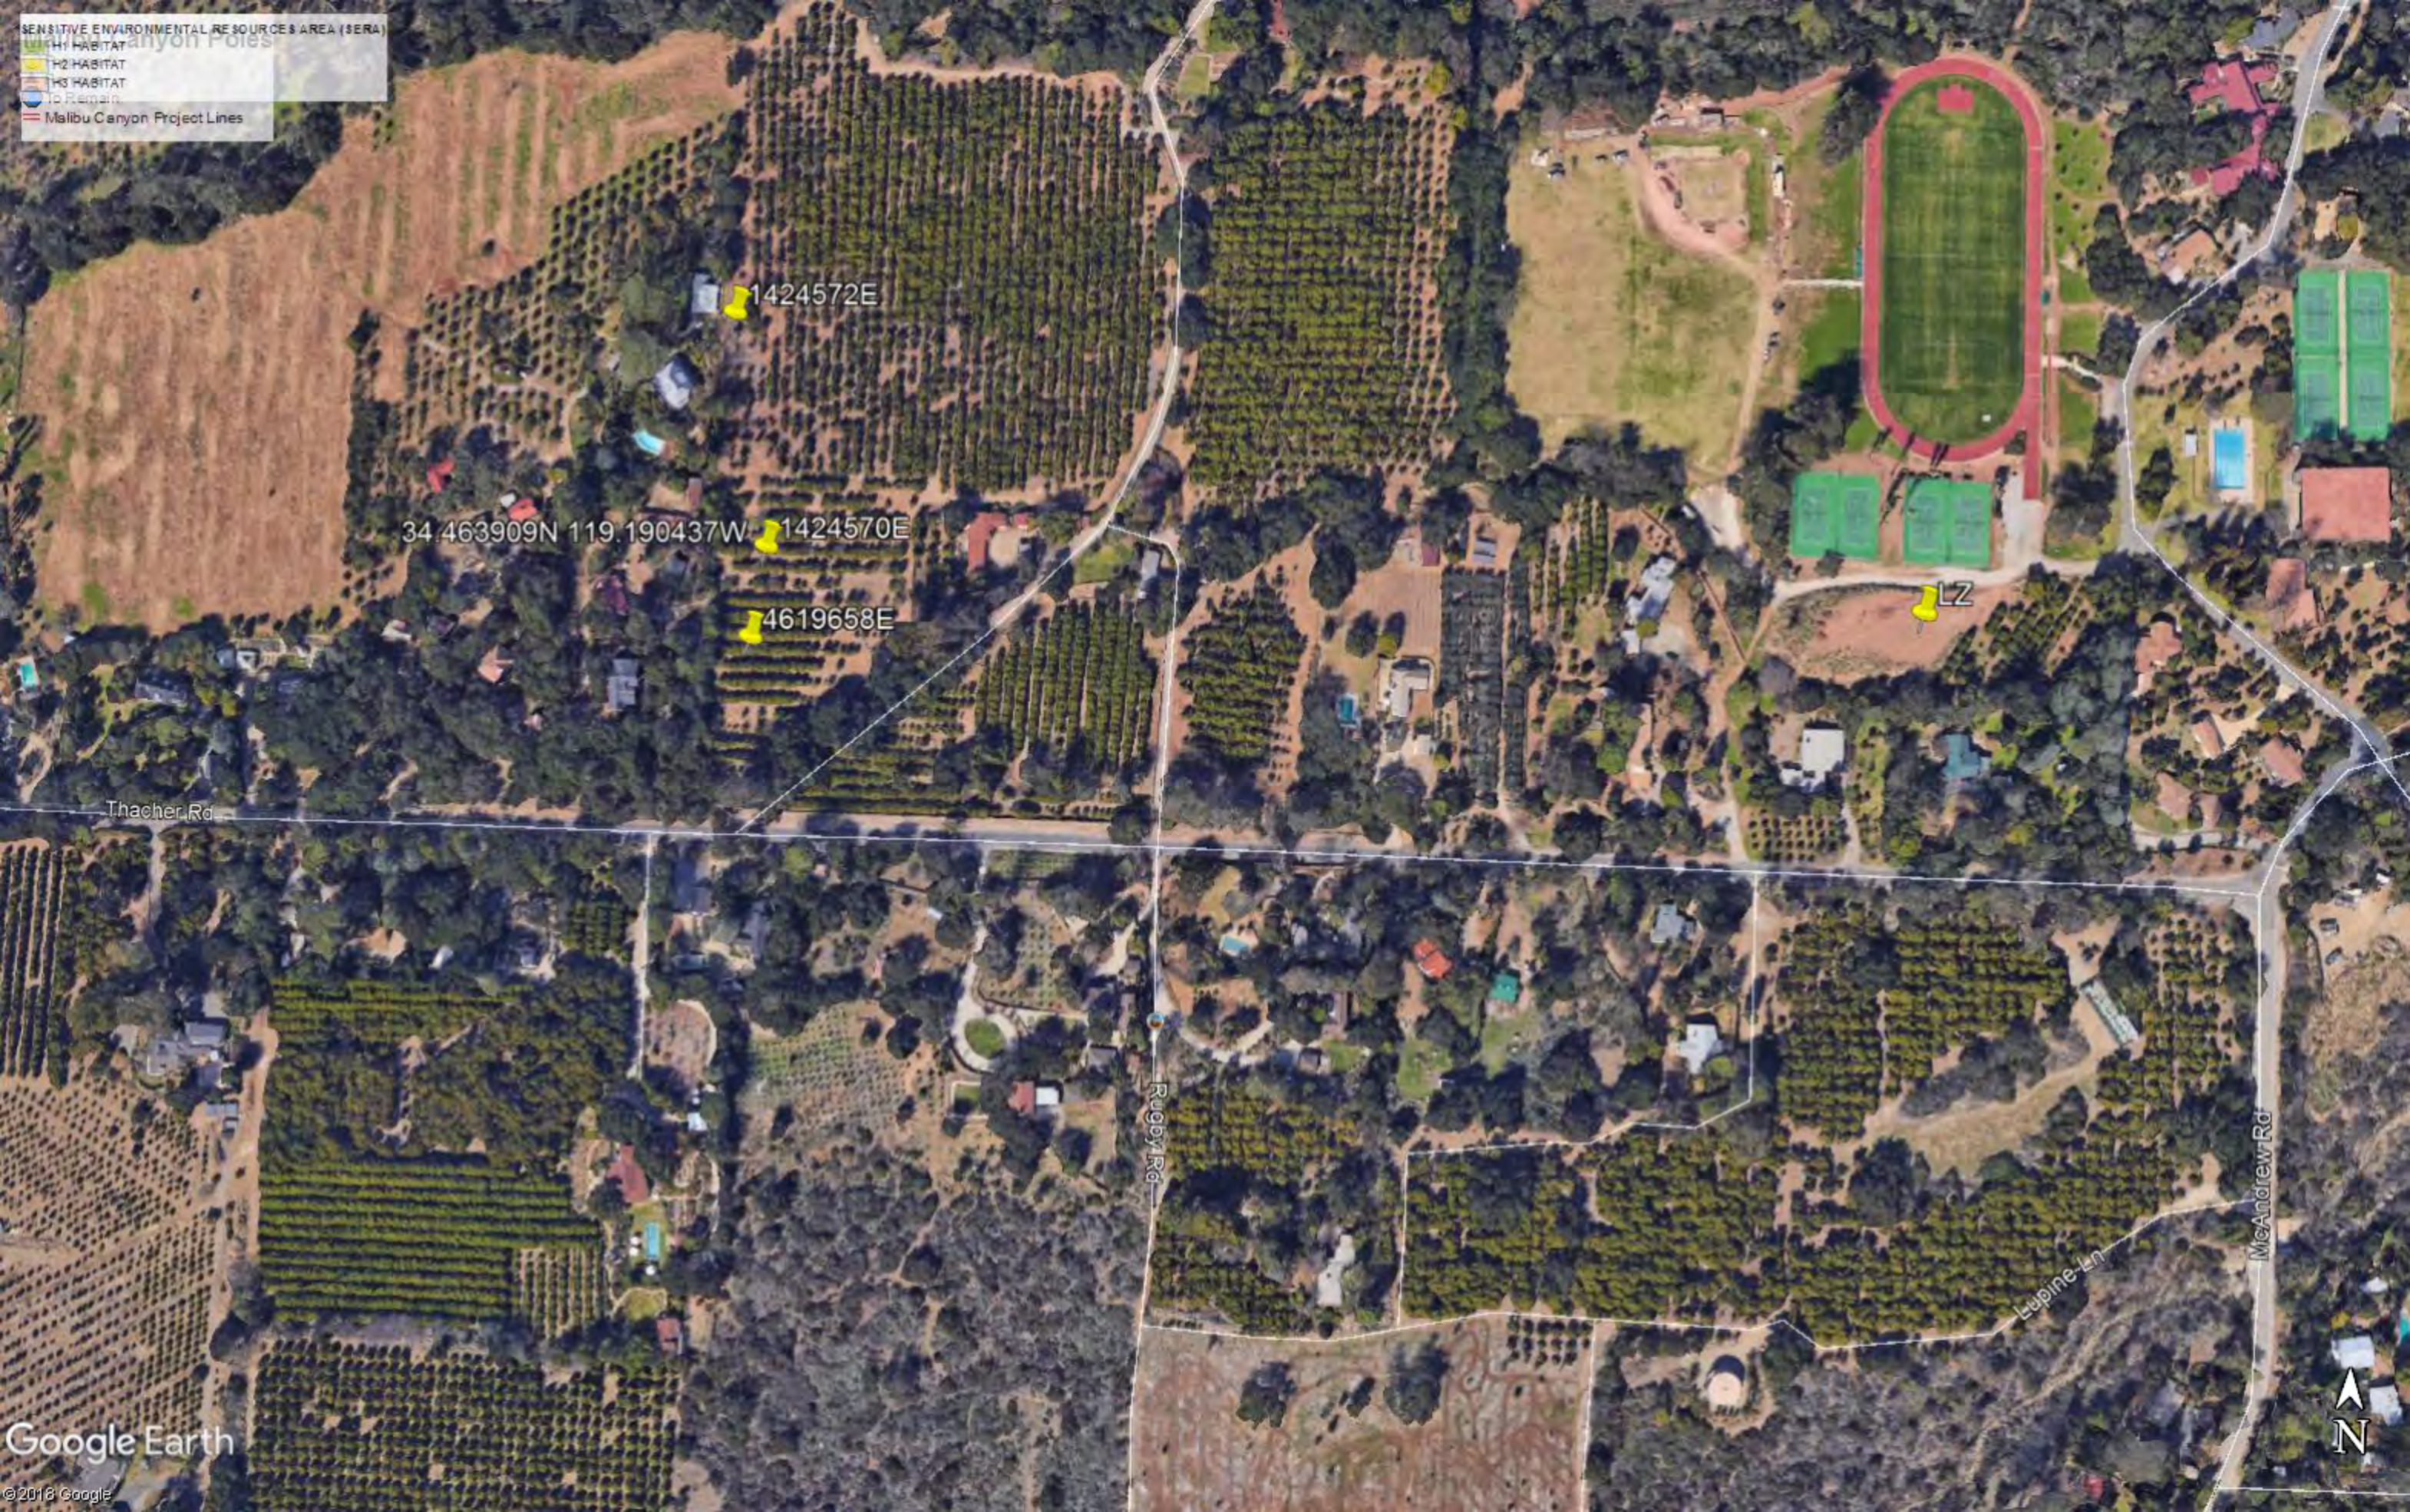

34.463909N 119.190437W

1424572E

1424570E

4619658E

LZ

Thacher Rd

Rugby Rd

Lupine Ln

McAndrew Rd

