

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

Untitled Map

Write a description for your map.

Legend

 Pole#

Pole# 838529H (34°25'50.85"N 119° 9'50.44"W)

Pole# 838530H (34°25'49.92"N 119° 9'50.29"W)

Pole# 2234758E (34°25'46.47"N 119° 9'50.58"W)

Bo-Merritt Rd

Big Canyon Rd


Sulphur Mountain Rd



HARDSET NORTH WEST
GATE CODE FOR ACCESS IS #12345
TRANSFER RISER
POLE 4626774E
Class C1
IN: 1- POLE 45' CLASS 1 COMPOSITE HOLES TO 21'
IN: 3- XA SNGL DE HD COMP 10' W/BKT
IN: 6- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
IN: 3- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG DOWN GUY 7/16" - 50' LESS THAN 22.5KV
IN: 1- RSR PRECUT UNISTRUT W/ HARDWARE NO PVC
IN: 1- GR OH #6 SOL WP PRIMARY W/ROD
IN: 2- FE CO OPEN 100A 16KV 1-EA
IN: 1- TR OH 25KVA 16KV 120/240 1P
SN: _____

T.L.M. DATA: 4626774E
SIZE KVA CUST % LOAD
EXIST. 25 4.4 1 17.78
PROP. 25 4.4 1 17.78

POLE DETAILS
JOINT POLE ☒
RENTER ☐
MITC FUME ☐
JOINT MEET ☒
TRUCK ACCESS ☒
HAND SET ☐
CONTACT CATV ☒

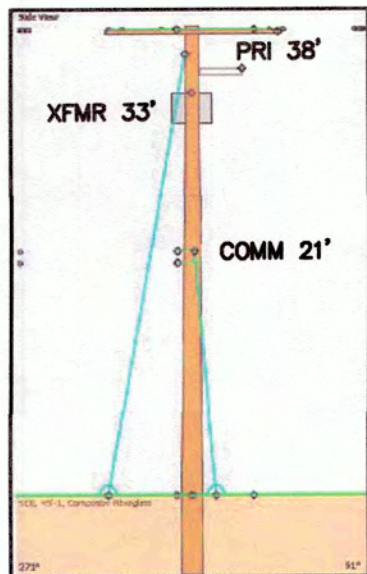

PROPOSED
4626774E
L/N

N: 34.432608
W: -119.169655
RM 4626774E
Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 2- XA SNGL FB 10' STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 2- FE CO OPEN 100A 16KV 1-EA
RM: 1- TR OH 25KVA 16KV 120/240 1P
SN: _____

SEE SHEET 3
MATCH LINE 'E'

RM: 3/C #4 ACSR 16KV
IN: 3/C 1/O ATW 16KV


RM: 3/C #4 ACSR 16KV
IN: 3/C 1/O ATW 16KV

RM: 3/C #4 ACSR 16KV
IN: 3/C 1/O ATW 16KV

RM: 3/C #4 ACSR 16KV
IN: 3/C 1/O ATW 16KV

T.L.M. DATA: 2235332E
SIZE KVA CUST % LOAD
EXIST. 50 3.3 2 6.67
PROP. 50 3.3 2 6.67

POLE DETAILS
JOINT POLE ☐
RENTER ☐
MITC FUME ☐
JOINT MEET ☐
TRUCK ACCESS ☐
HAND SET ☐
CONTACT CATV ☐

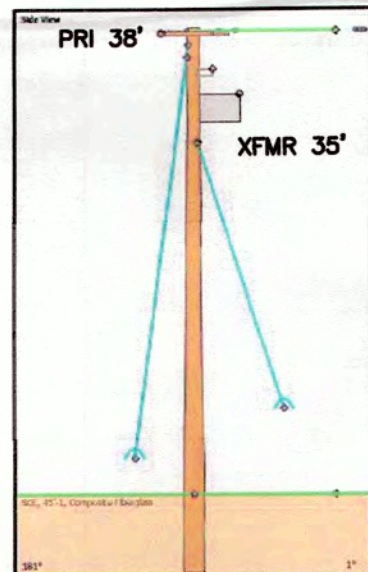

PROPOSED
2235332E
L/W

N: 34.429739
W: -119.169772
RM 2235332E
Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA DBLE FB 10' STEEL PINS
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 3- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
RM: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 2- FE CO OPEN 100A 16KV 1-EA
RM: 1- TR OH 50KVA 16KV 120/240 1P
SN: _____

SET 1' EAST
TRANSFER RISER
ADD SECOND 3/8" DG AT 36'
POLE 2235332E

Class C1
IN: 1- POLE 45' CLASS 1 COMPOSITE HOLES TO 21'
IN: 3- XA SNGL DE HD COMP 10' W/BKT
IN: 3- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
IN: 3- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- RSR PRECUT UNISTRUT W/ HARDWARE NO PVC
IN: 1- GR OH #6 SOL WP PRIMARY W/ROD
IN: 2- FE CO OPEN 100A 16KV 1-EA
IN: 1- TR OH 50KVA 16KV 120/240 1P
SN: _____

NOTE:
ALL POLES TO BE CONSTRUCTED WITH
WILDLIFE PROTECTIVE COVERS
INSTALL SAP #10211487 ON ALL DE INS

PROJECT REQUIREMENTS (Y/N)
EDISON EASEMENT REQUIRED ☐
PWRD 88 REQUIRED ☐
UG CIVIL ONLY WORK ORDER ☐
PERMIT REQUIRED ☒
PERMIT TYPE: ENCROACHMENT
OUTAGE REQUIRED ☒
OUTAGE DATE: _____ TIME: _____
TRAFFIC CONTROL REQUIRED ☒
PED. TRAFFIC CONTROL REQ'D ☐
CONVEYANCE LETTER REQ'D ☐
ENVIRONMENTAL CLEARANCE REQ'D ☐
CSD 140 (TLM) REQ'D ☐

SEE SHEET 4
MATCH LINE 'F'

EXISTING 4626775E
50'
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
RM: 4- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
IN: 4- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR

RM: 2/C #4 ACSR 16KV
IN: 2/C 1/O ATW 16KV

EXISTING 4032730E
50'
RM: 1- XA DBLE FB 10' STEEL PINS
RM: 2- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR

RM: 2/C #4 ACSR 16KV
IN: 2/C 1/O ATW 16KV

N: 34.430793
W: -119.16401
RM 838529H
Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 2- XA SNGL FB 10' STEEL PINS
RM: 2- INS GLASS DE 16KV W/L-GUARD #4
RM: 3- INS GLASS & PIN 16KV
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

HARDSET EAST
NO TRUCK ACCESS. ON HILL
POLE 4557246E

Class C1
IN: 1- POLE 45' CLASS 1 COMPOSITE HOLES TO 21'
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 1- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
IN: 2- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG DOWN GUY 7/16" - 50' LESS THAN 22.5KV

EXISTING 838530H
45'
RM: 1- XA DBLE FB 10' STEEL PINS
RM: 4- INS GLASS DE 16KV W/L-GUARD #4
RM: 2- INS GLASS & PIN 16KV
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
IN: 4- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
NOTE TO CREWS: TR F.H.

EXISTING 2234759E
45'
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 4- INS GLASS DE 16KV W/L-GUARD #4
RM: 2- INS GLASS & PIN 16KV
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
IN: 4- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR

EXISTING 4783619E
55'
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON


EXISTING 4788745E
55'
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
RM: 4- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON

EXISTING 4788746E
55'
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
NOTE TO CREWS: REPLACE DG WITH NEW 3/8"

RM: 2/C #4 ACSR 16KV
IN: 2/C 1/O ATW 16KV

N: 34.43284
W: -119.163793
RM 1702708E
Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 1- AG SPAN GUY 7/32" - 200' MORE THAN 22.5KV

SET 1' NORTH
POLE 1702708E
Class C1
IN: 1- POLE 45' CLASS 1 COMPOSITE HOLES TO 21'
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY PIN 16KV VRT VICE NYLON
IN: 1- AG SPAN GUY 7/32" - 200' MORE THAN 22.5KV

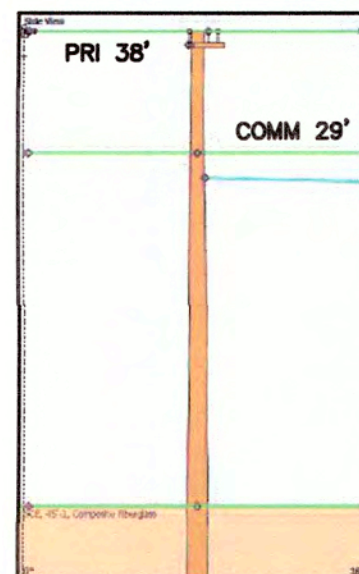

PROPOSED
1702708E
L/E


POLE DETAILS
JOINT POLE ☒
RENTER ☐
MITC FUME ☐
JOINT MEET ☒
TRUCK ACCESS ☒
HAND SET ☐
CONTACT CATV ☒

EXISTING 1702709E
45'
RM: 2- XA DBLE FB 10' STEEL PINS
RM: 7- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR
RM: 3- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
IN: 4- XA SNGL DE HD COMP 10' W/BKT
IN: 3- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
IN: 7- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR

EXISTING 823554H
45'
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS GLASS & PIN 16KV
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON

EXISTING 823555H
45'
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS GLASS DE 16KV W/L-GUARD #4
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 2- INS POLY DE 16KV HOT SHOE #4 & 1/O ACSR

N: 34.429598
W: -119.164051
RM 2234758E
Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS GLASS & PIN 16KV
NOTE TO CREWS: SET 1' SOUTH
NO TRUCK ACCESS BUT WALKING PATH.
POLE 2234758E
Class C1
IN: 1- POLE 45' CLASS 1 COMPOSITE HOLES TO 21'
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 2- INS POLY PIN 16KV VRT VICE NYLON

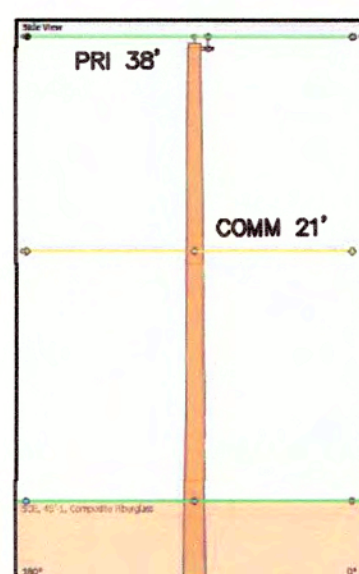

POLE DETAILS
JOINT POLE ☐
RENTER ☐
MITC FUME ☐
JOINT MEET ☐
TRUCK ACCESS ☐
HAND SET ☐
CONTACT CATV ☐

INVENTORY MAP NUMBERS

57-26; 58-26A,B,D; 59-26

FINAL DESIGN
APPROVED FOR CONSTRUCTION

DISTRICT	59 - VENTURA	PROJ. MGR. GONZALEZ, CAROLINA	PLANNER FLANNERY, ROBERT	DESIGNER FLANNERY, ROBERT
PROJECT NO.	1574756	SERVICE REQUEST 2484640	MSR NO. 1447049-INFRA	PRODUCT-1 1447049-INFRA REPLACEMENT (CONDUCTOR)
CIRCUIT / VOLTAGE	THACHER 16KV	THOMAS GUIDE	PRODUCT-2	ASSOC DESIGN
SUB / PG NO.	JUAI SUB	CIRCUIT CODE	PRODUCT-3	ASSOC DESIGN
INVENTORY MAP (SEE ABOVE)	J.P.A. NO. E6039-409957595	PROPOSED CONSTRUCTION (LOCATION)	PIF#939221 2019 BUNDLED PROJECT THACHER	
		HFA OH RECONDUCTOR		
		OJAI, CA 93023		
F 03/30/19	V. DICHOSI	J. CUREL	J. RICHY	
B 02/13/19		C. COX	UDG/L. RICHY	
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY
				PAX #
				5 of 5
				1072187_0.01



SOUTHERN CALIFORNIA
EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 100'

UNDERGROUND SERVICE ALERT

1-800-422-4133

or

1-800-227-2600

Call USA

For Underground Locating

2 Working Days Before You Dig