


REPLACE DETERIORATED POLE
NOTIFICATION #410042320; DUE: 10/23/19




GPS COORDINATES:
34.239643; -117.147333

NOTES TO CREW:

NO TRUCK ACCESS
HELICOPTER SET AND HIKE IN
TREE TRIMMING BY CREW
WORK WITH TD1566798 AND
TD1567438
COORDINATE ACCESS WITH WASTE
TRANSFER STATION
REQUIRES 3-KEY TO ACCESS CLOSED
LANDFILL AREA

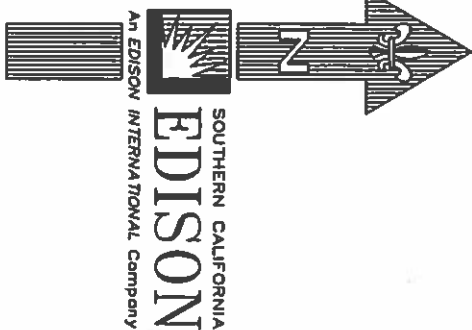

SCALE: 1" = 40'

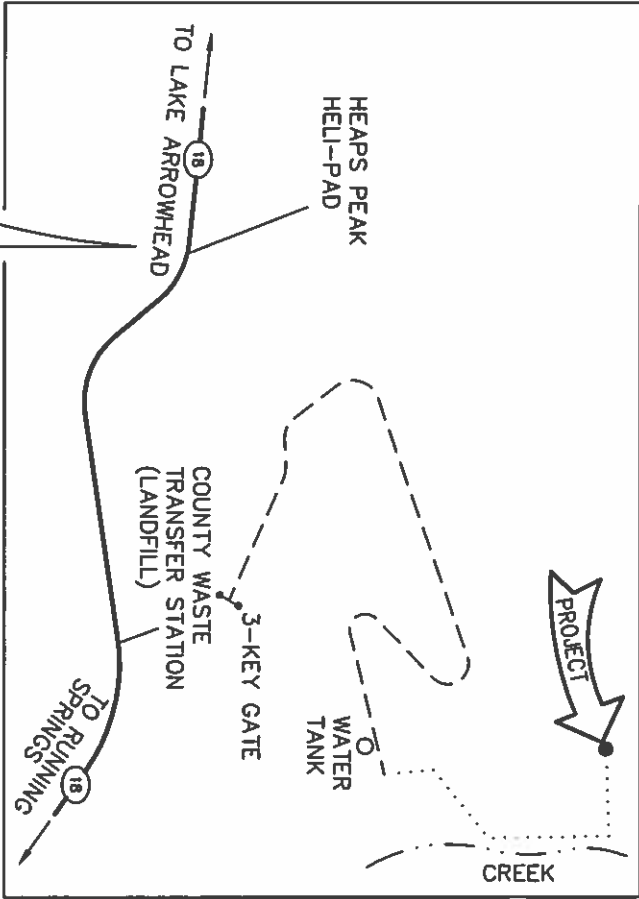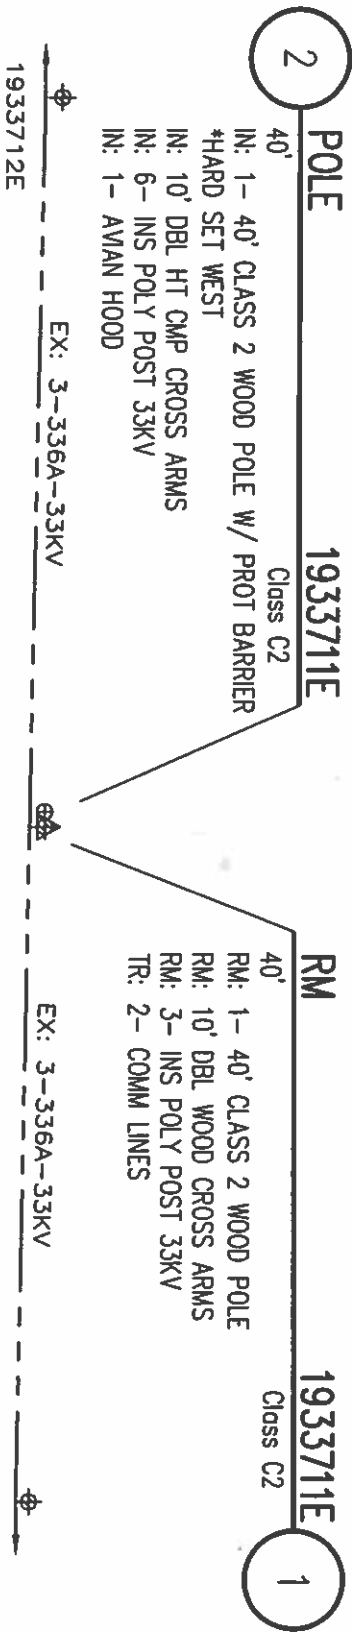

HEAVY LOADING AREA
PROJECT ELEVATION ABOVE 5000 FT

UNDERGROUND SERVICE ALERT


Call USA
Dial 811
For Underground Locating
2 Working Days Before You Dig

<u>PROJECT REQUIREMENTS (Y/N)</u>	
EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☒
UG CIVL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE: <u>BLANKET</u>	
OUTAGE REQUIRED	☐
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐




D124: Rev. 02/08/18

DISTRICT 40 - ARROWHEAD		PROJ. MGR. CUMMING, JAMES	PLANNER CUMMING, JAMES	DESIGNER CUMMING, JAMES			
PROJECT NO. 1784050	SERVICE REQUEST 2688487	PHONE 909-273-7029	PHONE 909-273-7029				
CIRCUIT / VOLTAGE HEAPS PEAK 33KV	MSR NO. N/A	THOMAS GUIDE N/A	PRODUCT-1 1567437-OCI REPLACE DET POLE	ASSOC DESIGN			
SUB / PG NO. BURNIT MILL A1	CIRCUIT CODE 08268	PRODUCT-3		ASSOC DESIGN			
INVENTORY MAP 270-2256-1		J.P.A. NO. E6040-410271369	PROPOSED CONSTRUCTION (LOCATION) REPLACE DETERIORATED POLE COUNTY LANDFILL RUNNING SPRINGS, CA				
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET 1 of 1	DESIGN/DRWG NO. 1167391_0.01
Southern California Edison Company							

REPLACE DETERIORATED POLE
NOTIFICATION #410042317; DUE: 10/23/19

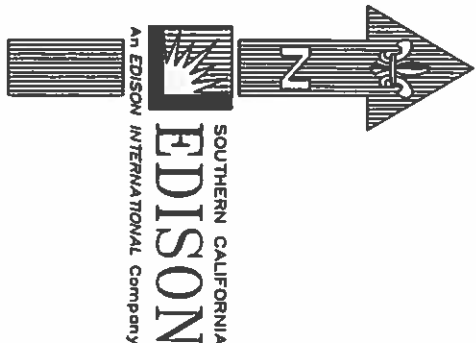

SCALE: 1" = 40'

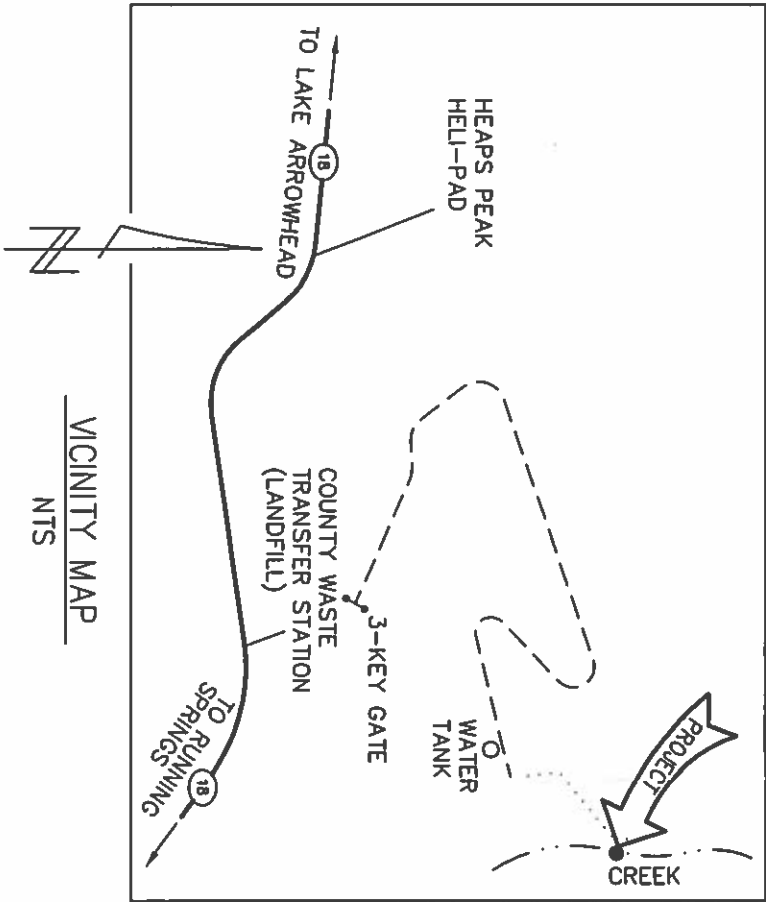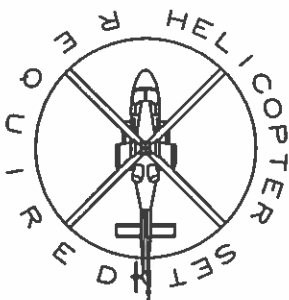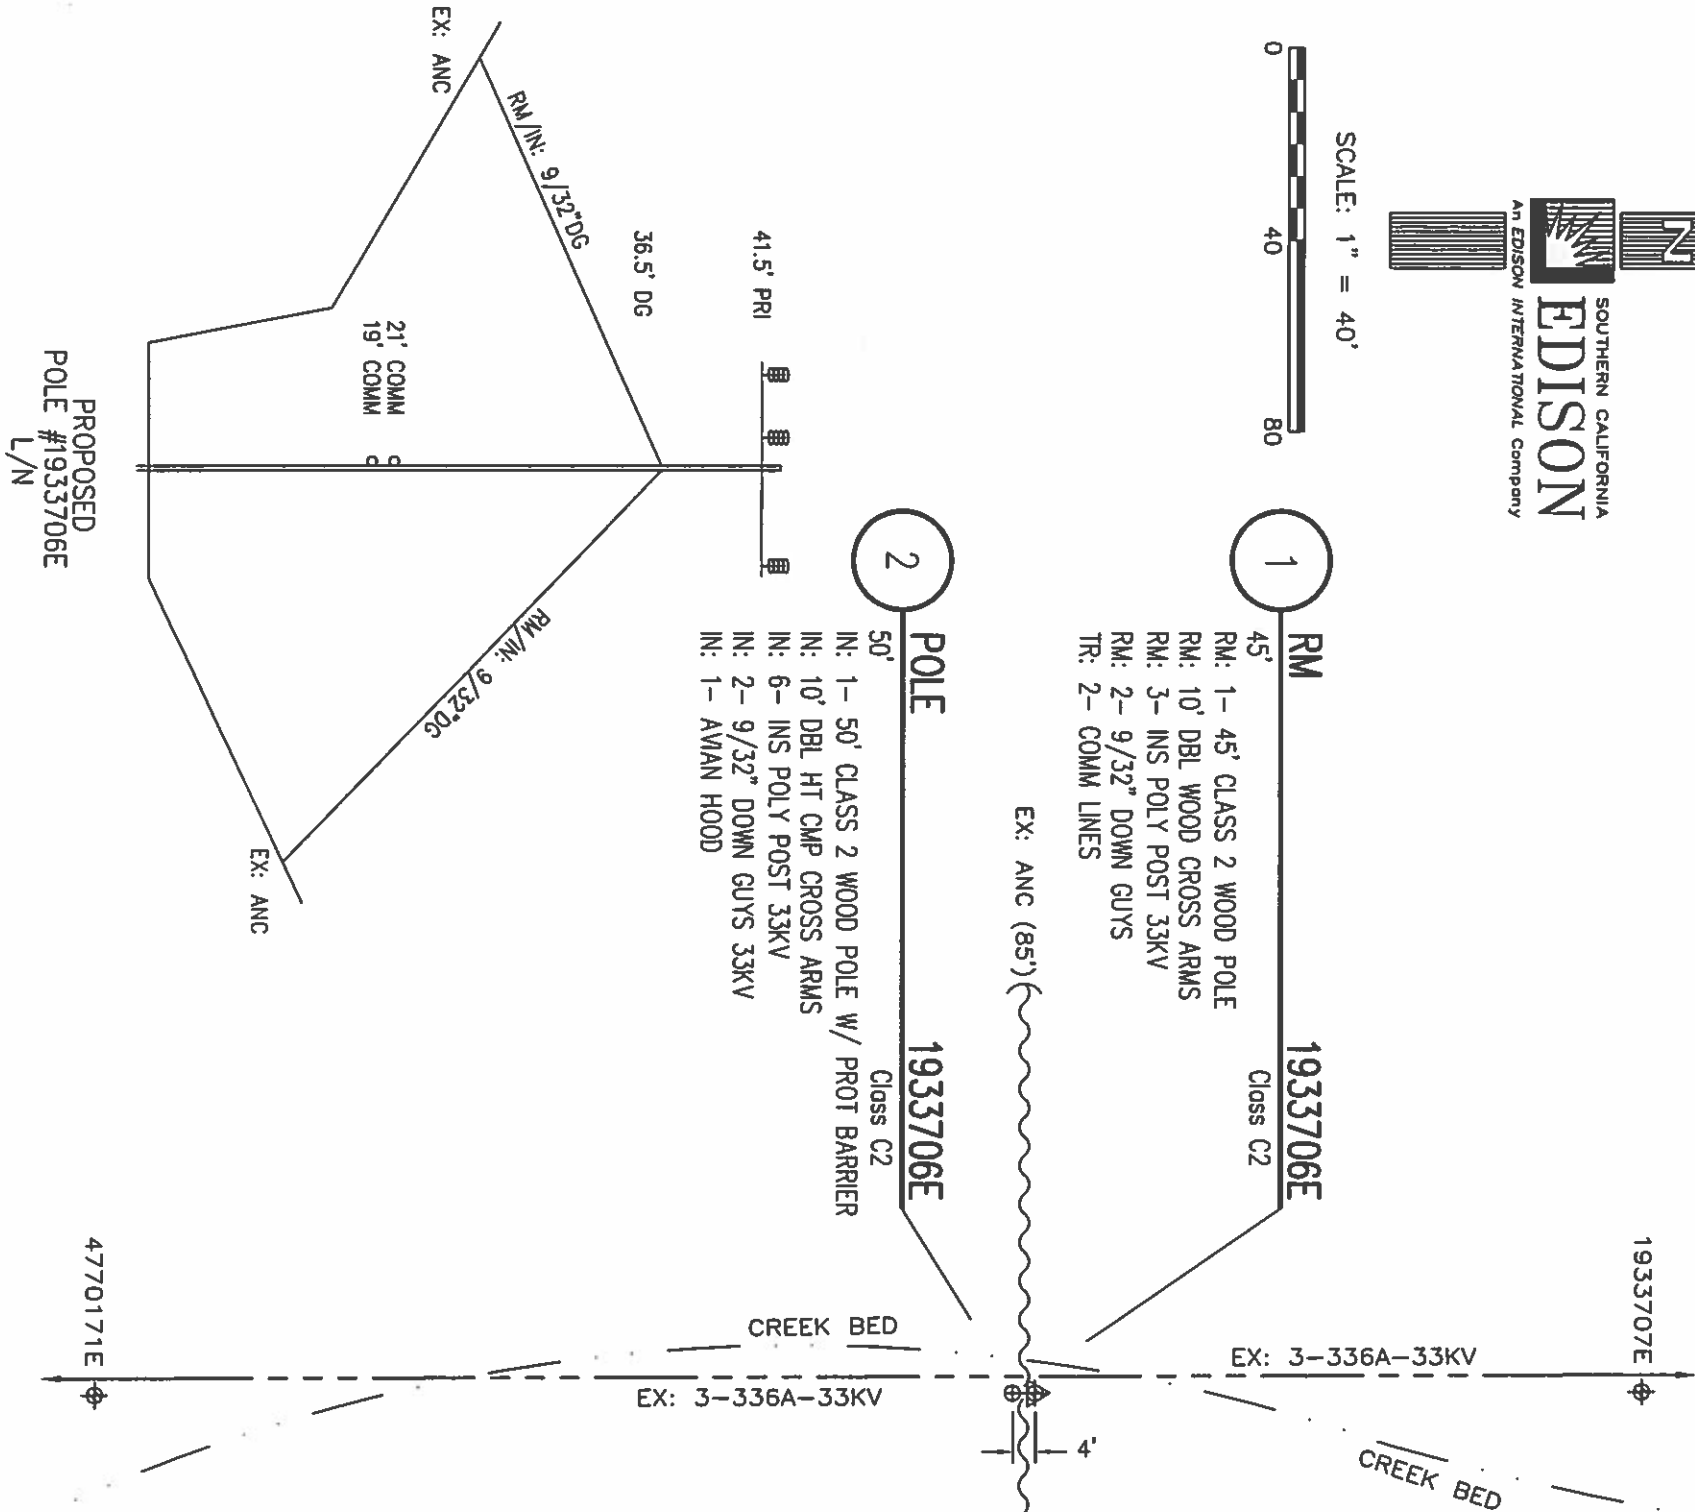

CPS COORDINATES:
34.238588, -117.146336

NOTES TO CREW:
NO TRUCK ACCESS
HELICOPTER SET AND HIKE IN
TREE TRIMMING BY CREW
WORK WITH TD1566798 AND TD1567437
COORDINATE ACCESS WITH WASTE TRANSFER STATION
REQUIRES 3-KEY TO ACCESS CLOSED LANDFILL AREA

**HEAPS PEAK 33KV
BURNT MILL SUB** **A1**

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
OUTAGE REQUIRED	☐
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐





UNDERGROUND SERVICE ALERT
Dig! 811
Call USA
For Underground Locating
2 Working Days Before You Dig

HEAVY LOADING AREA
PROJECT ELEVATION ABOVE 5000 FT

DISTRICT 40 - ARROWHEAD		PROJ. MGR. CUMMING, JAMES		PLANNER CUMMING, JAMES	
PROJECT NO. 1784047		PHONE 909-273-7029		PHONE 909-273-7029	
SERVICE REQUEST 2688484		MSG NO. N/A		PRODUCT-1	
CIRCUIT / VOLTAGE HEAPS PEAK 33KV		THOMAS GUIDE N/A		PRODUCT-2	
SUB / Pg NO. BURNT MILL A1		CIRCUIT CODE 08268		PRODUCT-3	
INVENTORY MAP 268-2256-1		J.P.A. NO. E6040-410271862		PROPOSED CONSTRUCTION (LOCATION)	
				REPLACE DETERIORATED POLE	
				COUNTY LANDFILL	
				RUNNING SPRINGS, CA	
TYPE		DATE		SHEET 1 of 1	
APPROVED BY		CHECKED BY		DESIGN/DRWG NO. 1167392_0.01	
DRAWN BY		PAX #			
Southern California Edison Company					

REPLACE DETERIORATED POLE
NOTIFICATION #410043240; DUE: 10/23/19

GPS COORDINATES:
34.239621; -117.146339

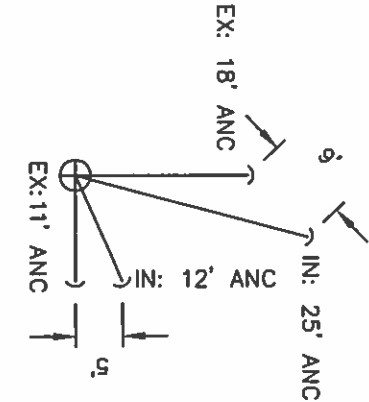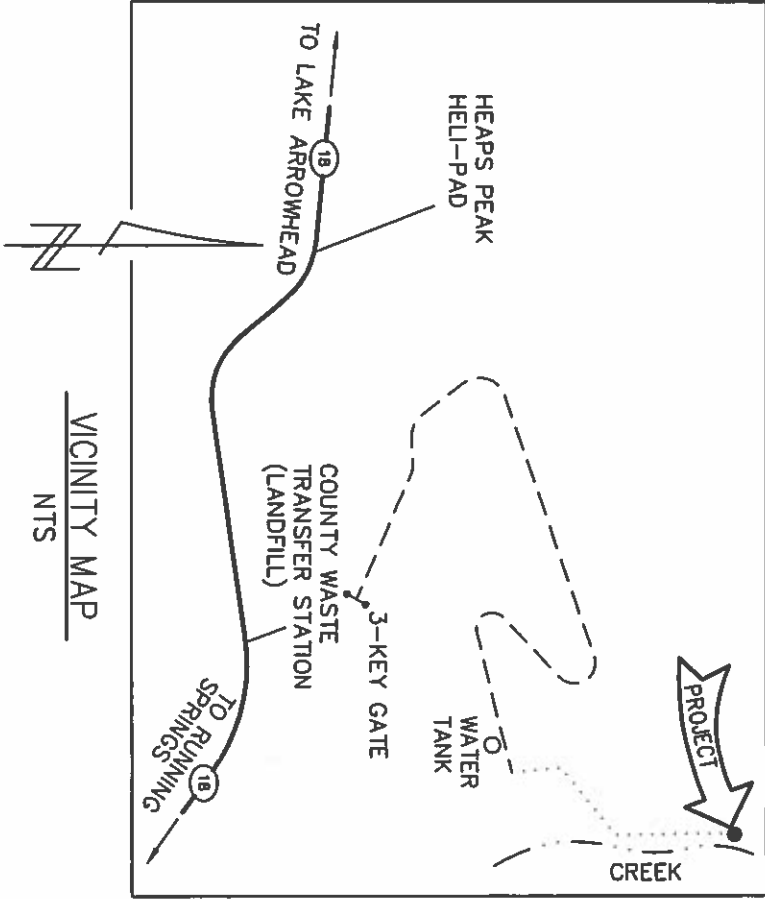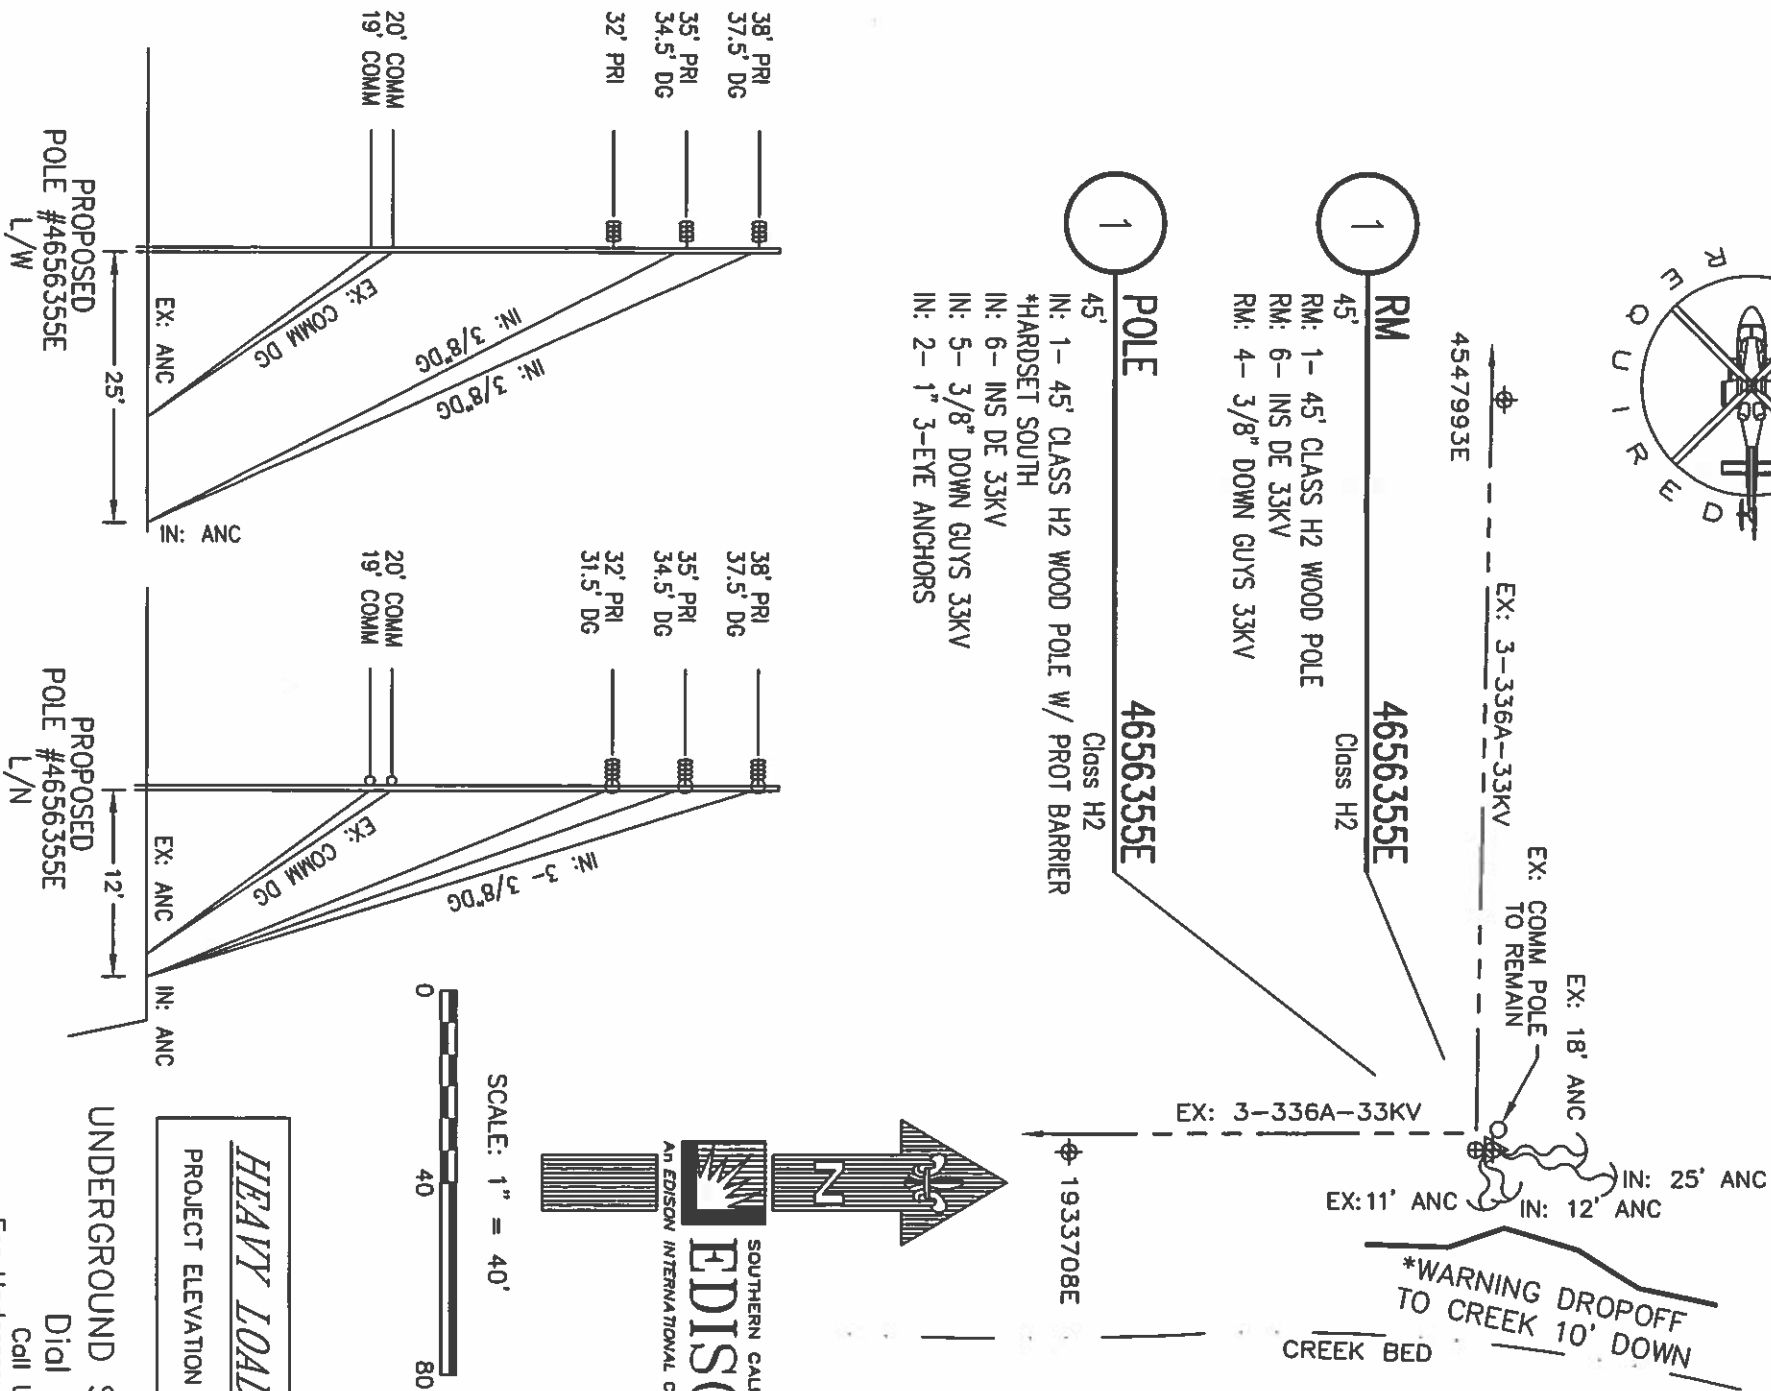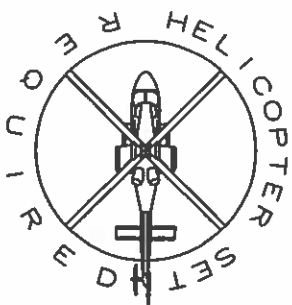

ANCHOR LAYOUT DETAIL
NOT TO SCALE

NOTES TO CREW:
NO TRUCK ACCESS
HELICOPTER SET AND HIKE IN
TREE TRIMMING BY CREW
WORK WITH TD1567438 AND TD1567437
COORDINATE ACCESS WITH WASTE TRANSFER STATION
REQUIRES 3-KEY TO ACCESS CLOSED LANDFILL AREA

HEAPS PEAK 33KV
BURNT MILL SUB **A1**

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE: <u>BLANKET</u>	
OUTAGE REQUIRED	☐
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

0124 Rev. 02/08/18

DISTRICT 40 - ARROWHEAD	PROJ. MGR. CUMMING, JAMES PHONE 909-273-7029	PLANNER CUMMING, JAMES PHONE 909-273-7029	DESIGNER CUMMING, JAMES				
PROJECT NO. 1783957	SERVICE REQUEST 2688394	MSR NO. N/A	PRODUCT-1 1566798-OCI REPLACE DET POLE				
CIRCUIT / VOLTAGE HEAPS PEAK 33KV	THOMAS GUIDE N/A	PRODUCT-2	ASSOC DESIGN				
SUB / Pg NO. BURNT MILL A1	CIRCUIT CODE 08268	PRODUCT-3	ASSOC DESIGN				
INVENTORY MAP 270-2256-1	J.P.A. NO. E6040-40271460	PROPOSED CONSTRUCTION (LOCATION) REPLACE DETERIORATED POLE COUNTY LANDFILL RUNNING SPRINGS, CA					
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET 1 OF 1	DESIGN/DRWG NO. 1166886_0.01
Southern California Edison Company							

HEAVY LOADING AREA
PROJECT ELEVATION ABOVE 5000 FT

UNDERGROUND SERVICE ALERT
Dial 811
Call USA
For Underground Locating
2 Working Days Before You Dig