

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____



Follow up status: ☐ Week 1 _____

☐ Week 2 _____


☐ Week 3 _____

NOTES:
-BULL. 322 AREA.
-SCE TO PTD.
-SAME HOLE SET REQ'D. DUE TO RISERS.
-JOINT MEET REQ'D. w/ NEXTG, FTR & CATV.
-HAND SET/DIG REQ'D.
-POLE ON PROPOERTY LINE OF 45 LANGLO TERRACE.
-NO EAGLE ZONE.

TRANSFER:
4- #6 BC 16KV
1- 4" to 2" 120/240V RISER
1-9/32" SPAN GUY

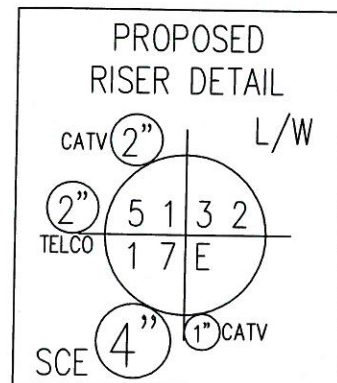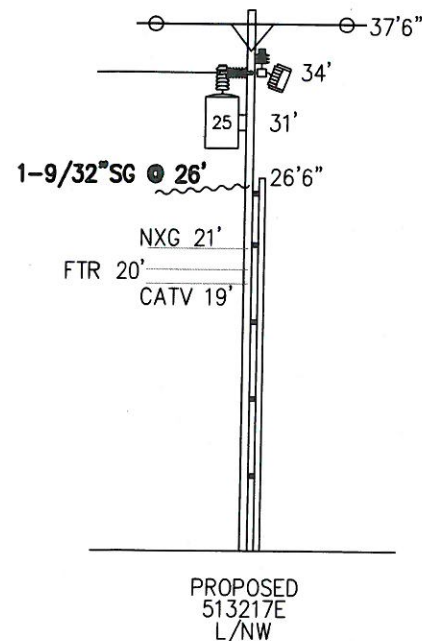

4611338E
45'



45

513218E
40'

POLE
N: 34° 26' 57.47"
W: -119° 44' 08.17"
ELEVATION: 333'

513217E

RM 513217E Class C5
40'
RM: 1- RM POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- TR OH 15KVA 16KV 120/240 1P
SN: _____
RM: 1- XA DBLE FB 10' STEEL PINS
RM: 4- INS GLASS/POLY 35KV & LESS
RM: 2- INS GLASS & PIN 16KV
RM: 1- XA SNGL FB 10' STEEL PINS SECONDARY
RM: 4- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- SEC 2" PVC FOR UNDER ARM W/#2 TW
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
RM: 1- AG ANCHOR ROD 5/8" X 8' 1-EYE W/PLATE
RM: 2- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

ONTARE RD.


LANGLO TERRACE

T.L.M. DATA:				
	SIZE	KVA	CUST	% LOAD
EXIST.	15	9.55	2	63.66%
PROP.	25	9.55	2	38.2 %
VOLTAGE DROP: _____				
FLICKER FACTOR: _____				
PRI. CIRCUIT: HURST 16KV				

45' Class C1
IN: 1- POLE 45' CLASS 1 RS COMP SEC POLE
IN: 1- TR OH 25KVA 16KV 120/240 1P
SN: _____
IN: 2- FE FH SMD20 17" 200A 16KV 1-EA
IN: 2- FE FUSE SMU20 17KV 6K
IN: 2- XA SNGL DE HD COMP 10' W/BKT
IN: 4- INS POLY DE 16KV RIG #6
IN: 2- INS POLY W/PIN 16KV CLMP #6-4/0 CU
IN: 1- RSR PRECUT UNISTRUT W/ HARDWARE NO PVC
IN: 1- COMPOSITE POLE RISER SUPPORT
IN: 4- OH GUYING TEE W/HARDWARE CMP & WOOD
IN: 1- AG ANCHOR ROD 1" X 10' 3-EYE W/PLATE
IN: 3- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- GR CMP OH #6 SOL WP SECONDARY W/ROD



NOT TO SCALE

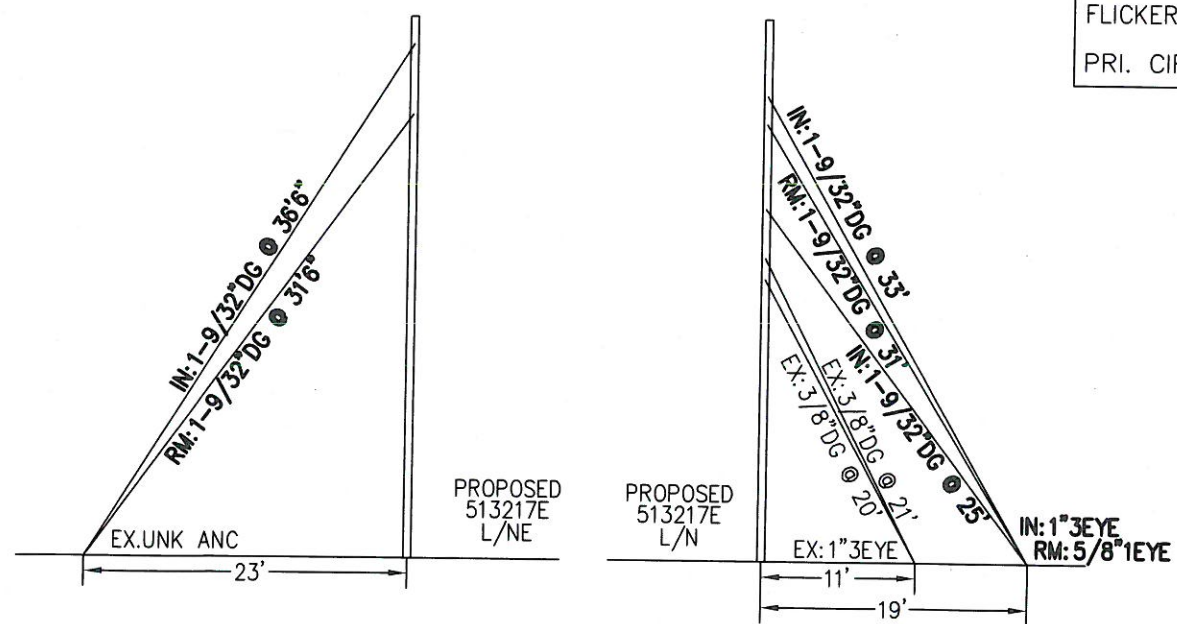


PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☒
OUTAGE DATE:	
TIME:	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 49 - SANTA BARBARA			PROJ. MGR. PARK, JU YOUNG PHONE 909-222-9350			PLANNER TIDWELL DESIGN PHONE 805-647-4707			DESIGNER TIDWELL DESIGN		
PROJECT NO. 1547003		SERVICE REQUEST 2457652		MSR NO.		PRODUCT-1 1360091-INFRA REPLAC - DET POLE REPLACEMENT				ASSOC DESGN	
CIRCUIT / VOLTAGE HURST 16KV				THOMAS GUIDE N/A		PRODUCT-2				ASSOC DESGN	
SUB / PG NO. SAN MARCOS				CIRCUIT CODE		PRODUCT-3				ASSOC DESGN	
INVENTORY MAP 18-56C			J.P.A. NO. E6049-409363354			PROPOSED CONSTRUCTION (LOCATION) 513217E 45 LANGLO TERRACE, SANTA BARBARA					
					TIDWELL						
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET			DESIGN\DRWG NO.		
Southern California Edison Company						OF			1002334 0 01		

461338E

LIN

05/09/2018

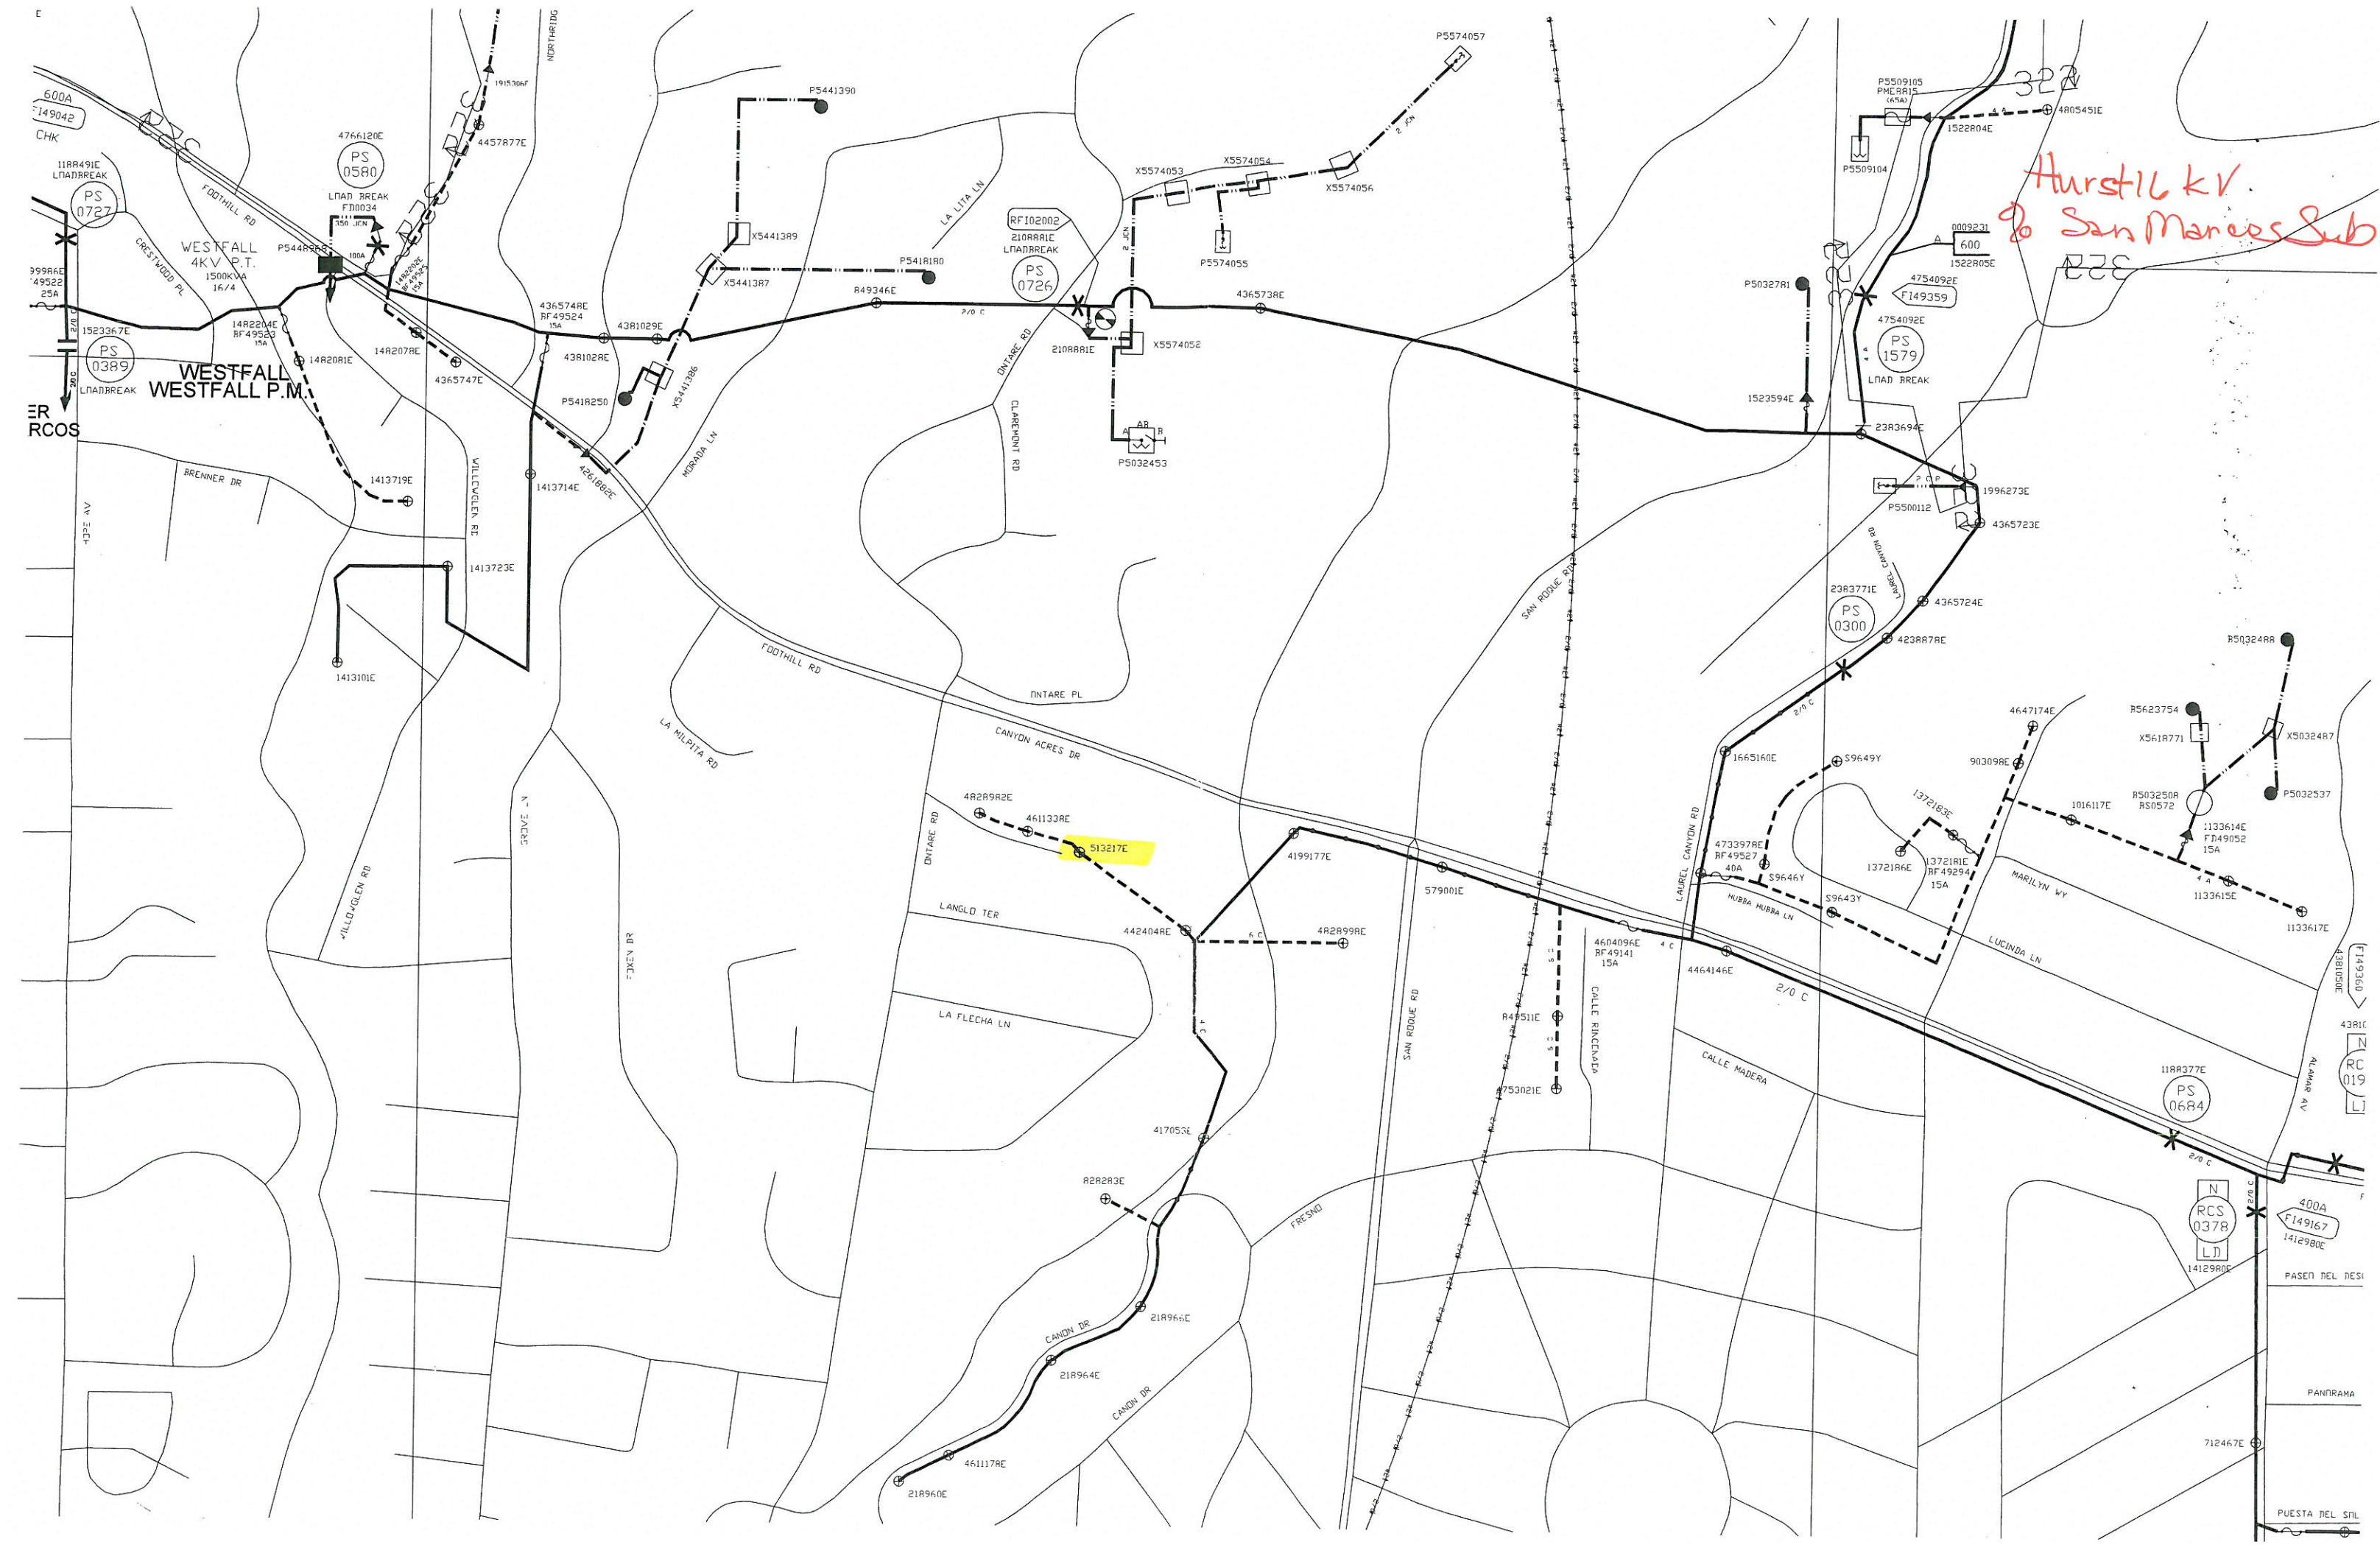

Hurst 16 KV
& San Marcos Sub

513217E