

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____




☐ Week 2 _____

☐ Week 3 _____

* NOTES: JOINT POLE
ENVIRO POLE - WOODPECKER DAMAGE
REAR PROPERTY LINE POLE
TREE TRIMMING REQ'D
BULLETIN 322 AREA
EAGLE ZONE
+2 MILES FROM SUB
HAND SET
SET SAME HOLE

TRANSFER (S):
2/C 4A-16KV
1-1/OAT-120V (N)
1-9/32" SPAN GUY
1-3" SEC RISER

1 RM 4154884E Class C4
50'
RM: 1- RM POLE 50' CLASS 4 WOOD FULL TREAT
RM: 1- TR OH 15KVA 16KV 120/240 1P
SN: _____
RM: 2- FE CO OPEN 100A 16KV 1-EA
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 2- INS GLASS & PIN 16KV
RM: 2- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD

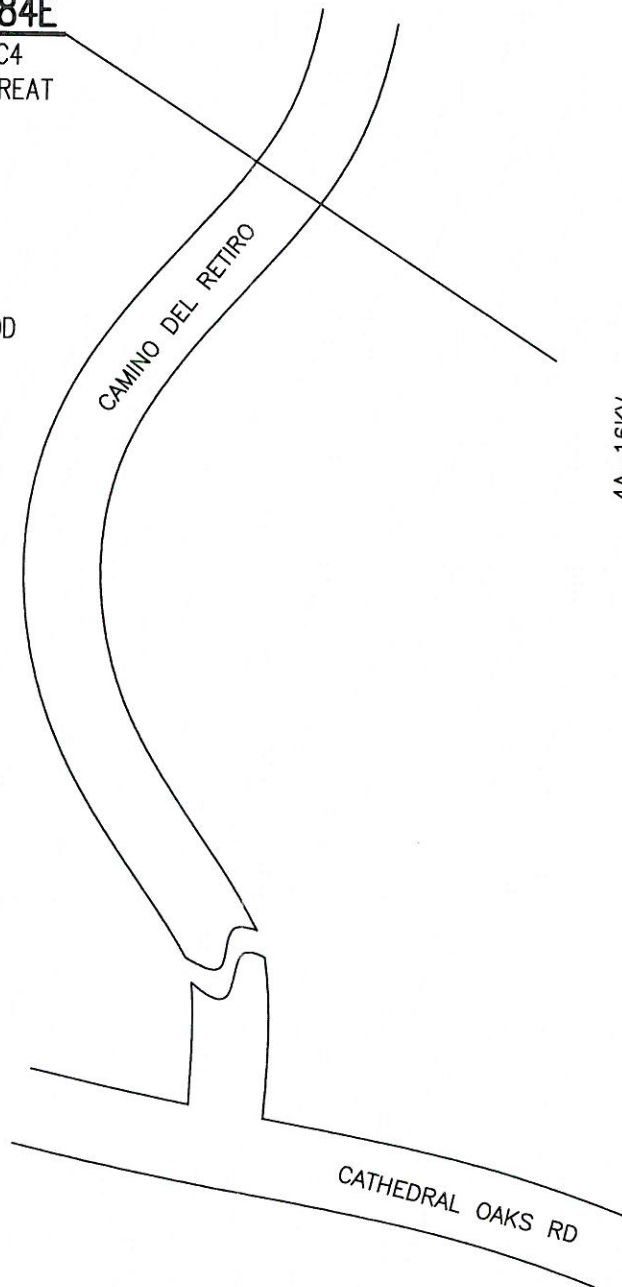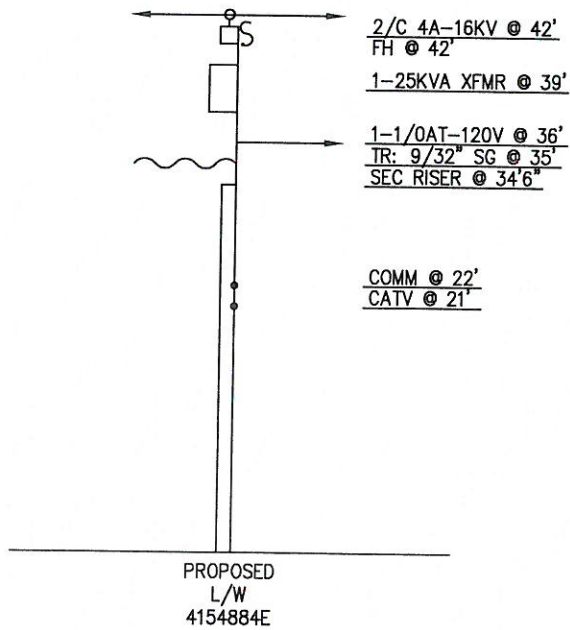

N 34° 27' 22.13"
W 119° 46' 31.35"
ELEVATION: 339'
POLE 4154884E Class C4
50'
IN: 1- POLE 50' CLASS 4 WOOD FULL TREAT
IN: 1- TR OH 25KVA 16KV 120/240 1P
SN: _____
IN: 2- FE CO MNT FOR ELF 100A 16KV 1-EA
IN: 2- FE FUSE ELF 15KV 6A
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 2- INS POLY W/PIN 16KV CLMP #4-653 ACSR
IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD

T.L.M. DATA:

	SIZE	KVA	CUST	% LOAD
EXIST.	15	13.7	2	91.3 %
PROP.	25	13.7	2	54.8 %

VOLTAGE DROP: _____
FLICKER FACTOR: _____
PRI. CIRCUIT: HURST 16KV



NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☒
OUTAGE DATE:	TIME:
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 49 - SANTA BARBARA			PROJ. MGR. PARK, JU PHONE 909-222-9350			PLANNER ASP PHONE 714-893-2405			DESIGNER ASP		
PROJECT NO. 1665829		SERVICE REQUEST 2572953		MSR NO.		PRODUCT-1 1456472-INFRA REPLAC - DET POLE REPLACEMENT				ASSOC DESGN	
CIRCUIT / VOLTAGE HURST 16KV				THOMAS GUIDE		PRODUCT-2				ASSOC DESGN	
SUB / PG NO. SAN MARCOS SUB				CIRCUIT CODE		PRODUCT-3				ASSOC DESGN	
INVENTORY MAP 19-53D			J.P.A. NO. 409693938			PROPOSED CONSTRUCTION (LOCATION) 4154884E CAMINO DEL RETIRO PL/E, 1,503' N/O CATHEDRAL OAKS RD GOLETA, CA					
					ASP						
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET			DESIGN\DRWG NO.		
Southern California Edison Company						_____ OF _____			1079584_0.01		

4154884E

