

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

- NOTES:
- SCE TO CUT ABOVE COMM.
 - AT&T TO PTD.
 - HARD SET NORTH EAST QUADRANT.
 - EAGLE ZONE.
 - HAND SET.
 - HAND DIG.
 - BULLETIN 322 AREA.

TRANSFER:

- 6-1/0ACSR 12KV



HIGH FIRE
TIER 2
LOCATION

SECTIONAL COMPOSITE

- 1 RM 4079852E Class C5
- 40'
- RM: 1- RM POLE 40' CLASS 5 WOOD FULL TREAT
- RM: 2- XA DBLE VB 10' STEEL PINS
- RM: 6- INS GLASS/POLY 35KV & LESS
- RM: 4- INS GLASS & PIN 12KV
- RM: 2- AG DOWN GUY 5/16" - 50' LESS THAN 22.5KV

EX: 3-1/0ACSR 12KV
324'

GPS COORDINATES
N: 34° 48' 27.46"
W: 118° 53' 14.15"
ELEVATION: 4665'

CREW TO MOVE CENTER
NEUTRAL PHASES TO NW
SIDE OF POLE FOR JUMPERS

- 2 POLE 4079852E Class C1
- 45'
- IN: 1- POLE 45' CLASS 1 COMP SEC POLE
- IN: 2- XA DBL HD DE COMP 10'
- IN: 6- INS POLY DE 12KV HOT SHOE #4 & 1/0
- IN: 4- INS POLY W/PIN 12(25)KV CLMP #4-336 ACSR
- IN: 1- AG DOWN GUY 3/8" - 50' LESS THAN 22.5KV
- IN: 1- AG DOWN GUY 7/16" - 50' LESS THAN 22.5KV
- IN: 2- OH GUYING TEE W/HARDWARE CMP & WOOD

CATV 22'3"
TELCO 21'3"
CATV 22'6"
TELCO 21'6"


ELEVATION -1'
EX: 1-1"3EYE ANC

ELEVATION -1'
EX: 1-3/4" 2EYE ANC

PROPOSED
4079852E
L/N


GROUND
LEVEL

PROJECT REQUIREMENTS (Y/N)		DISTRICT 36 - ANTELOPE VALLEY		PROJ. MGR. TOLMASOFF, LAURA M PHONE 714-796-9811		PLANNER TIDWELL DESIGN PHONE 805647-4707		DESIGNER TIDWELL DESIGN	
EDISON EASEMENT REQUIRED	☒	PROJECT NO.	1637641	SERVICE REQUEST	2545519	MSR NO.		PRODUCT-1	1433770-INFRA REPLAC - DET POLE REPLACEMENT
PWRD 88 REQUIRED	☒	CIRCUIT / VOLTAGE	RIDGE 12KV	THOMAS GUIDE	N/A			PRODUCT-2	
UG CIVIL ONLY WORK ORDER	☒	SUB / PG NO.	GORMAN	CIRCUIT CODE				PRODUCT-3	
PERMIT REQUIRED	☒	INVENTORY MAP	157-38	J.P.A. NO.	E6036-409512985	PROPOSED CONSTRUCTION (LOCATION) 4079852E 1055' W/O PEACE VALLEY RD., '622' N/O FALCON WAY LEBEC			
PERMIT TYPE:		OUTAGE DATE:		TIME:		DESIGN\DRWG NO. 1061629_0.01			
OUTAGE REQUIRED	☒	TRAFFIC CONTROL REQUIRED	☒	PED. TRAFFIC CONTROL REQ'D	☒	CONVEYANCE LETTER REQ'D	☒	ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒	TYPE		DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET
Southern California Edison Company									

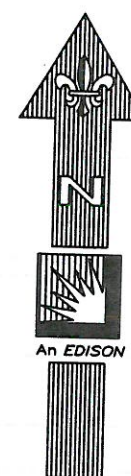

NOT TO SCALE

4079852E

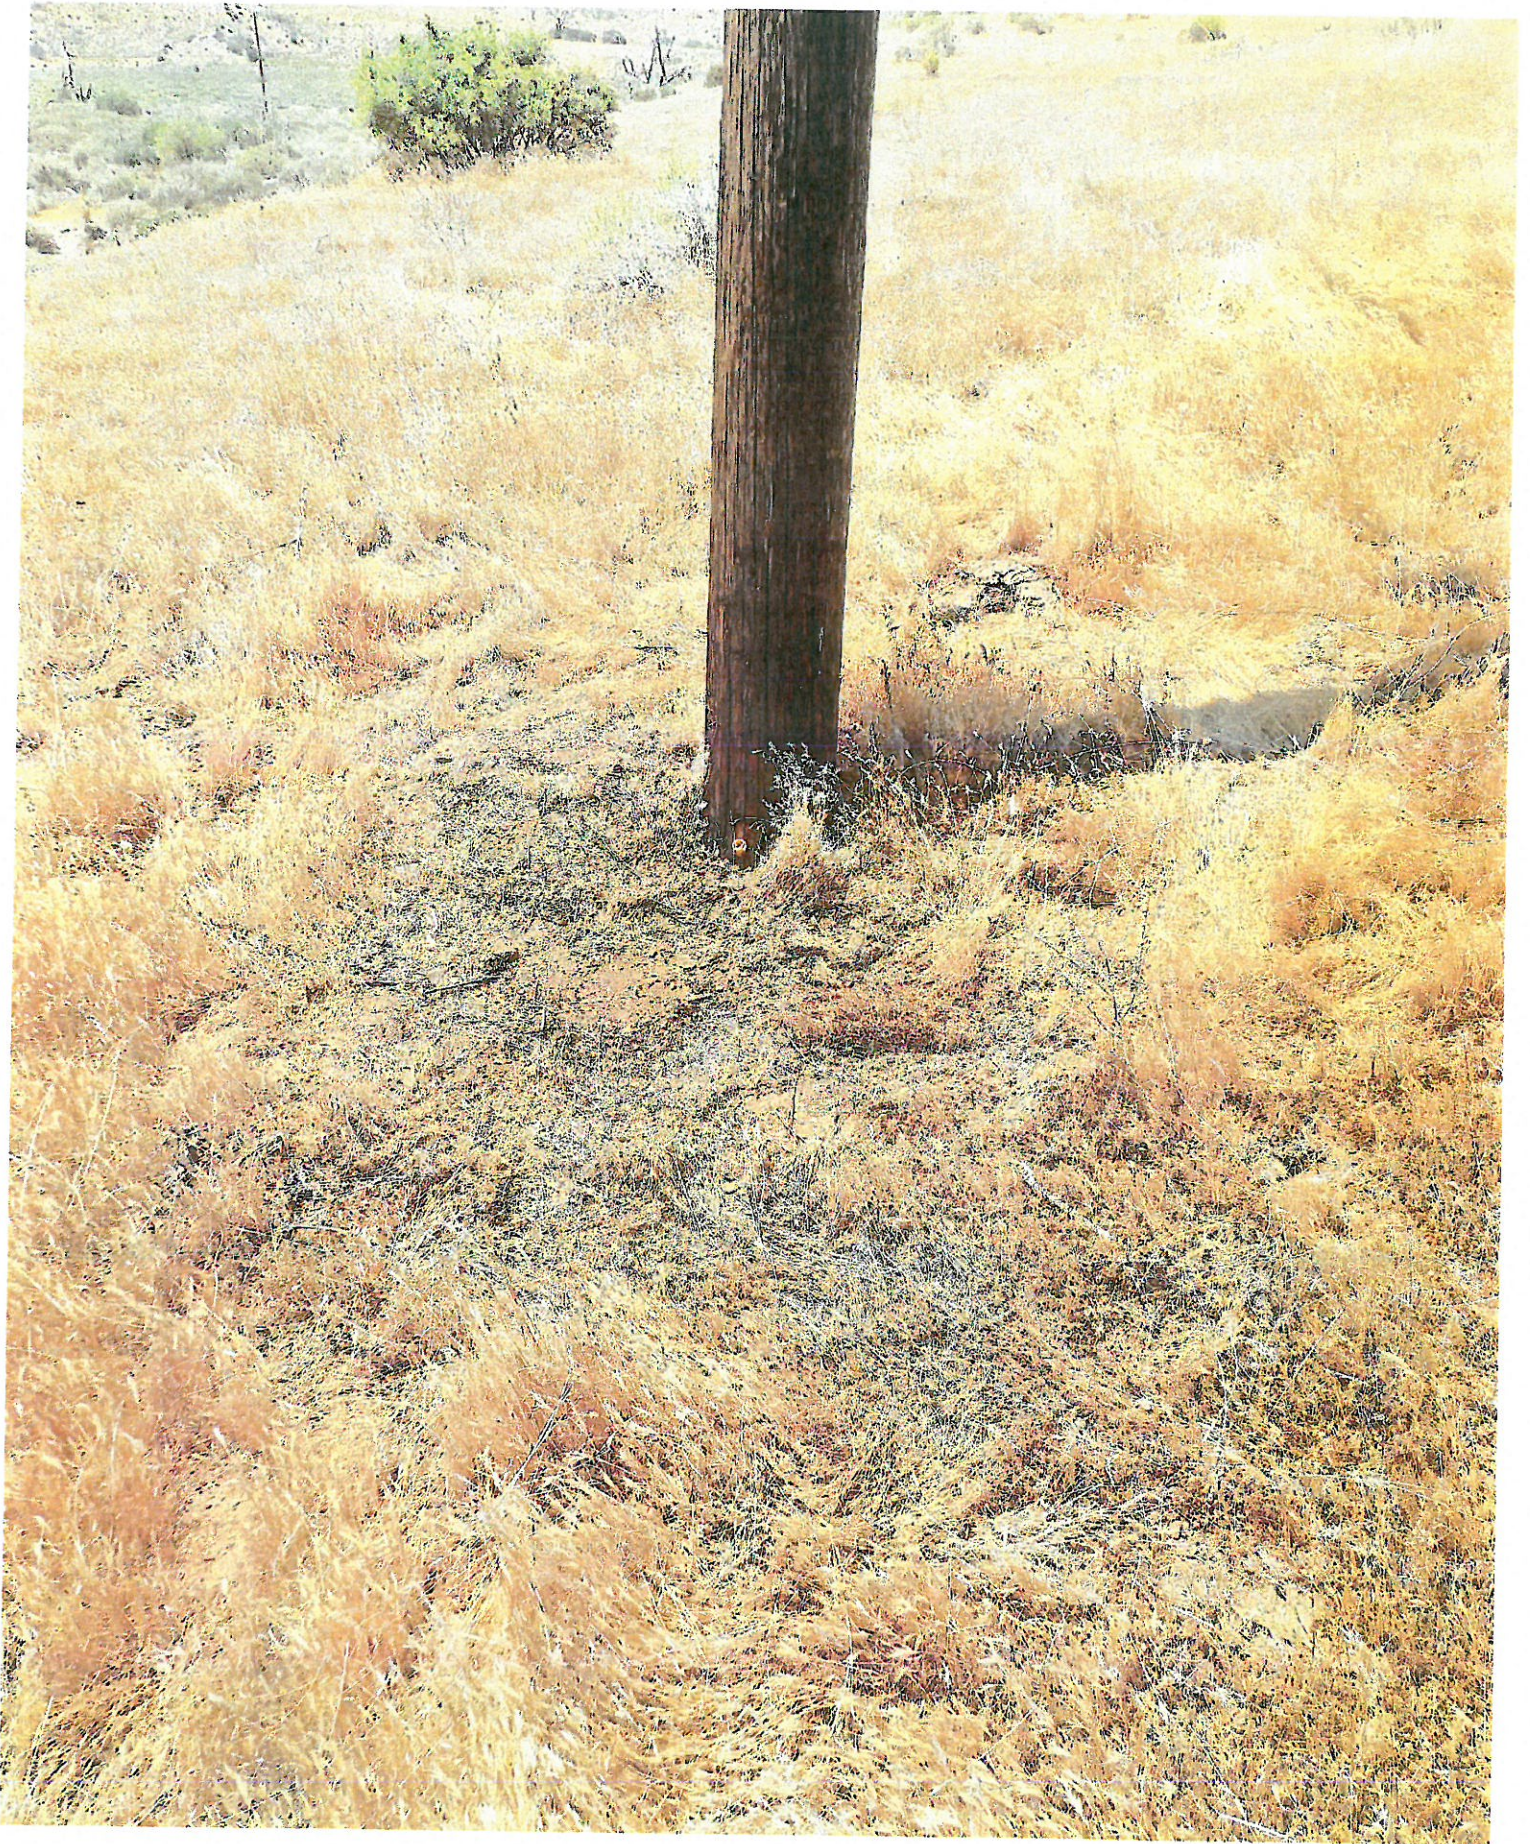

Dist. 36 Deteriorated Pole
L / W

4079852E




Dist. 36 Deteriorated Pole
L / N

4079852E




Dist. 36 Deteriorated Pole
L / W

4079852E

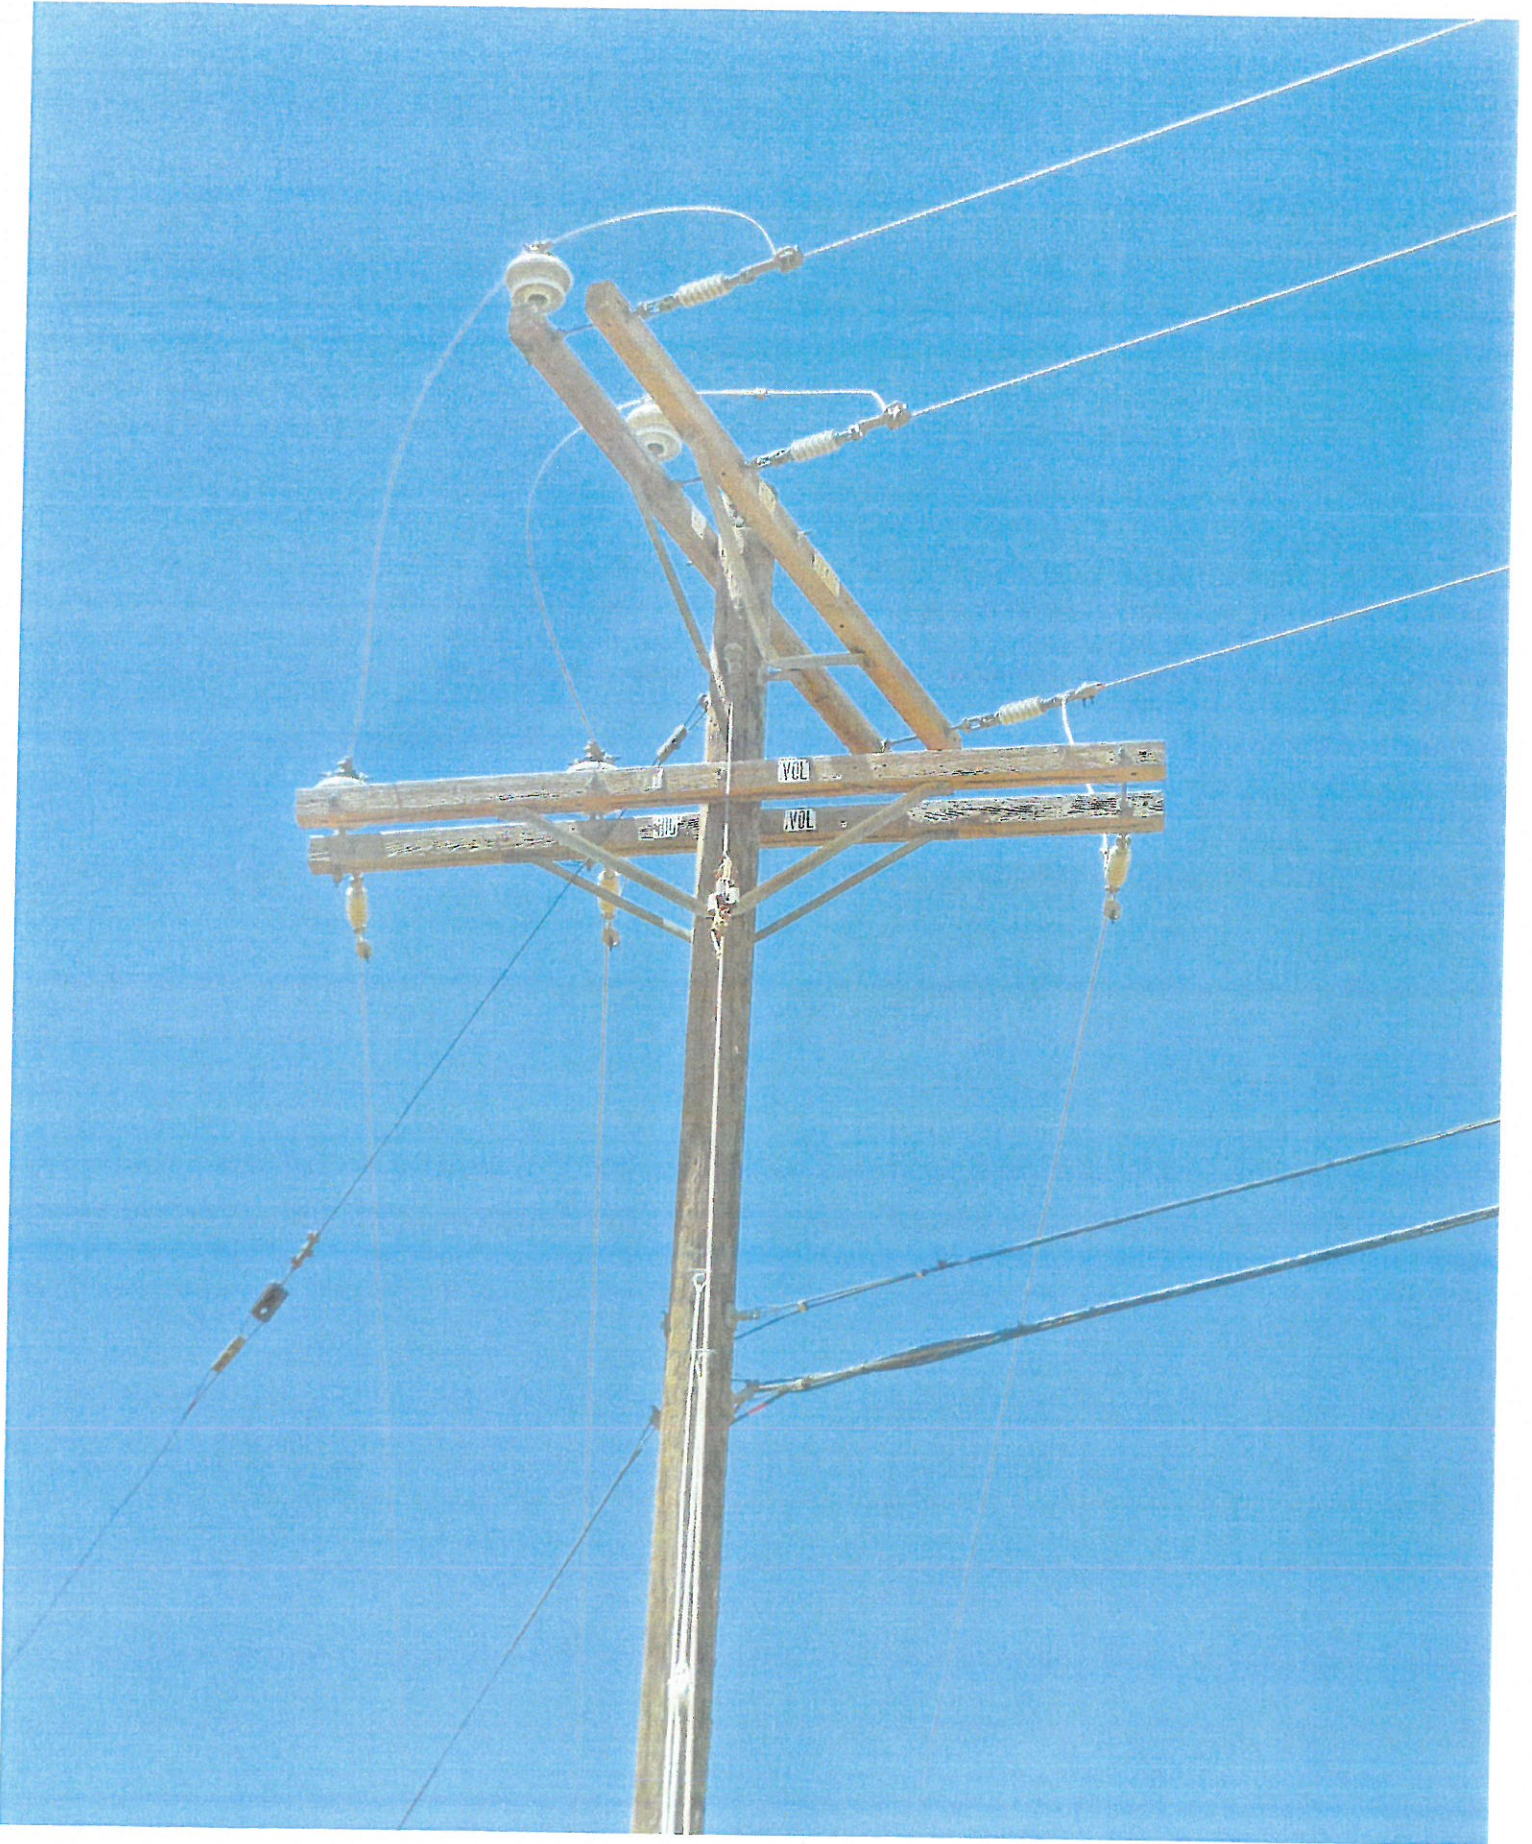


Dist. 36 Deteriorated Pole
L / W

4079852E

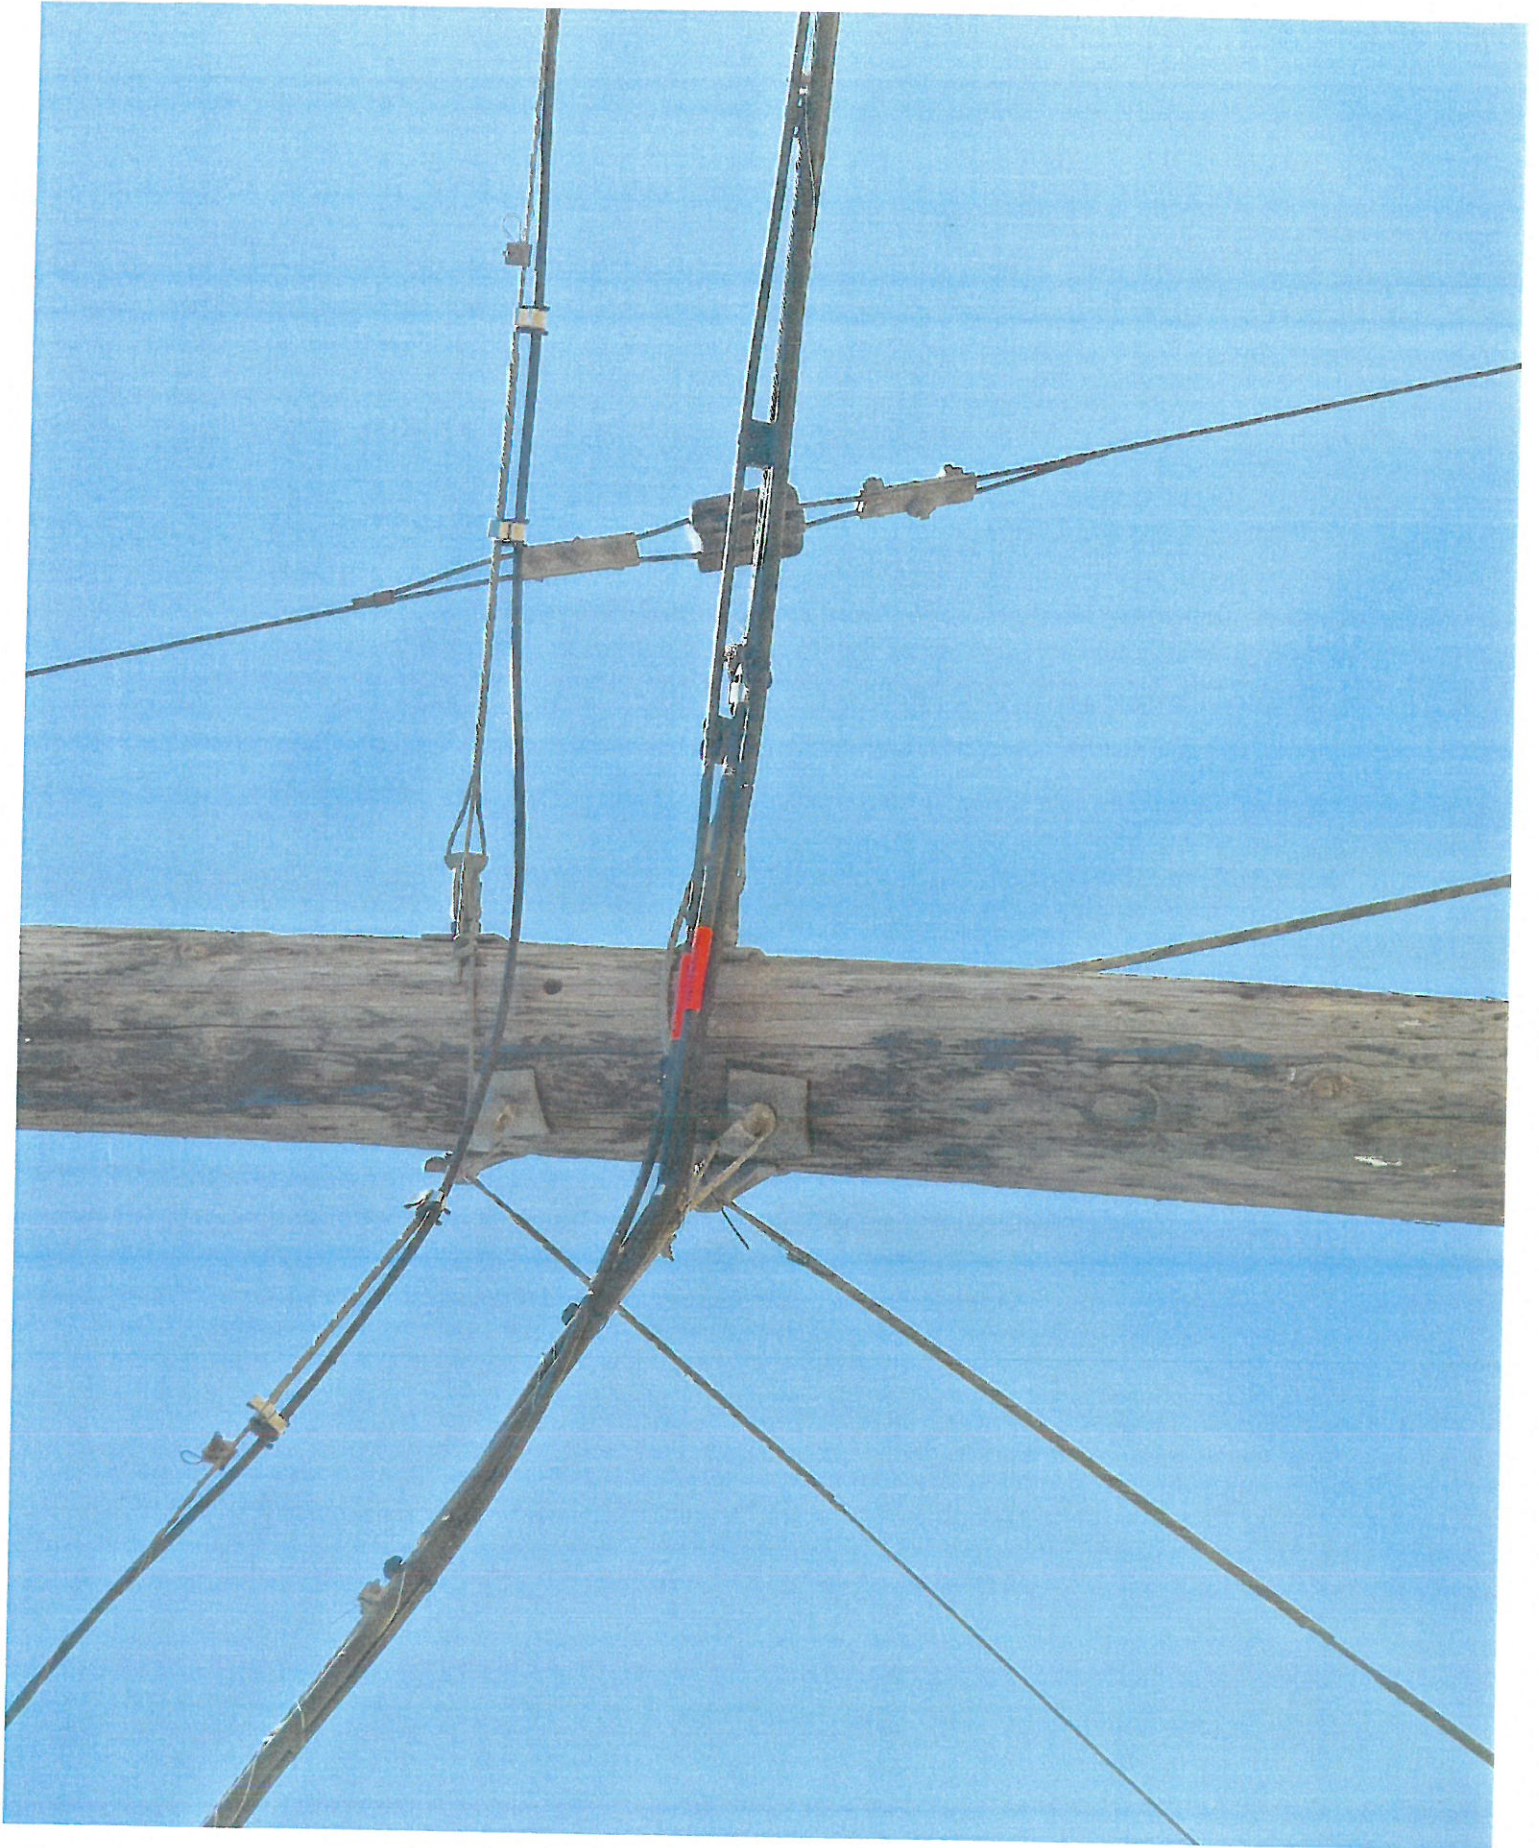

Dist. 36 Deteriorated Pole
L / S

4079852E

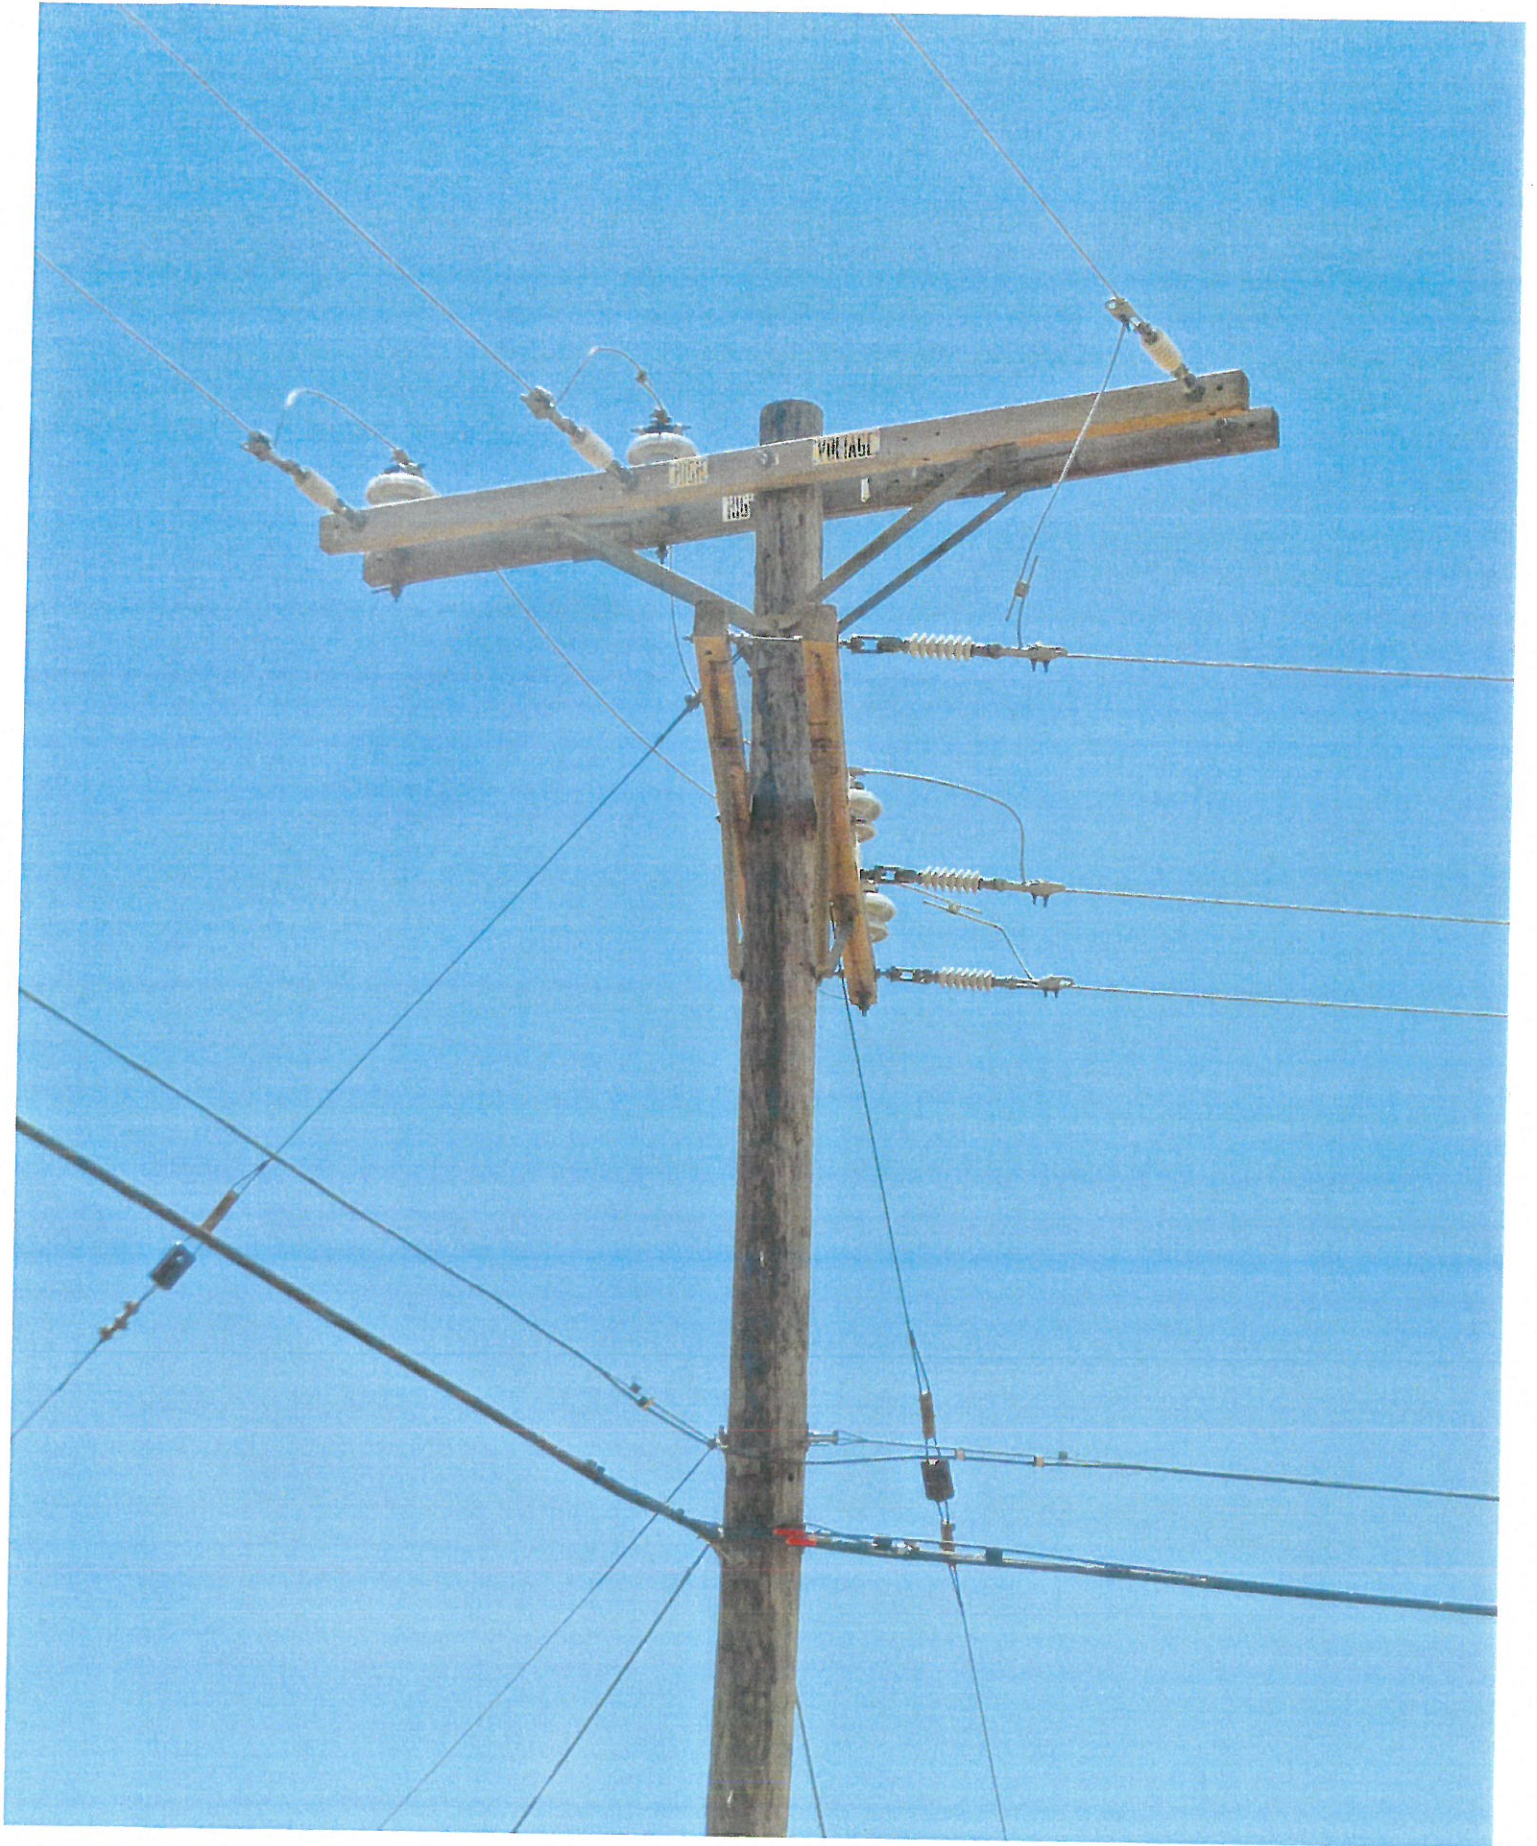


Dist. 36 Deteriorated Pole
L / S

4079852E



Dist. 36 Deteriorated Pole
L / N

4079852E

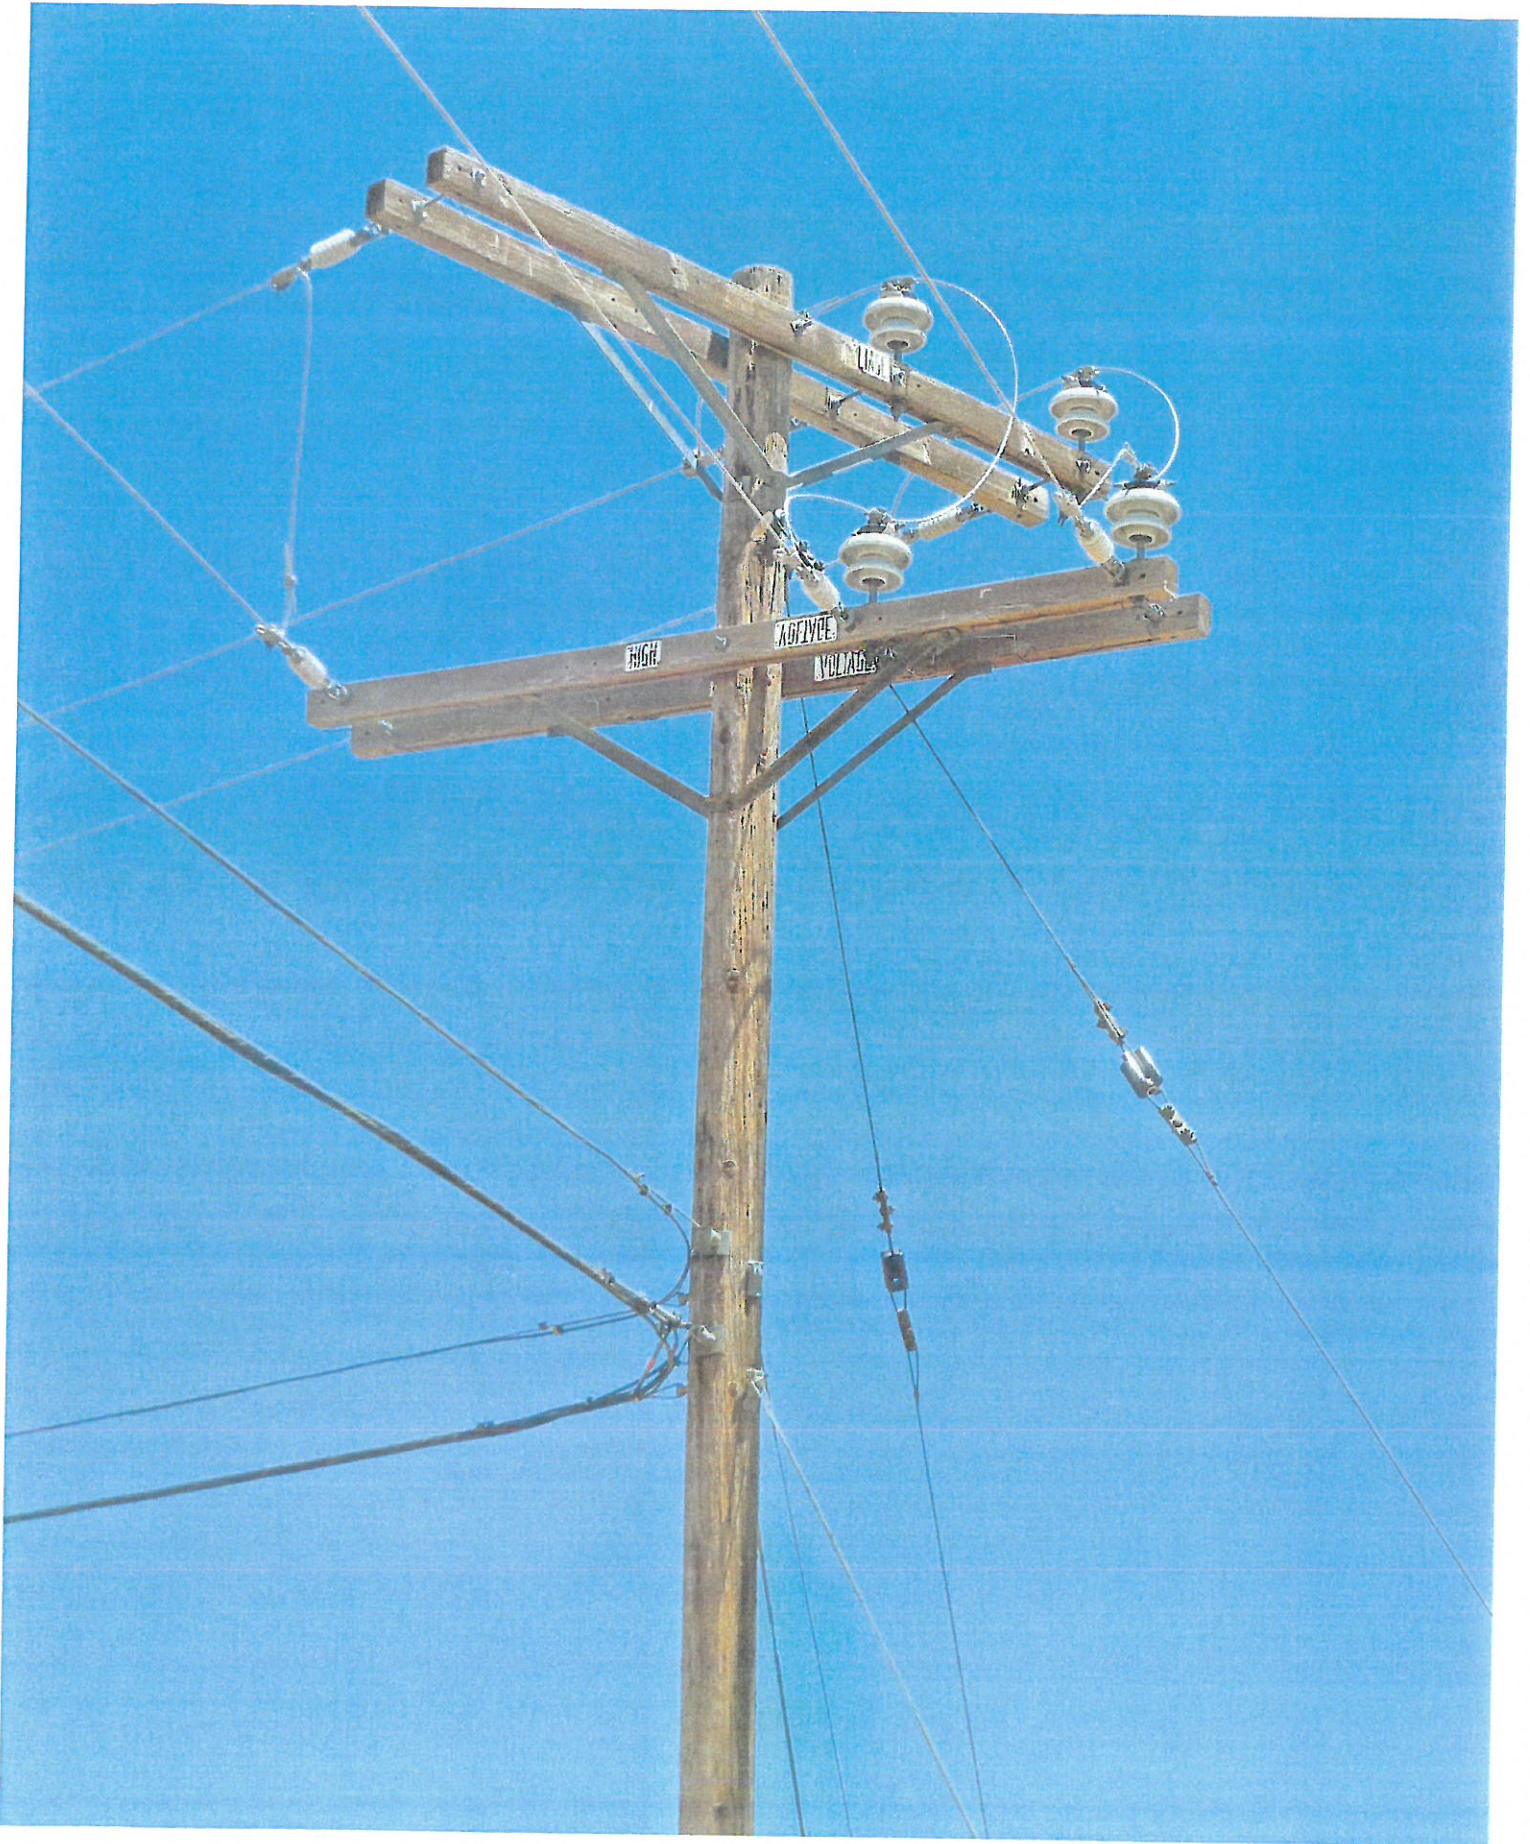

Dist. 36 Deteriorated Pole
L / E