

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

TD 1493751

- VIEW NOTES:
- TRANSFER ALL WIRE
 - USE EX ANCHOR
 - SAME HOLE SET
 - TOP OF TORO CYN USE CODE ## 4602

SANTA BARBARA CO. 19-65C

- 1 RM: 1675193E POLE
- RM: 1- 45' CL 4 DF
 - RM: 1- 10' DBL X ARM - 16KV
 - RM: 1- 10' SINGL X ARM - 16KV
 - RM: 5- PORC DE BELL - 16KV
 - RM: 2- PORC ENS. 16KV
 - RM: 2- 7/32" D.G.
 - RM: 1- 284 RACK

- IN: 1675193E POLE 2
- IN: 1- 45' CL 2 - DF-TB
 - IN: 1- COMP 10' - DBL - X ARM - 16KV
 - IN: 1- COMP 10' - SINGL X ARM - 16KV
 - IN: 7- POLY #4 - 1/0 ACSR D.E. - 16KV
 - IN: 2- POLY ENS - 16KV
 - EN: 2- 3/8" D.G.
 - EN: 1- 166 ROLLER

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☒
PWRD 88 REQUIRED	☒
PERMIT REQUIRED	☒
PERMIT TYPE: _____	
OUTAGE REQUIRED	☒
OUTAGE DATE: _____ Time: _____	
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒

NOT TO SCALE


INSPECTED BY _____
DATE INSPECTED _____



CIRCUIT:		SUBSTATION:		STA #:	
PLANNER L. Smead	JOB NAME DCF- POLE REPLACEMENT	FOREMAN	DISTRICT 49-Santa Barbara		
DWO TD1493751	JOB LOCATION TORO CYN RD EXT'D 80'E 7810' N/O E RD.	TRUCK	P/E	DATE SENT TO R/W	DIST SKETCH
A.I. NO.	TLM-CSD 140 REQUIRED YES NO X	T.L.M. DATA: SIZE KVA CUST %LOAD		DRAWN BY L. Smead	
		EXIST. PROP.		WORKED BY	
J.P.A. NO. E6049-409871988	T.G. PAGE	VOLTAGE DROP % Flicker		INV MAP NO.'S	
RELATED W.O. TD1493753				INV MAP NO.'S VERIFIED () X	

PROPOSED
L/E

PROPOSED
L/N

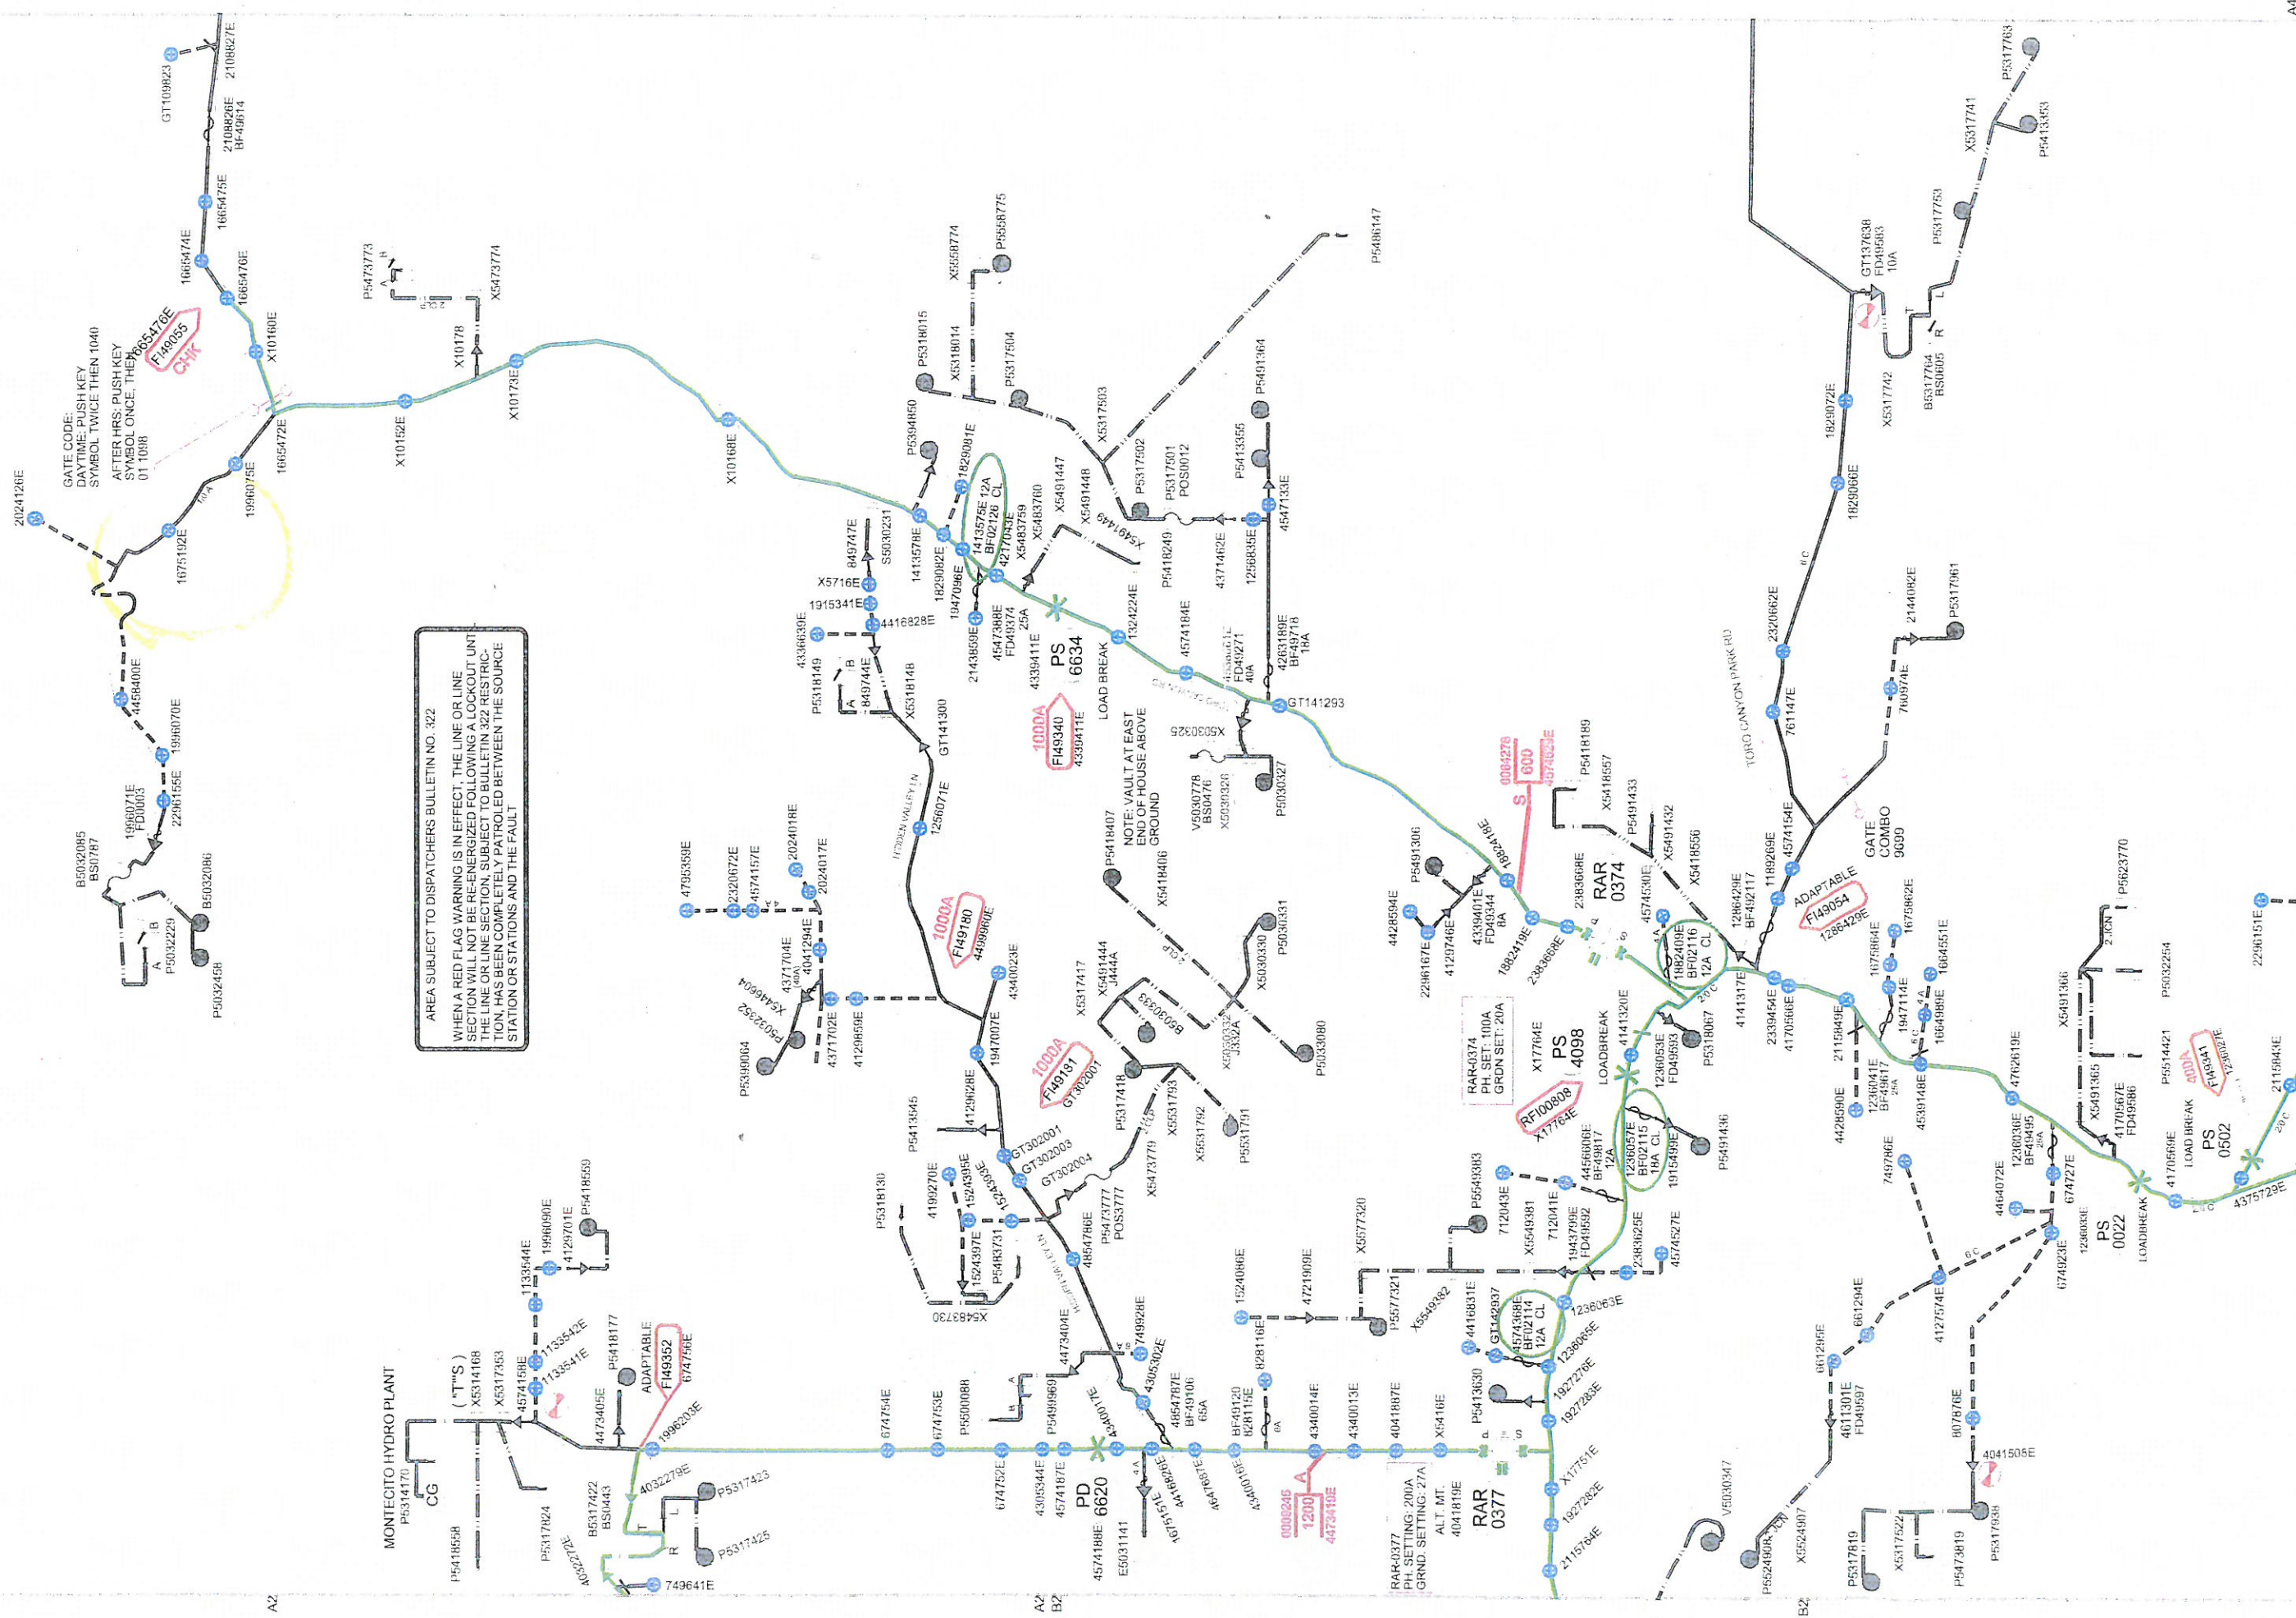

FOREMEN	DATE	SYSTEM: GOLETA
BESCH	01/14/2019	PRIORITY NOTIFICATION :
W.RHODESHL	12/04/2018	FAULT INDICATORS ON
STA BARB	49	LOOP STATIONS :
EQUIP	400	AUTOMATIC SW. GEAR (SCADA):
		NETCOMM EQUIPMENT :

SHEFFIELD 16KV
CODE: 16310

CARPINTERIA SUB (D5)
CODE: 5503

NO
NO
NO

A3