

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____



CREW NOTES:

- SAME HOLE SET
- TRANSFER ALL OH WIRES
- TRANSFER L.A'S
- TRANSFER - POT HEADS & RTSEF

TOP OF TORO CYN
LEFT GATE
CODE: H# 4602

JAY @ 1204 Toro CYN
PHONE #: 805-969-1841

SANTA BARBARA CO. 19-65C

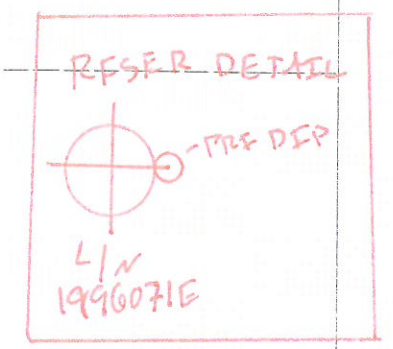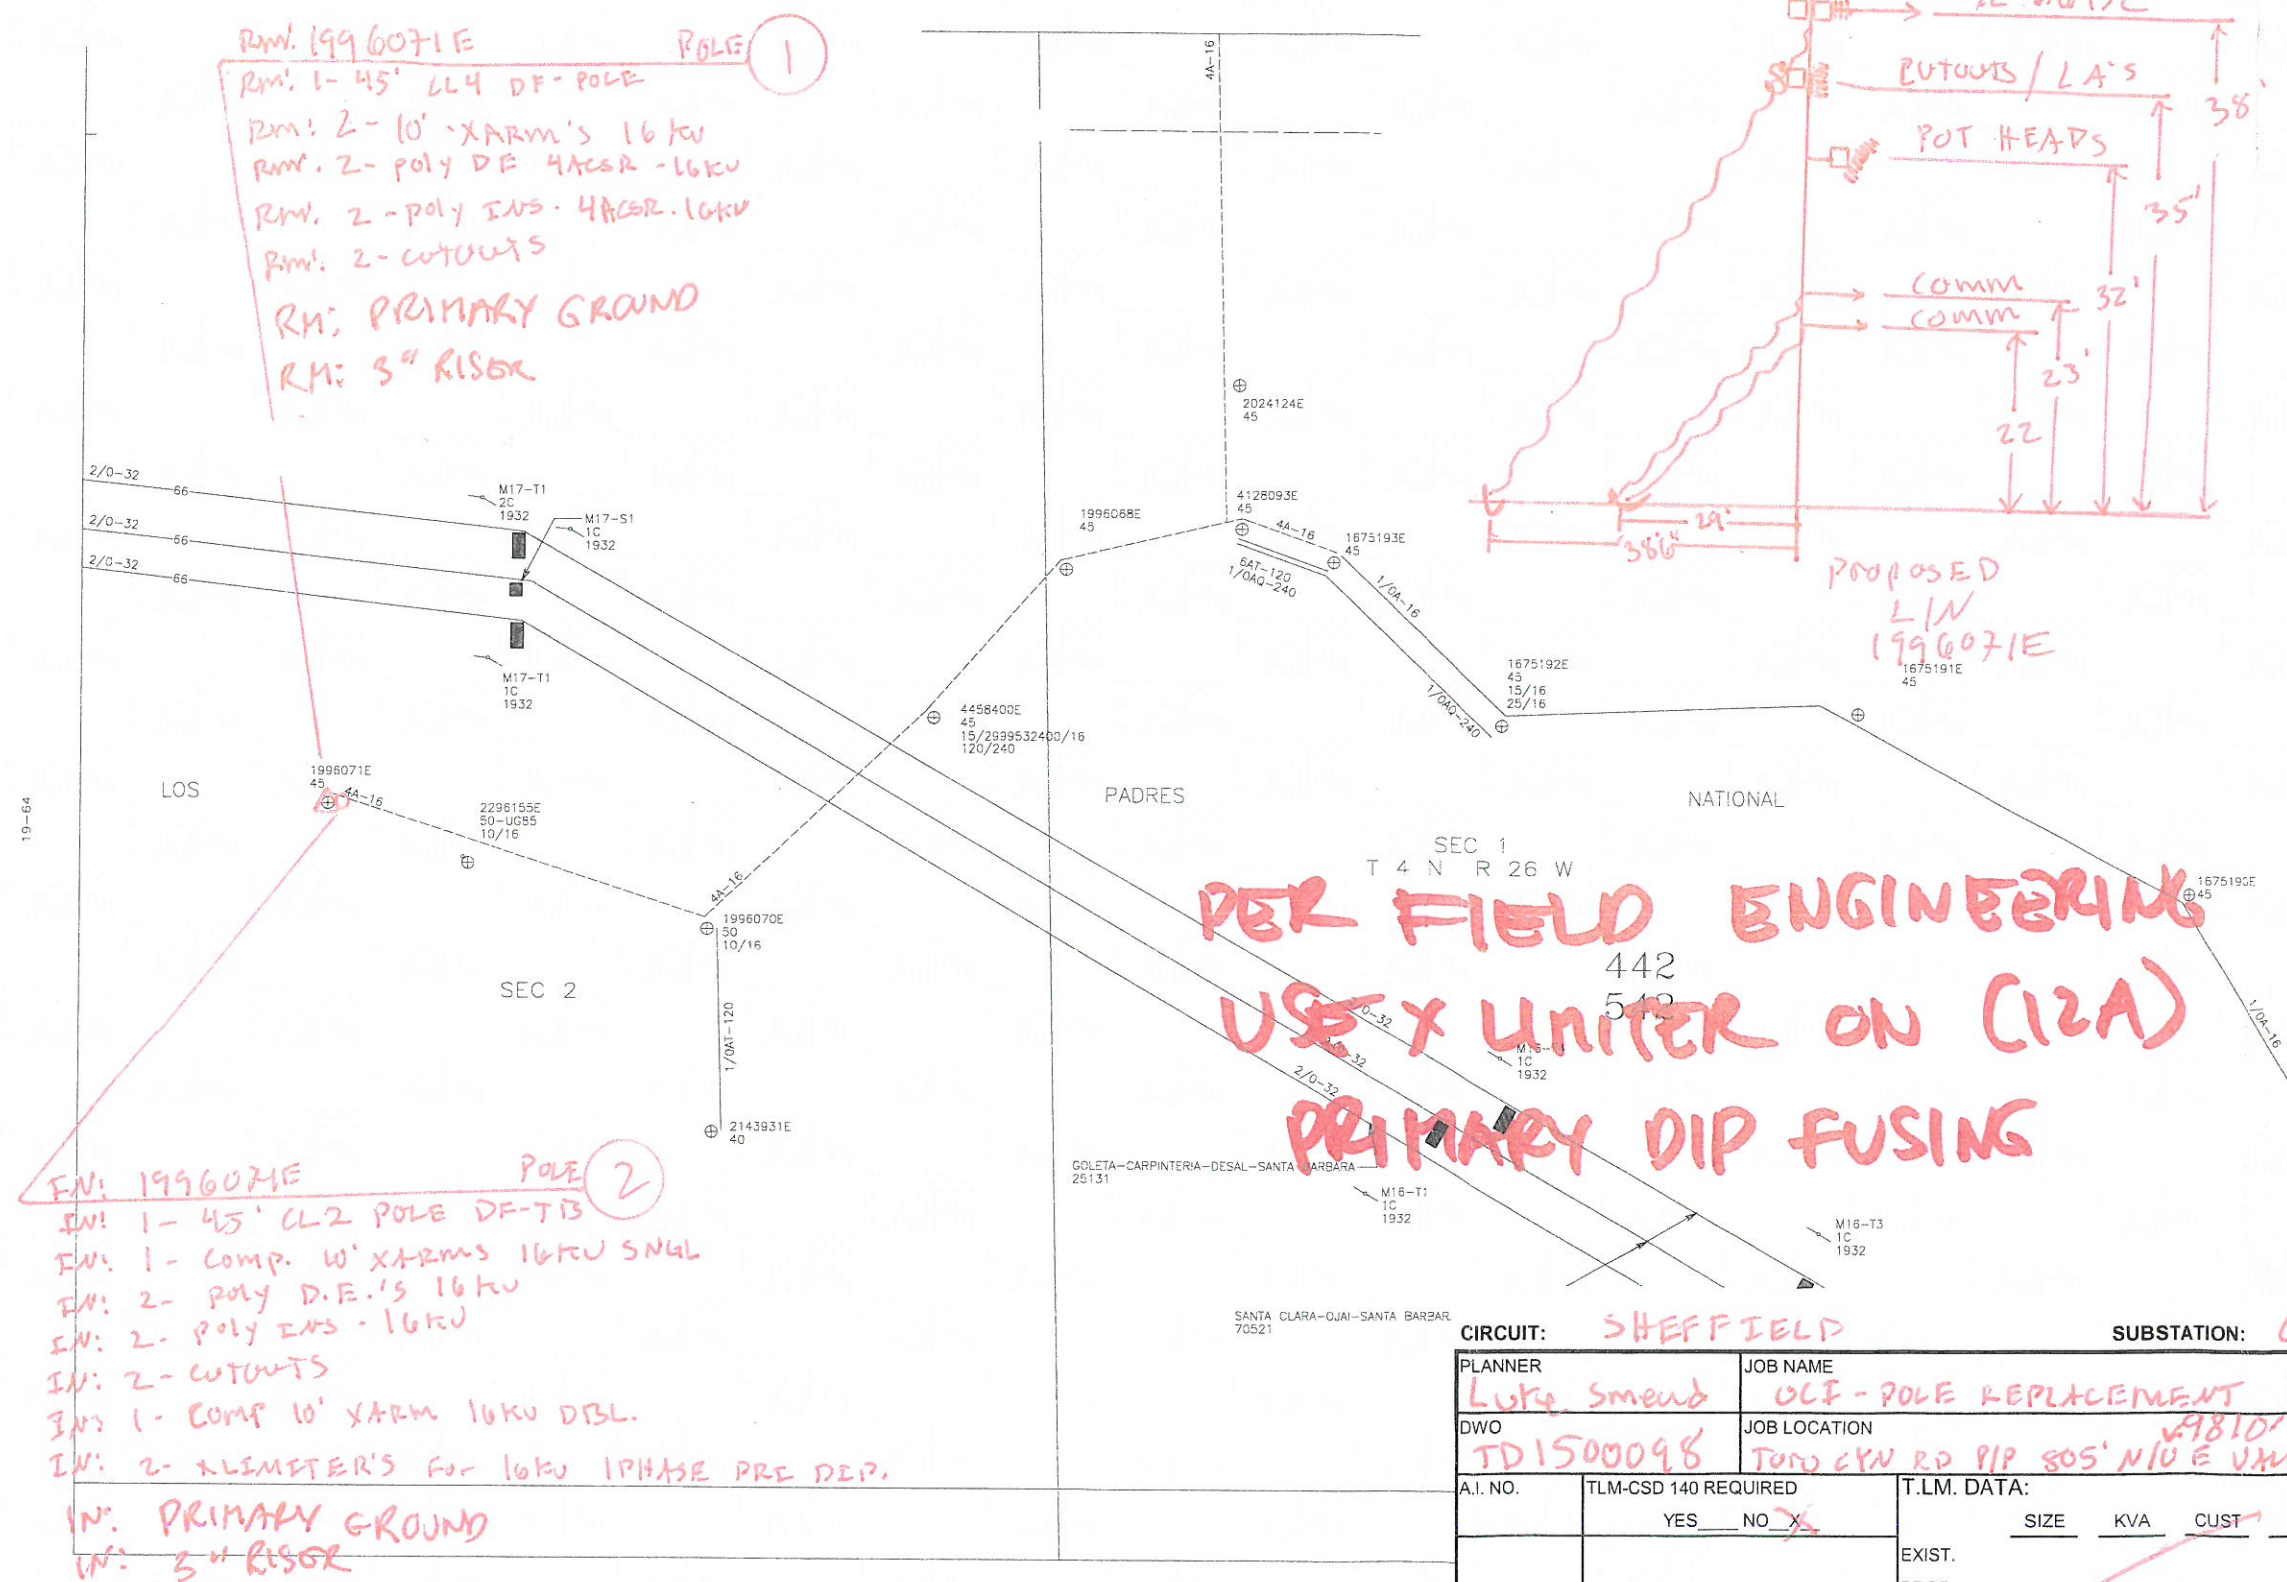

PROJECT REQUIREMENTS		(Y / N)
EDISON EASEMENT REQUIRED		☒
PWRD 88 REQUIRED		☒
PERMIT REQUIRED		☒
PERMIT TYPE:		
OUTAGE REQUIRED		☐
OUTAGE DATE:	Time:	
TRAFFIC CONTROL REQUIRED		☒
PED. TRAFFIC CONTROL REQ'D		☒
CONVEYANCE LETTER REQ'D		☒
ENVIRONMENTAL CLEARANCE REQ'D		☐
CSD 140 (TLM) REQ'D		☒

NOT TO SCALE

INSPECTED BY _____
DATE INSPECTED _____



IN: 199607E POLE 2

IN: 1- 45' CL2 POLE DF-TIS

IN: 1- Comp. W' XARMS 16KV SNGL

IN: 2- Poly D.E.'S 16KV

IN: 2- Poly INS - 16KV

IN: 2- CUTOUTS

INS 1- Comp 10' XARM 16KV DBL.

IN: 2- XLIMITER'S for 16KV 1PHASE PRE DEP.

IN: PRIMARY GROUND


IN: 3" RISER

EL049-4099145-84 →

CIRCUIT: SHEFFIELD			SUBSTATION: CARP SUB			STA #: 1-2		
PLANNER Luky Smeud		JOB NAME OLT - POLE REPLACEMENT			FOREMAN		DISTRICT 49-Santa Barbara	
DWO TD1500098		JOB LOCATION TOW CYN RD 910' 805' NIVE VALLEY RD			TRUCK	P/E	DATE SENT TO R/W	DIST SKETCH
A.I. NO.		TLM-CSD 140 REQUIRED YES ___ NO <u>X</u>		T.L.M. DATA: SIZE KVA CUST %LOAD		DRAWN BY Luky Smeud		INV MAP NO.'S 19-65C
				EXIST. PROP.		WORKED BY		
J.P.A. NO.		GRID NO.		T.G. PAGE				
RELATED W.O.		VOLTAGE DROP		% Flicker		INV MAP NO'S VERIFIED() X		





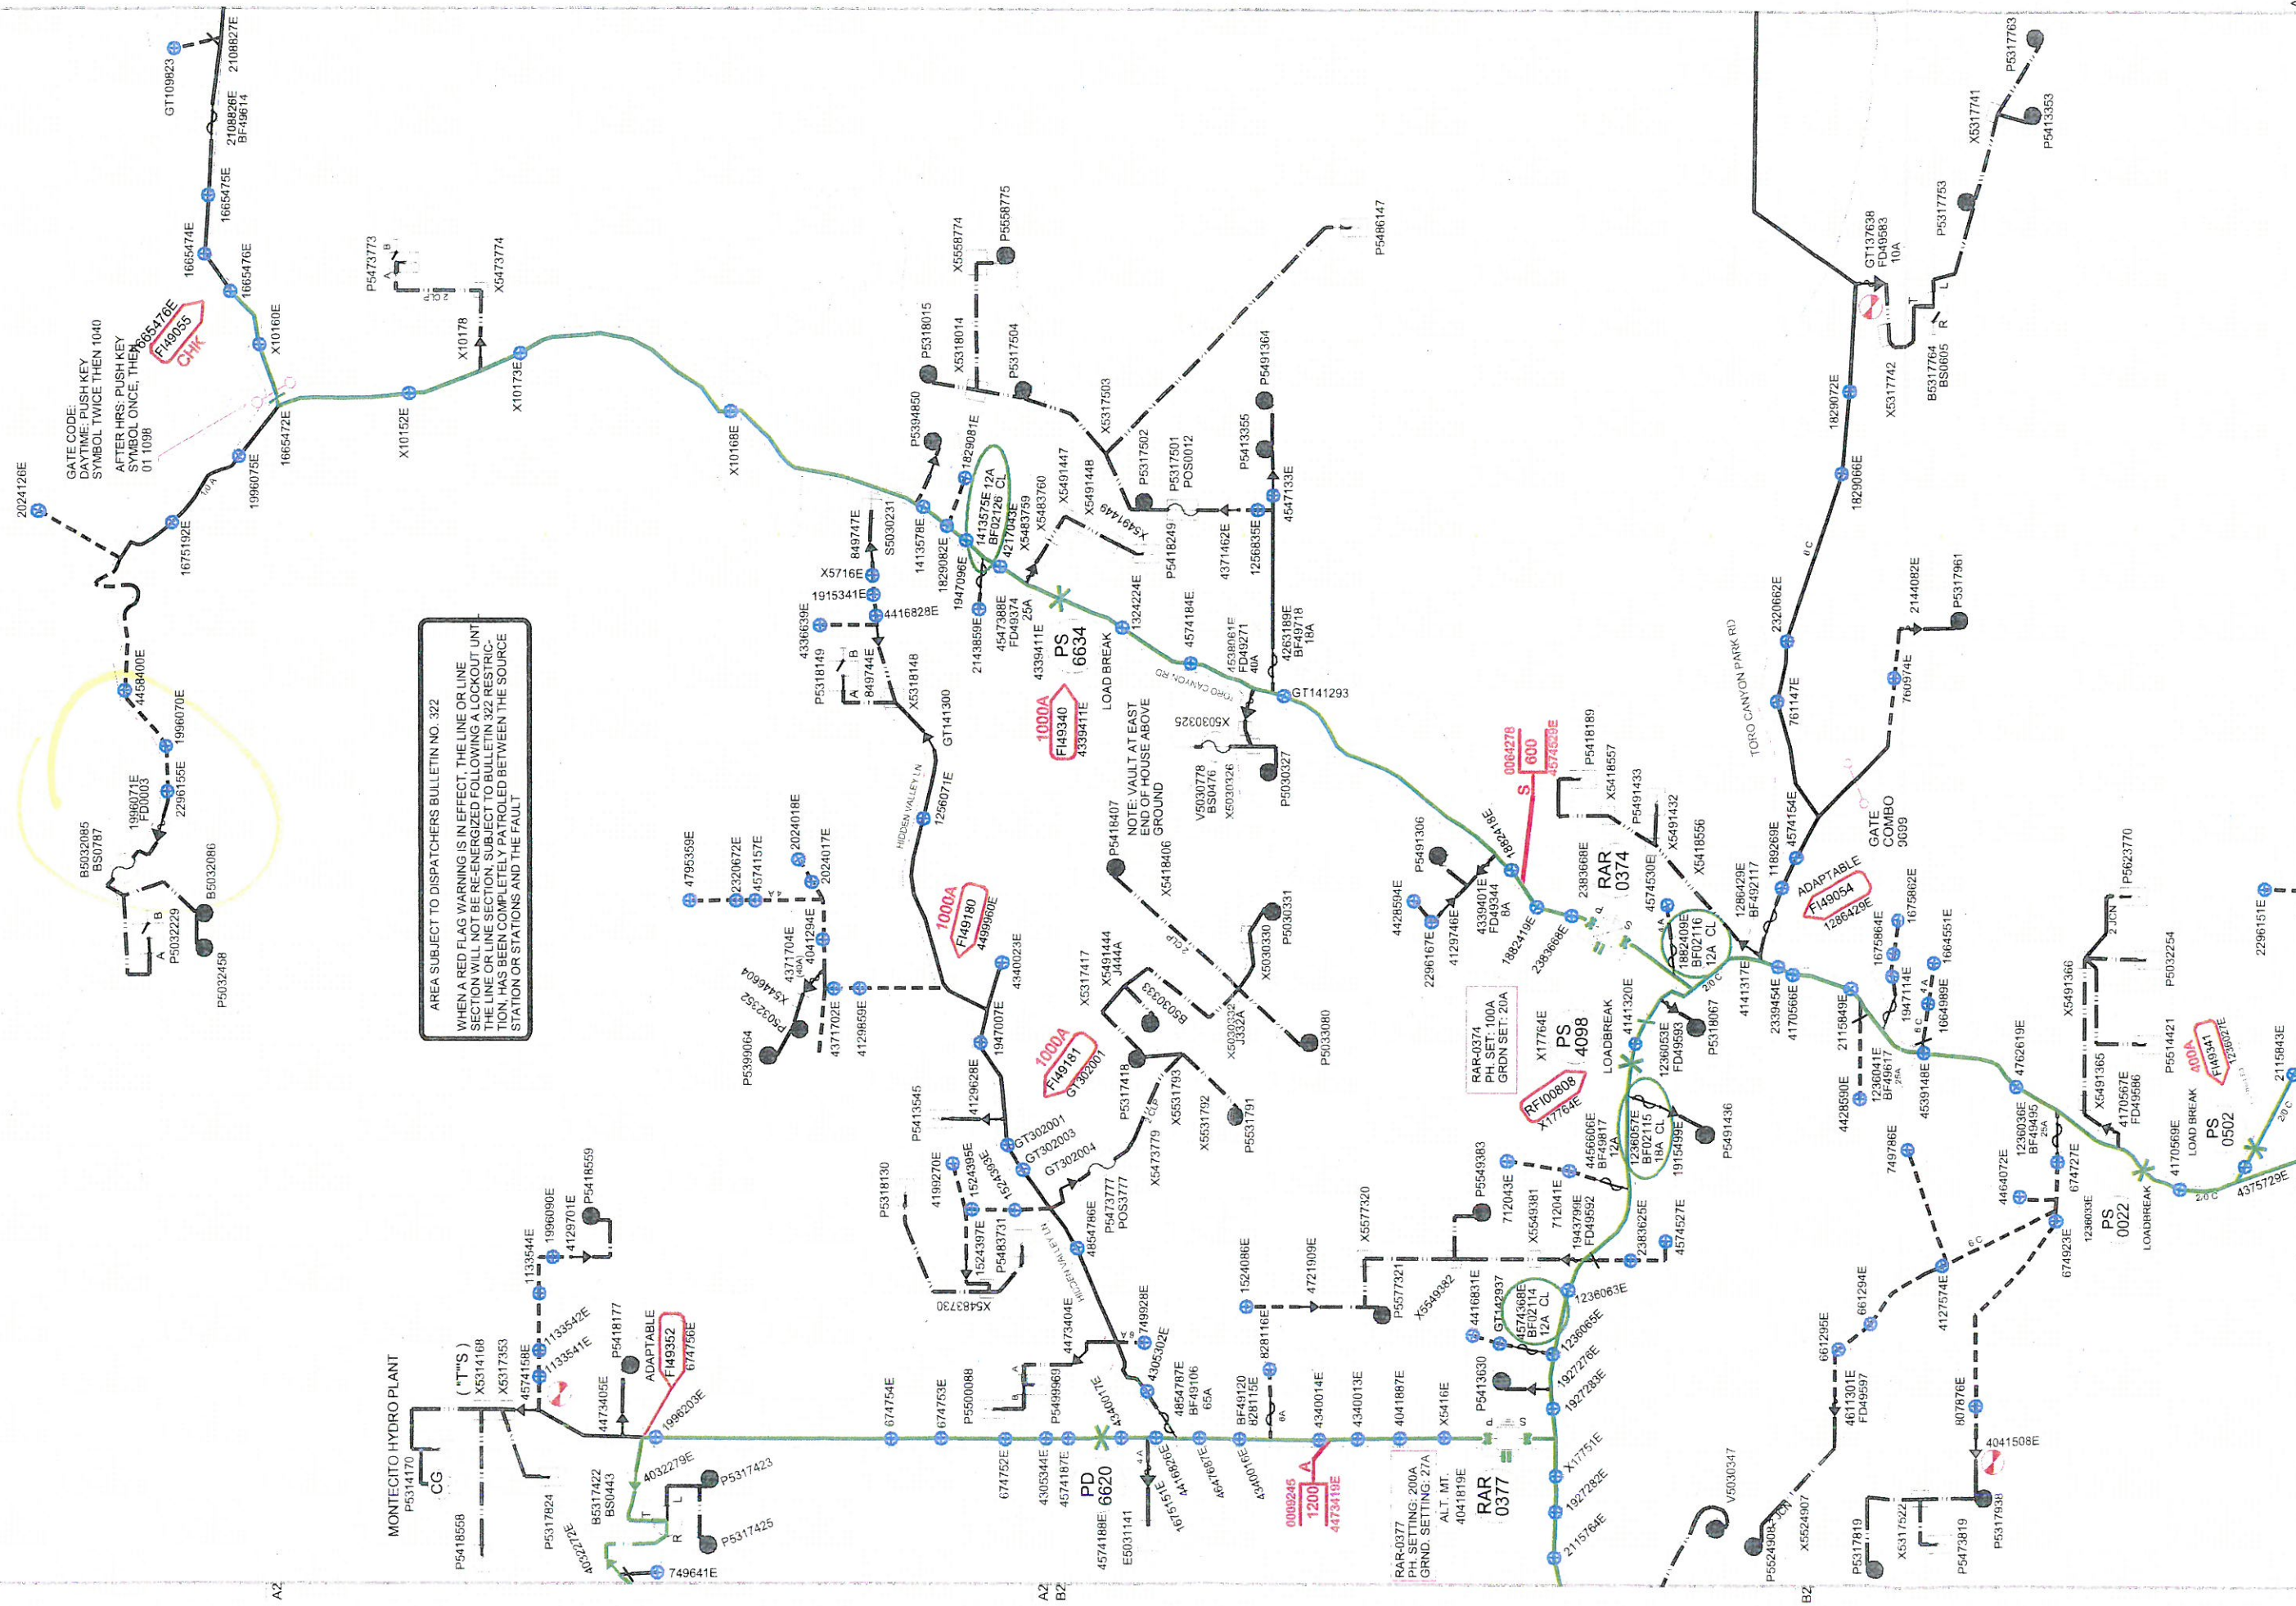

FOREMEN
BESCH
W.RHODES/H
STA BARB
EQUIP

DATE	
01/14/2019	49
12/04/2018	400

SYSTEM: GOLETA
PRIORITY NOTIFICATION :
FAULT INDICATORS ON
LOOP STATIONS :
AUTOMATIC SW. GEAR (:
NETCOMM EQUIPMENT :

NO	NO	NO
----	----	----

SCALE: 801

SHEFFIELD 16KV
CODE: 16310

CARPINTERIA SUB (D5)
CODE: 5503

A3