



NOTES:

- NO TRUCK ACCESS
- SET 1' WEST
- E TO CUT 10' & PTD
- FTR TO SOP
- CREW TO CUT PRIMARY & INSTALL DEAD END TO ACCOMMODATE HEIGHT ADJUSTMENT

TRANSFER:

- 3-336A-33
- 3-1/OA-12

- 1 RM 1261314E
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA DBLE VB 10' STEEL PINS
RM: 1- XA SNGL VB 10' STEEL PINS
RM: 6- INS GLASS/POLY 35KV & LESS
- 34° 13' 23.0" N,
117° 2' 59.5" W
ELEV: 6,708'
- 2 POLE 1261314E
50' Class H1
IN: 1- POLE 50' CLASS H1 WOOD FULL TREAT
IN: 1- XA DBLE VB 10' STEEL PIN D/A BRKT
IN: 6- INS POLY DE 33KV HOT SHOE 336 ACSR
IN: 3- INS POLY POST 33KV CLMP #4-336
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653
IN: 1- XA DBLE VB 10' STEEL PINS
IN: 6- INS POLY DE 12KV HOT SHOE 336 ACSR
IN: 3- INS POLY POST W/PIN 12KV CLMP #4-336
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653

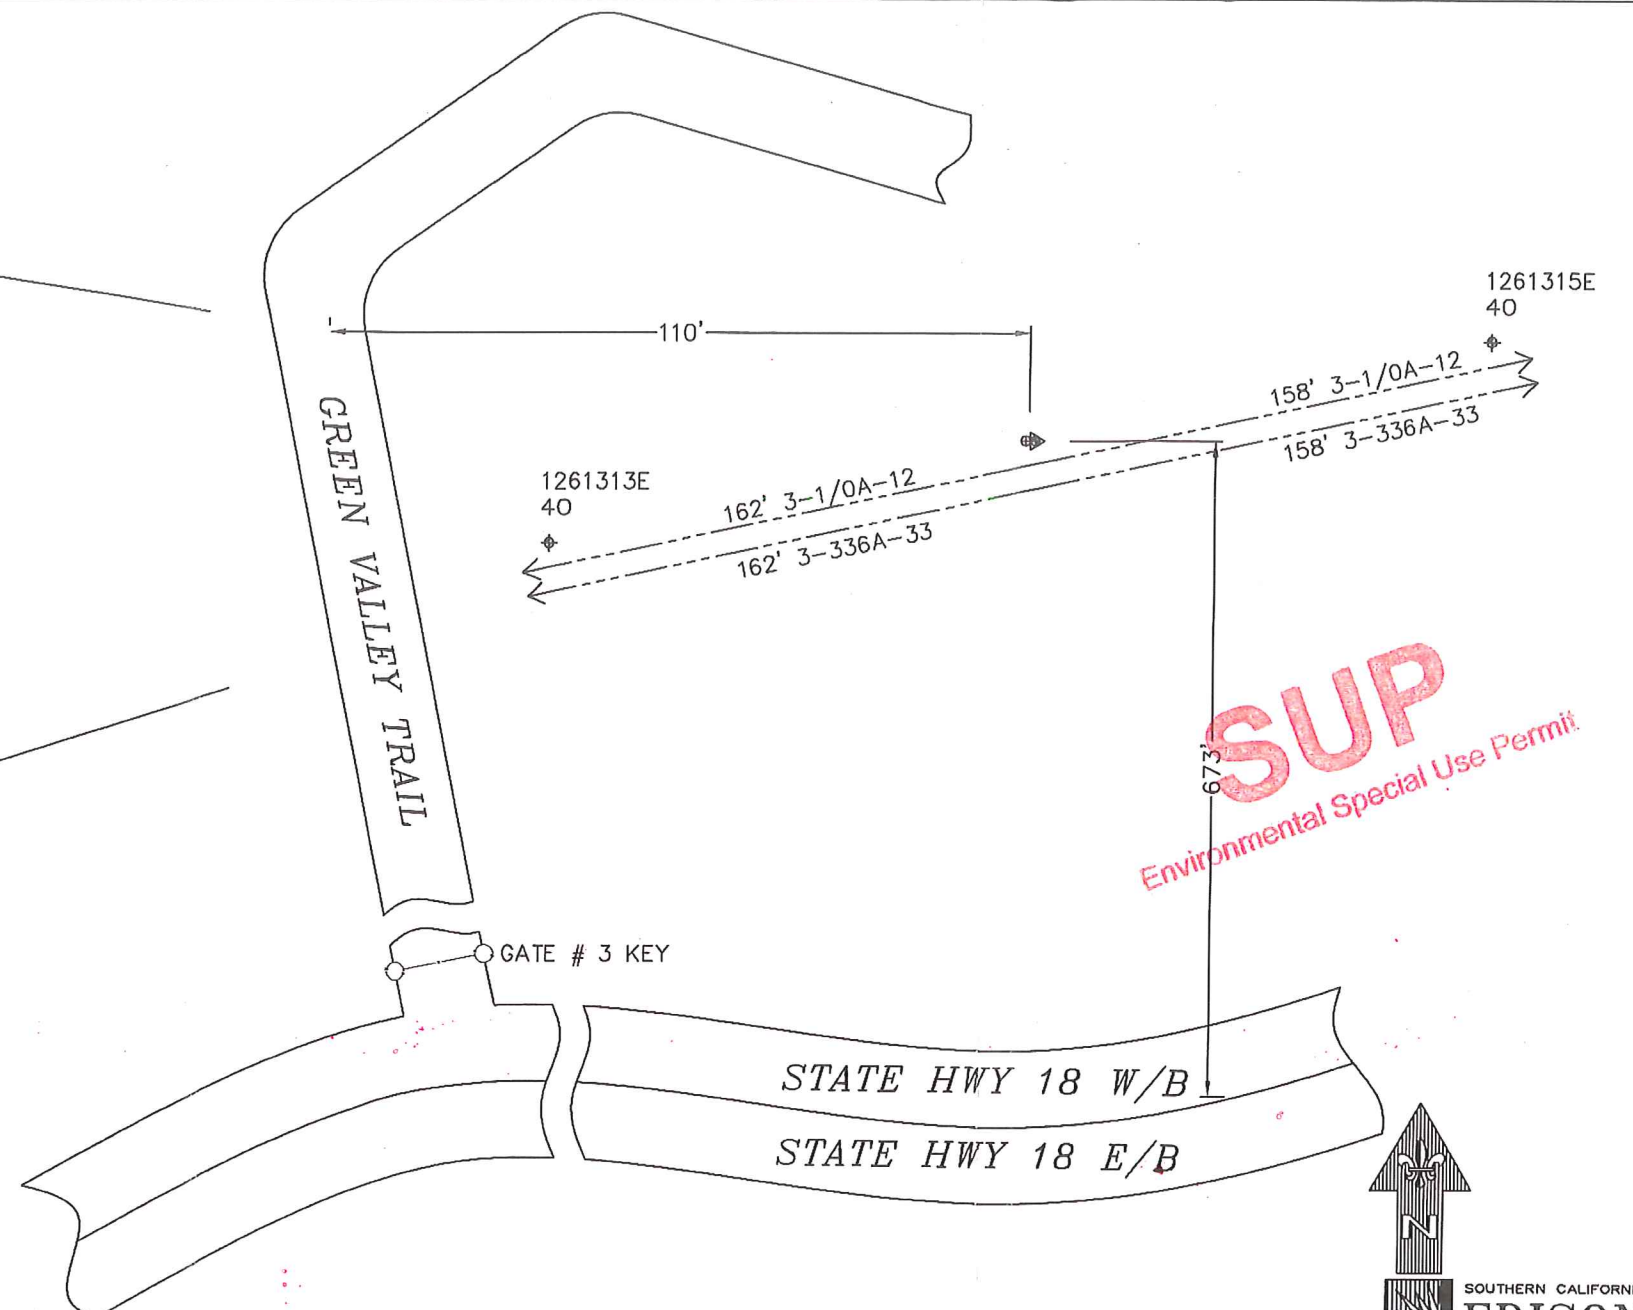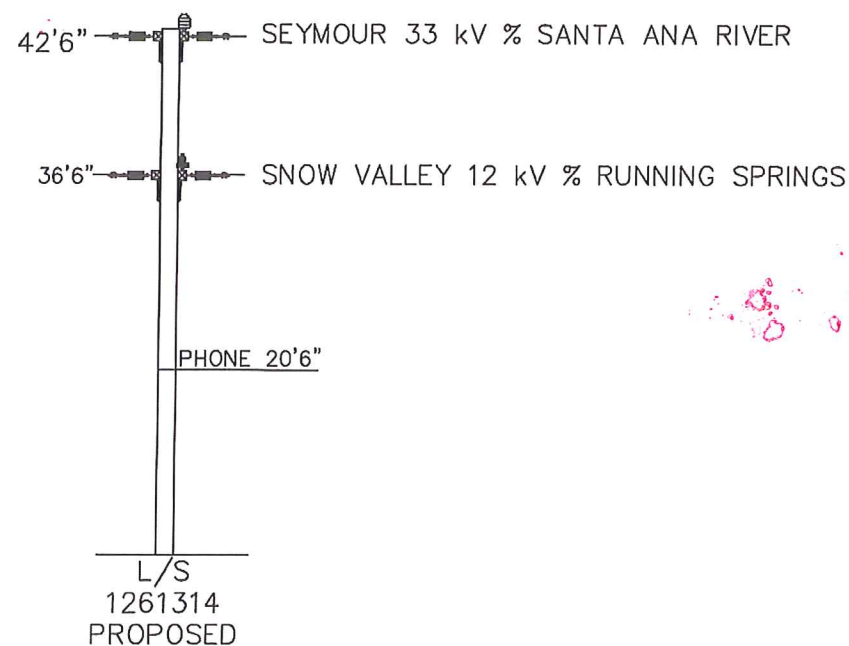

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE: NATIONAL FOREST	
OUTAGE REQUIRED	☒
OUTAGE DATE: TIME:	
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 40 - ARROWHEAD	PROJ. MGR. GALLARDO, ANTHONY PHONE	PLANNER DIVERSIFIED UTILITIES PHONE 661-325-3212	DESIGNER DIVERSIFIED UTILITIES
PROJECT NO. 1576061	SERVICE REQUEST 2485924	MSR NO.	PRODUCT-1 1383703-INFRASTRUCTURE REPLACEMENT PLP
CIRCUIT / VOLTAGE SNOW VALLEY 12KV SEYMOUR 33 kV	THOMAS GUIDE	PRODUCT-2	ASSOC DESGN
SUB / PG NO. % RUNNING SPRINGS C3 %SANTA ANA RIVER A1	CIRCUIT CODE	PRODUCT-3	ASSOC DESGN
INVENTORY MAP 264-2286-1	J.P.A. NO.	PROPOSED CONSTRUCTION (LOCATION) STR# 1261314E 110' E/O GREEN VALLEY TRAIL 673' N/O STATE HWY 18 ARROWBEAR, CA	
3/26/2018	DUSI-DC/AR		
TYPE	DATE	APPROVED BY	CHECKED BY
		DRAWN BY	PAX #
Southern California Edison Company			
SHEET		DESIGN\DRWG NO. 1021722_0.01	
		OF	