

SAUCUS-ELIZABETH LAKE FILLMORE 66KV (IDLE)

NOTES:



- POLES LOCATED IN TIER 3 HFIA
- INSTALL 5' TALLER POLE PER ENGINEERING REVIEW
- CLEARANCES OR HEIGHT CHANGES WERE USED PER ENGINEERING REVIEW
- POLES LOCATION ±5,325' NORTHWEST OF SAN MARTINEZ GRANDE CANYON RD & CA-126
- POLES LOCATED ±4,220' WEST OF DIRT ROAD
- CREW TO DETERMINE POLE SETTING

GPS COORDINATES:

848259E: 34.410307° ; -118.675844°
848260E: 34.410290° ; -118.675828°

TRANSFERS:

3-4/OCU 66KV

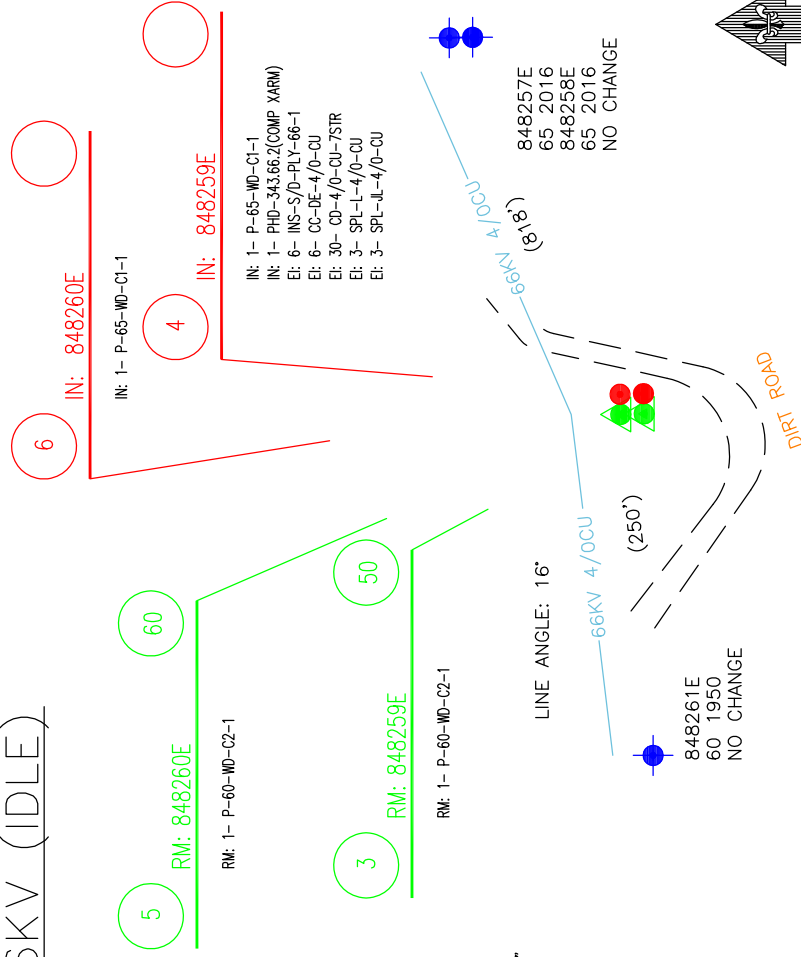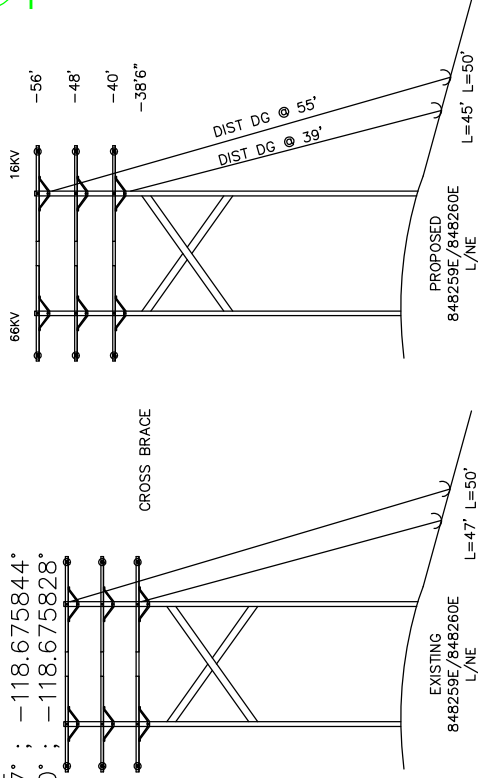

- LEGEND**
- 848259E_260E
 - SAN MARTINEZ GRANDE CANYON RD
 - CA-126
 - DIRT ROAD

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☒
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒
PERMIT TYPE: CITY	
OUTAGE REQUIRED	☒
OUTAGE DATE: _____ TIME: _____	
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒



JOINT MEET	N	PAVEMENT REPAIR	N
TRUCK ACCESS	Y	ASPHALT: CONCRETE:	
HFIA	Y	REPAIR SIZE:	
CRITICAL HABITAT	N	WIND RATING	12# GRADE B
EAGLE ZONE	Y	NETCOMM SHEET	N
MITC POLE	N	CONTACT CATV	N
RISER	N	TREE TRIMMING REQ'D	N

EOI POLE REPLACEMENT

ASSOCIATED WITH DIST TD1539130

PROD #	1770395	ESTIMATE	JAIN, PIYUSH	PHONE	909-469-7113	J.P.A. NO.	
DIVISION	NORTH COAST	INVENTORY MAP	THOMAS BRILL	SAP ORDER	108-48		
DISTRICT	NORTHWEST	PRODUCT/MAT	59 - VALENCIA		1535551-119 POLE OH REPL		
LINE	ET-00630-Saugus-Elizabeth Lake-Fillmore-NON-ISO					LINE VOLTAGE	66KV
REV	APPROVED BY	DATE	CHECKED BY	SKETCH BY	DATE	SHEET	DESIGN NO.
						2	1141363_0.01



SOUTHERN CALIFORNIA
EDISON
An Edison International Company

NOT TO SCALE