

SAUGUS-ELIZABETH LAKE FILLMORE (IDLE SECTION) 66KV

NOTES:


- POLES ARE LOCATED IN TIER III HF/A
- CREW TO HELICOPTER SET POLES DUE TO NO TRUCK ACCESS
- POLES ARE LOCATED ±215' NORTH OF HENRY MAYO DR
- POLES ARE LOCATED ±1,822' NORTHEAST FROM HENRY MAYO DR & CHIQUITO CANYON RD
- TRANSMISSION TO ORDER SHARED COMPOSITE XARMS
- POLE# 848234E IS 55' PER FIELD MEASUREMENTS (60' PER SAP)
- DESIGN STANDARDS DECIDED UPON BY ENGINEERING REVIEW

GPS COORDINATES:

34.423437; -118.652606

TRANSFERS:

3- 4/OA 66KV

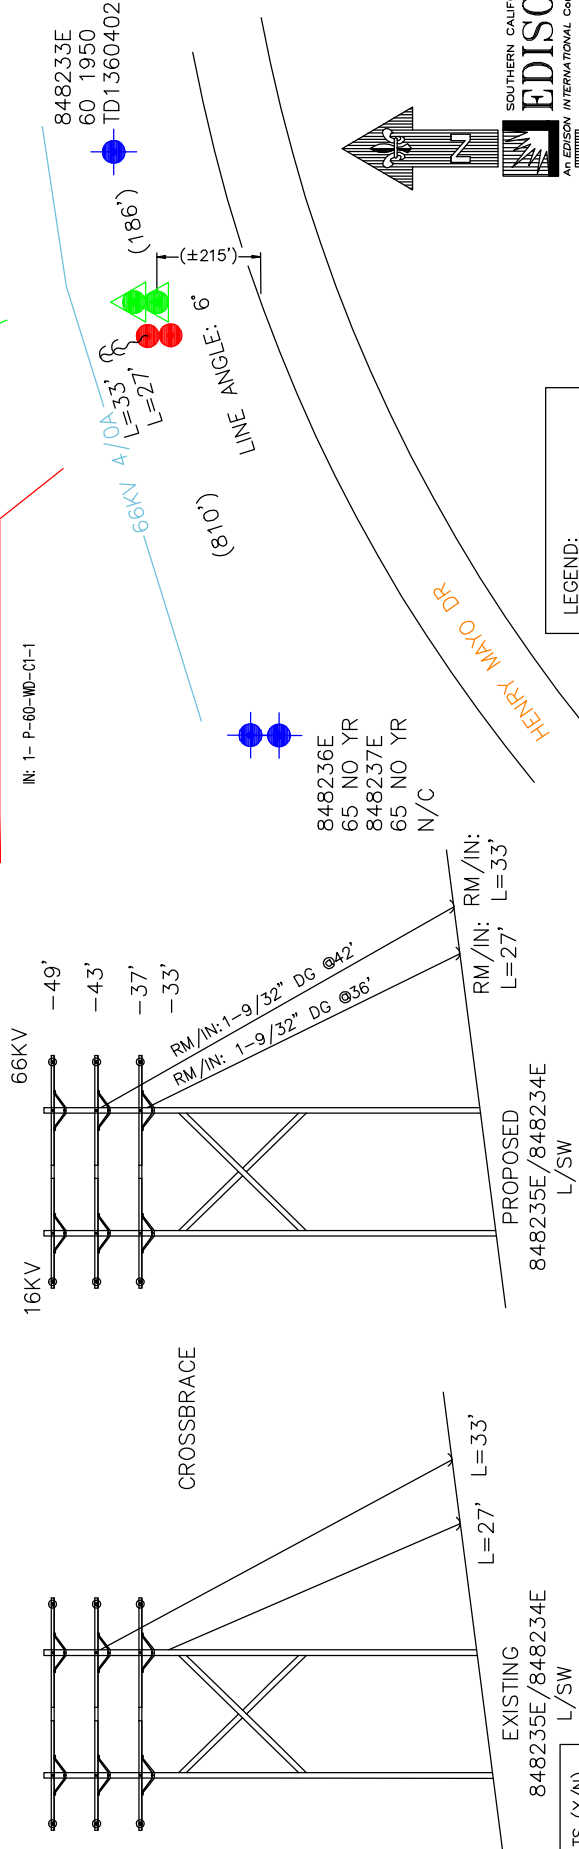

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☒
PWRD 88 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒
PERMIT TYPE: CITY / CALTRANS	
OUTAGE REQUIRED	☒

OUTAGE DATE: _____	TIME: _____
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒

BULLETIN 322 HIGH FIRE/HAZARD AREA	JOINT MEET	N	N	PAVEMENT REPAIR	N
	TRUCK ACCESS	N	N	ASPHALT:	CONCRETE:
	HF/A	Y	Y	REPAIR SIZE:	
	CRITICAL HABITAT	N	N	WIND RATING	12# GRADE B
	EAGLE ZONE	Y	Y	NETCOMM SHEET	N
	MITC POLE	N	N	CONTACT CATV	N
	RISER	N	N	TREE TRIMMING REQ'D	N

VICINITY MAP



LEGEND:	
	CHIQUITO CANYON RD
	HENRY MAYO DR
	848234E-235E

EOI POLE REPLACEMENT	
ASSOCIATED WITH DIST TD1558997	

PROJECT #	1798523	ESTIMATOR	SEGURA, ANTONIO	PHONE	909-469-7225	J.P.A. NO.	
DIST	NORTH COAST	INVENTORY MAP	THOMAS BROS.	SAP	10-50	SAP	10-50
DIVISION	NORTHWEST	DISTRICT	59 - VALENCIA	PRODUCT/MAT	1558681-119 POLE OH REPL	LINE VOLTAGE	66KV
LINE		ET-00630-Saugus-Elizabeth Lake-Fillmore-NON-ISO		PROPOSED CONSTRUCTION (LOCATION)		R/R 2 EOI POLES	
						HENRY MAYO DR & CHIQUITO CANYON RD	
						CASTAIC, CA	
DESIGNED BY		CHECKED BY		DRAWN BY		SHEET	1
DATE		DATE		DATE		DESIGN NO.	1160259_0.01
SOUTHERN CALIFORNIA EDISON COMPANY							



NOT TO SCALE