


SANTA BARBARA CO. 14-66

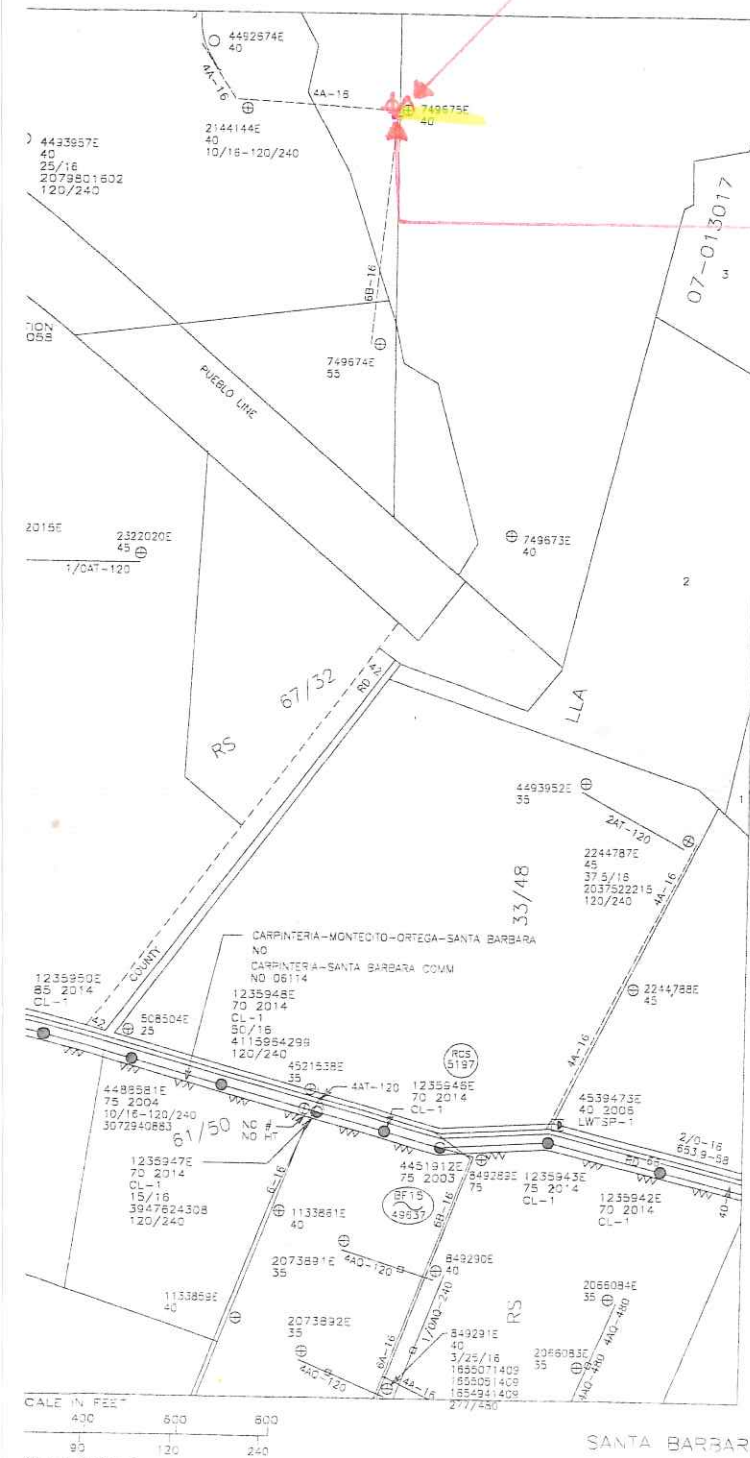

Rm: 749675E POLE ①
 Rm: 40' CL 5 POLE
 Rm: 2- 10' SMGL XARM - 16KV
 Rm: 2- POLY DE - 16KV - COPPER
 Rm: 2- POLY DE - 16KV - ACSR
 Rm: 1- UNISTRUT

Rm: 3- POLY INS - 16KV
 Rm: 2- 3/32" D.G. Rm: 3- L.A'S - 16KV
 TR: 1- PRIMARY RISER
 TR: ALL PRIMARY WIRES.
 TR: 3 POTHEADS
 * SAME HOLE SET *


IN: 749675 POLE ②
 IN: 45' CL 1 COMPOSITE POLE
 IN: 2- 10' COMPOSITE XARMS - 16KV
 IN: 2- POLY - DE - ACSR - 16KV
 IN: 2- POLY - DE - COPPER - 16KV
 IN: 1- UNISTRUT
 IN: 3- POLY INS - 16KV
 IN: 2- 3/8" D.G.

OCT - POLE REPLACEMENT
 TD 1515729

SHEFFIELD % (CARPINTERIA)

CREW NOTES:

- POLE IS IN REAR PROP OF 4036 Foothill Rd. DRIVE THROUGH Gate all the TO Brown Buildings.
- POLE IS IN Field S/W OF Brown Buildings
- SAME HOLE SET.
- NOTIFY CUST TO LOCK DOGS UP

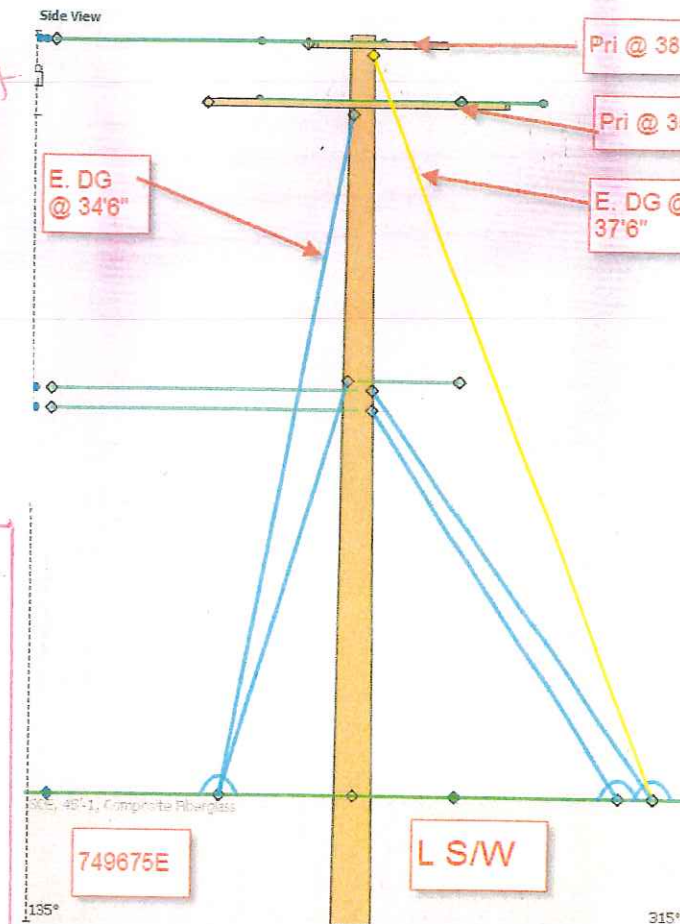

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☒
PWRD B8 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☒
OUTAGE DATE:	TIME:
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLV) REQ'D	☒

- TRANSFER POTHEAD ASSEMBLY TO NEW COMPOSITE PRIMARY ARM
- TRANSFER PRIMARY DIP
- REPLACE 9/32 DIGS WITH 3/8s.

PLANNER: Lukesmud	JOB NAME: OCT - POLE REPLACEMENT	FOREMAN:	DISTRICT: 49 - S.B.
DWO:	JOB LOCATION: 4036 Foothill Rd.	TRUCK	P/E:
A.I. NO.:	TLM-CSD 140 REQUIRED YES NO	T.L.M. DATA: SIZE KVA CUST. LOAD	DRAWN BY:
J.P.A. NO.:	GRID NO. THOMAS MAP	EXIST. PROP. VOLTAGE DROP PRI. CIRC.:	WORKED BY:
RELATED W.O.:	REL 049-410038250	INV. MAP NO.'S VERIFIED: (Y)	DATE SENT TO R/W:
			DIST. SKETCH #