



An *EDISON INTERNATIONAL*® Company

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | | | | |
|--------------------------|-----------------------|--------------------------|--------------------|--------------------------|---------------------------------------|
| ☐ | Camera – HD/IR | ☐ | Line String | ☐ | Pole-set |
| ☐ | Crew support | ☐ | Passenger | ☐ | Recon |
| ☐ | External Load | ☐ | Patrol | ☐ | Training |
| ☐ | HEC | ☐ | Photo | ☐ | Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only


Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1

□ Week 2

□ Week 3

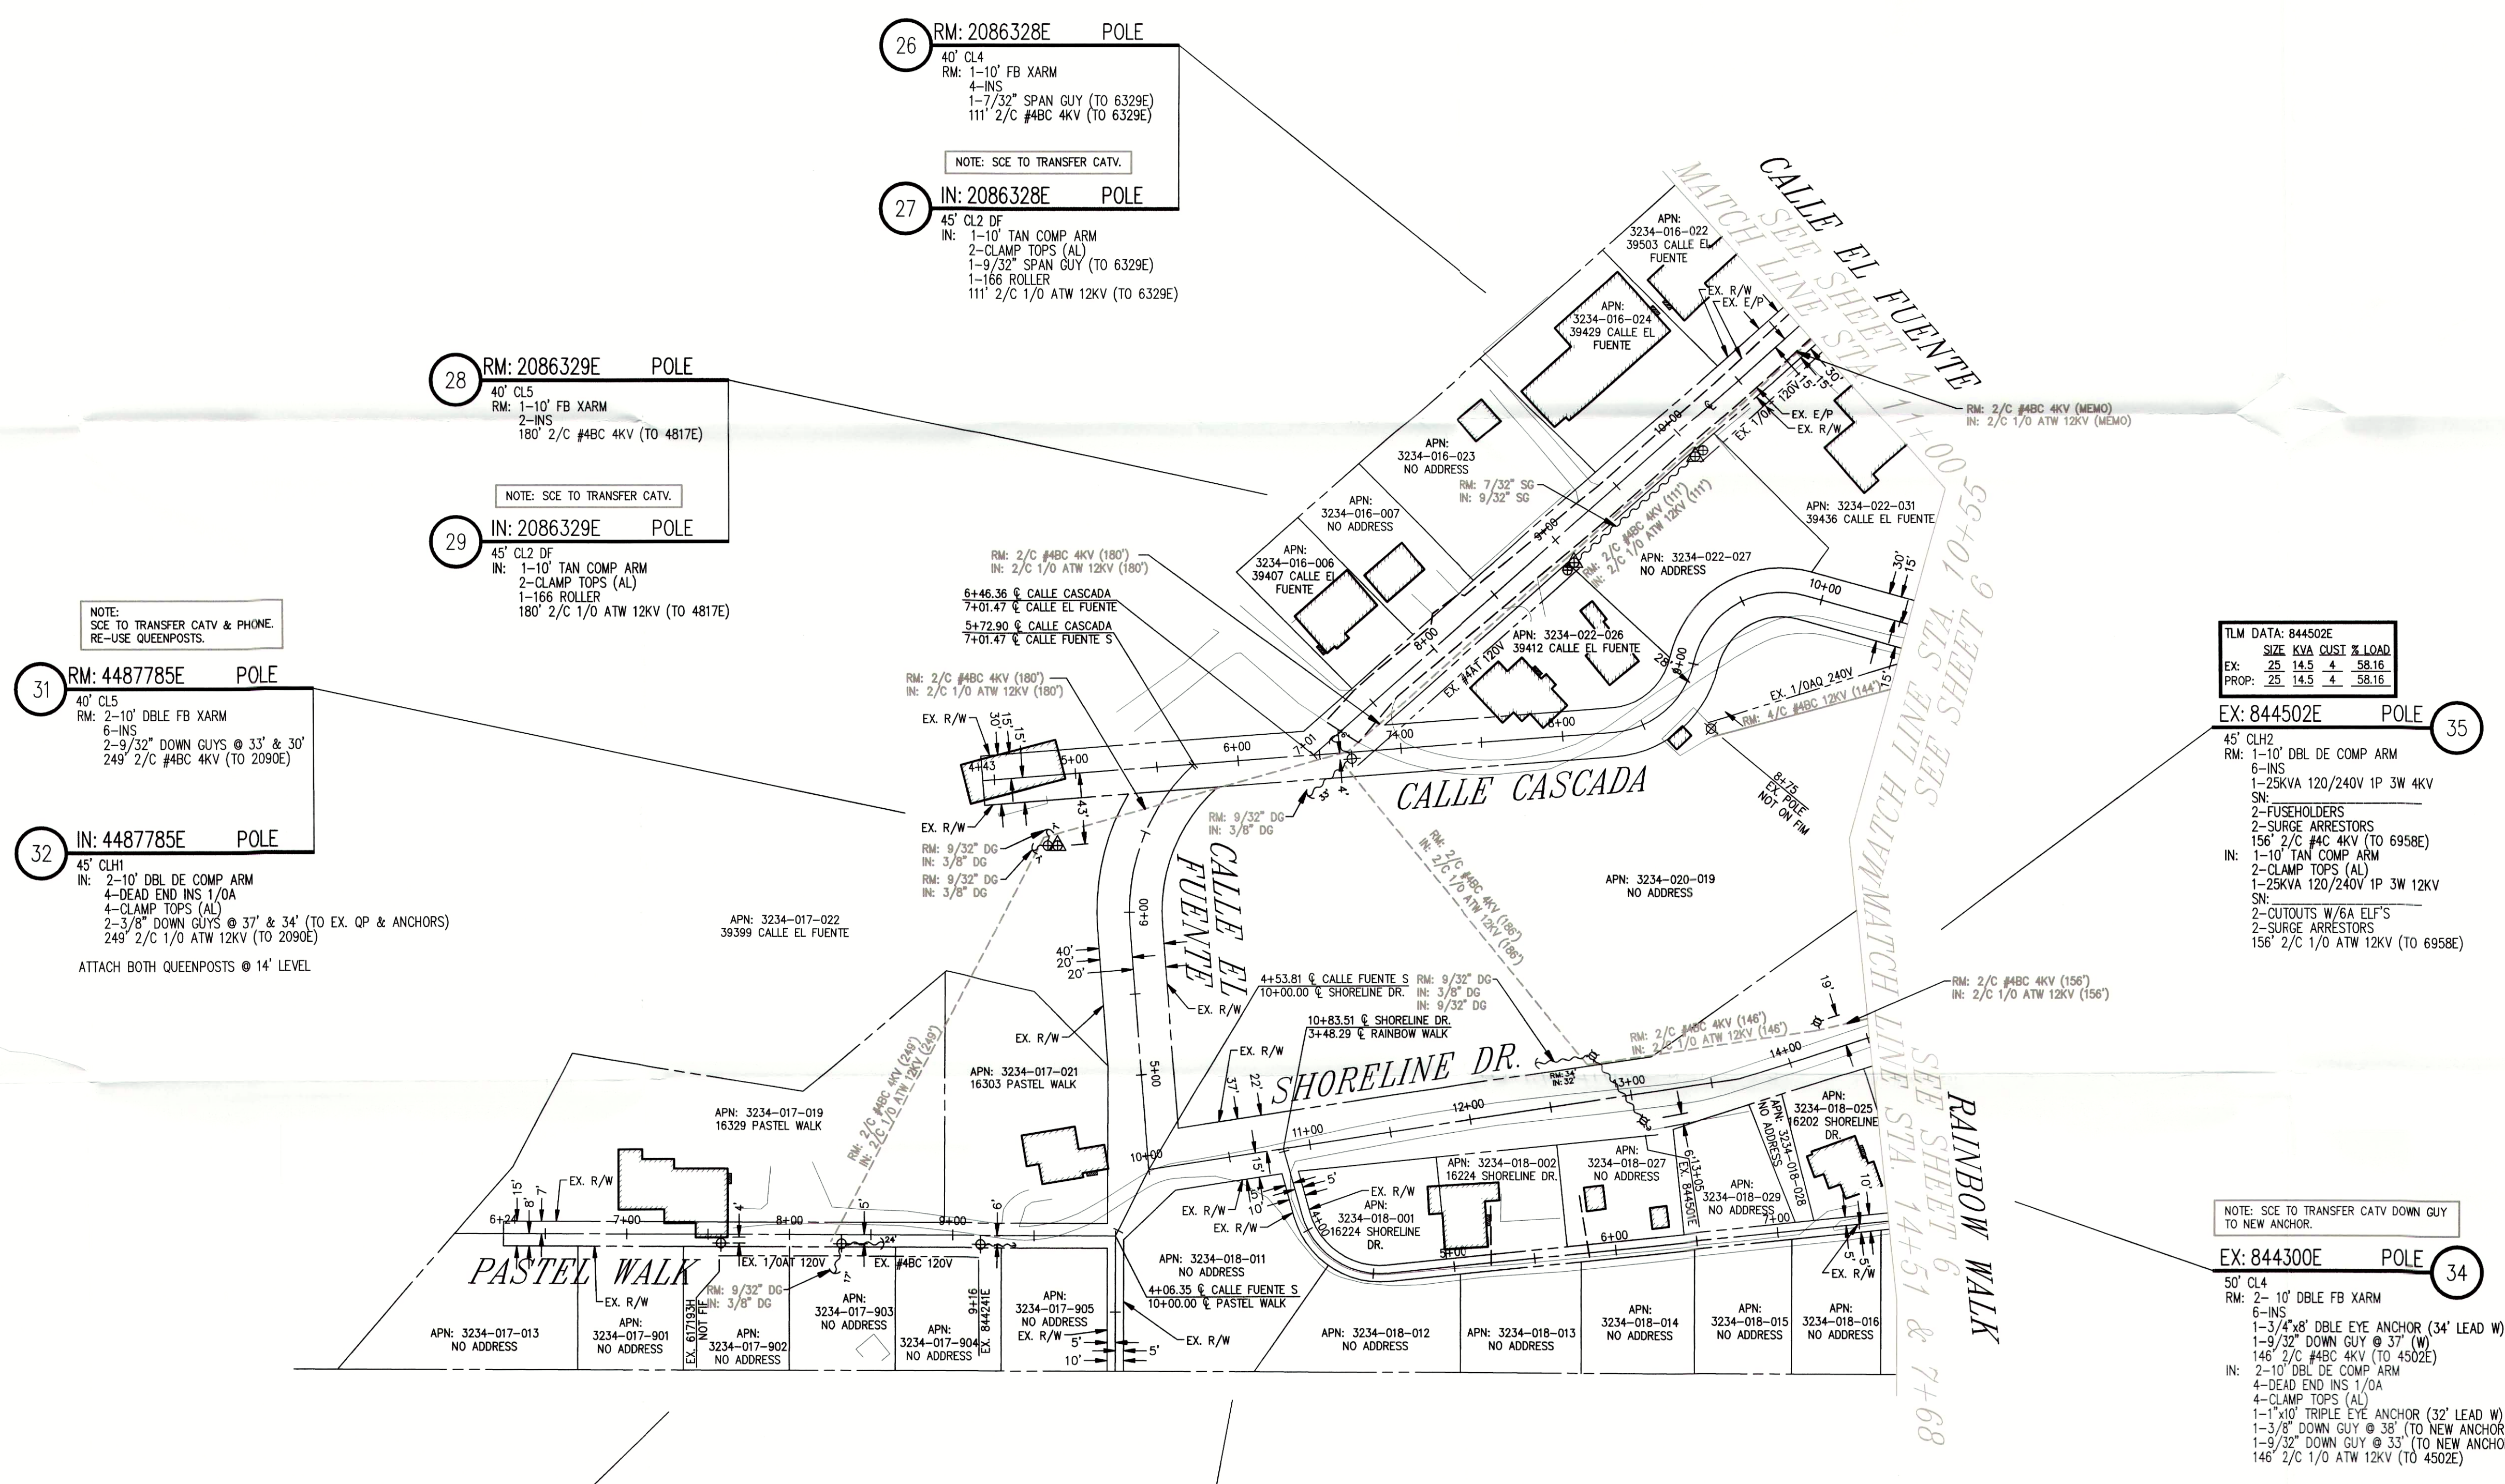

NOTE: SCE TO TRANSFER CATV & PHONE. RE-USE QUEENPOSTS.

31 RM: 4487785E POLE
40' CL5
RM: 2-10' DBLE FB XARM
6-INS
2-9/32" DOWN GUYS @ 33' & 30'
249' 2/C #4BC 4KV (TO 2090E)

32 IN: 4487785E POLE
45' CLH1
IN: 2-10' DBL DE COMP ARM
4-DEAD END INS 1/OA
4-CLAMP TOPS (AL)
2-3/8" DOWN GUYS @ 37' & 34' (TO EX. QP & ANCHORS)
249' 2/C 1/O ATW 12KV (TO 2090E)

ATTACH BOTH QUEENPOSTS @ 14' LEVEL

TLM DATA: 542090E
SIZE KVA CUST % LOAD
EX: 25 9.6 4 38.39
PROP: 25 9.6 4 38.39

33 EX: 542090E POLE
45' CL4
RM: 1-10' DBL DE COMP ARM
2-INS
1-25KVA 120/240V 1P 3W 4KV
SN:
2-FUSEHOLDERS
2-SURGE ARRESTORS
1-9/32" DOWN GUY @ 36' (SW)
IN: 1-10' DBL DE COMP ARM
2-DEAD END INS 1/OA
1-25KVA 120/240V 1P 3W 12KV
SN:
2-CUTOUPS W/6A ELF'S
2-SURGE ARRESTORS
1-3/8" DOWN GUY @ 36' (TO EX ANCHOR SW)

TLM DATA: 4484817E
SIZE KVA CUST % LOAD
EX: 25 17.3 3 69.40
PROP: 25 17.3 3 69.40

30 EX: 4484817E POLE
45' CL3
RM: 2-10' DBLE FB XARM
10-INS
1-25KVA 120/240V 1P 3W 4KV
SN:
2-FUSEHOLDERS
1-8/32" DOWN GUY @ 33' (NW)
186' 2/C #4BC 4KV (TO 4300E)
180' 2/C #4BC 4KV (TO 7785E)
IN: 2-10' DBL TAN COMP ARM
6-CLAMP TOPS (AL)
1-25KVA 120/240V 1P 3W 12KV
SN:
2-CUTOUPS W/6A ELF'S
2-SURGE ARRESTORS
1-3/8" DOWN GUY @ 33' (TO EX ANCHOR (NW))
186' 2/C 1/O ATW 12KV (TO 4300E)
180' 2/C 1/O ATW 12KV (TO 7785E)


TLM DATA: 844502E
SIZE KVA CUST % LOAD
EX: 25 14.5 4 58.16
PROP: 25 14.5 4 58.16

35 EX: 844502E POLE
45' CLH2
RM: 1-10' DBL DE COMP ARM
6-INS
1-25KVA 120/240V 1P 3W 4KV
SN:
2-FUSEHOLDERS
2-SURGE ARRESTORS
156' 2/C #4C 4KV (TO 6958E)
IN: 1-10' TAN COMP ARM
2-CLAMP TOPS (AL)
1-25KVA 120/240V 1P 3W 12KV
SN:
2-CUTOUPS W/6A ELF'S
2-SURGE ARRESTORS
156' 2/C 1/O ATW 12KV (TO 6958E)

NOTE: SCE TO TRANSFER CATV DOWN GUY TO NEW ANCHOR.

34 EX: 844300E POLE
50' CL4
RM: 2-10' DBLE FB XARM
6-INS
1-3/4"x8" DBLE EYE ANCHOR (34' LEAD W)
1-9/32" DOWN GUY @ 37' (W)
146' 2/C #4BC 4KV (TO 4502E)
IN: 2-10' DBL DE COMP ARM
4-DEAD END INS 1/OA
4-CLAMP TOPS (AL)
1-1"x10" TRIPLE EYE ANCHOR (32' LEAD W)
1-3/8" DOWN GUY @ 36' (TO NEW ANCHOR W)
1-9/32" DOWN GUY @ 33' (TO NEW ANCHOR W)
146' 2/C 1/O ATW 12KV (TO 4502E)

SURVEYED
DATE: 7/8/17

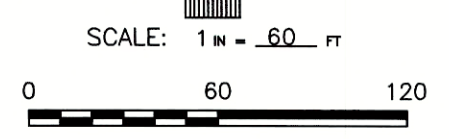

UNDERGROUND SERVICE ALERT
Dial 811
Call USA
For Underground Locating
2 Working Days Before You Dig

FINAL DESIGN APPROVED FOR CONSTRUCTION

DISTRICT 36 - ANTELOPE VALLEY			PROJ MGR. PHONE 805-654-7311			THOMAS GUIDE LA 4192-AA,B3,B4,C2,C3 LA 4192-DD,D3,E1,E2,E3 LA 4192-E4,F3,F4			PLANNER ERIC THOMAS PHONE 559-331-0927			SR NO. 2331491		
FOREMAN			TRUCK NO.			INVENTORY MAP NO. THOMAS GUIDE			GRID NO.			DESIGN NO. 919544		
CSD 140 Y			BY-PASS			TLM			J.P.A. NO.			ASSOCIATED DESIGN NO. 919543, 919545, 919546		
N			EXISTING			CHECKED			LOAD			PRODUCT/SAP NO. TD1281404, TD1281405		
PRODUCT/SAP NO. TD1281405			PRODUCT/SAP NO. TD1281404, TD1281405			PRODUCT/SAP NO. TD1281407			PROPOSED CONSTRUCTION (LOCATION) GREEN VALLEY 4KV PH.2-DSP 4KV CUTOVER SPUNKY CYN. RD. & CALLE EL FUENTE GREEN VALLEY			JOB NO. 0919544		
P			11/17/17			OF/ASP			UM/ASP			SHEET 5 OF 9		
B			07/27/19			S. GOUSSA			DW/HTE			PAX #		
TYPE APPROVED BY			DATE			CHECKED BY			DRAWN BY			Southern California Edison Company		

Sta. 31 + 32



4487785E

