

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

APPROVED

By Omar Sharif at 8:09 am, Dec 20, 2019

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____



SOUTHERN CALIFORNIA
EDISON
An EDISON INTERNATIONAL Company

T.L.M. DATA:

	SIZE	KVA	CUST	% LOAD
EXIST.	<u>7S</u>	<u>47.8</u>	<u>2</u>	<u>63.7 %</u>
PROP.	<u>7S</u>	<u>47.8</u>	<u>2</u>	<u>63.7 %</u>

VOLTAGE DROP: N/A

FLICKER FACTOR: N/A

PRI. CIRCUIT:

EDISON EASEMENT REQUIRED ☒ N

PWRD 88 REQUIRED ☒ Y


UG CIVIL ONLY WORK ORDER ☒ N

PERMIT REQUIRED ☒ N

PERMIT TYPE: N/A

TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☒

100

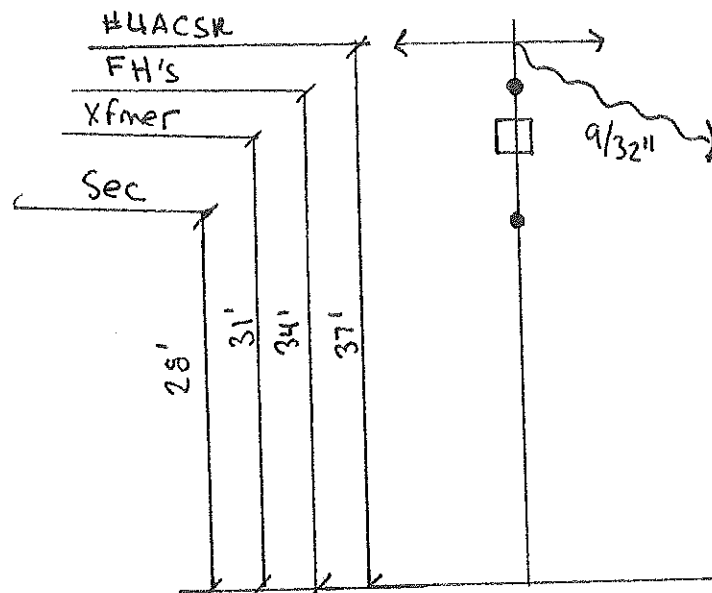

2 POLE 12618SSE

4S' COMP CLI

IN: 1-4S' CLI COMP POLE

IN: 1-10' SGLE COMP XARM

IN: 3-DE POLY INS

IN: 1-10' SGLE COMP XARM

IN: 3- CO Fuse holders

IN: 3- 8A Eif fuses

IN: 3- 2S KVA 277/480 xfmers

— — — — — — —

— — — — — — —

— — — — — — —

IN: 143' - 1/0 AQ (West)

IN: 210' - 1/0 AQ (East)


IN: 1-9/32" Spangwy

IN: 1-Avion Hood



- * Wood Pecker Damage and Limited truck access
- Tree trimming Required around climbing space

DISTRICT 39 - VENTURA		PROJ. MGR. PHONE		PLANNER LOZANO, JOEL PHONE		DESIGNER LOZANO, JOEL	
PROJECT NO. 1838758		SERVICE REQUEST 2741886		MSR NO.		PRODUCT-1 1589932-INFRA REPLAC - DET POLE REPLACEMENT	
CIRCUIT / VOLTAGE Balcom 116kv		THOMAS GUIDE		PRODUCT-2		ASSOC DESGN	
SUB / PG NO. Fillmore		CIRCUIT CODE 00990		PRODUCT-3		ASSOC DESGN	
INVENTORY MAP 48-3S		J.P.A. NO. N/A		PROPOSED CONSTRUCTION (LOCATION) EOI - Det Pole PRCL SOUTH MOUNTAIN RD P/P 215'N 8102'W/C B. SANTA PAULA, CA 93060			
TYPE		DATE		APPROVED BY		CHECKED BY	
DRAWN BY		PAX #		SHEET 1 - 1		DESIGN\DRWG NO. 1185670 0 01	

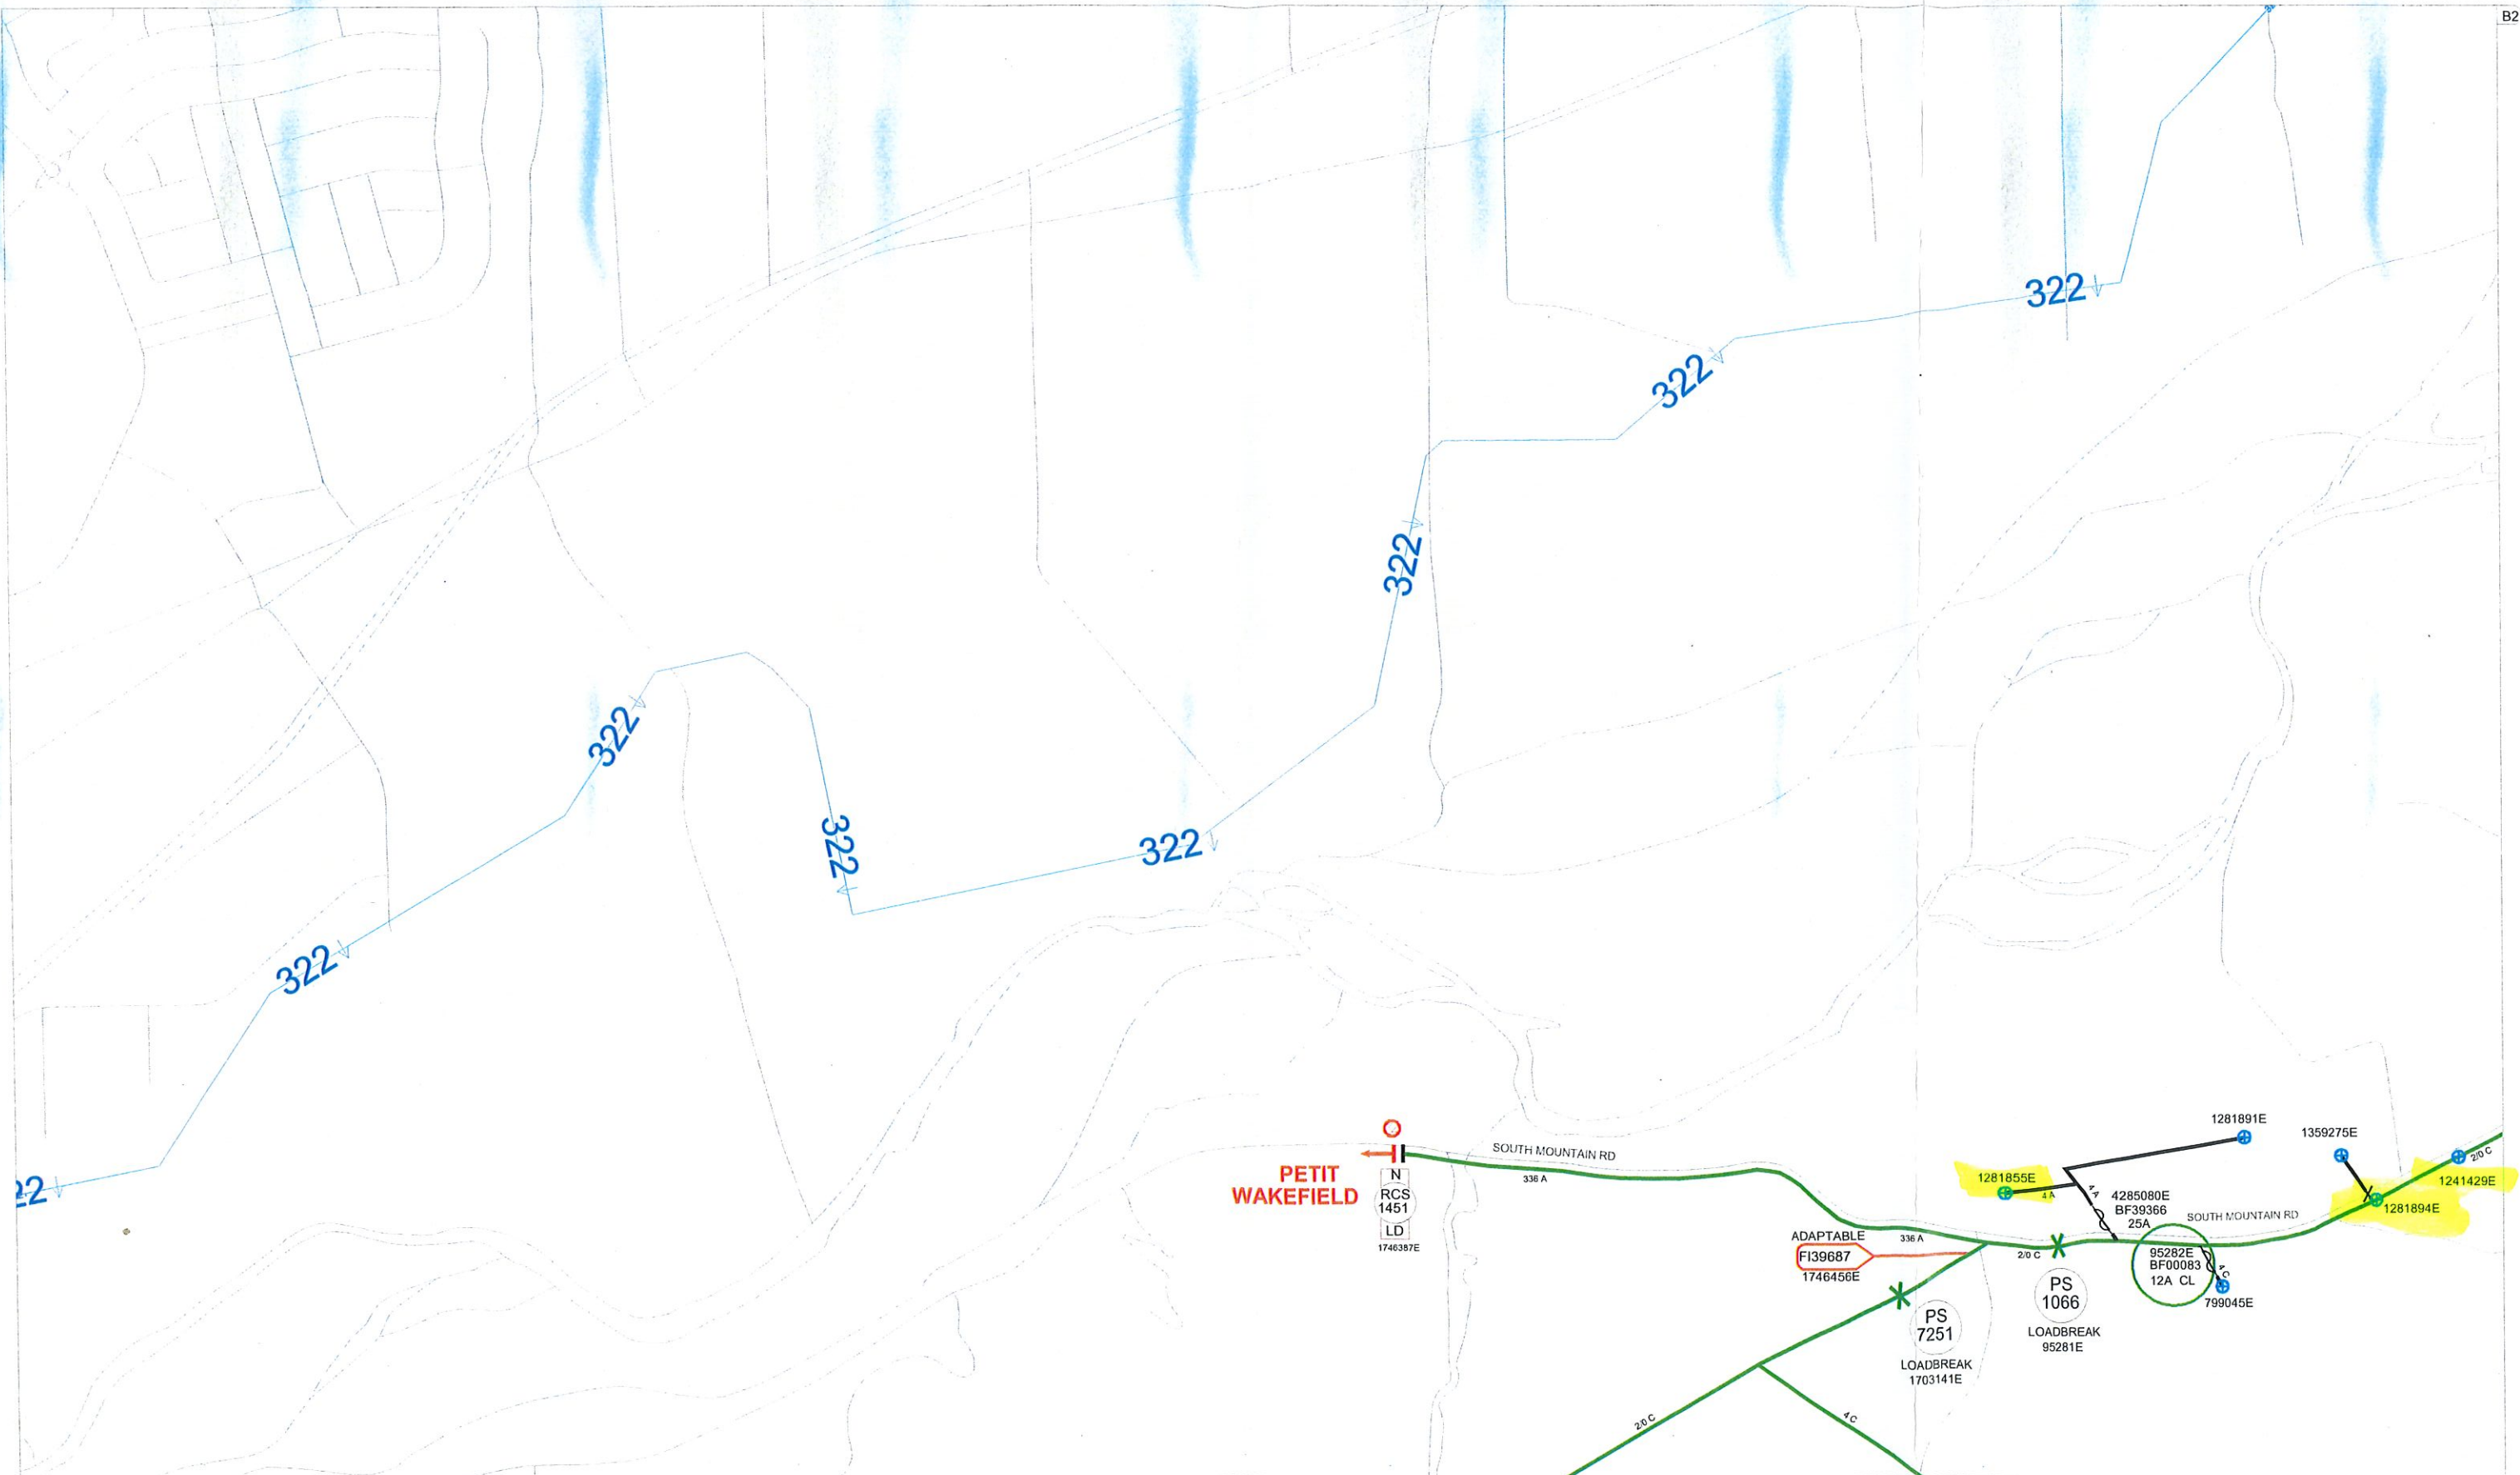

FOREMEN	DATE	SYSTEM: SAUGUS		
BESCH	01/02/2019	PRIORITY NOTIFICATION :		
MAPPING	04/20/2018			
VENTURA	39	FAULT INDICATORS ON LOOP STATIONS :		NO
EQUIP	400	AUTOMATIC SW. GEAR (SCADA):		NO
		NETCOMM EQUIPMENT :		NO

SCALE: 799

BALCOM 16KV
CODE: 00990
FILLMORE SUB (A5)
CODE: 5510

B1

