

PROJECT REQUIREMENTS

EASEMENT REQ'D	☒	PED. TRAFFIC CONTROL REQ'D	☒
PWRD 88 REQ'D	☒	CONVEYANCE LETTER REQ'D	☒
PERMIT REQ'D	☒	JPA REQ'D	☒
PERMIT TYPE:	☐	RENTER NOTIFICATION REQ'D	☒
OUTAGE REQ'D	☒	ENVRO. CLEARANCE REQ'D	☒
TRAFFIC CNTRL REQ'D	☒	CSD 140 (TLM) REQ'D	☒

COST PLUS TO DIG POLE HOLE
HELICOPTER SET

CLEAR BRUSH

L2
33° 39' 15" N
116° 58' 16" W

TID 1608587

SCHEDULES DATE 1.24.2020

(5000 TUBS)


33° 39' 4.87" N 116° 58' 4.83" W

RM: 219519S
RM: 35' CL5
10' X-ARM FB
3-12KV P&I

IN: 219519S
IN: 45' CL4
10' COMP X-ARM TANGENT
3-12KV POLY P&I #8CW
TR: GUY
HARD SET E

SADDLE RIDGE RD

CLEAR A PATH
FOR THE CARS.

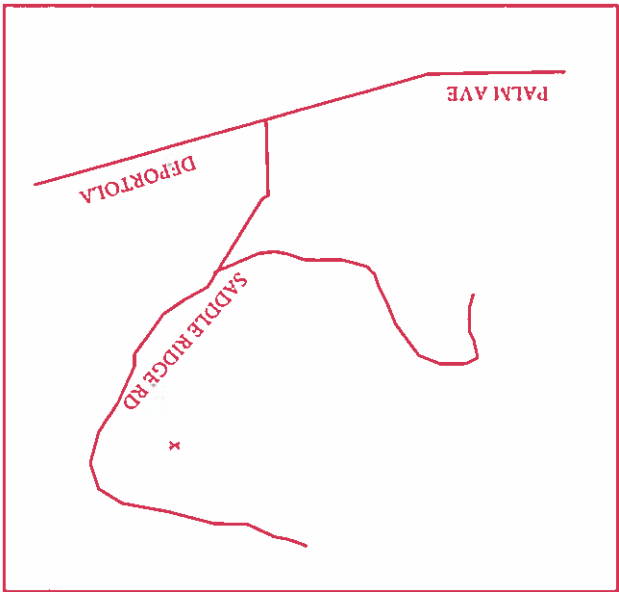

CORSAIR/STETSON G3 (04109)

NOT. 410338296 REPLACE POLE
NOT. 400336165 HIGH SIGNS

NOT TO SCALE

PLANNER: DIGANGI	JOB NAME: OCI-R&R PRIMARY POLE	FOREMAN:	DISTRICT: MENIFEE-77
DWO: TID1608587	JOB LOCATION: SADDLE RIDGE RD E/O DE PORTOLA HEMET	TRUCK	P/E:
A.I. NO.:	TLM-CSD 140 REQUIRED YES NO X	MSR NO.	DRAWN BY: DIGANGI
J.P.A. NO. N/A	GRID NO. THOMAS MAP 871 B6	T.L.M. DATA SIZE KVA CUST. LOAD EX. PROP. NA NA NA NA VOLTAGE DROP PRI. CIRC.: CORSAIR 12KV	DATE SENT TO R/W:
RELATED W.O.		WORKED BY:	DIST. SKETCH
		INV. MAP NO.'S VERIFIED: (✓)	INV. MAP NO'S 540-1782-1

Untitled Map

Write a description for your map.

Saddle Ridge Rd

Feature 1 33°39'15.47"N 116°58'21.55"W

Pole location 33°39'4.87"N 116°58'4.83"W

Legend


- Feature 1
- Palm Ave & Saddle Ridge Rd

Google Earth

© 2019 Google

700 ft



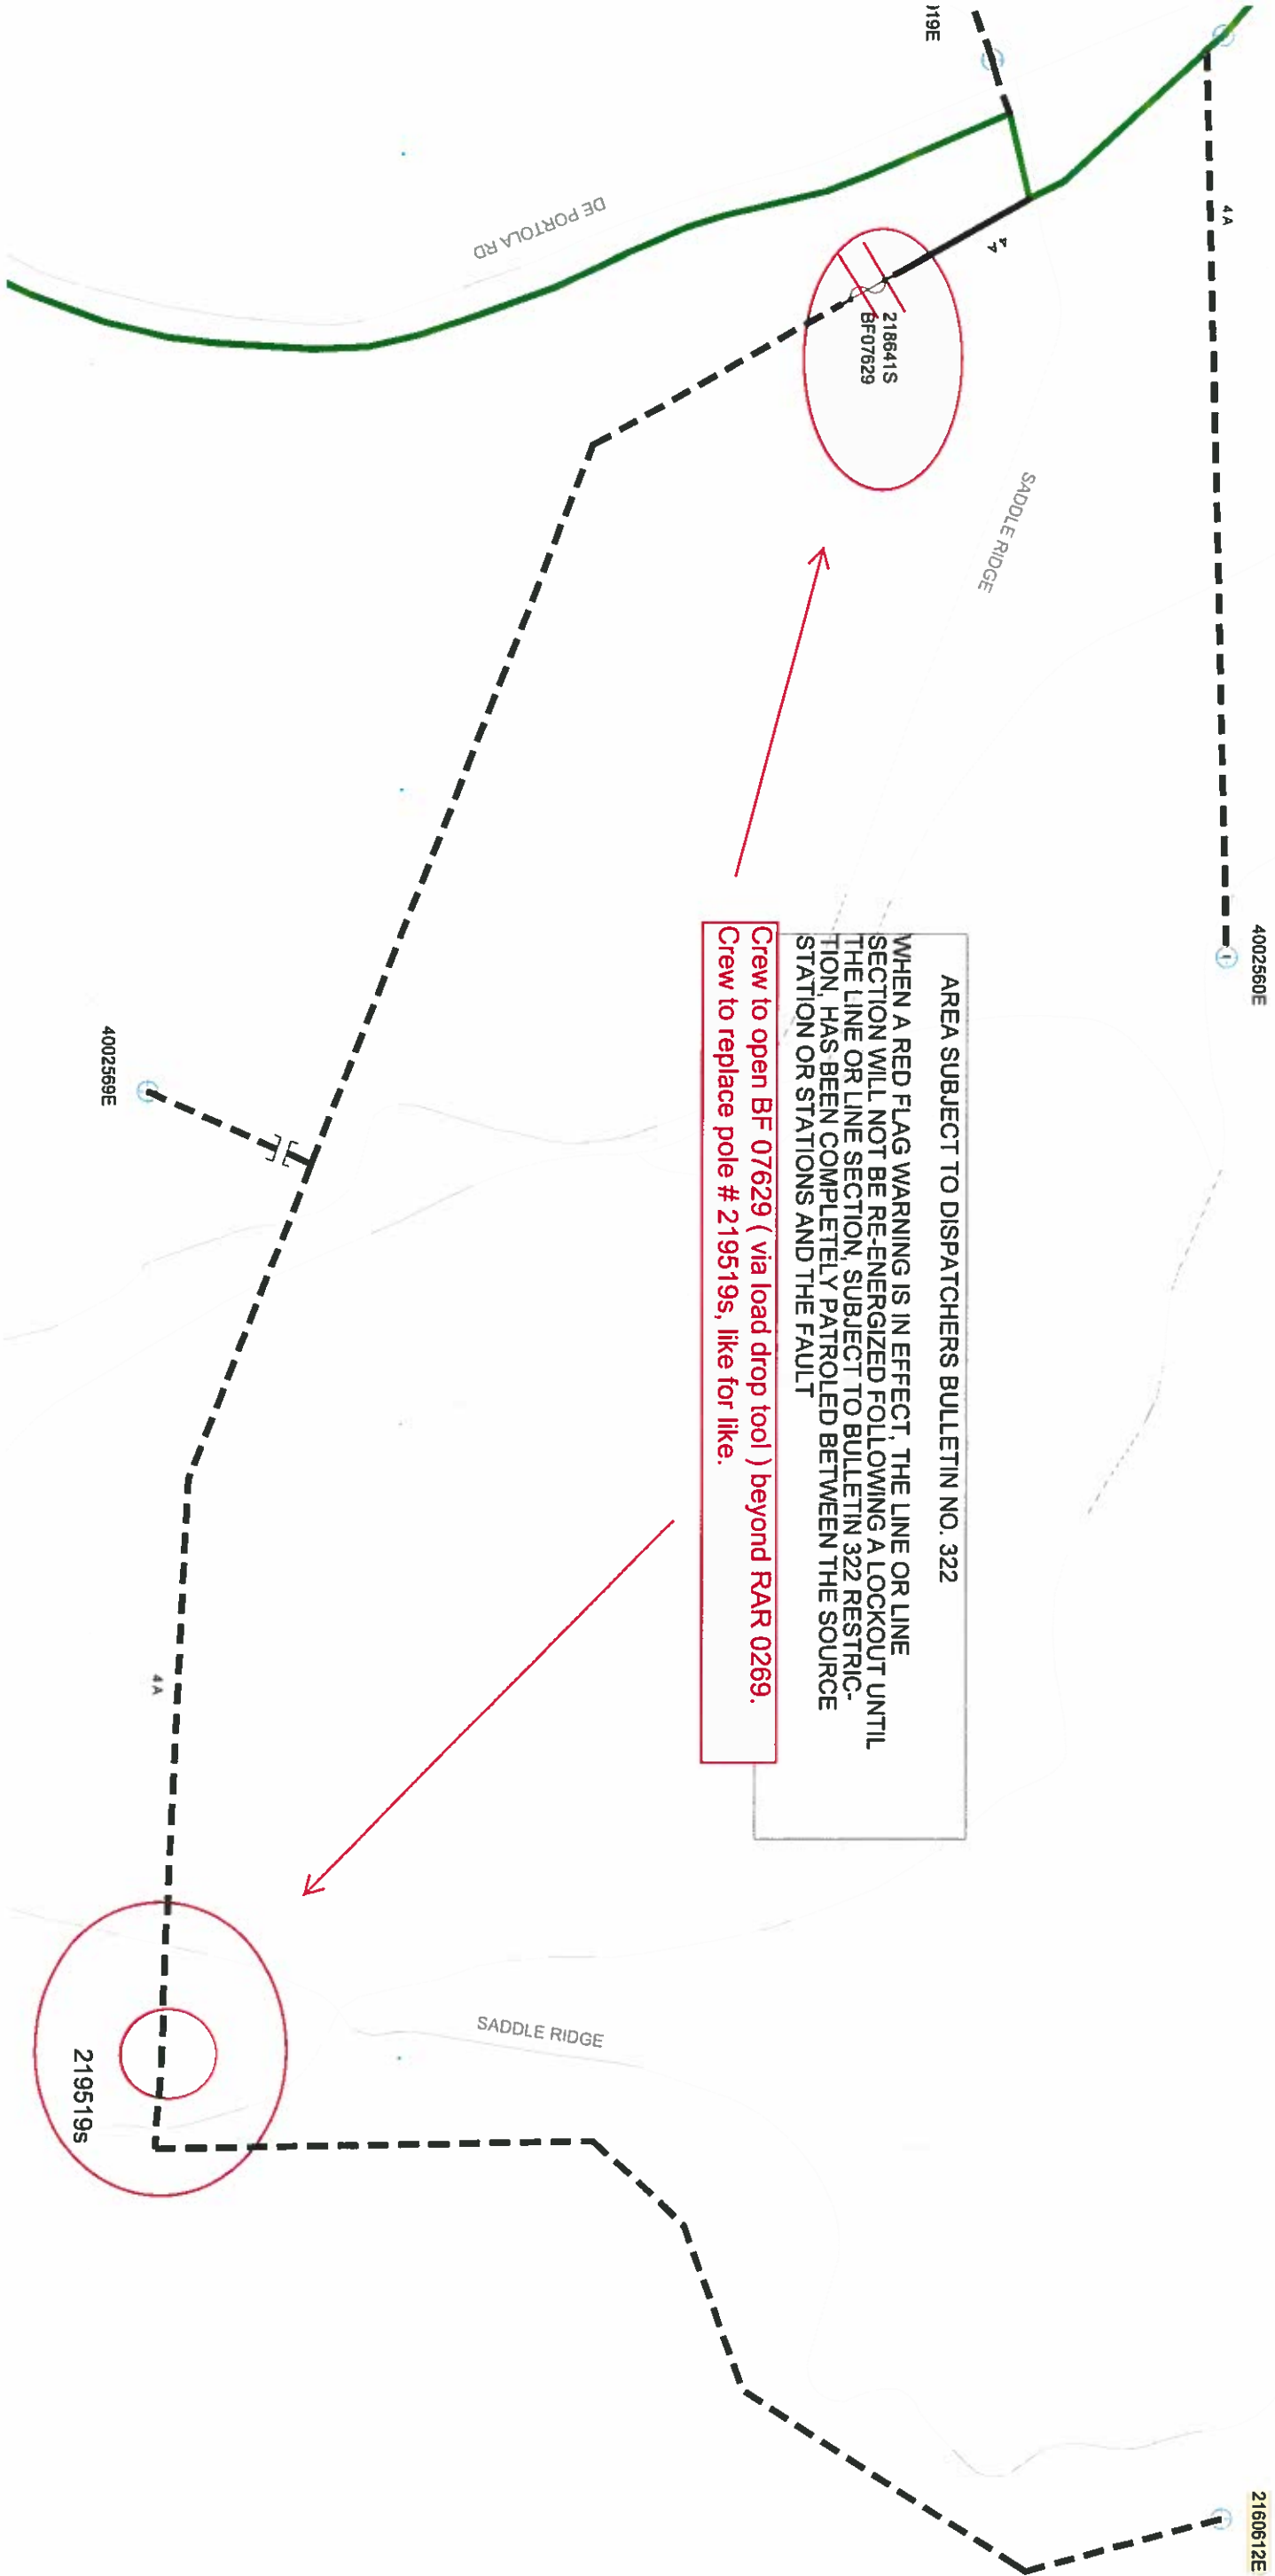

AREA SUBJECT TO DISPATCHERS BULLETIN NO. 322

WHEN A RED FLAG WARNING IS IN EFFECT, THE LINE OR LINE SECTION WILL NOT BE RE-ENERGIZED FOLLOWING A LOCKOUT UNTIL THE LINE OR LINE SECTION, SUBJECT TO BULLETIN 322 RESTRICTION, HAS BEEN COMPLETELY PATROLED BETWEEN THE SOURCE STATION OR STATIONS AND THE FAULT

Crew to open Bf 07629 (via load drop tool) beyond RAR 0269.
Crew to replace pole # 219519s, like for like.

Appels 39980 ✓