


NOTES:

TR: 3-1/OA-16kV (NW/SE)

-BULLETTIN 322

-EAGLE ZONE

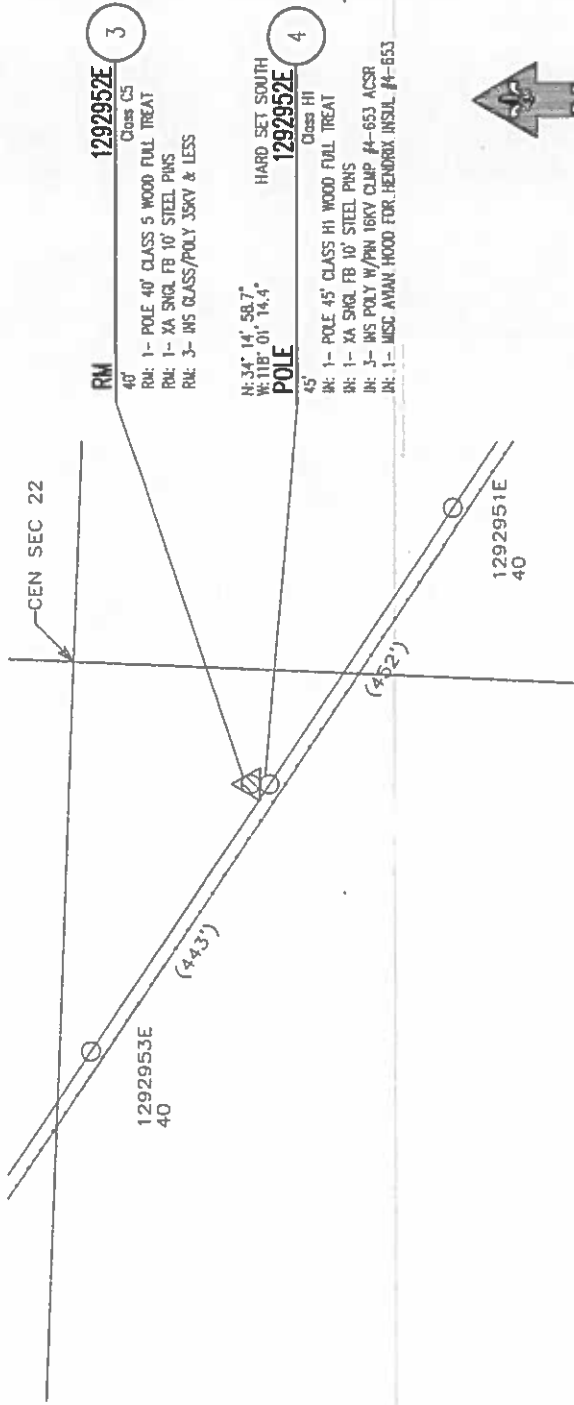

SOUTHERN CALIFORNIA
EDISON
AN EDISON INTERNATIONAL COMPANY

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)	
DESIGN EXEMPT REQUIRED	☐
PERMITS REQUIRED	☐
USE ONLY DAY WORK ORDER	☐
PERMIT REQUIRED	☐
PERMIT TYPE	
OUTLINE REQUIRED	☐
OUTLINE DATE	
TRAFFIC CONTROL REQUIRED	☐
RED. TRAFFIC CONTROL REQD	☐
CONFORMANCE LETTER REQD	☐
ENVIRONMENTAL CLEARANCE REQD	☐
CSD 140 (PLM) REQD	☐


DISTRICT 27 - MONROVIA		PROJ. MGR. KERRAN, STEPHEN J		PLANNER CABLE, HARRISON (HM)		DESIGNER FELIX, DAVID (HM)	
PROJECT NO. 1694874		SERVICE REQUEST 2601265		PHONE 909-274-1792		PHONE 809-670-7049	
CIRCUIT / VOLTAGE RED BOX / 16kV		THOMAS CODE		1478948-INFRA REPLAC-DET POLE REPLACEMENT		ASSOC. DESIGN	
SUB / PG. NO.		CIRCUIT CODE 14758		PRODUCT-3		ASSOC. DESIGN	
RED BOX PT / A4		J.P.A. NO.		PRODUCT-3		ASSOC. DESIGN	
INVENTORY MAP 97-84		PROPOSED CONSTRUCTION (LOCATION) SEC 22 T3N R11W 2440' E/O W/L 2415' S/O N/L LA CANADA, CA					
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAGE #	DESIGN/WORKING NO.	
						10956945 0 01	

DATE: 10/10/00

Southern California Edison Company

TR: 3-1/0A-16kV (NW/SE)

-BULLETIN 322
-EAGLE ZONE

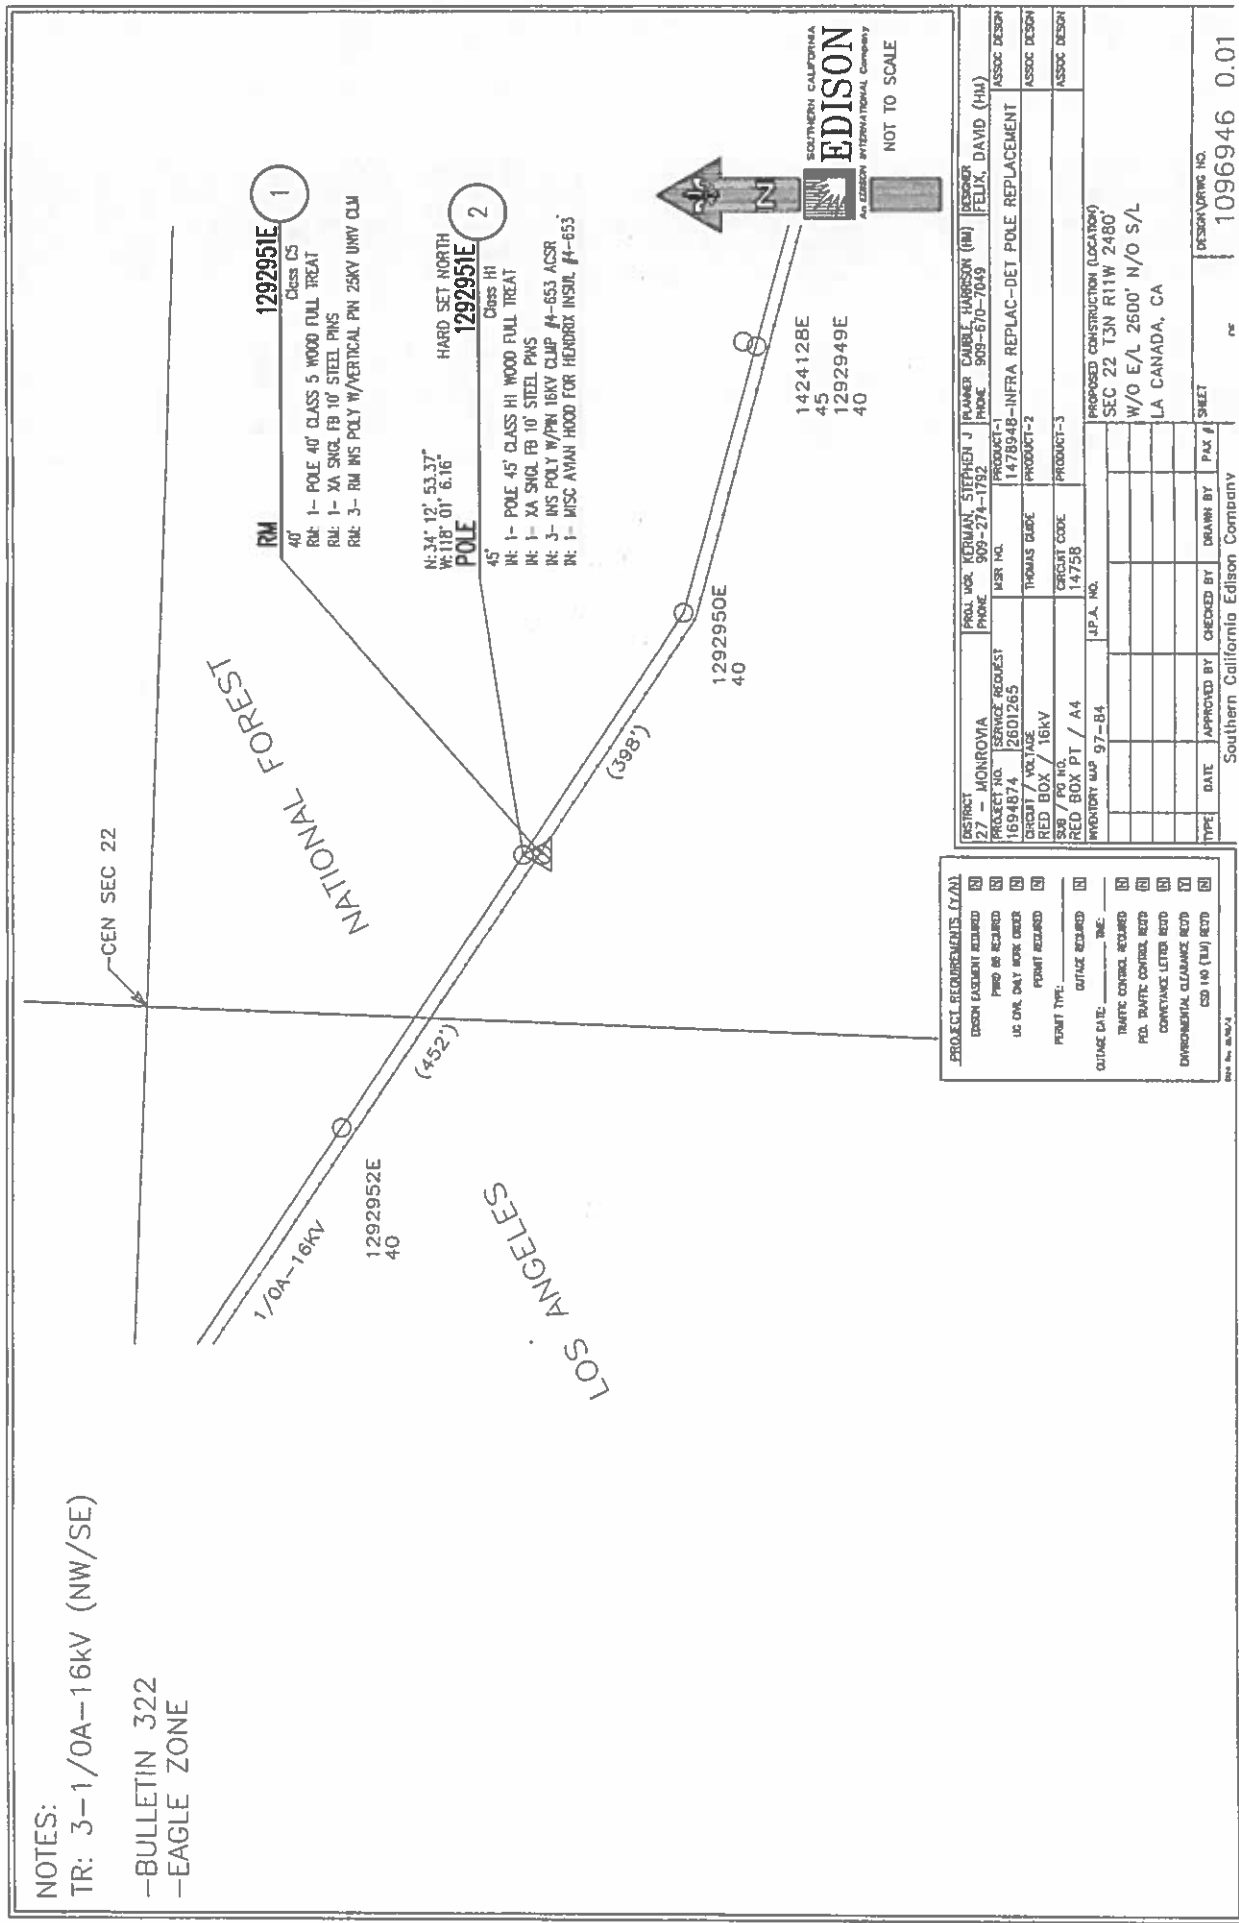


TR: 3-1/0A-16KV (N/S) @ 38'

-BULLETIN 322

—EAGLE ZONE

—POSSIBLE HELICOPTER SET

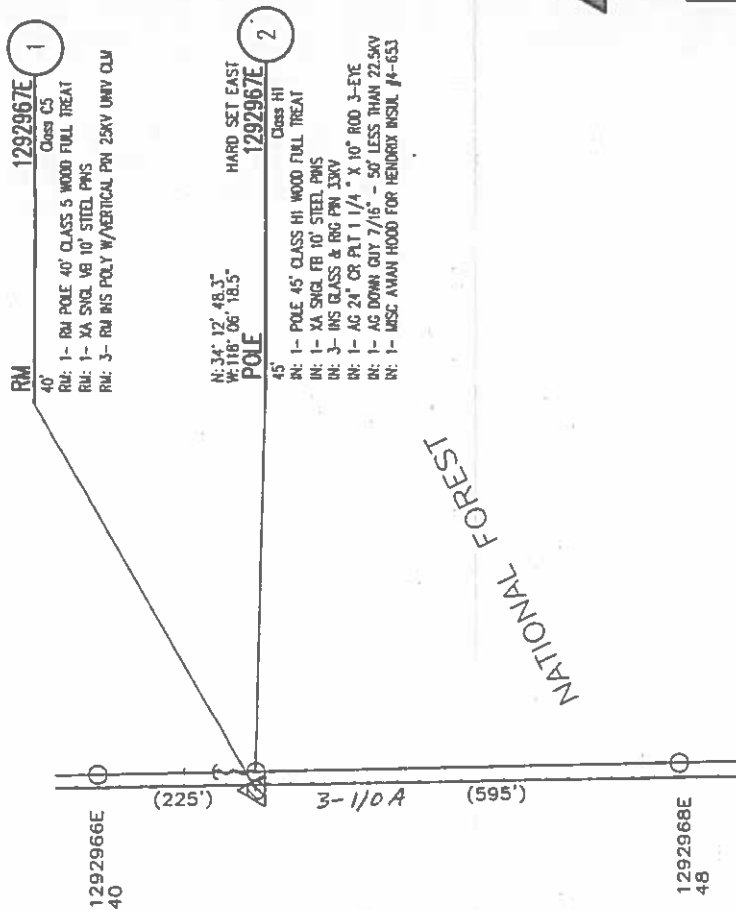

NATIONAL FOREST

LOS ANGELES



**SOUTHERN CALIFORNIA
EDISON**
an Edison International Company

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)	
DISSEM. ASSISTANT REQUIRED	NO
PHOTO GR. REQUIRED	NO
UC. OML. ONLY WORK ORDER	NO
PERMIT REQUIRED	NO
PERMIT TYPE _____	
OUTAGE DATE _____	OUTAGE REQUIRED
NO.	NO.
BLM/FPC CONTROL REQUIRED	NO
PEL. TRAFFIC CONTROL NEEDED	NO
COMPLIANCE LETTER NEEDED	NO
ENVIRONMENTAL CLEARANCE NEEDED	NO
CSD 142 (FLY) NEEDED	NO

[illegible]