

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____



☐ Week 2 _____

☐ Week 3 _____

- NOTES:
- SCE TO PTD.
 - HAND SET NORTH.
 - HAND SET/DIG REQUIRED.
 - NO TRUCK ACCESS.
 - TREE TRIMMING REQUIRED.
 - EAGLE ZONE.
 - BULLETIN 322 AREA.

TRANSFER:

- 3- #4BC 16KV

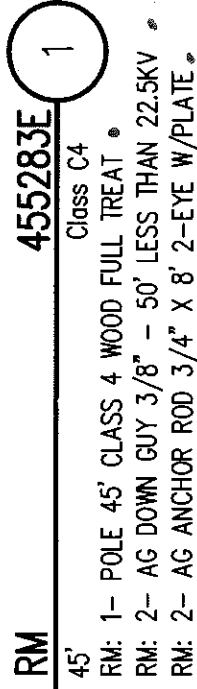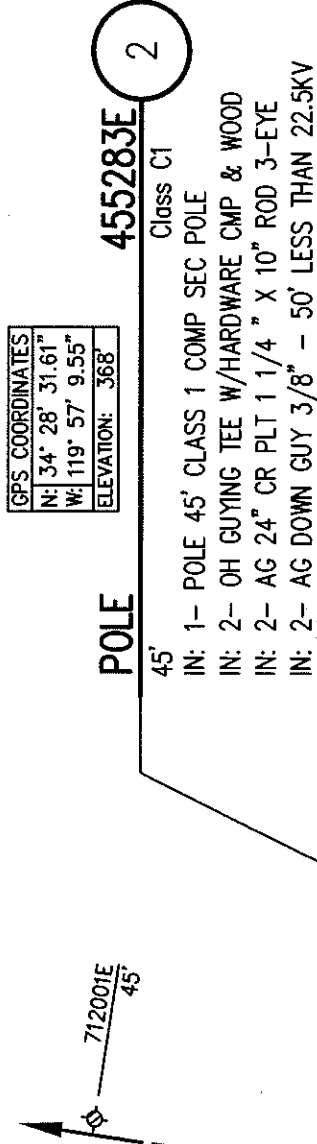

CONDUCTOR REPLACED ON
RELATED OCP TD1506910

RM: 3- #4BC 16KV
IN: 3- #2CTW 16KV



RM: 1- 3/8" D.G. 037'6"
IN: 1- 3/8" D.G. 037'

PROPOSED
455283E
L/W

RM: 1- 5/8" EYE ANCHOR
IN: 1- 1.25" EYE ANCHOR

ELEVATION +3'
GROUND LEVEL

24'



RM: 1- 3/8" D.G. 037'
IN: 1- 3/8" D.G. 036'6"

PROPOSED
455283E
L/N

RM: 1- UNKNOWN BURIED ANCHOR
IN: 1- 1.25" EYE ANCHOR

ELEVATION +1'
GROUND LEVEL

29'

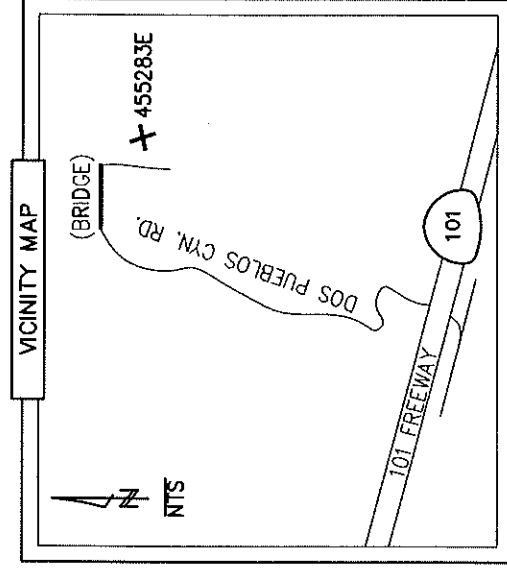


SOUTHERN CALIFORNIA
EDISON
AN EDISON INTERNATIONAL COMPANY

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)		DISTRICT 49 - SANTA BARBARA		PROJ. MGR. TOLMASOFF, LAURA M		PLANNER TIDWELL DESIGN		DESIGNER TIDWELL DESIGN	
EDISON EASEMENT REQUIRED	☒	PROJECT NO.	1676359	SERVICE REQUEST	2583209	MSR NO.	1464894	INFRA REPLAC - DET POLE REPLACEMENT	ASSOC DESIGN
PERMITS REQUIRED	☒	CIRCUIT / VOLTAGE	MIST 16KV	THOMAS GUIDE	N/A	PRODUCT-1	1506910	INFRA REPLACEMENT (CONDUCTOR)	ASSOC DESIGN
UG CIVIL ONLY WORK ORDER	☒	SUB / PG NO.	CAPITAN	CIRCUIT CODE		PRODUCT-2			ASSOC DESIGN
PERMIT REQUIRED	☒	INVENTORY MAP	21-44	J.P.A. NO.	N/A	PRODUCT-3			ASSOC DESIGN
OUTAGE REQUIRED	☒	PROPOSED CONSTRUCTION (LOCATION)							
OUTAGE DATE:	TIME:	455283E							
TRAFFIC CONTROL REQUIRED	☒	9545 DOS PUEBLOS CYN. RD.,							
PED. TRAFFIC CONTROL REQ'D	☒	GOLETA							
CONVEYANCE LETTER REQ'D	☒								
ENVIRONMENTAL CLEARANCE REQ'D	☒								
CSD 140 (TUM) REQ'D	☒								
Southern California Edison Company									
TYPE		DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	DESIGN/DRWG NO.		
					TIDWELL		1085793_0.01		

DTK Rev. 02/05/18

455283E

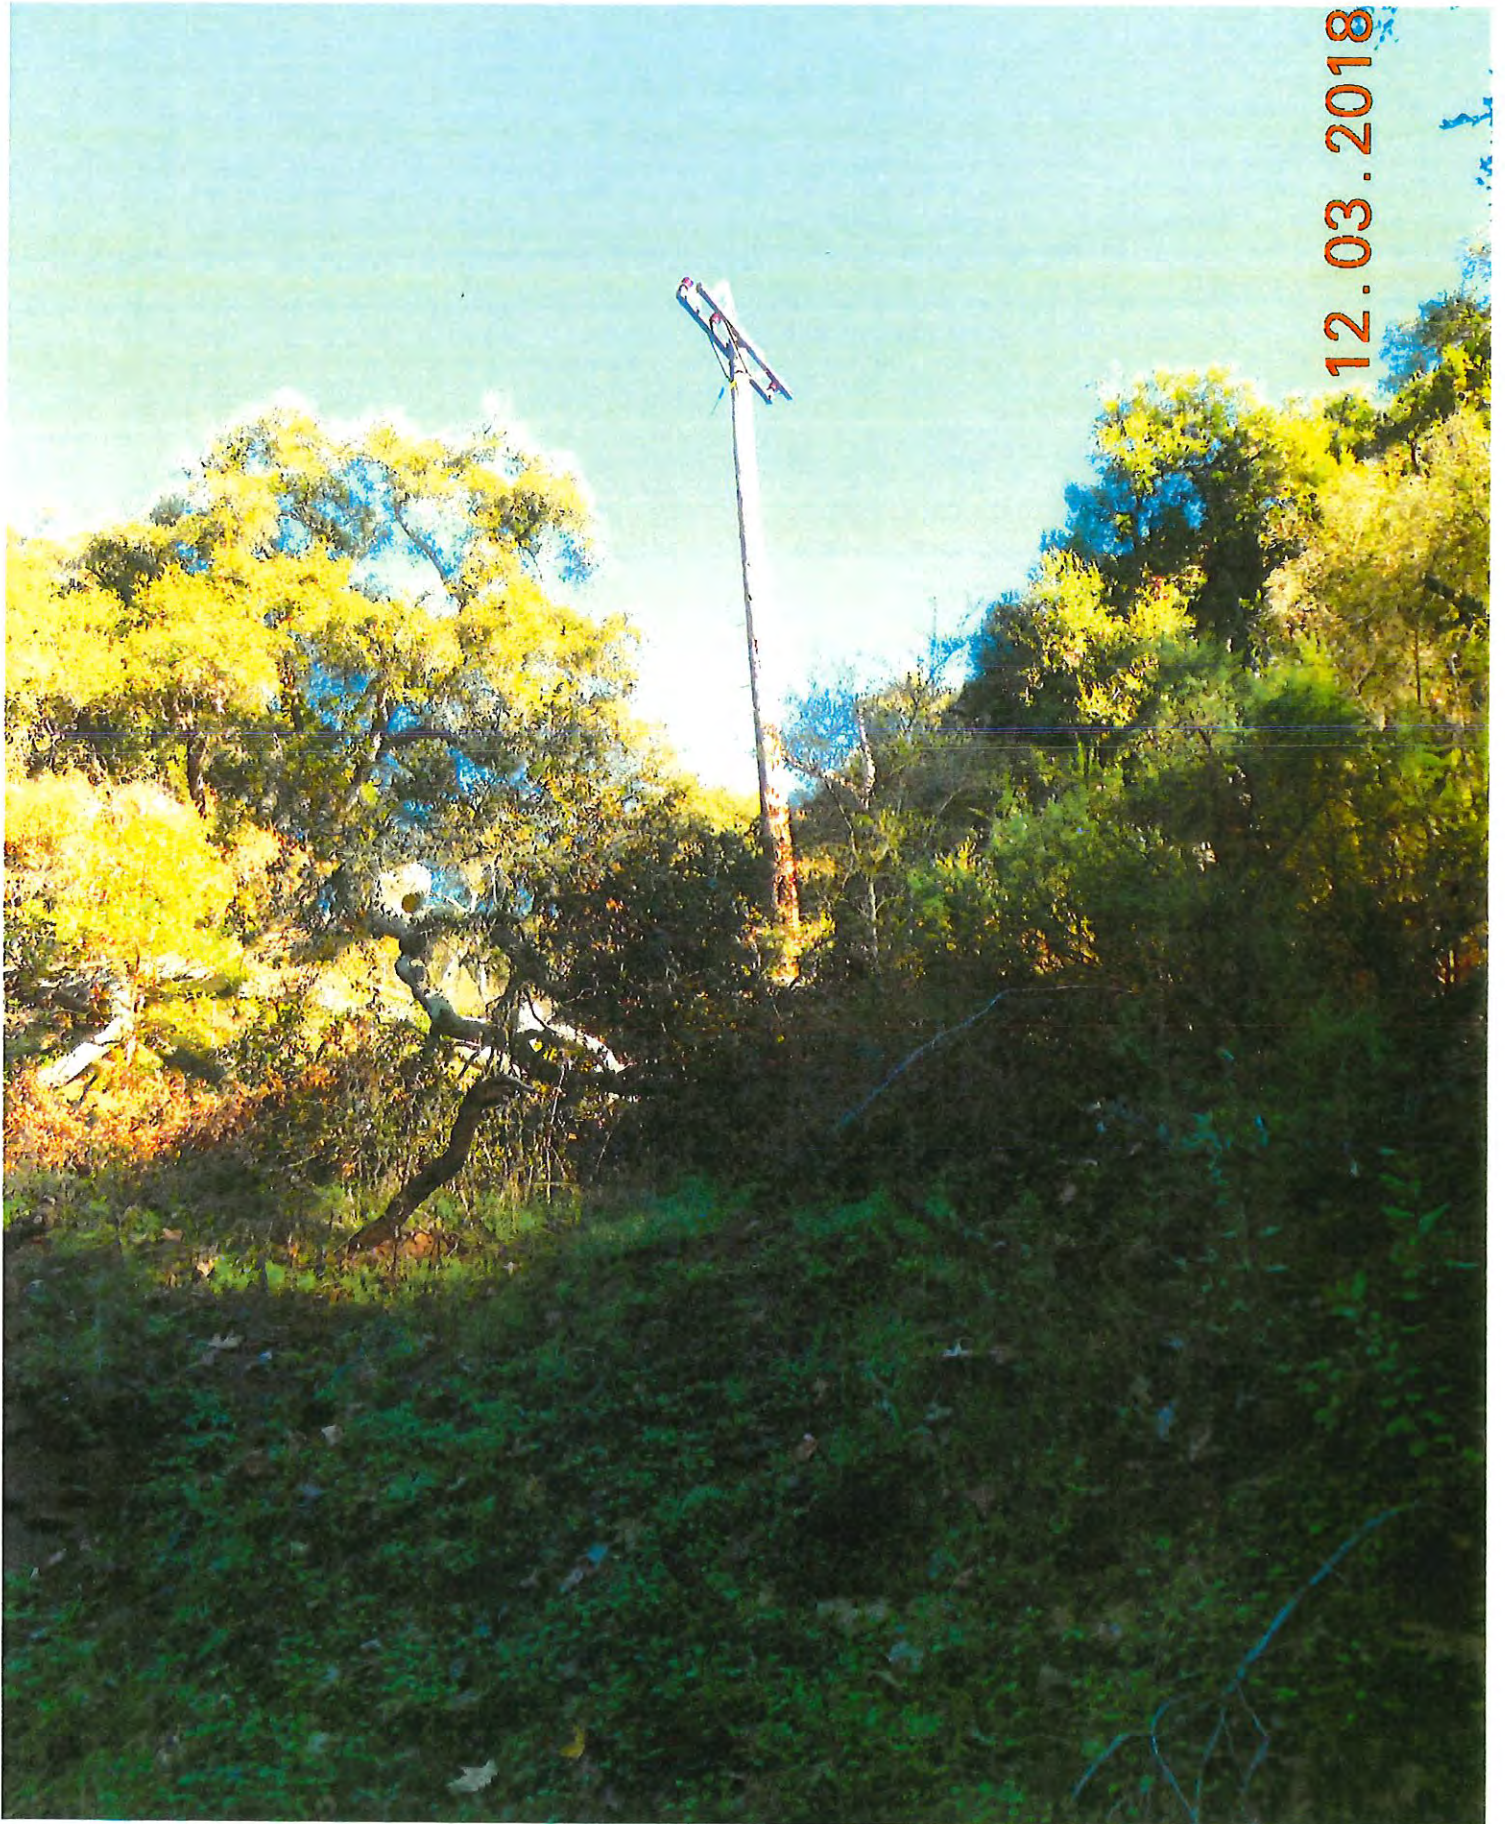

Dist. Deteriorated Pole
L / NE