

HELICOPTER LIFT OPERATIONS SAFETY BRIEF CHECKLIST

PRIOR TO BEGINNING ANY HELICOPTER OPERATION A THOROUGH SAFETY BRIEF WILL BE CONDUCTED UTILIZING THE FOLLOW CHECKLIST: *Dos Pueblos SB*

- ☐ SAFETY BRIEF SIGN IN *2-27-2020*
- ☐ GHI CREW INTRODUCTION *2-28-2020*
- ☐ IS A TRANSLATOR REQUIRED *2-29-2020*
- ☐ WORK STOP AUTHORITY *HEC (8) poles Digger compressors*
- ☐ DESIGNATE A 911 CALLER *UH-1H - HEC ship*
- ☐ IDENTIFY CLOSEST EMERGENCY MEDICAL SERVICES *TD1485929 - TD1489914 TD1483903*
- ☐ CREW FATIGUE AND HYDRATION *TD1463008 - TD1464894*
- ☐ HELICOPTER LIFT LIMITATIONS
- ☐ HAZMAT WILL OR WILL NOT BE CARRIED ON THE HOOK
- ☐ NON GHI EMPLOYEES WILL NOT APPROACH HELICOPTER WITH ROTORS ENGAGED
- ☐ HELICOPTER HAZARD AREA (TAIL/MAIN ROTOR)
- ☐ EFFECT OF ROTOR DOWN WASH ON LOAD

DUST MASK: BURN AREA, DUST, POLLEN EXPOSURE

- ☐ HELICOPTER DOOR REMOVAL AND FIRE EXTINGUISHER LOCATION
- ☐ PPE REQUIREMENTS (GLOVES, EYE PROTECTION, HARD HAT WITH CHIN STRAP)
- ☐ PILOT/GROUND CREW COMMUNICATIONS/ LOST COMMUNICATIONS

PROCEDURES

- ☐ POTENTIAL STATIC CHARGE CAUSED BY HELICOPTER
- ☐ SITE PLAN / FLIGHT PATH
- ☐ FALL, PINCH, CRUSH DANGER POINTS
- ☐ RIGGING OPERATIONS CONNECTING AND DISCONNECTING CRANE HOOK AND SPREADER BAR HOOK
- ☐ PROPER SECURING OF EQUIPMENT / TOOLS IN SUPER SACK AND ON LONG LINE
- ☐ STREET CLOSURE / EVACUATION USE DIAGRAM TO ENSURE ALL HOMES ARE CLEAR
- ☐ NO CELL PHONES OR CAMERA USED BY GROUND CREW

Non-compliance with established procedures may result in your removal from the mission

AIRCRAFT	ENVIRONMENT	EXTERNAL LOAD
☐ Approach and departure ☐ Main/tail rotor hazards ☐ Safe cargo loading/unloading ☐ Loose articles: - Aircraft & LZ ☐ Hearing protection ☐ Door/seatbelt operation ☐ Headset/helmet/intercom ☐ Air-sickness ☐ In-flight emergencies Establish who will call 911 ☐ Location of: o First aid/survival kit o Fire extinguisher o Fuel and battery shut off procedure o Radios, ELT, SAT Phone ☐ Fueling Operations: - Duties & Safety Issues	☐ Weather conditions ☐ Wind direction ☐ Fuel ☐ Gross weight ☐ Terrain ☐ Landing zone hazards ☐ Density altitude ☐ Noise abatement ☐ Congested area plan ☐ Traffic/crowd control CRM ☐ COMMUNICATION IS CRITICAL ☐ Standardized language ☐ "Code Red" phrases ☐ Sterile cockpit ☐ Flight following/radio procedures ☐ Possible tasks for crew, e.g., switch/tune radios, maps ☐ Hazard awareness, e.g., birds, other hazards ☐ STOP work policy ☐ Re-brief in case scope changes ☐ <u>IMSAFE Acronym</u> Pilot fatigue mitigation must be briefed prior to work	☐ Ground crew PPE ☐ Long Line & Rigging Equipment Inspection ☐ Communication: Use of headset for lineman communicating with pilot ☐ Head/Hand Signals ☐ Pole set procedures: Brief how pole will be secured: 1) Taglines 2) Pikes 3) fill dirt ☐ Steps on pole ☐ Remote hook operations ☐ Ground crew hook up procedures ☐ Static discharge ☐ Emergency flyaway procedures ☐ Long line clearance (6'- 25'- 150% rule) ☐ No person under load ☐ Ground crew safety zone ☐ Pole removal with potential snag issues must be discussed ☐ Nylon straps (wood vs. glass) ☐ Load ratings (7:1 minimum) ☐ Dry Run/Play by play pole set Procedures ☐ Induced Voltage from: - Adjacent circuits, Underbuild, Parallel circuits etc. ☐ In case of Non-Company ground crew: Rigging procedures must be briefed ☐ No cell phone/camera use during external loads ☐ Essential crew only



SECTION 7

Part 135 GH 4A Part 133 GH 4L

NON Congested Area Plan

Operator: Guardian Helicopters, Inc
67 D STREET
Fillmore CA. 93015
Phone (818) 442-9904
FAX (818) 442-9901

PROJECT: EDISON POLE REPLACEMENT WORK ORDER #: TD1485929 TD 1485914 TD 1485903TD

1465008 TD1464894 ADDRESS: DOS PUEBLOS CANYON RD : GOLETA CA

LZ STAGING AREA 34°28'5.78"N 119°57'23.22"W

LZ STAGING AREA LATITUDE 34°27'44.68"N LONGITUDE 119°58'3.72"W

2108853E LATITUDE 34°28'40.71"N LONGITUDE 119°57'4.68"W 45 CL 1 COMP 1300 LBS

455282E LATITUDE 34°28'28.36"N LONGITUDE 119°57'10.54"W 45 CL 4 WOOD 1500 LBS

455283E LATITUDE 34°28'31.61"N LONGITUDE 119°57'9.55"W 45 CL 1 COMP 1300 LBS

712011E LATITUDE 34°28'41.95"N LONGITUDE 119°57'10.57"W 45 CL 1 COMP 1300 LBS

2134286E LATITUDE 34°28'46.15"N LONGITUDE 119°57'8.23"W 45 CL 4 WOOD 1500 LBS

2134291E LATITUDE 34°28'53.37"N LONGITUDE 119°56'51.68"W 45 CL 1 COMP 1300 LBS

1081630E 1081630E 34°28'16.96"N 119°57'15.78"W 34°28'16.96"N 119°57'15.78"W 45 CL 1 1900 LBS

CONTACT AT SITE; JEREMY BRIGG PHONE#: 805-807-6272

PEDRO LEMUS PHONE#: 909-306-8203

PILOT'S NAME(S): 1. JOHN OLSON CERT #: 2769166
2. BUCKEY MACKAY CERT #: 2778051
3. MICHAEL KLINK CERT# 3018828
4. IAN GOODALE CERT# 3741973

TYPE OF AIRCRAFT:

BELL UH-1H N# N711GH A/C CATEGORY: RESTRICTED

BELL UH-1H N# N214KK A/C CATEGORY: RESTRICTED

BELL 407 N# N407GH A/C CATEGORY: STANDARD

BELL 205A1 N# N216GH A/C CATEGORY: STANDARD

AS350 B2 N# N498PT A/C CATEGORY: STANDARD

AS350 B3 N# N718GH A/C CATEGORY: STANDARD

AS350 B3 N# N215GH A/C CATEGORY: STANDARD

IF SAFETY DICTATES AND OR THE CUSTOMER REQUESTS ADDITIONAL LIFTS THE LIFTS WILL BE CONDUCTED REMAINING WITHIN THE APPROVED TIME PARAMETERS.

TYPE OF LIFTS: POLES LOAD:EXTL CL B TYPE OF ITEM LIFTING: POLE EQUIPMENT ☐

AERODYNAMIC ☒ NON- AERODYNAMIC MAX 1700 LBS

NO. OF LIFTS: 18 LONG LINE: (NO) XXX (YES) LESS THEN 150 FT (LENGTH)

OPERATIONAL ALTITUDE: < 250 STREET CLOSING: (NO) XX (YES)

DATE AND TIMES OPERATION WILL BEGIN AND TERMINATE:

FLIGHT DATES	TIME BEGIN	TIME END	TODAY'S DATE
2-27-2020	SUNRISE	SUNSET	2-20-2020
2-28-2020	SUNRISE	SUNSET	2-20-2020
2-29-2020	SUNRISE	SUNSET	2-20-2020
AGENCY NAME:	PHONE#:	PERSON NOTIFIED:	DATE:
SANTA BARBARA SHERIFF	805-928-3781	WATCH COMMANDER	NOTIFY
SANTA BARBARA COUNTY FIRE	805-681-5518	STATION 18	NOTIFY



Part 135 GH 4A Part 133 GH 4L
NON Congested Area Plan

Evacuation

☒ No Evacuated Structures

☐ Evacuated Structures

Crowd Control

☒ Operator

☒ Contractor

Street Closure

☐ Yes ☒ No

☒ Contractor

☐ Operator

LIST OF BUILDINGS THAT SHALL EITHER BE PARTIALLY OR ENTIRELY UNOCCUPIED PERSONS ALSO HOMES THAT WILL BE NOTIFIED OF ACTIVITY:

BUILDING DESCRIPTION/ADDRESS	REMARKS	METHOD
NONE		
ALL HOMES WITHIN RED OPERATING AREA	VACANT DURING OPS	HAND DELIVER
SEE DIAGRAM = VACANT	VACANT DURING OPS	HAND DELIVER

Narrative description of pick-up site, route, delivery site, and plan for ceasing operation if unauthorized persons enter operational area or real hazard occurs.

SITE INSPECTION NOTES


ONLY PERSONNEL ESSENTIAL TO COMPLETING THE JOB SAFELY WILL BE PERMITTED TO PARTICIPATE IN THE EVOLUTION. ONLY PERSONNEL PARTICIPATING IN THE SAFETY BRIEF WILL BE PERMITTED TO BE IN THE AREA OF OPERATIONS. ONLY AUTHORIZED ESSENTIAL PERSONAL WILL BE PERMITTED IN THE IMMEDIATE AREA OF OPERATIONS. IN THE EVENT AN UNAUTHORIZED PERSON ENTERS THE OPERATIONS AREA OR A POTENTIAL HAZARD IS IDENTIFIED THE PILOT WILL HOLD THE AIRCRAFT IN RELATIVE POSITION. THIS WILL BE ACHIEVED WITHOUT OVER FLYING THE GROUND CREW. ALL OPERATIONS WILL BE CEASED UNTIL THE PROBLEM IS RECTIFIED. IN THE EVENT OF AN AIRCRAFT EMERGENCY, THE PILOT WILL RADIO GROUND PERSONNEL AND WILL ATTEMPT TO LAND IN THE EMERGENCY LANDING AREA.

DURING THE LIFT EVOLUTION THE AIRCRAFT AND GROUND CREW WILL ALL BE IN RADIO COMMUNICATIONS. IN THE EVENT OF LOSS COMMUNICATIONS, THE CREW WILL USE STANDARD HAND SIGNALS TO COMMUNICATE WITH THE PILOT. WHEN THE PILOT IS CLEAR HE WILL MOVE THE AIRCRAFT TO A SAFE LOCATION TO ALLOW THE COMMUNICATION PROBLEM TO BE RECTIFIED.


THE OPERATIONS AREA IS WITHIN THE SECURED AREA. ALL ESSENTIAL CREW WITHIN THE OPERATIONS AREA WILL NOT BE INVOLVED IN TAKING PICTURES OR ANY OTHER USE OF CELL PHONES.


PRIOR TO BEGINNING OPERATIONS, A TAILBOARD SAFETY BRIEF WILL BE CONDUCTED.

1. HELICOPTER WILL LAND AT THE LZ TO CONNECT THE LONGLINE AND CONDUCT A SAFETY TAILBOARD
2. FUELING WILL BE CONDUCTED AT THE LANDING ZONE
3. EMERGENCY LANDING ZONE IS AT THE STAGING AREA AND ALONG THE FLIGHT PATH
4. POLES WILL BE STAGED AT THE LZ
5. RADIOS WILL BE PROVIDED TO EACH POLE SITE
6. WATER TRUCK REQUIRED AT LANDING ZONE
7. NO STREET CLOSURES
8. THE CONTRACTOR WILL TRIM TREES IF REQUIRED

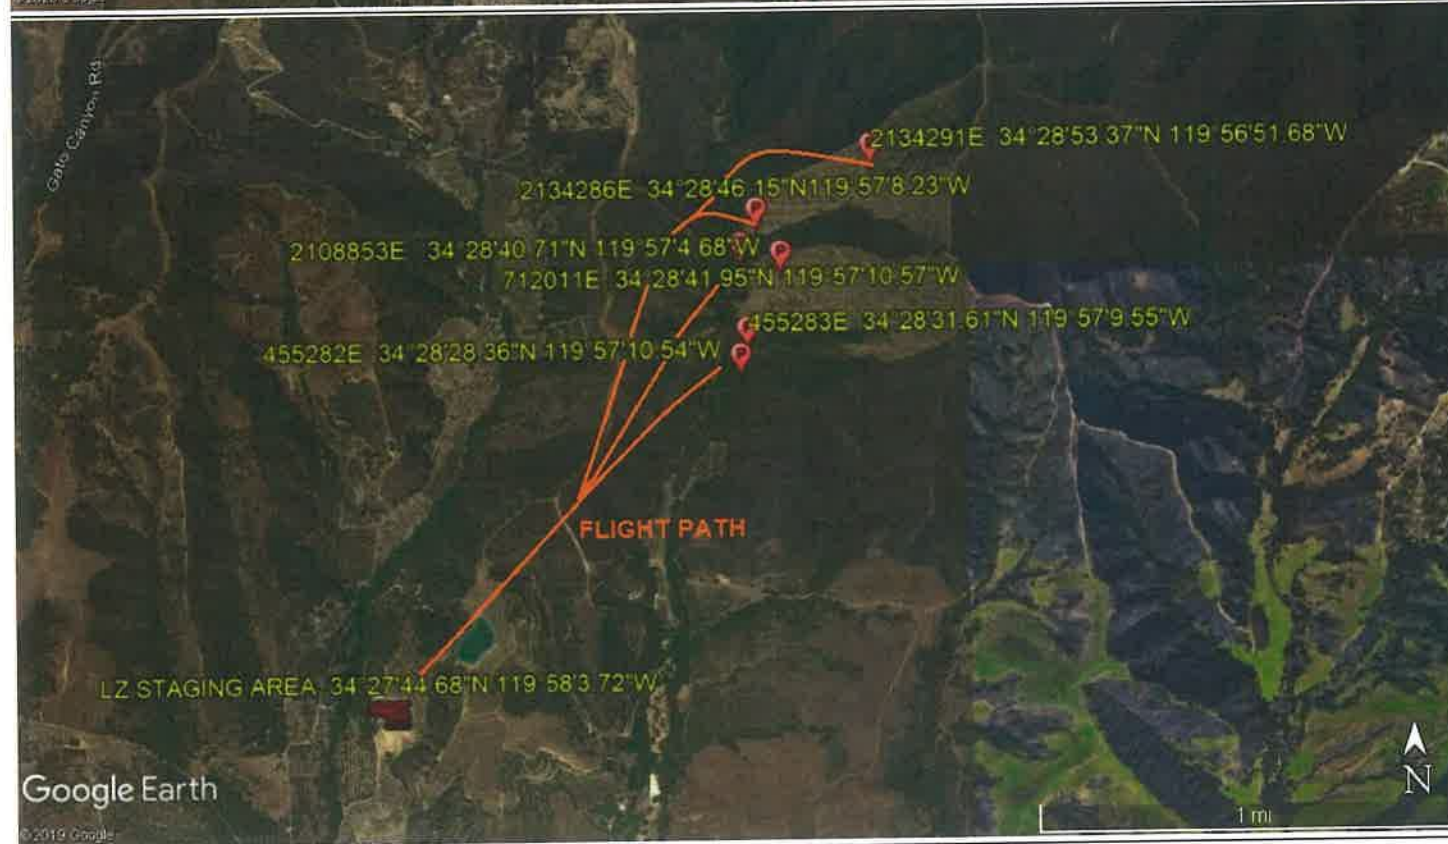



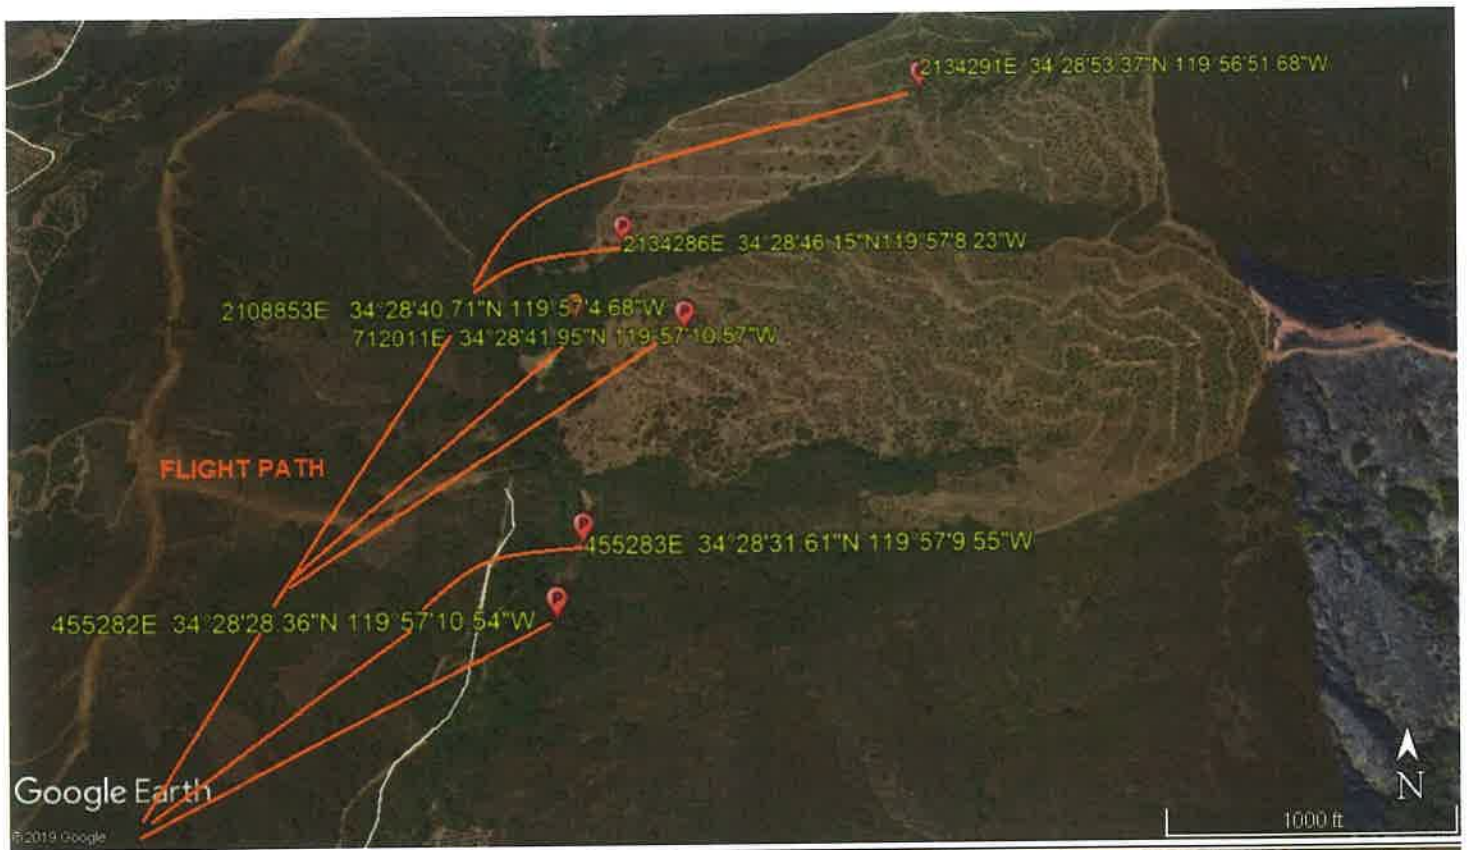

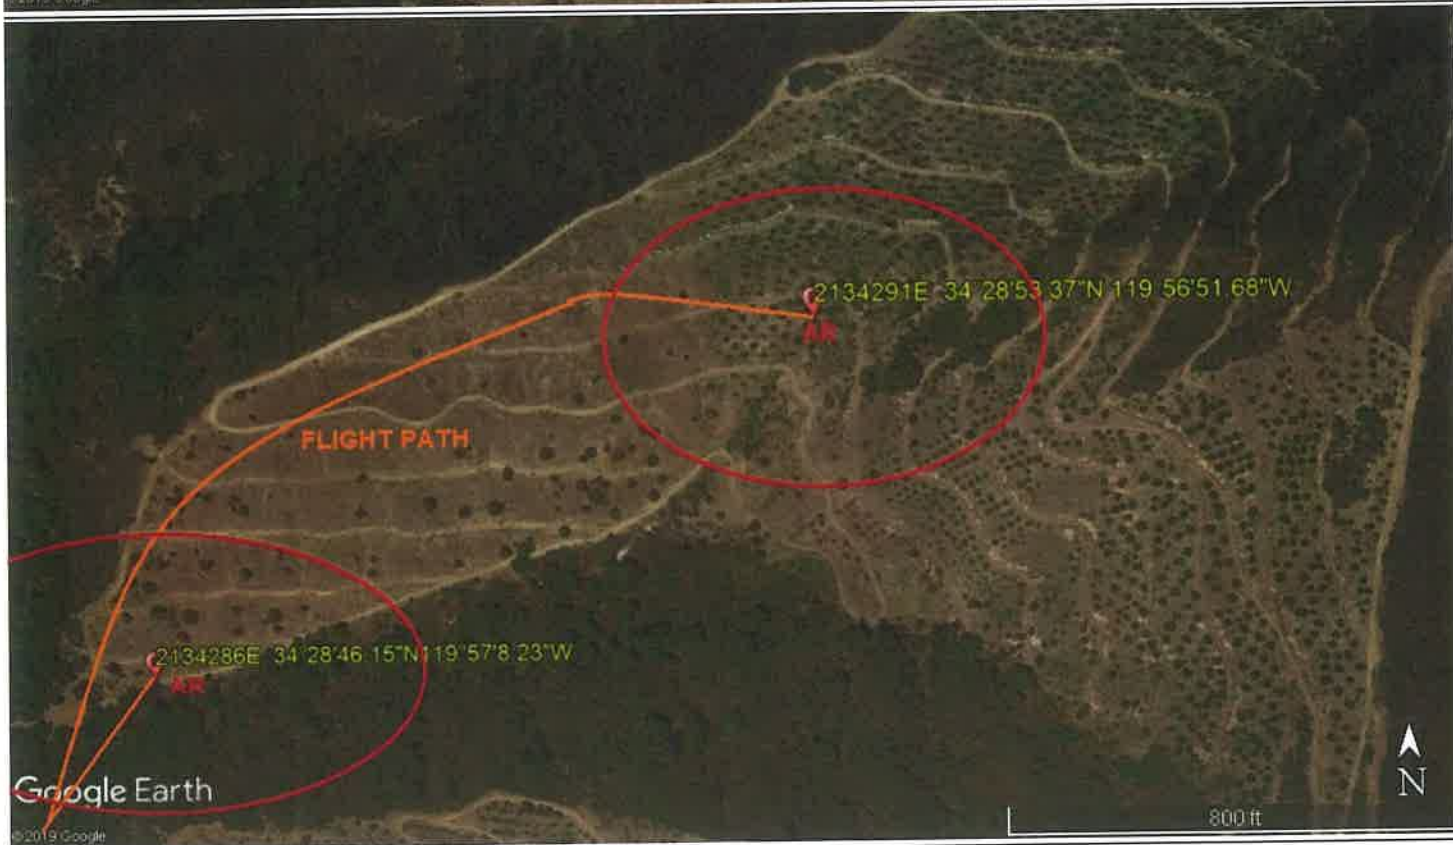

2-20-2020
DATE OF SUBMISSION

Jeffrey M. J...

COMPANY OFFICIAL / TITLE



SOUTHERN CALIFORNIA
EDISON[®]

An EDISON INTERNATIONAL[®] Company

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	PEDRO LEMUS
Department:*	HAMPTON TEDDER
Pax:*	N/A
Cell Number:*	909-306-8203
Email Address:*	pedro.lemus@hamptontedder.com

SAP Accounting Number*	TD1464894
-------------------------------	-----------

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☒ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

POLE 455283E RM: 45' CL 5 WOOD IN: 45' CL 1 COMP

General Operating Location	DOS PUEBLOS CANYON RD, GOLETA
District	49 SANTA BARBARA
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	LAST WEEK OF NOVEMBER 2019 MANDATED COMPLIANCE WORK AND THE SCHEDULE MUST REMAIN
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

[Click to e-mail form](#)

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____


☐ Week 3 _____

1085793-0.01



NOTES:

455283E

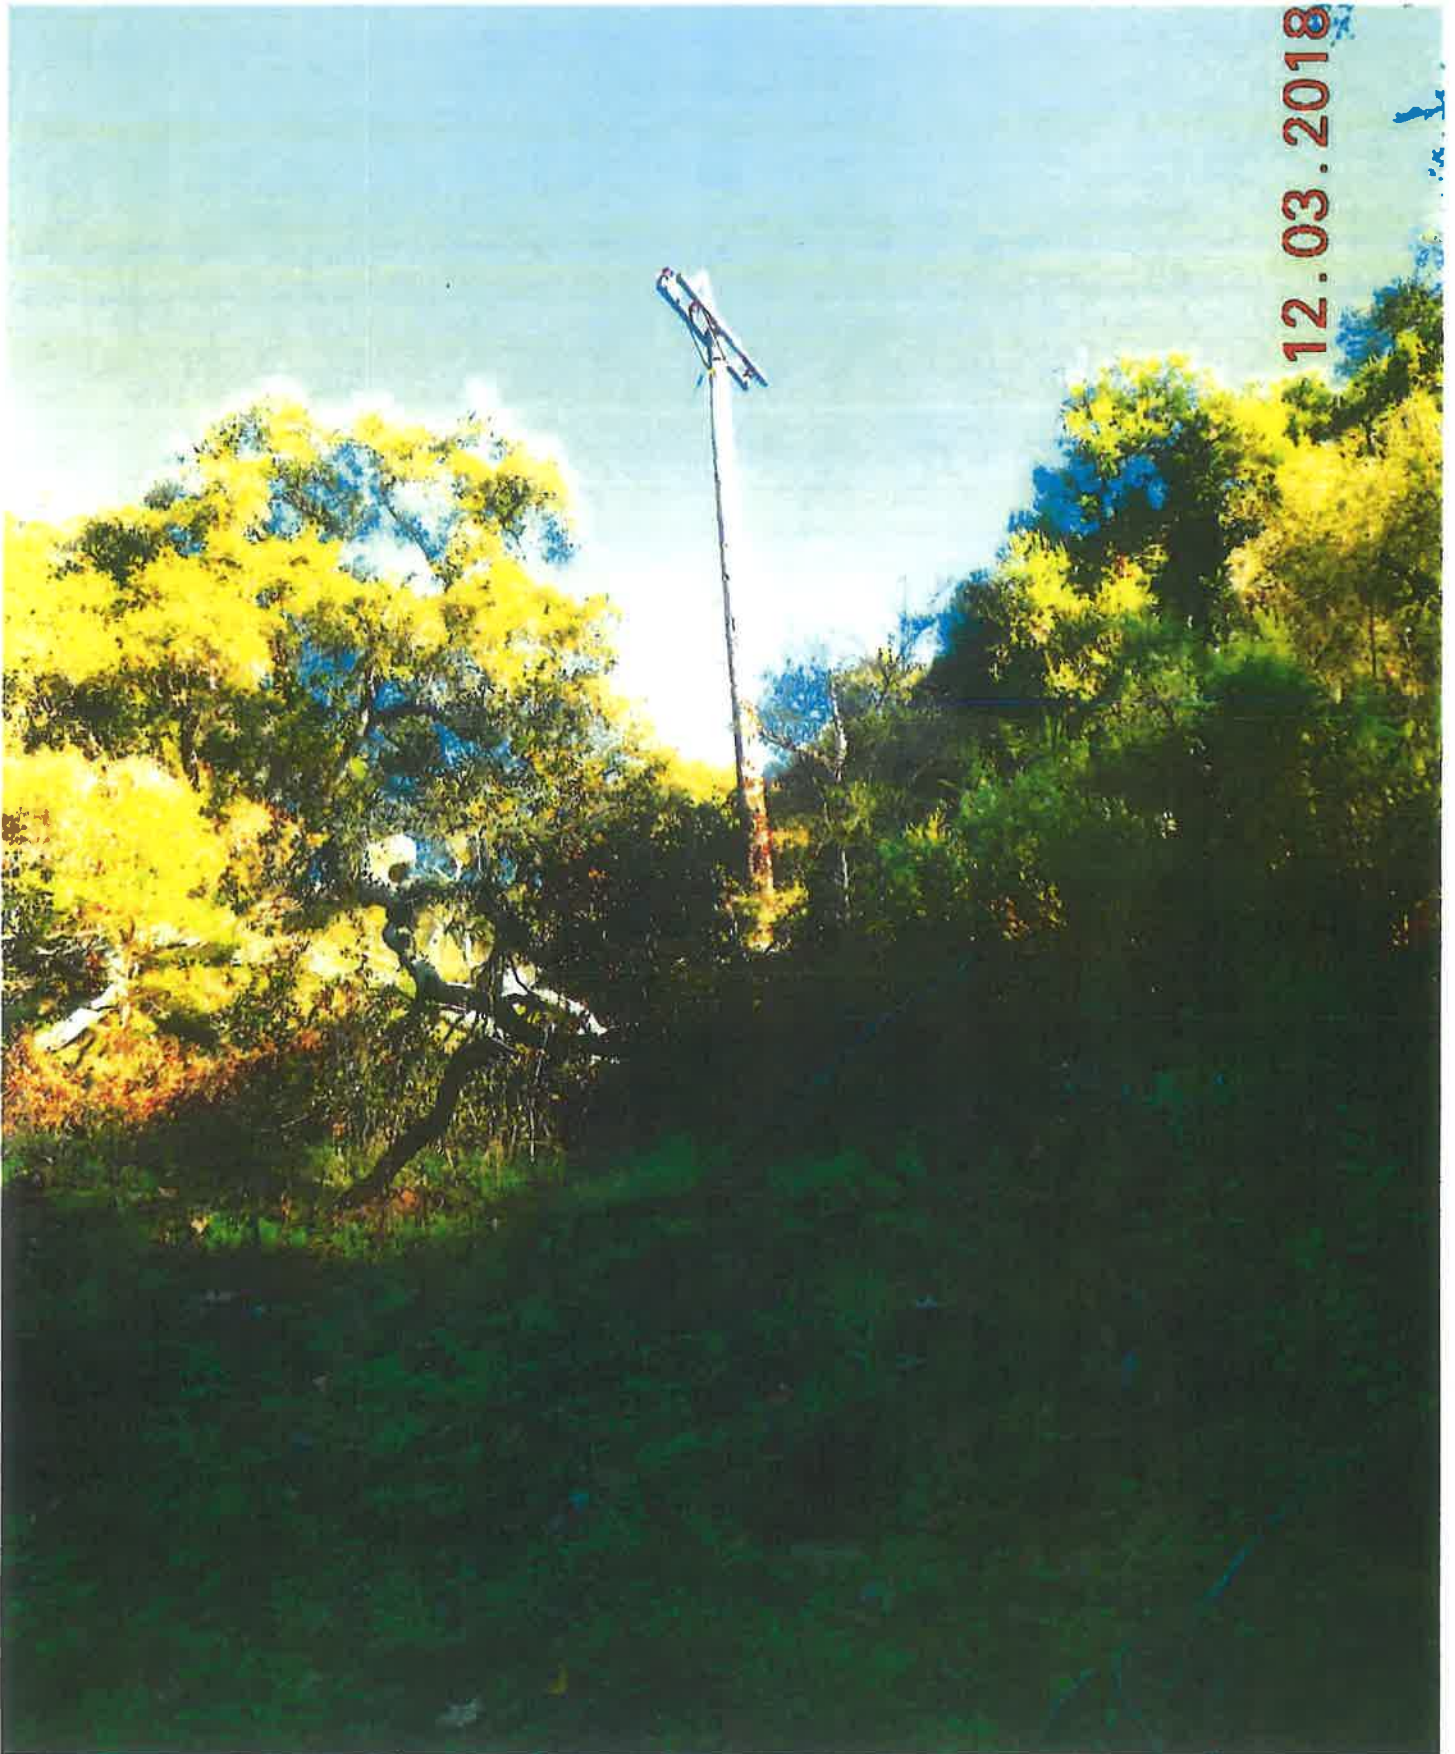

Dist. Deteriorated Pole
L / NE

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	CHRIS BROWN
Department:*	HOTLINE CONSTRUCTION INC
Pax:*	N/A
Cell Number:*	951-282-1467
Email Address:*	CBROWN@hotlineconstructioninc.com

SAP Accounting Number*	TD1465008
-------------------------------	-----------

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☒ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☒ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

R&R 712011E - RM 40' CL5 WD, IN 45' CL1 CMP SEC 34 28 42.06N, 119 57 10.55W

R&R 2134286E - RM 40' CL5 WD, IN 45' CL4 WD 34 28 46.15N, 119 57 8.23W

APPROX HEAVIEST POLE WEIGHT : 1500 LBS

General Operating Location	DOS PUEBLOS CANYON RD
District	49 SANTA BARBARA
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	12-13-19
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

[Click to e-mail form](#)

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

NOTES:

- SCE TO PTD.
- SET LOCATION: HARD SET SOUTH WEST.
- EAGLE ZONE.
- HAND SET.
- HAND DIG.
- TREE TIM / BRUSH REMOVAL REQUIRED.
- BULLETIN 322 AREA.

TRANSFER:


- 3-#4BC 16KV



HIGH FIRE
TIER 3
LOCATION

JOB LOCATION IS IN CLOSE
PROXIMITY TO CREEK


SECTIONAL COMPOSITE

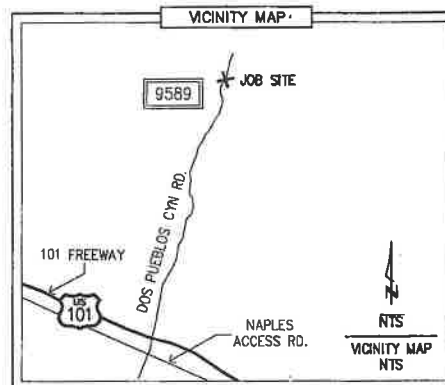

GPS COORDINATES
N: 34° 28' 42.06"
W: 119° 57' 10.55"
ELEVATION: 445'

- 2 POLE 45' Class C1
- IN: 1- POLE 45' CLASS 1 COMP SEC POLE
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY W/PIN 16KV CLMP #6-4/0 CU
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653


- RM 40' Class C5
- RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 3- INS GLASS & PIN 16KV

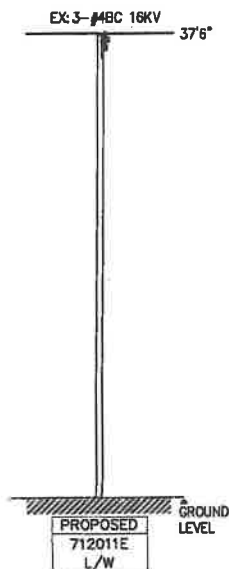

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)		DISTRICT 49 - SANTA BARBARA		PROJ. MGR. TOLMASOFF, LAURA M PHONE 714-796-9811		PLANNER TIDWELL DESIGN PHONE 805-647-4707		DESIGNER TIDWELL DESIGN	
EDISON EASMENT REQUIRED	☒	PROJECT NO. 1676519	SERVICE REQUEST 2583363	MSR NO.	PRODUCT-1 1465008-INFRA REPLAC - DET POLE REPLACEMENT	ASSOC DESIGN			
PERM. ON REQUIRED	☒	CIRCUIT / VOLTAGE MIST 16KV		THOMAS GUIDE N/A	PRODUCT-2	ASSOC DESIGN			
UG CIVIL ONLY WORK ORDER	☒	SUB / PG NO. CAPITAN		CIRCUIT CODE	PRODUCT-3	ASSOC DESIGN			
PERMIT REQUIRED	☒	INVENTORY MAP 22-44		J.P.A. NO.	PROPOSED CONSTRUCTION (LOCATION) 712011E 9589 DOS PUEBLOS CANYON RD., GOLETA				
OUTAGE REQUIRED	☒	DATE: _____		TIME: _____	SHEET				
TRAFFIC CONTROL REQUIRED	☒	CONVEYANCE LETTER REQ'D		☒	DESIGN/DRWG NO. 1085895_0.01				
PEEL TRAFFIC CONTROL REQ'D	☒	ENVIRONMENTAL CLEARANCE REQ'D		☒	CSD 140 (TLM) REQ'D				
TYPE		DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	Southern California Edison Company		

712011E

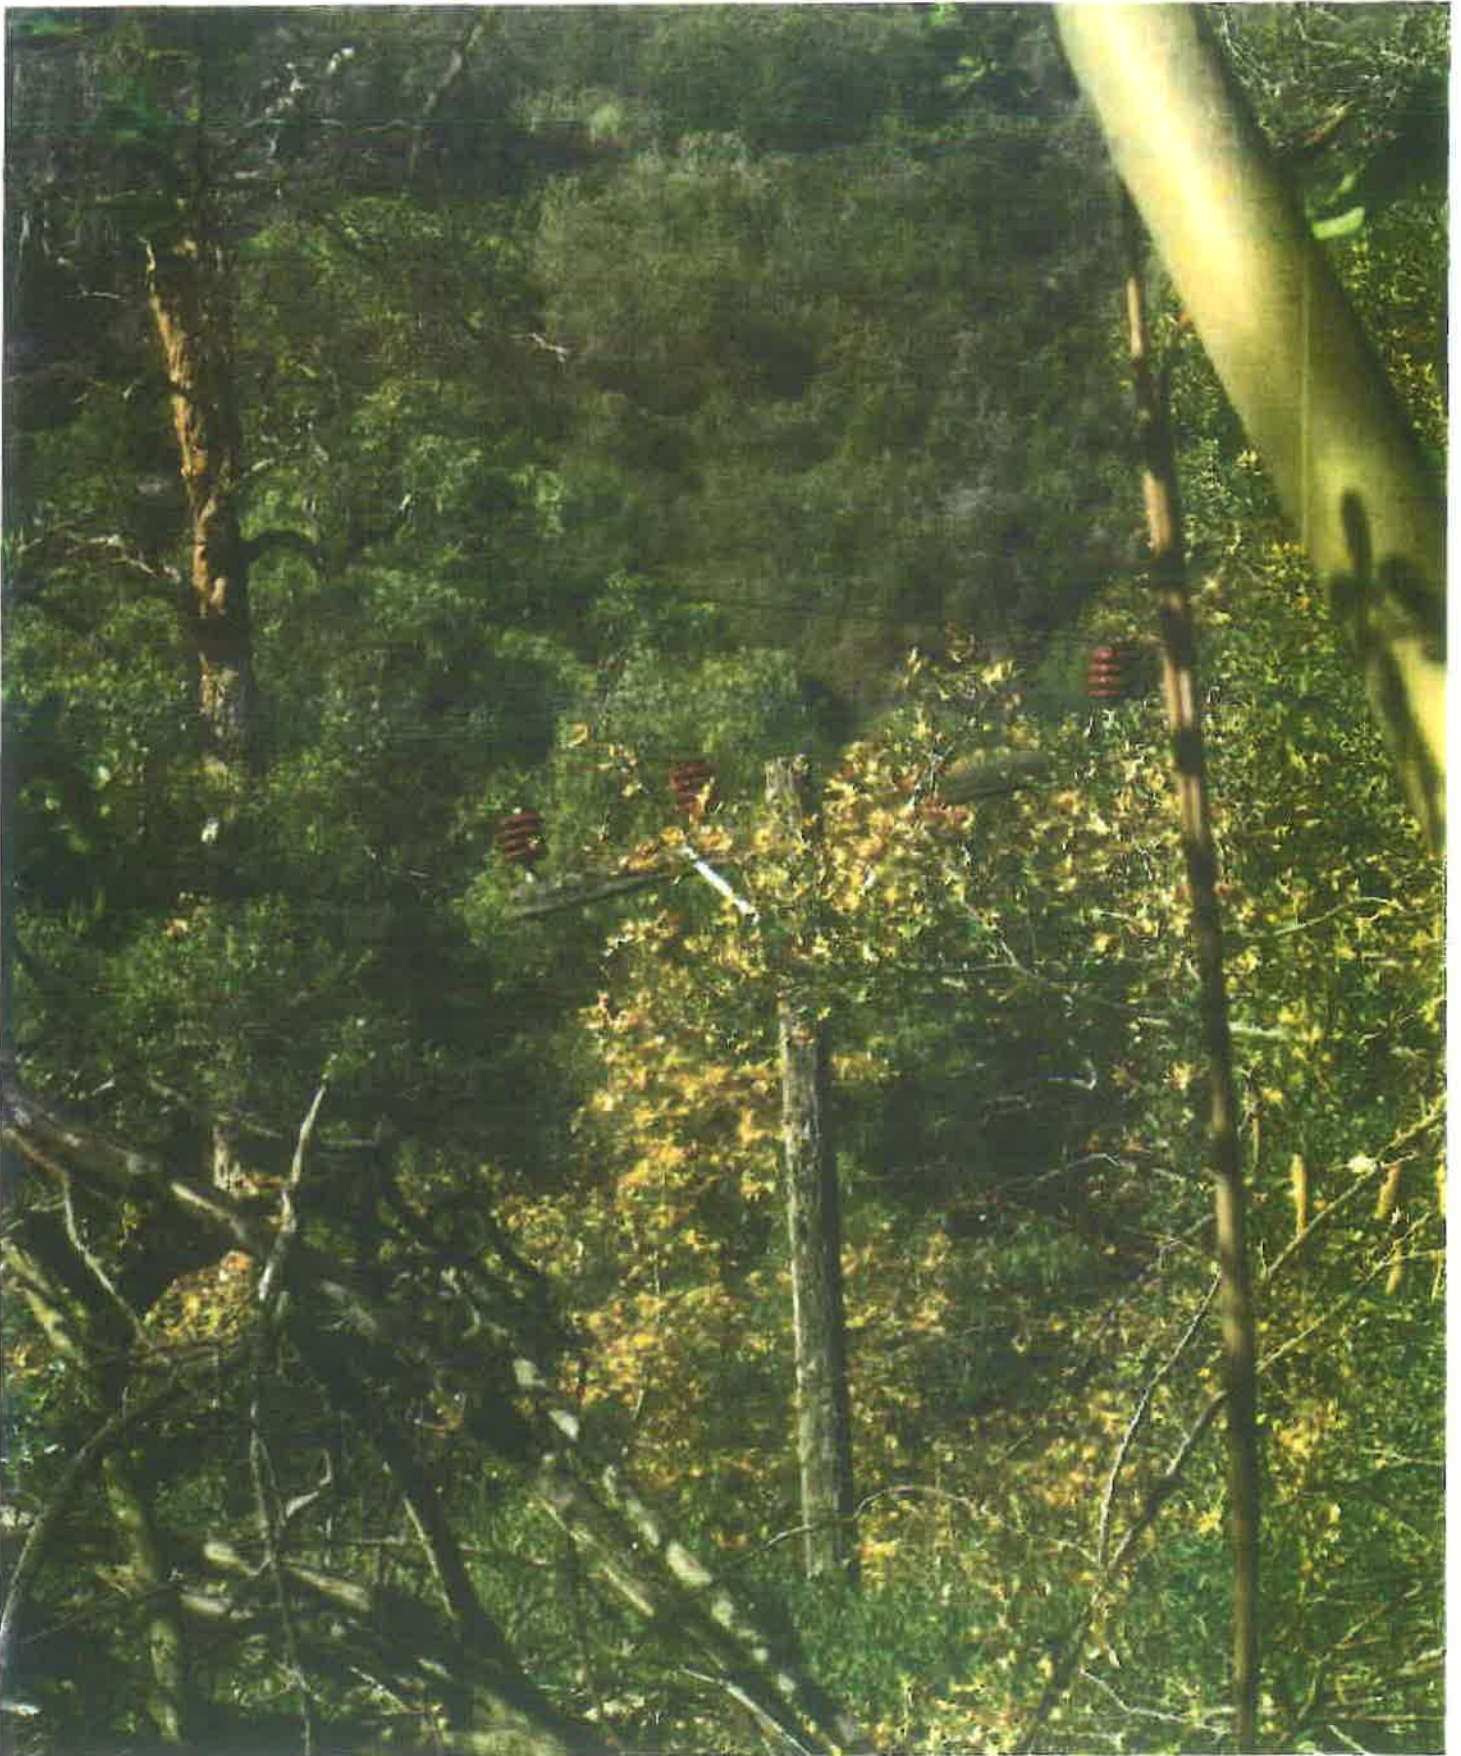

Dist. 49 Deteriorated Pole
L / NW

- NOTES:
- SEE TO PTD.
 - SET LOCATION: HARD SET NORTH EAST.
 - EAGLE ZONE
 - BULLETIN 322 AREA

TRANSFER:

- 3-#8C 18KV



JOB LOCATION IS IN CLOSE PROXIMITY TO CREEK




3 **POLE** **2134286E**
 40' Class C5
 RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
 RM: 1- XA SNGL FB 10' STEEL PINS
 RM: 3- INS GLASS & PIN 18KV
 RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

EX-3-#4ACSR 18KV
 284' 457A322E 45'

GPS COORDINATES
 N: 34° 28' 46.15"
 W: 119° 57' 08.23"
 ELEVATION: 456'

4 **POLE** **2134286E**
 45' Class C4
 IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
 IN: 1- XA SNGL TAN HD COMP 10' W/BKT
 IN: 3- INS POLY W/PIN 18KV CLAMP #4-653 ACSR
 IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
 IN: 1- MISC AVIAN HOOD FOR HENRICH INSUL #4-653

CREEK
 2'

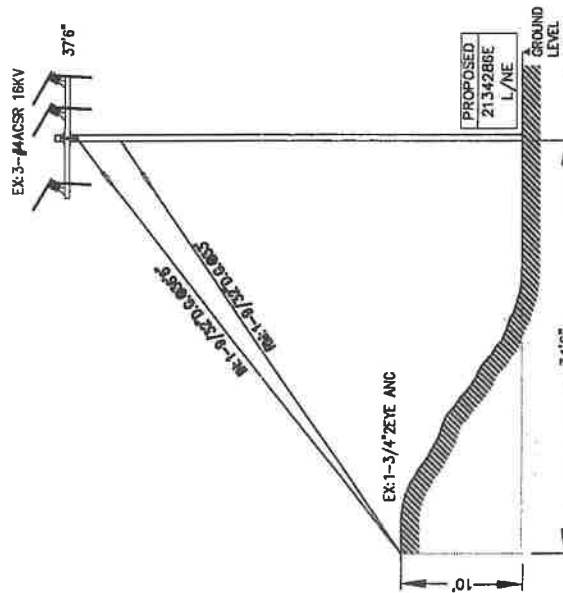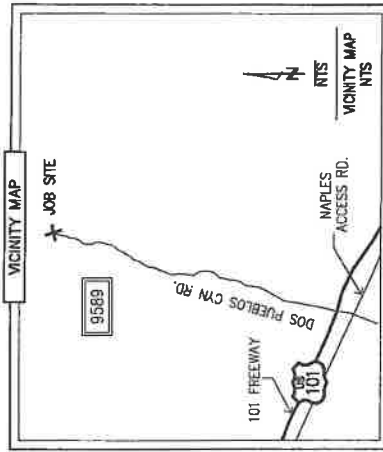

NOT TO SCALE

PROJECT REQUIREMENTS (C/A)		DISTRICT	PROJ. MGR.	PLANNER	DESIGNER
EDISON		49 - SANTA BARBARA	BARBARA	LAURA M.	TIDWELL
EDISON		PROJECT NO.	1676519	PHONE	714-796-9811
EDISON		SERVICE REQUEST	2583363	PHONE	805-647-4707
EDISON		LG C/A ONLY WORK ORDER		PRODUCT-1	1465008-INFRA REPLAC - DET POLE REPLACEMENT
EDISON		PERMIT REQUIRED		PRODUCT-2	
EDISON		POUT TYPE		PRODUCT-3	
EDISON		OUTAGE REQUIRED		AP.A. NO.	
EDISON		TRAFFIC CONTROL REQUIRED		PROPOSED CONSTRUCTION (LOCATION)	
EDISON		PREL. TRAFFIC CONTROL REPORT		2134286E	
EDISON		CONFORMANCE LETTER #670		9589 DOS	PUEBLOS CANYON RD.,
EDISON		ENVIRONMENTAL CLEARANCE REPORT		GOLETA	
EDISON		CSO 140 (TUM) REPORT			
EDISON		DATE		APPROVED BY	TIDWELL
EDISON		CHECKED BY		DRAWN BY	PAX #
EDISON		DESIGN/WORK NO.		SHEET	1085895_0.01


Southern California Edison Company

2134286E




Dist. Deteriorated Pole
L / E

2134286E

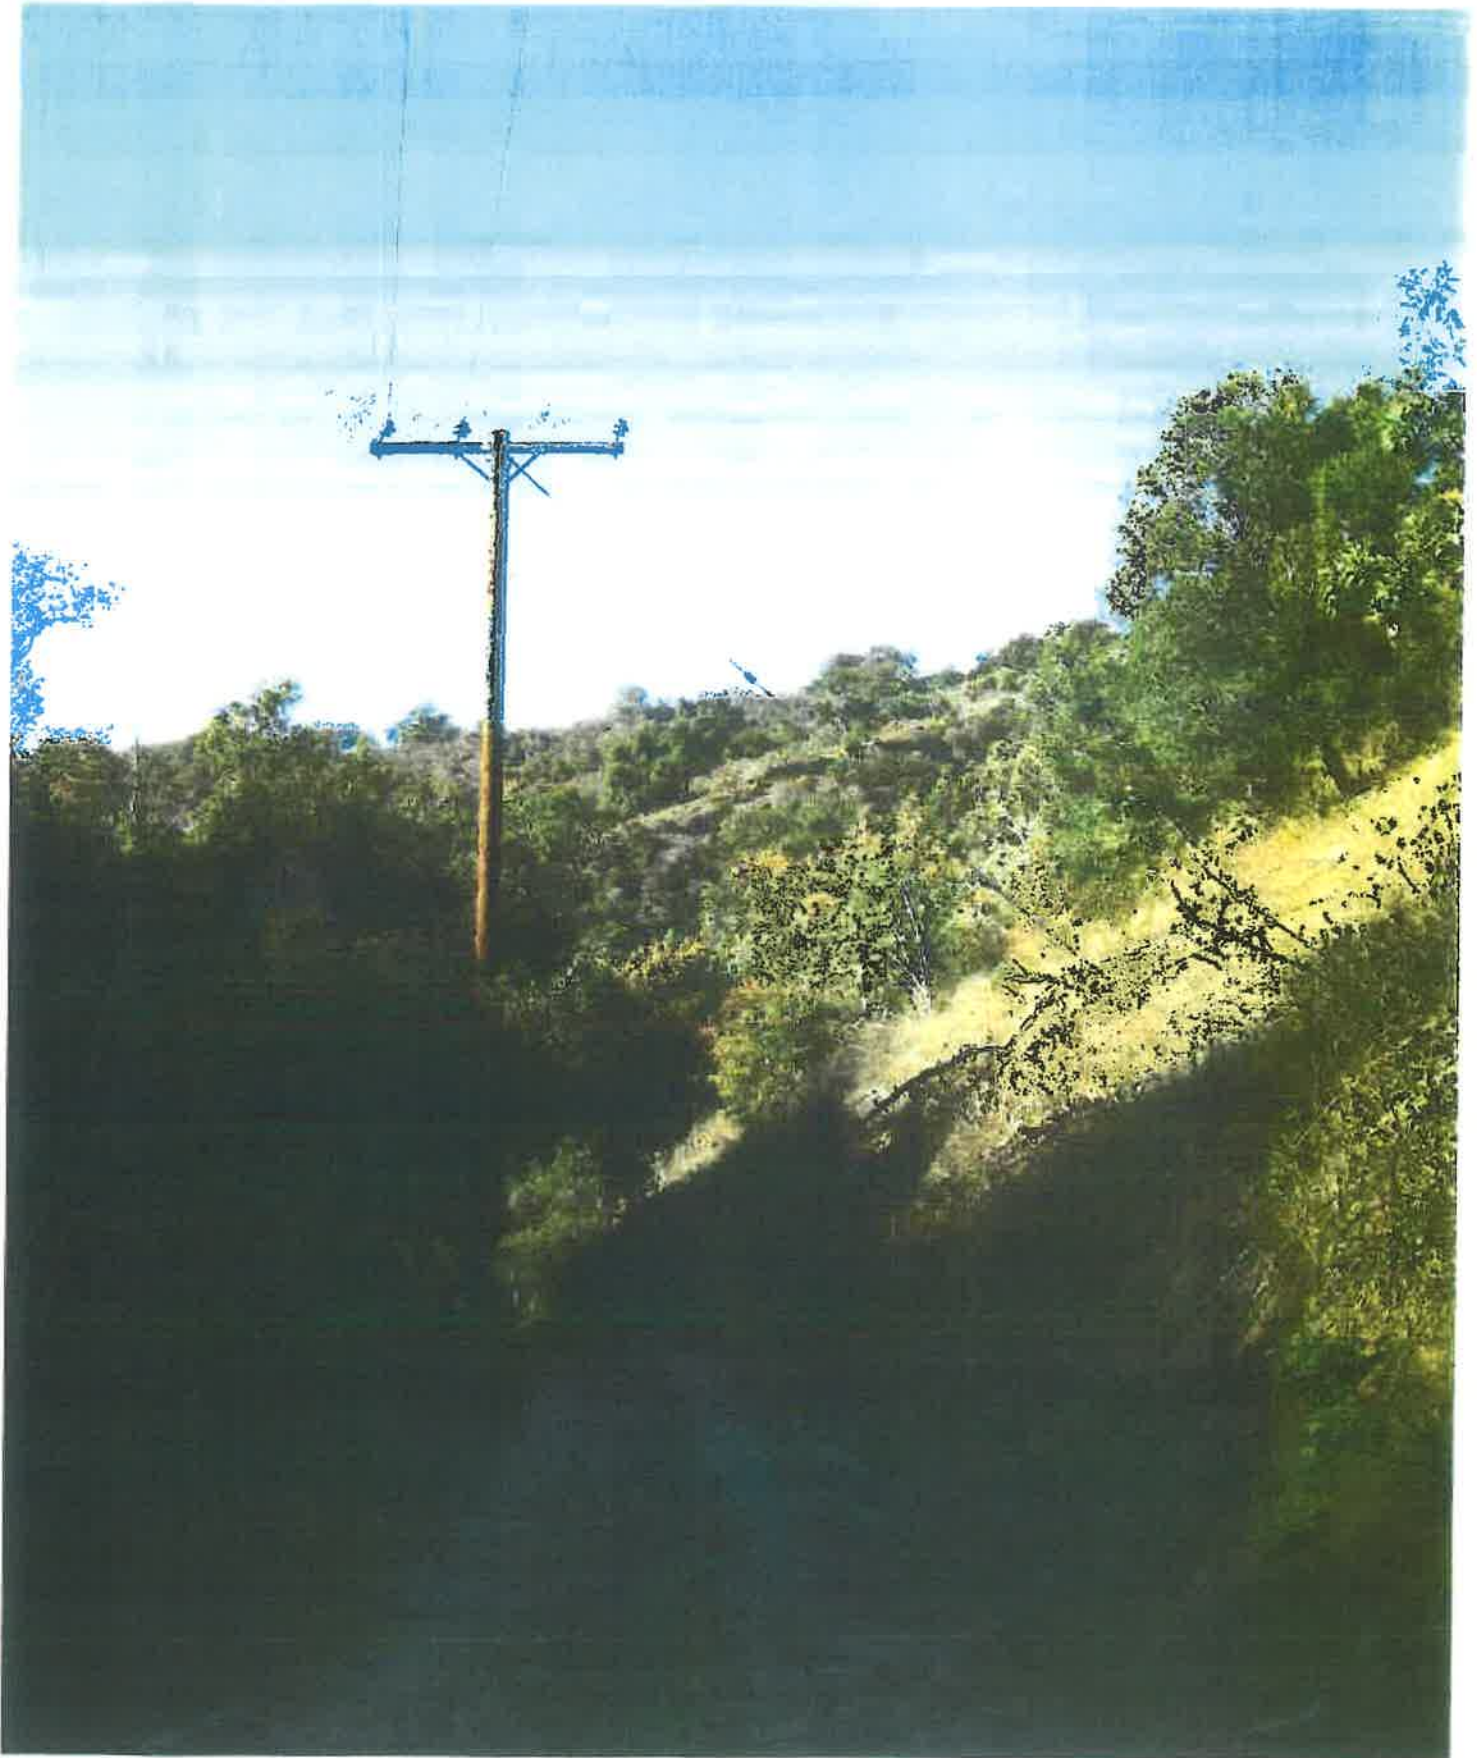

**Dist. Deteriorated Pole
L / SW**

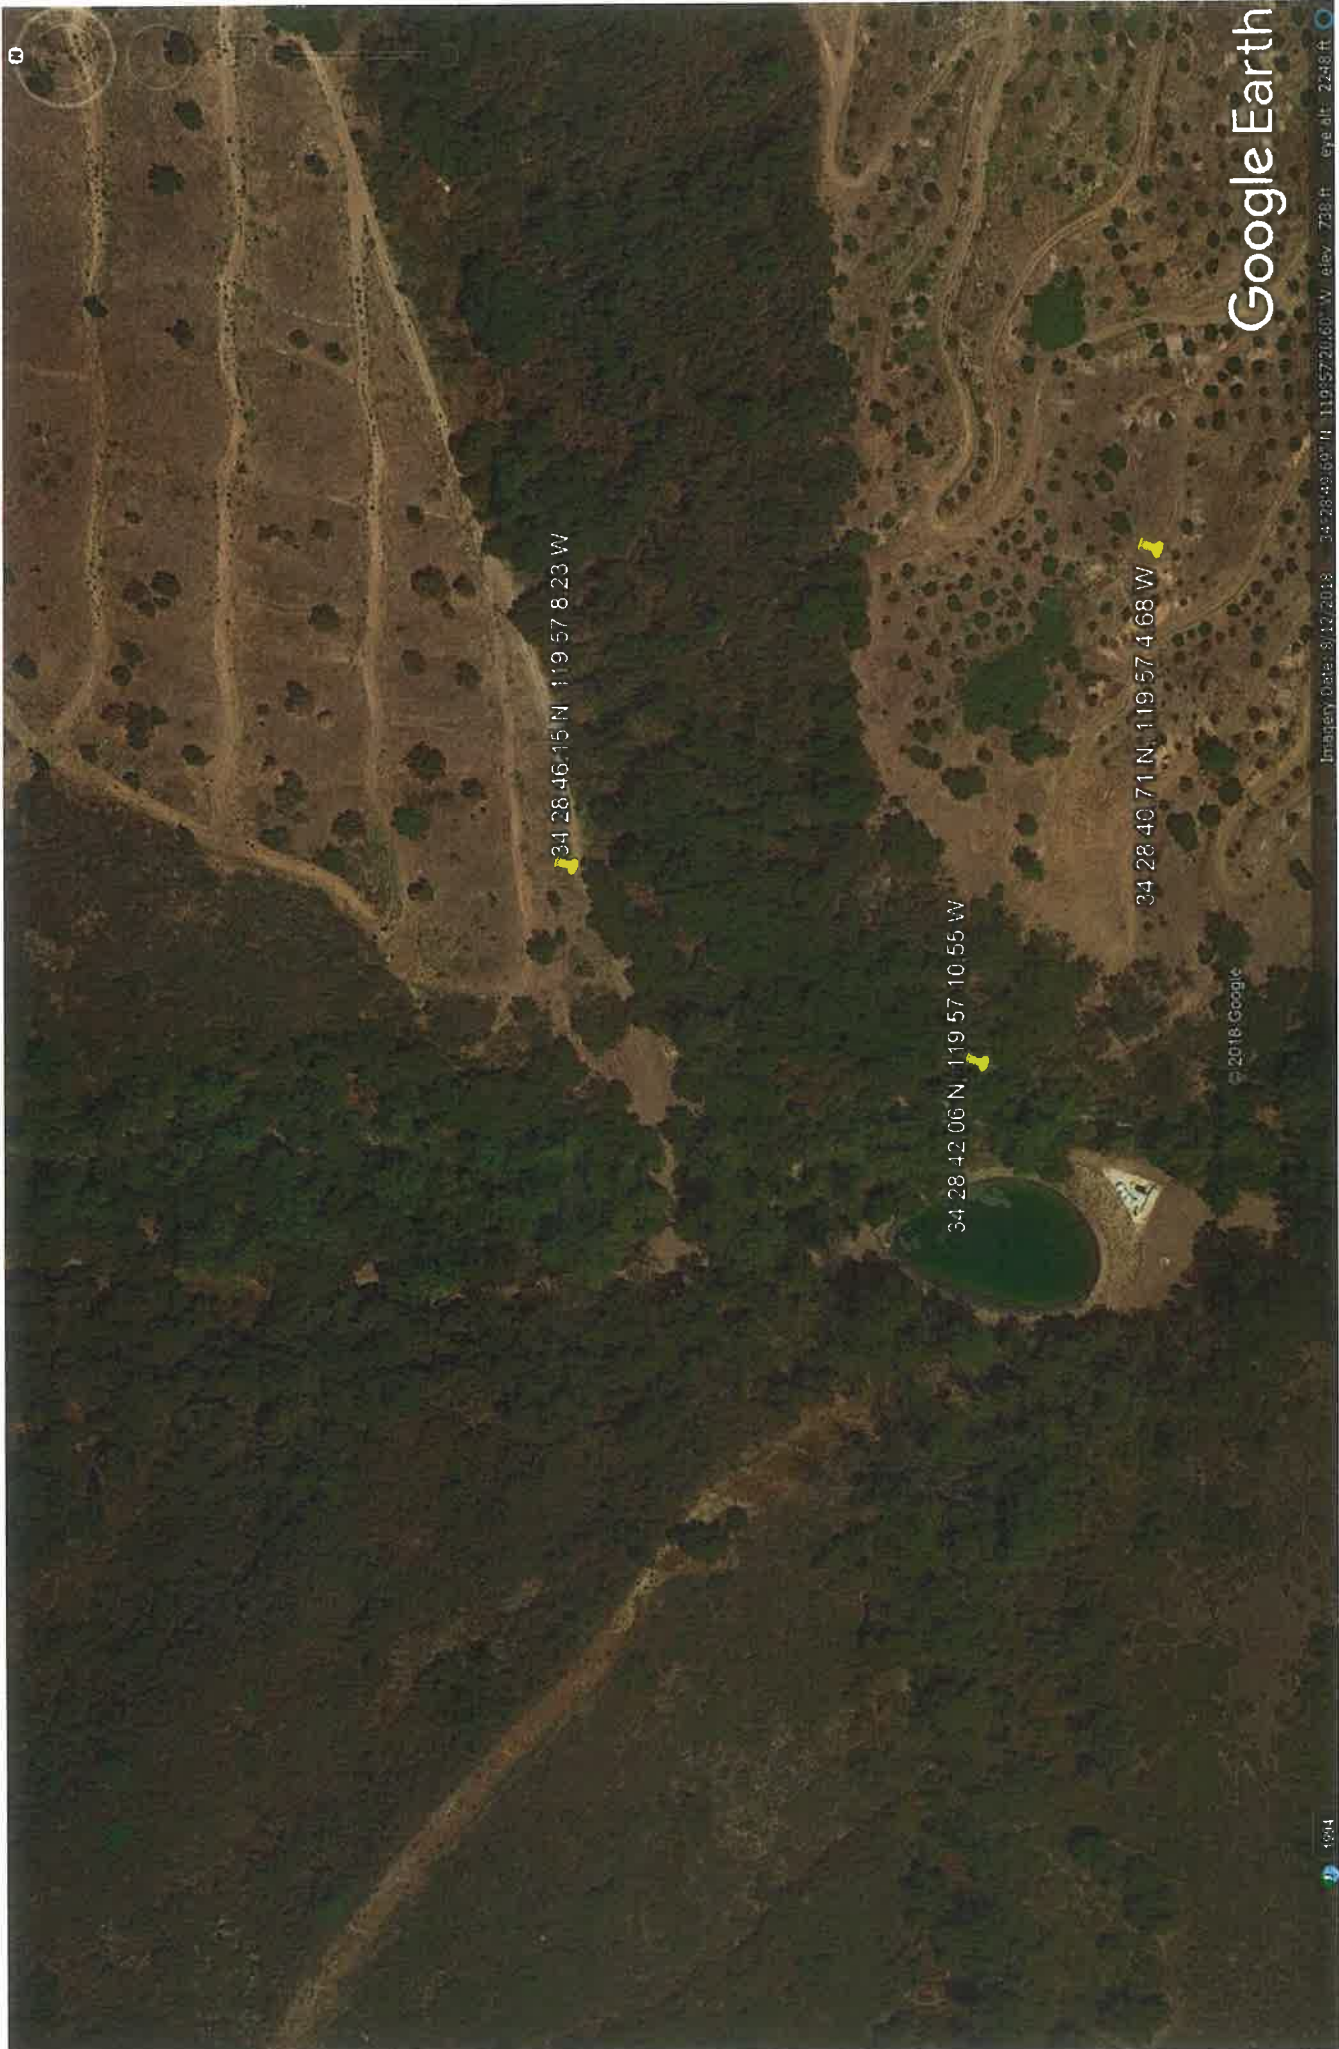

34 28 46.15 N 119 57 8.23 W

34 28 42.06 N 119 57 10.55 W

34 28 40.71 N 119 57 4.68 W

© 2018 Google

Google Earth

ImageW Date: 8/12/2018 34 28 42.06° N 119 57 20.60° W elev. 738 ft eye alt: 2248 ft



An EDISON INTERNATIONAL® Company

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	CHRIS BROWN
Department:*	HOTLINE CONSTRUCTION INC
Pax:*	N/A
Cell Number:*	951-282-1467
Email Address:*	CBROWN@hotlineconstructioninc.com

SAP Accounting Number*	TD1465008
-------------------------------	-----------

Flight Description

Please choose a mission type:

- | | | | | | |
|-------------------------------------|----------------|--------------------------|-------------|-------------------------------------|--------------------------------|
| ☐ | Camera – HD/IR | ☐ | Line String | ☒ | Pole-set |
| ☐ | Crew support | ☐ | Passenger | ☐ | Recon |
| ☐ | External Load | ☐ | Patrol | ☐ | Training |
| ☒ | HEC | ☐ | Photo | ☐ | Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

R&R 712011E - RM 40' CL5 WD. IN 45' CL1 CMP SEC 34 28 42.06N, 119 57 10.55W

R&R 2134286E - RM 40' CL5 WD. IN 45' CL4 WD	34 28 46.15N, 119 57 8.23W
---	----------------------------

APPROX HEAVIEST POLE WEIGHT : 1500 LBS

General Operating Location	DOS PUEBLOS CANYON RD
District	49 SANTA BARBARA
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	12-13-19
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

[Click to e-mail form](#)

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2

☐ Week 3

NOTES:

- SCE TO PTD.
- SET LOCATION: HARD SET SOUTH WEST.
- EAGLE ZONE.
- HAND SET.
- HAND DIG.
- TREE TIM / BRUSH REMOVAL REQUIRED.
- BULLETIN 322 AREA.

TRANSFER:


- 3-#4BC 16KV



HIGH FIRE
TIER 3
LOCATION



JOB LOCATION IS IN CLOSE
PROXIMITY TO CREEK

SECTIONAL COMPOSITE

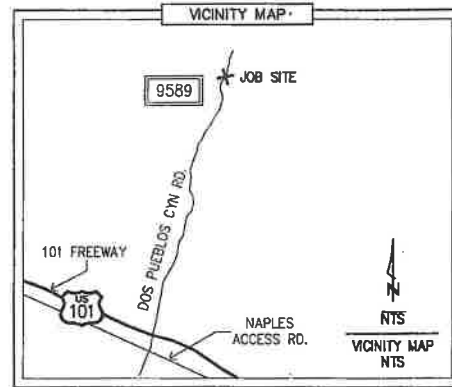

GPS COORDINATES
N: 34° 28' 42.06"
W: 119° 57' 10.55"
ELEVATION: 446'

- 2 POLE 712011E Class C1
- 45'
- IN: 1- POLE 45' CLASS 1 COMP SEC POLE
- IN: 1- XA SNGL TAN HD COMP 10' W/BKT
- IN: 3- INS POLY W/PIN 16KV CLMP #6-4/0 CU
- IN: 1- MISC AMAN HOOD FOR HENDRIX INSUL #4-653

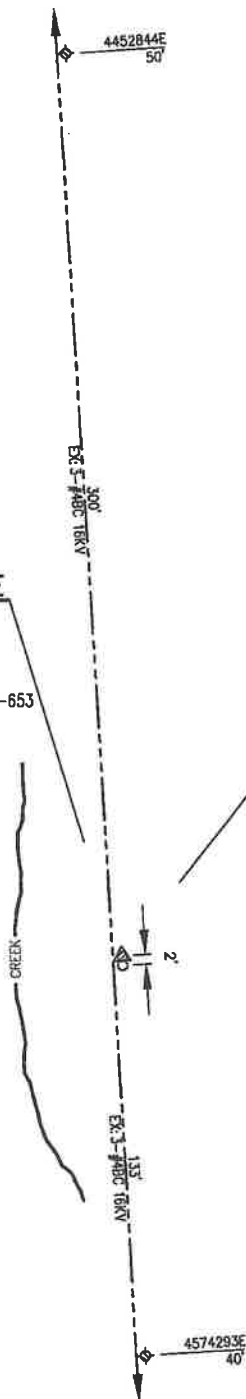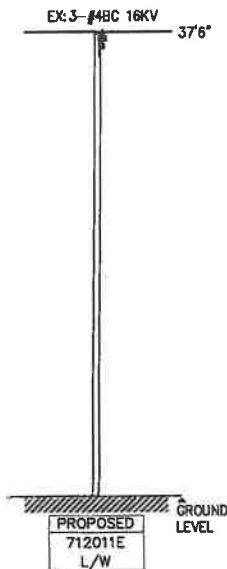

- RM 712011E Class C5 1
- 40'
- RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
- RM: 1- XA SNGL FB 10' STEEL PINS
- RM: 3- INS GLASS & PIN 16KV



NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)		DISTRICT 49 -- SANTA BARBARA		PROJ. MGR. TOLMASOFF, LAURA M PHONE 714-796-9811	PLANNER TIDWELL DESIGN PHONE 805-647-4707	DESIGNER TIDWELL DESIGN
EDISON EASEMENT REQUIRED	☒	PROJECT NO. 1676519	SERVICE REQUEST 2583363	MSR NO.	PRODUCT-1 1465008-INFRA REPLAC - DET POLE REPLACEMENT	ASSOC DESIGN
PUMP OR REQUIRED	☒	CIRCUIT / VOLTAGE MIST 16KV		THOMAS GUIDE N/A	PRODUCT-2	ASSOC DESIGN
UG CIVIL ONLY WORK ORDER	☒	SUB / PG NO. CAPITAN		CIRCUIT CODE	PRODUCT-3	ASSOC DESIGN
POINT REQUIRED	☒	INVENTORY MAP 22-44		J.P.A. NO.	PROPOSED CONSTRUCTION (LOCATION) 712011E 9589 DOS PUEBLOS CANYON RD., GOLETA	
PERMIT TYPE:		OUTAGE DATE: _____ TIME: _____				
OUTAGE REQUIRED	☒	TRAFFIC CONTROL REQUIRED				
TRAFFIC CONTROL REQUIRED	☒	PEL TRAFFIC CONTROL REQ'D				
CONVEYANCE LETTER REQ'D	☒	ENVIRONMENTAL CLEARANCE REQ'D				
CSD 140 (TLM) REQ'D	☒	TYPE		DATE	APPROVED BY	CHECKED BY
		DRAWN BY		PAX #	SHEET	
		Southern California Edison Company				DESIGN/DRWG NO. 1085895_0.01

712011E



Dist. 49 Deteriorated Pole
L / NW

- NOTES:
- SEE TO PTD.
 - SET LOCATION: HARD SET NORTH EAST.
 - EAGLE ZONE.
 - BULLETIN 322 AREA.

TRANSFER:

- 3-#4BC 16KV



JOB LOCATION IS IN CLOSE PROXIMITY TO CREEK

POLE 3
40'
2134286E
Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL FB 10' STEEL PINS
RM: 3- INS GLASS & PIN 16KV
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

POLE 4
45'
2134286E
Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY W/PIN 16KV CLMP #4-653 ACSR
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653

GPS COORDINATES
N: 34° 28' 46.15"
W: 119° 57' 08.23"
ELEVATION: 458'

POLE



2134286E

4

CREEK

EX-3-#4BCSR 16KV
205

EX-3-#4BCSR 16KV
50

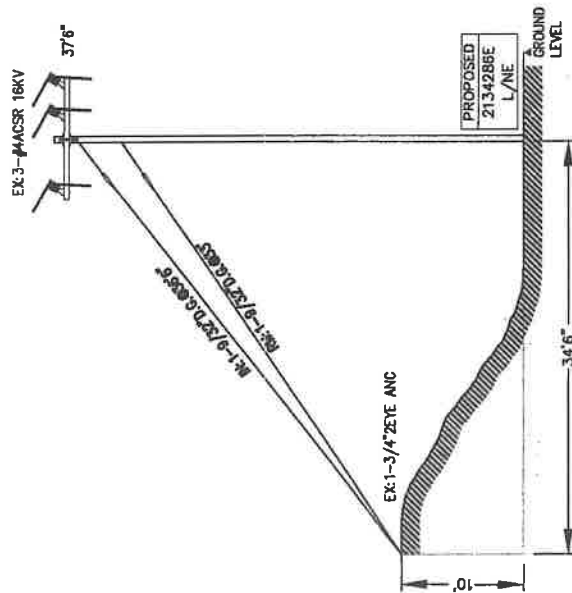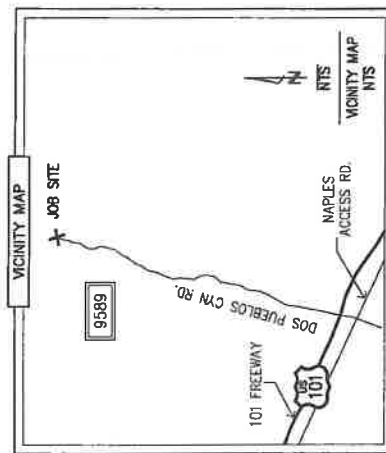

SOUTHERN CALIFORNIA
EDISON
AN EDISON INTERNATIONAL COMPANY

NOT TO SCALE


PROJECT REQUIREMENTS (X/A)		DISTRICT		PROJ. MGR. TOLMASOFF, LAURA W		PLANNER TIDWELL DESIGN		DESIGNER TIDWELL DESIGN	
EDISON FACILITY REQUIRED	NO	PROJECT NO.	1676519	SERVICE REQUEST	MSR NO.	714-796-9811	PHONE	805-647-4707	ASSOC DESIGN
PROJ. IS REQUIRED	NO	CIRCUIT / VOLTAGE	2583363	THOMAS GUIDE	PRODUCT-1	1-465008-INFRA REPLAC - DET POLE REPLACEMENT	THOMAS GUIDE	PRODUCT-2	ASSOC DESIGN
USE CHL. ONLY WORK ORDER	NO	SUB / PG. NO.	N/A	CIRCUIT CODE	PRODUCT-3		CIRCUIT CODE	PRODUCT-3	ASSOC DESIGN
POINT TYPE	NO	CAPITAN		J.P.A. NO.	21-44		PROPOSED CONSTRUCTION (LOCATION)	2134286E	
OUTLINE DATE	NO	TRAFFIC CONTROL REQUIRED	NO	TRAFFIC CONTROL REQD	NO		9589 DOS PUEBLOS CANYON RD.,		
CONVEYANCE LETTER REQD	NO	ENVIRONMENTAL CLEARANCE REQD	NO	ENVIRONMENTAL CLEARANCE REQD	NO		GOLETA		
CS 10 (U) REQD	NO	DATE		APPROVED BY		CHECKED BY	TIDWELL	PAX #	
Southern California Edison Company							SHEET	OF	1085895 0.01

2134286E



Dist. Deteriorated Pole
L / E

2134286E

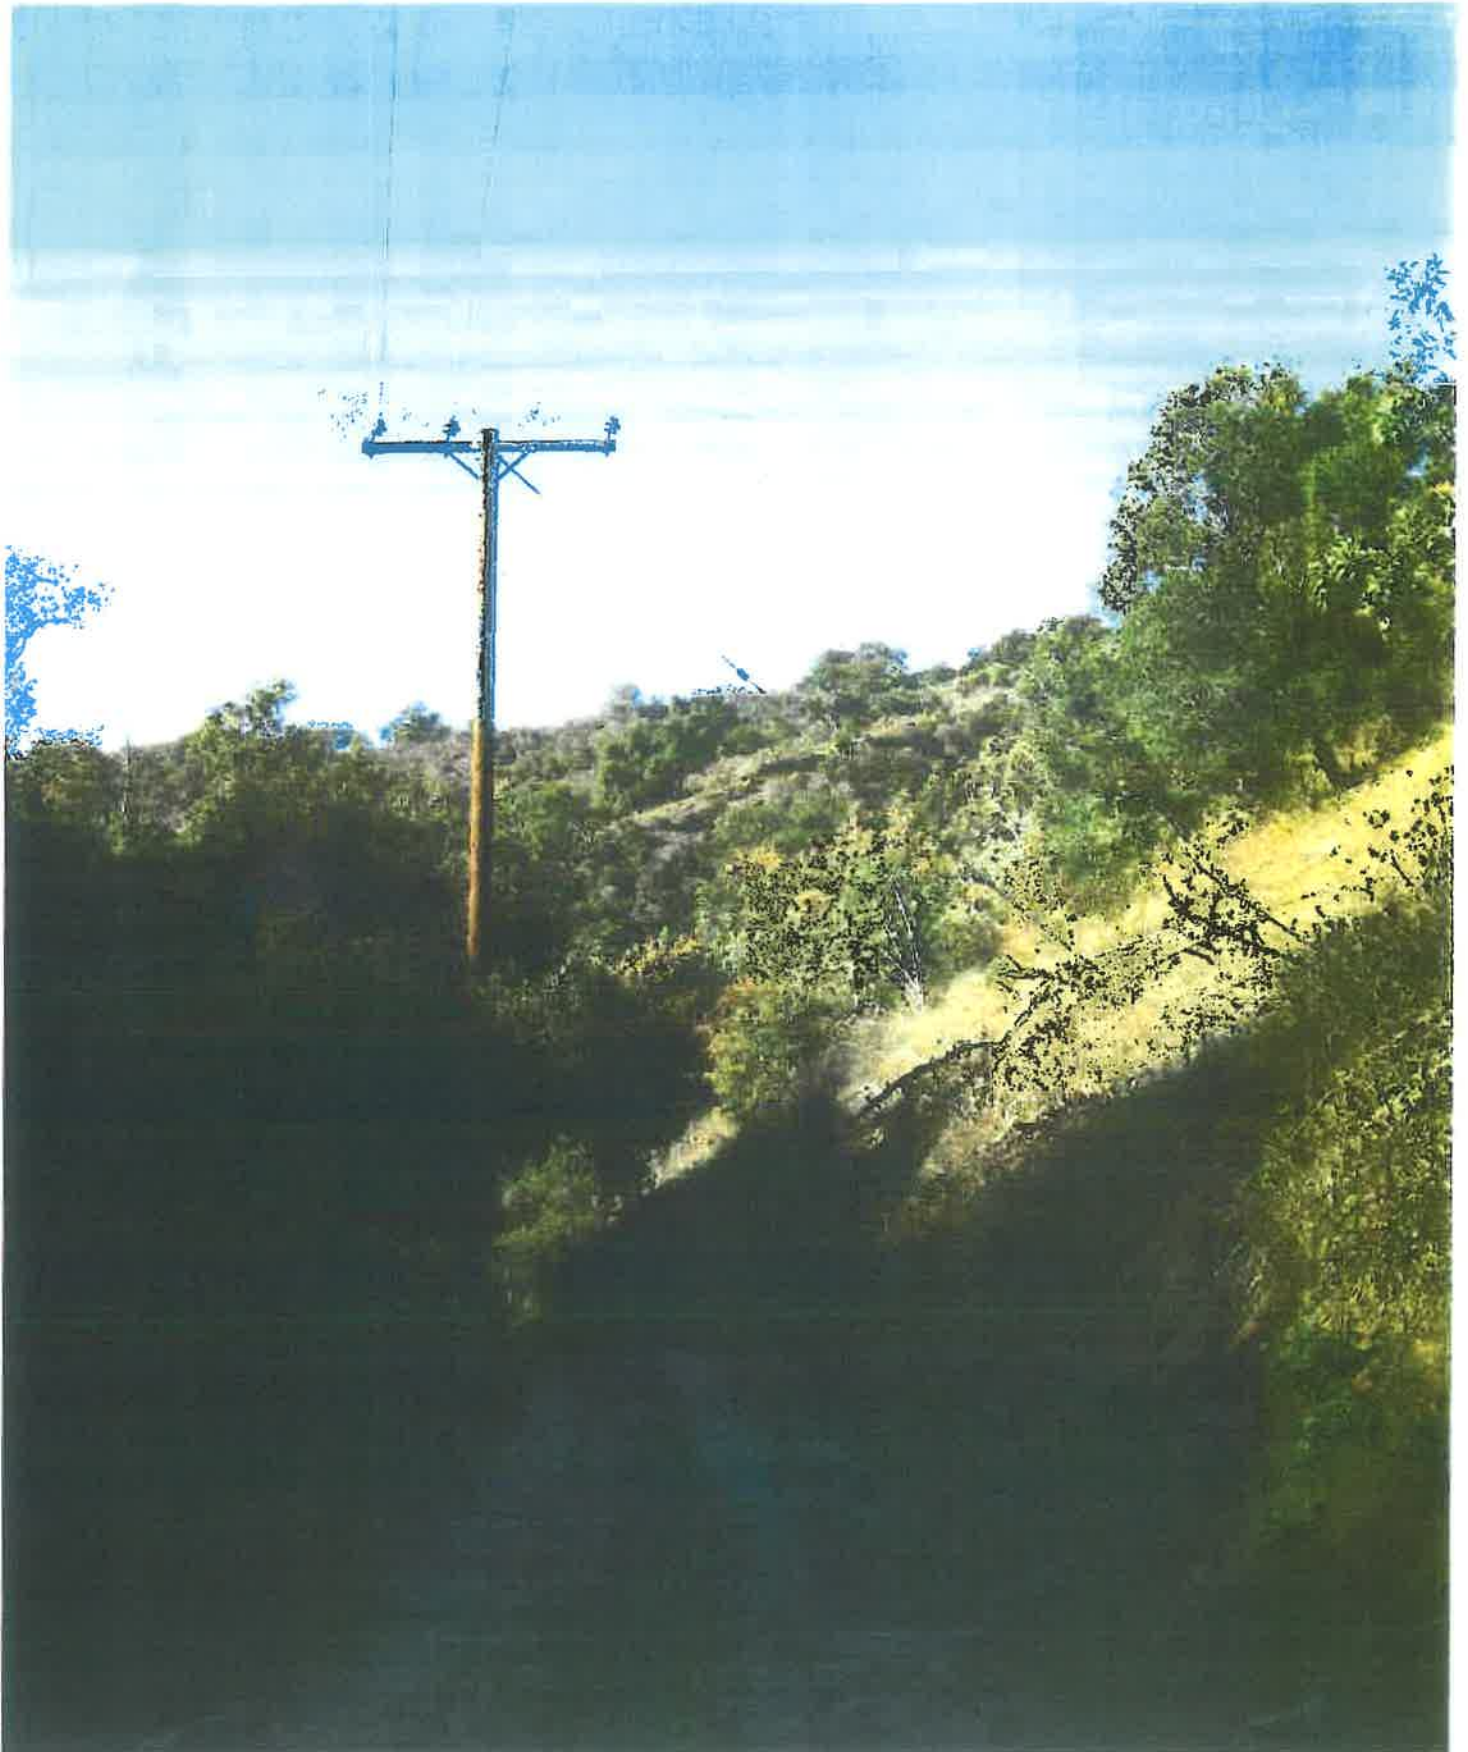

**Dist. Deteriorated Pole
L / SW**



34 28 46.15 N 119 57 8.23 W

34 28 42.06 N 119 57 10.55 W

34 28 40.71 N 119 57 4.68 W

© 2018 Google

Google Earth



SOUTHERN CALIFORNIA
EDISON

An EDISON INTERNATIONAL Company

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: aiops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	CHRIS BROWN
Department:*	HOTLINE CONSTRUCTION INC
Pax:*	N/A
Cell Number:*	951-282-1467
Email Address:*	CBROWN@hotlineconstructioninc.com

SAP Accounting Number*	TD1485914 TD1485903
-------------------------------	---------------------

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☒ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☒ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

R&R 455282E - RM 45' CL4 WD, IN 45' CL1 CMP SEC 34 28 28.64N, 119 57 10.76W

R&R 2108853E - RM 40' CL5 WD, IN 45' CL4 WD 34 28 40.71N, 119 57 4.68W

APPROX HEAVIEST POLE WEIGHT : 1500 LBS

General Operating Location	DOS PUEBLOS CANYON RD
District	49 SANTA BARBARA
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	12-13-19
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

[Click to e-mail form](#)

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

NOTES:

- SCE TO PTD.
- SET LOCATION: HARD SET SOUTH WEST.
- EAGLE ZONE.
- HAND SET.
- HAND DIG.
- BULLETIN 322 AREA.

TRANSFER:



- J-48C 16KV



HIGH FIRE
TIER 3
LOCATION

SECTIONAL COMPOSITE

1 RM **455282E**
45' Class C4
RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA SNGL VB 10' STEEL PINS
RM: 3- INS GLASS & PIN 16KV

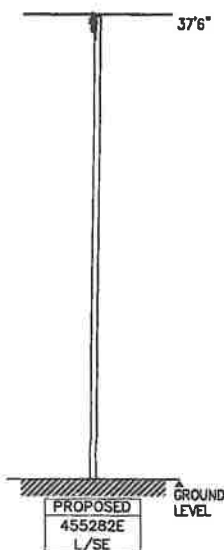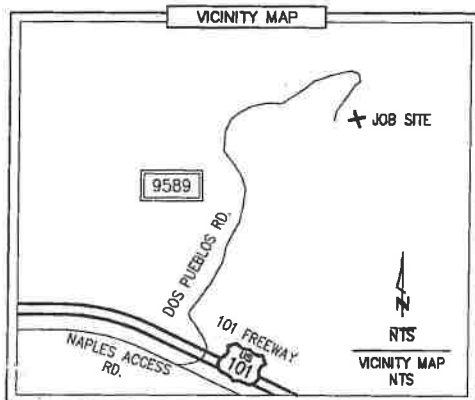

POLE **455282E**
45' Class C1
IN: 1- POLE 45' CLASS 1 COMP SEC POLE
IN: 1- XA SNGL TAN HD COMP 10' W/BKT
IN: 3- INS POLY W/PIN 16KV CLMP #6-4/0 CU
IN: 1- MISC AVIAN HOOD FOR HENDRIX INSUL #4-653

GPS COORDINATES
N: 34° 28' 28.64"
W: 119° 57' 10.76"
ELEVATION: 380'



**SOUTHERN CALIFORNIA
EDISON**
AN EDISON INTERNATIONAL Company

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)		DISTRICT 49 - SANTA BARBARA		PROJ. MGR. TOLMASOFF, LAURA M PHONE 714-796-9811		PLANNER TIDWELL DESIGN PHONE 805-647-4707		DESIGNER TIDWELL DESIGN		
EDISON EASEMENT REQUIRED	☐	PROJECT NO.	1704228	SERVICE REQUEST	2610475	MSR NO.		PRODUCT-1	1485914-INFRA REPLAC - DET POLE REPLACEMENT	
PERMITS REQUIRED	☐	CIRCUIT / VOLTAGE	MIST 16KV	THOMAS GUIDE	N/A	CIRCUIT CODE		PRODUCT-2		
US CIVIL ONLY WORK ORDER	☐	SUB / PG NO.	CAPITAN					PRODUCT-3		
PERMIT REQUIRED	☒	INVENTORY MAP	21-44	J.P.A. NO.	N/A	PROPOSED CONSTRUCTION (LOCATION)				
OUTAGE DATE:		455282E								
TRAFFIC CONTROL REQUIRED	☐	9589 DOS PUEBLOS RD.,								
FED. TRAFFIC CONTROL REQ'D	☐	GOLETA								
CONVEYANCE LETTER REQ'D	☐									
ENVIRONMENTAL CLEARANCE REQ'D	☐									
CSD 140 (TUM) REQ'D	☐									
		TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET		
		Southern California Edison Company							DESIGN/DRWG NO.	
									1102367 0.01	

455282E



Dist. 49 Deteriorated Pole
L / SE

455282E



Dist. 49 Deteriorated Pole
L / NE

- NOTES:
- SEE TO PTD.
 - SET LOCATION: HARD SET NORTH EAST.
 - EAGLE ZONE
 - BULLETIN 322 AREA



TRANSFER:

- 3-#4ACSR 16KV



HIGH FIRE
TIER 3
LOCATION

1 RM 40' 2108853E
Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- YA SINGL FB 10' STEEL PINS
RM: 3- INS GLASS & PIN 16KV

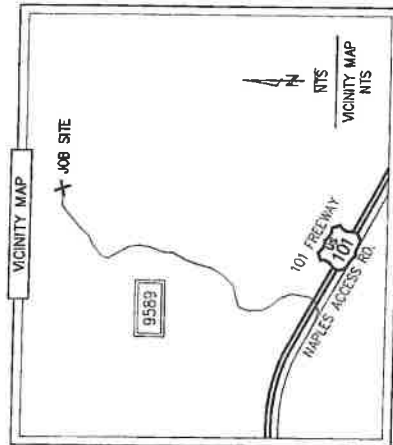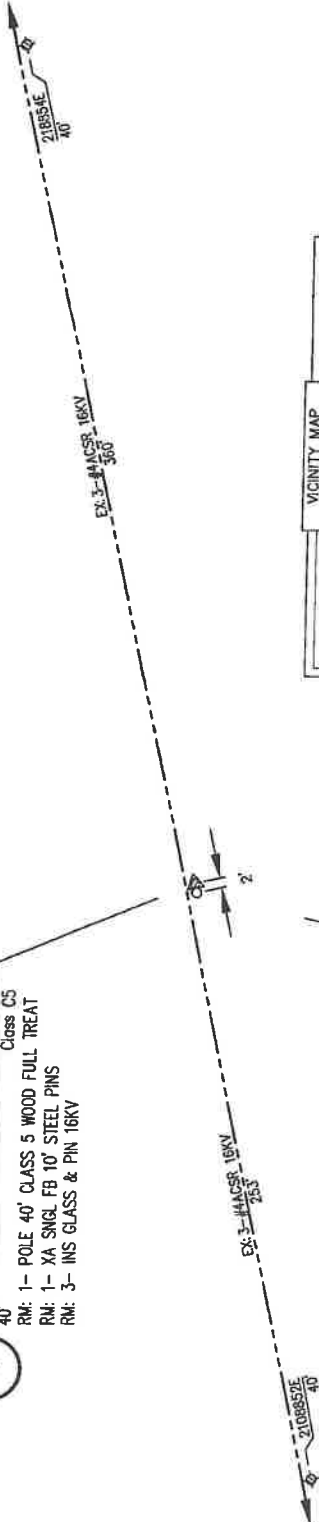


SOUTHERN CALIFORNIA
EDISON
AN EDISON INTERNATIONAL COMPANY

NOT TO SCALE

PROJECT REQUIREMENTS (V/ALL)		DISTRICT		PROJ. MGR. TOLMASOFF, LAURA		W. PLANNER		TOWELL DESIGN		DESIGNER	
EDISON EASEMENT REQUIRED ☒		49 - SANTA BARBARA		PHONE 714-796-9811		PHONE 805-547-1707		TOWELL DESIGN		TOWELL DESIGN	
POND BE REQUIRED ☒		PROJECT NO. 1704211		SERVICE REQUEST 2610458		MSR NO. 1485903		PRODUCT-1		PRODUCT-2	
USE CIVIL ONLY WORK ORDER ☒		CIRCUIT / VOLTAGE		MIST 16KV		THOMAS GUIDE		N/A		N/A	
PERMIT REQUIRED ☒		SUB / PG NO.		CAPITAN		CIRCUIT CODE		PRODUCT-3		PRODUCT-3	
PERMIT TYPE		INVENTORY MAP		21-44		J.P.A. NO.		PROPOSED CONSTRUCTION (LOCATION)		2108853E	
OUTAGE DATE		TMC						9589 DOS PUEBLOS CYN RD.,		GOLETA	
TRAFFIC CONTROL REQUIRED ☒											
P.D. TRAFFIC CONTROL REQD ☒											
CONVEYANCE LETTER REQD ☒											
ENVIRONMENTAL CLEARANCE REQD ☒											
CSD 140 (TM) REQD ☒											
DATE		APPROVED BY		CHECKED BY		DRAWN BY		PAX #		SHEET	
										DESIGN/WORKING NO.	
										1102357 0.01	

2-24 No. 10/20/14

2108853E

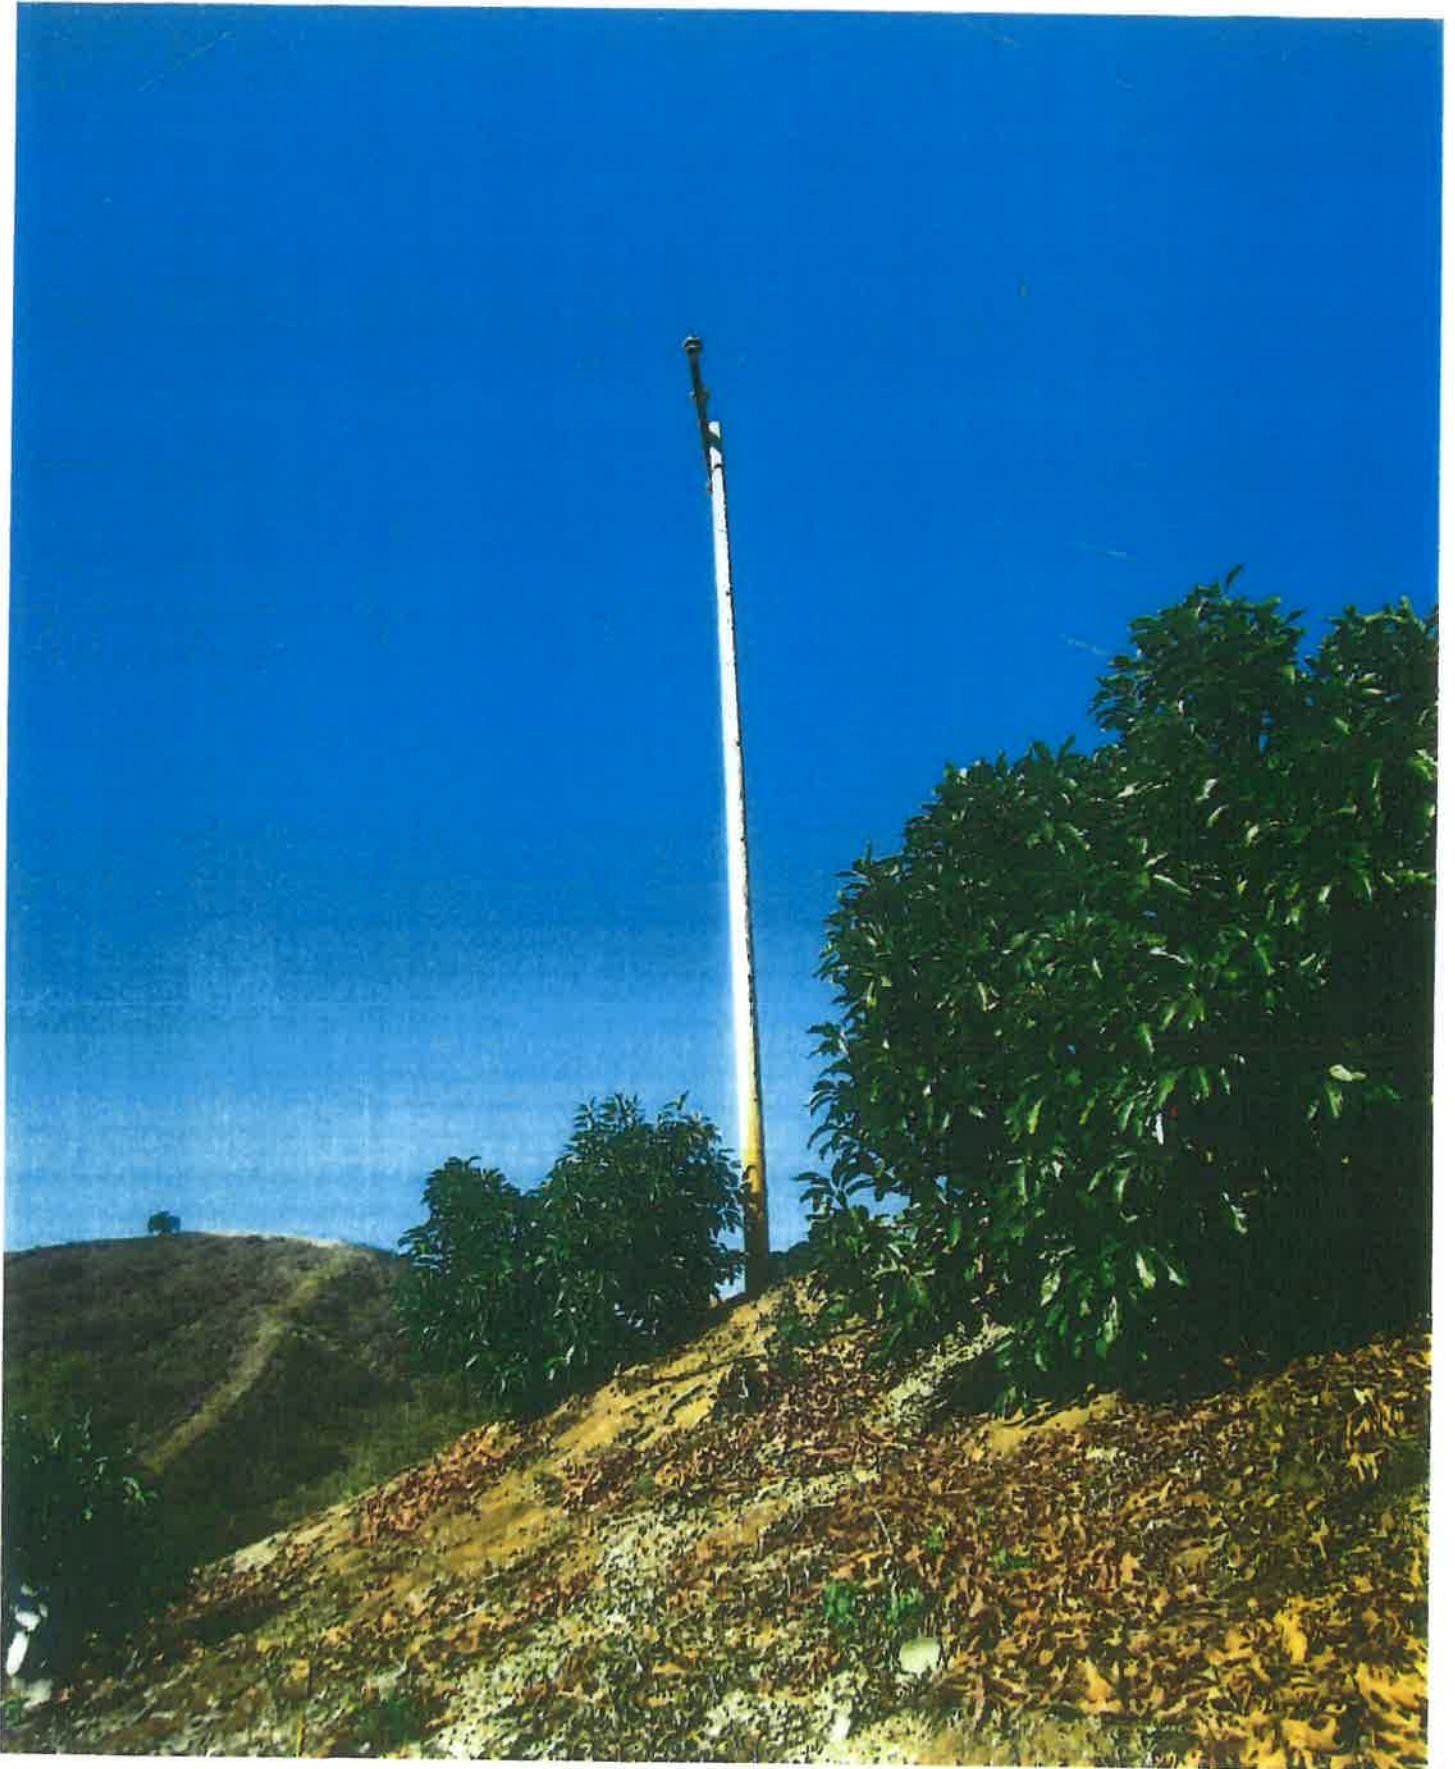


Dist. 49 Deteriorated Pole
L / NW

2108853E



Dist. 49 Deteriorated Pole
L / W

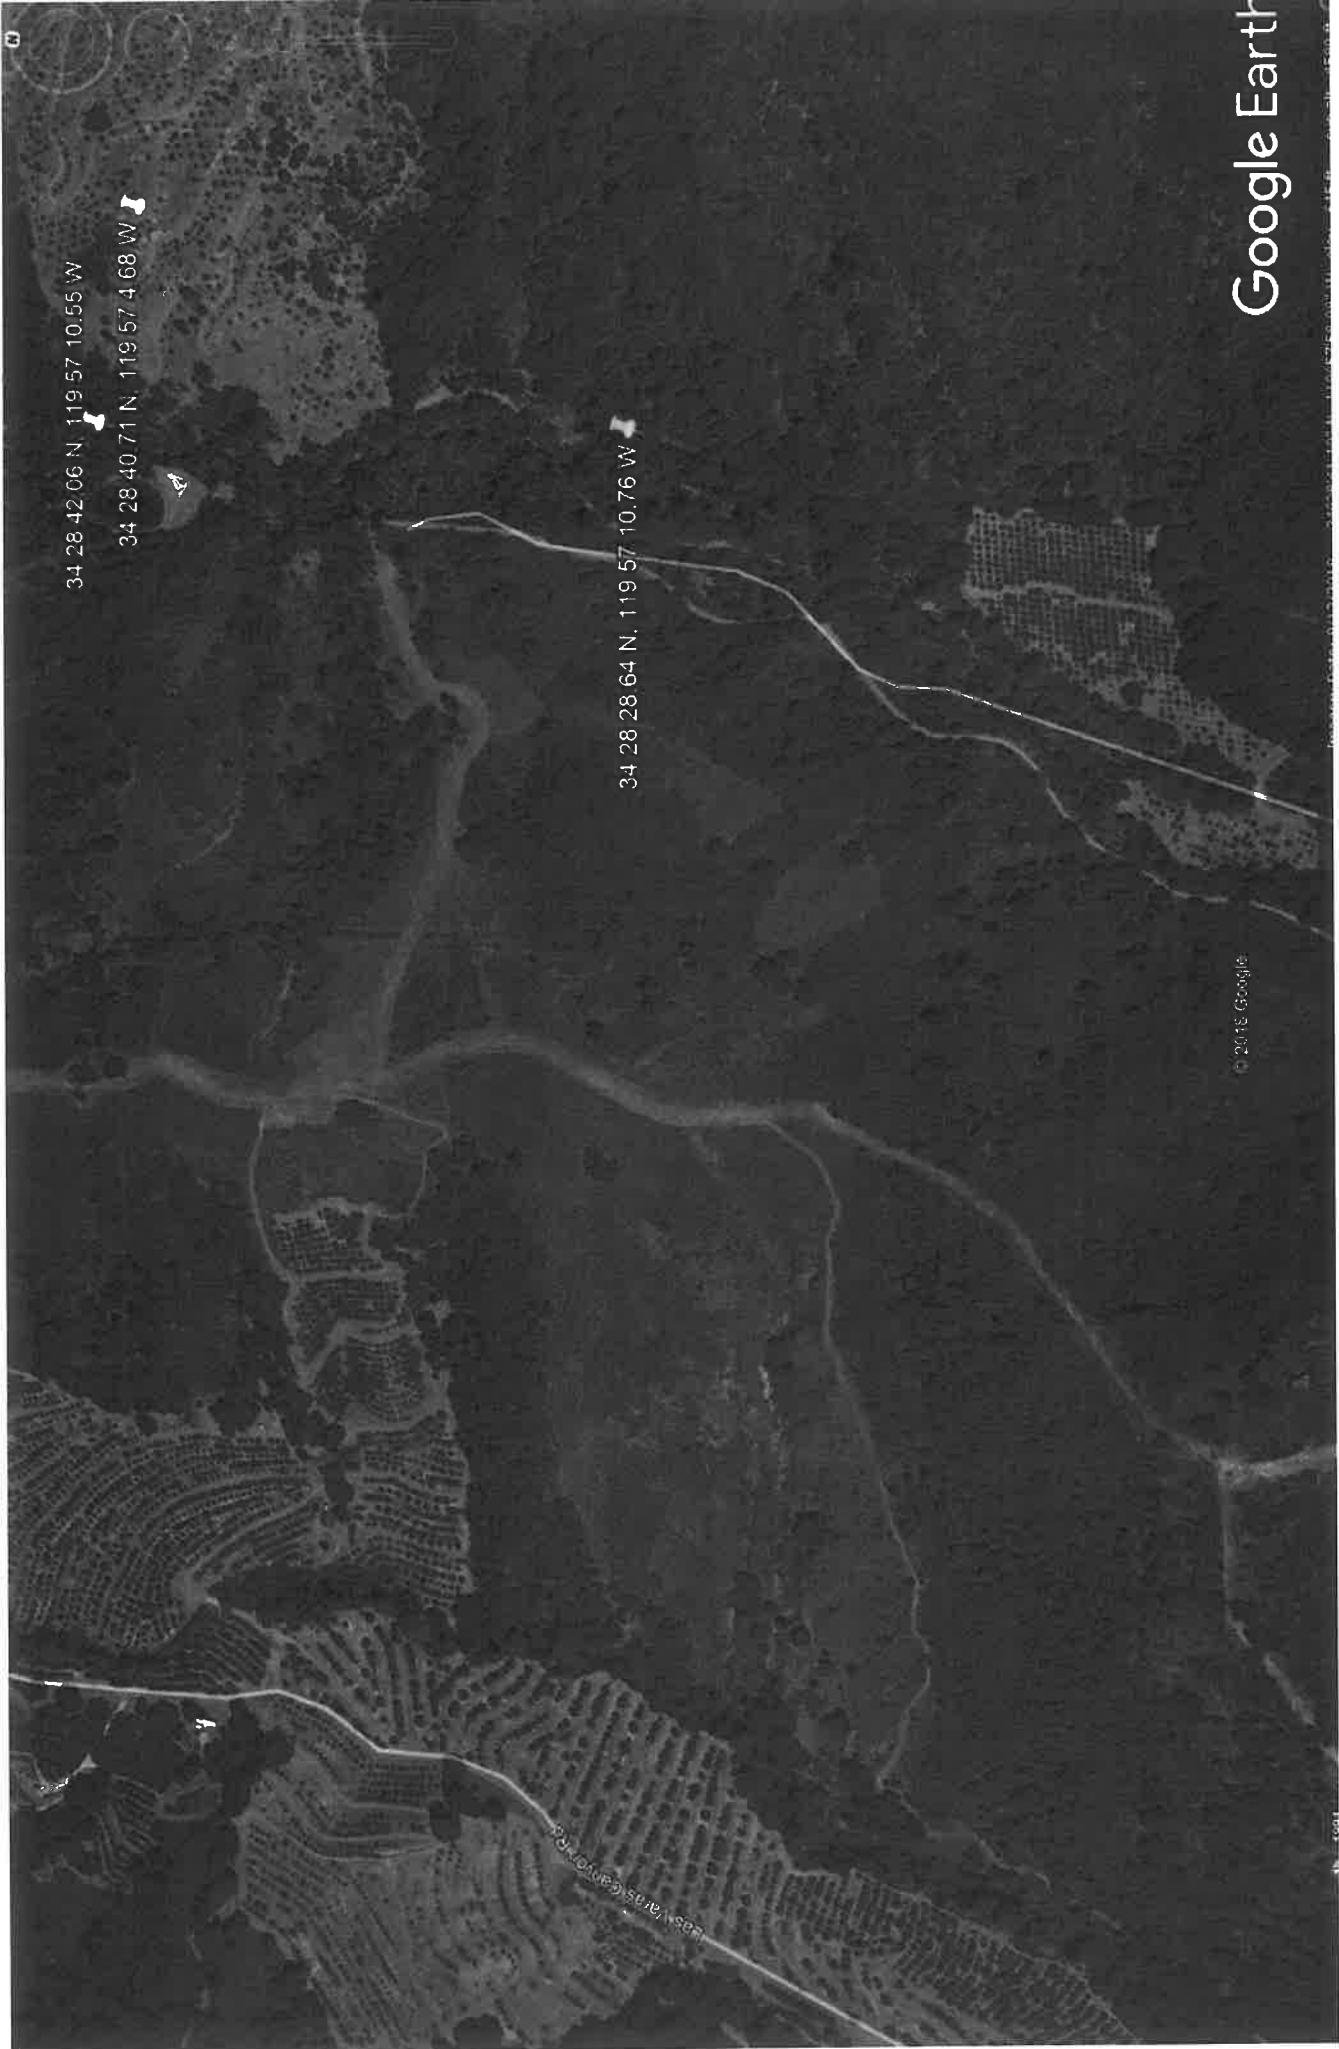

34 28 42.06 N 119 57 10.55 W

34 28 40.71 N 119 57 4.68 W

34 28 28.64 N 119 57 10.76 W

© 2015 Google

Google Earth

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	CHRIS BROWN
Department:*	HOTLINE CONSTRUCTION INC
Pax:*	N/A
Cell Number:*	951-282-1467
Email Address:*	CBROWN@hotlineconstructioninc.com

SAP Accounting Number*	TD1485929
-------------------------------	-----------

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☒ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☒ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

R&R 2134291E - RM 45' CL4 WD. IN 45' CL1 CMP SEC

34 28 53.37N, 119 56 51.68W

APPROX HEAVIEST POLE WEIGHT : 1500 LBS

General Operating Location	DOS PUEBLOS CANYON RD
District	49 SANTA BARBARA
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	12-13-19
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

[Click to e-mail form](#)

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

- NOTES:
- SEE TO PTD.
 - SET LOCATION: HARD SET SOUTH WEST.
 - EAGLE ZONE.
 - HAND SET.
 - HAND DIG.
 - BULLETIN 322 AREA.

TRANSFER:

- 3-#4CSR 18KV
- 1-1/0AT SVC 120/240V



T.L.M. DATA:				
SIZE	KVA	CUST	% LOAD	
EXIST. 45	26.7	1	59.33%	
PROP. 75	26.7	1	35.6%	
VOLTAGE DROP: _____				
FLICKER FACTOR: _____				
PRI. CIRCUIT: MIST 18KV				

SECTIONAL COMPOSITE

EXIST. 18KV 120/240V

1

RM

2134291E

Class C4

- RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
- RM: 1- XA DBLE FB 10' STEEL PINS
- RM: 3- INS GLASS/POLY 35KV & LESS
- RM: 1- XA SINGL FB 10' STEEL PINS
- RM: 3- FE PH CO ALL SIZES 200A OR LESS 18KV
- RM: 1- TR OH 3-15KVA 16KV 277/480Y 3P
- SN: _____
- SN: _____
- SN: _____
- RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
- RM: 2- SEC ROLLER (166-CLEWS & SPOOL)
- RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
- RM: 1- MISC RAPTOR GUARD TWO-PIECE

POLE


45'

2134291E

Class C1


- IN: 1- POLE 45' CLASS 1 COMP SEC POLE
- IN: 1- XA SINGL DE HD COMP 10' W/BKT
- IN: 3- INS POLY DE 18KV HOT SHOE #4 & 1/0 ACSR
- IN: 1- XA SINGL TAN HD COMP 10' W/BKT
- IN: 3- FE CO MNT FOR ELF 100A 18KV 1-EA
- IN: 3- FE FUSE ELF 15KV 8A
- IN: 1- TR OH 3-25KVA 16KV 277/480Y 3P
- SN: _____
- SN: _____
- SN: _____
- IN: 1- GR OH #6 SOL WP SECONDARY W/ROD
- IN: 2- SEC ROLLER (166-CLEWS & SPOOL)
- IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

GPS COORDINATES
N: 34° 28' 53.37"
W: 119° 56' 51.68"
ELEVATION: 670'

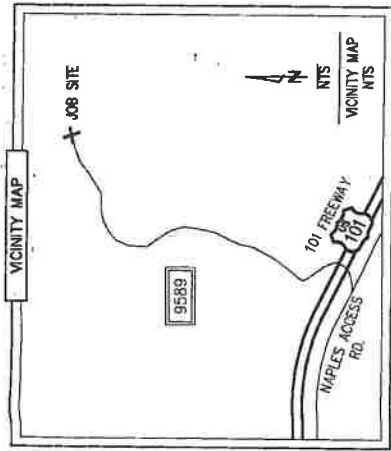

NOT TO SCALE


PROJECT REQUIREMENTS (Y/N)		DISTRICT		PROJ. MGR. TOLMASOFF, LAURA		TOWELL DESIGN		DESIGNER	
EXIST. FACILITY REQUIRED	NO	49 - SANTA BARBARA	PHONE 714-790-9811	PLANNER	PHONE 805-847-4707	TIDWELL DESIGN		ASSOC. DESIGN	
PERM. AS REQUIRED	NO	PROJECT NO. 1704244	SERVICE REQUEST 2610491	ASR NO.	PRODUCT-1	1485923-INFRA REPLAC - DET POLE REPLACEMENT		ASSOC. DESIGN	
10' DIA. DAILY WORK ORDER	NO	CIRCUIT / VOLTAGE	MIST 16KV	THOMAS GUIDE	PRODUCT-2			ASSOC. DESIGN	
PERMIT REQUIRED	NO	SUB / PG NO.	CAPITAN	CIRCUIT CODE	PRODUCT-3			ASSOC. DESIGN	
PERMIT TYPE	NO	INVENTORY MAP	22-44	J.P.A. NO.	N/A			PROPOSED CONSTRUCTION (LOCATION)	
OUTAGE DATE:	TIME	2134291E							
TRAFFIC CONTROL REQUIRED	NO	9589 DON PUEBLOS CYN RD.,							
PER. TRAFFIC CONTROL REQ'D	NO	GOLETA							
CONFORMANCE LETTER REQ'D	NO								
ENVIRONMENTAL CLEARANCE REQ'D	NO								
CSD 140 (ELA) REQ'D	NO								
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET		DESIGN DURING NO.	
						1102379		0.01	

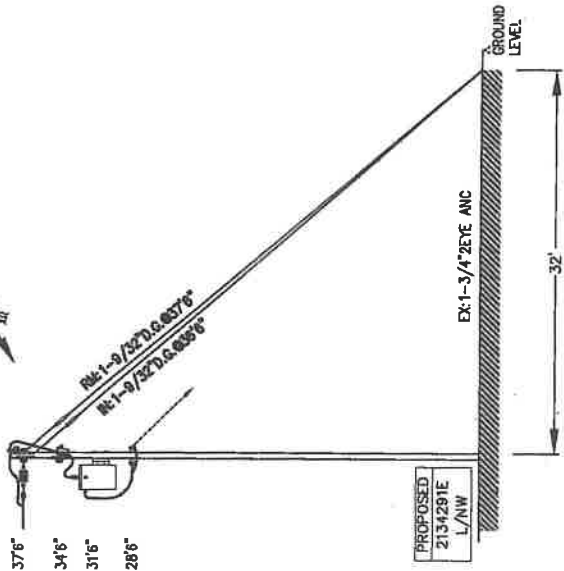

2134291E



**Dist. 49 Deteriorated Pole
L / NE**

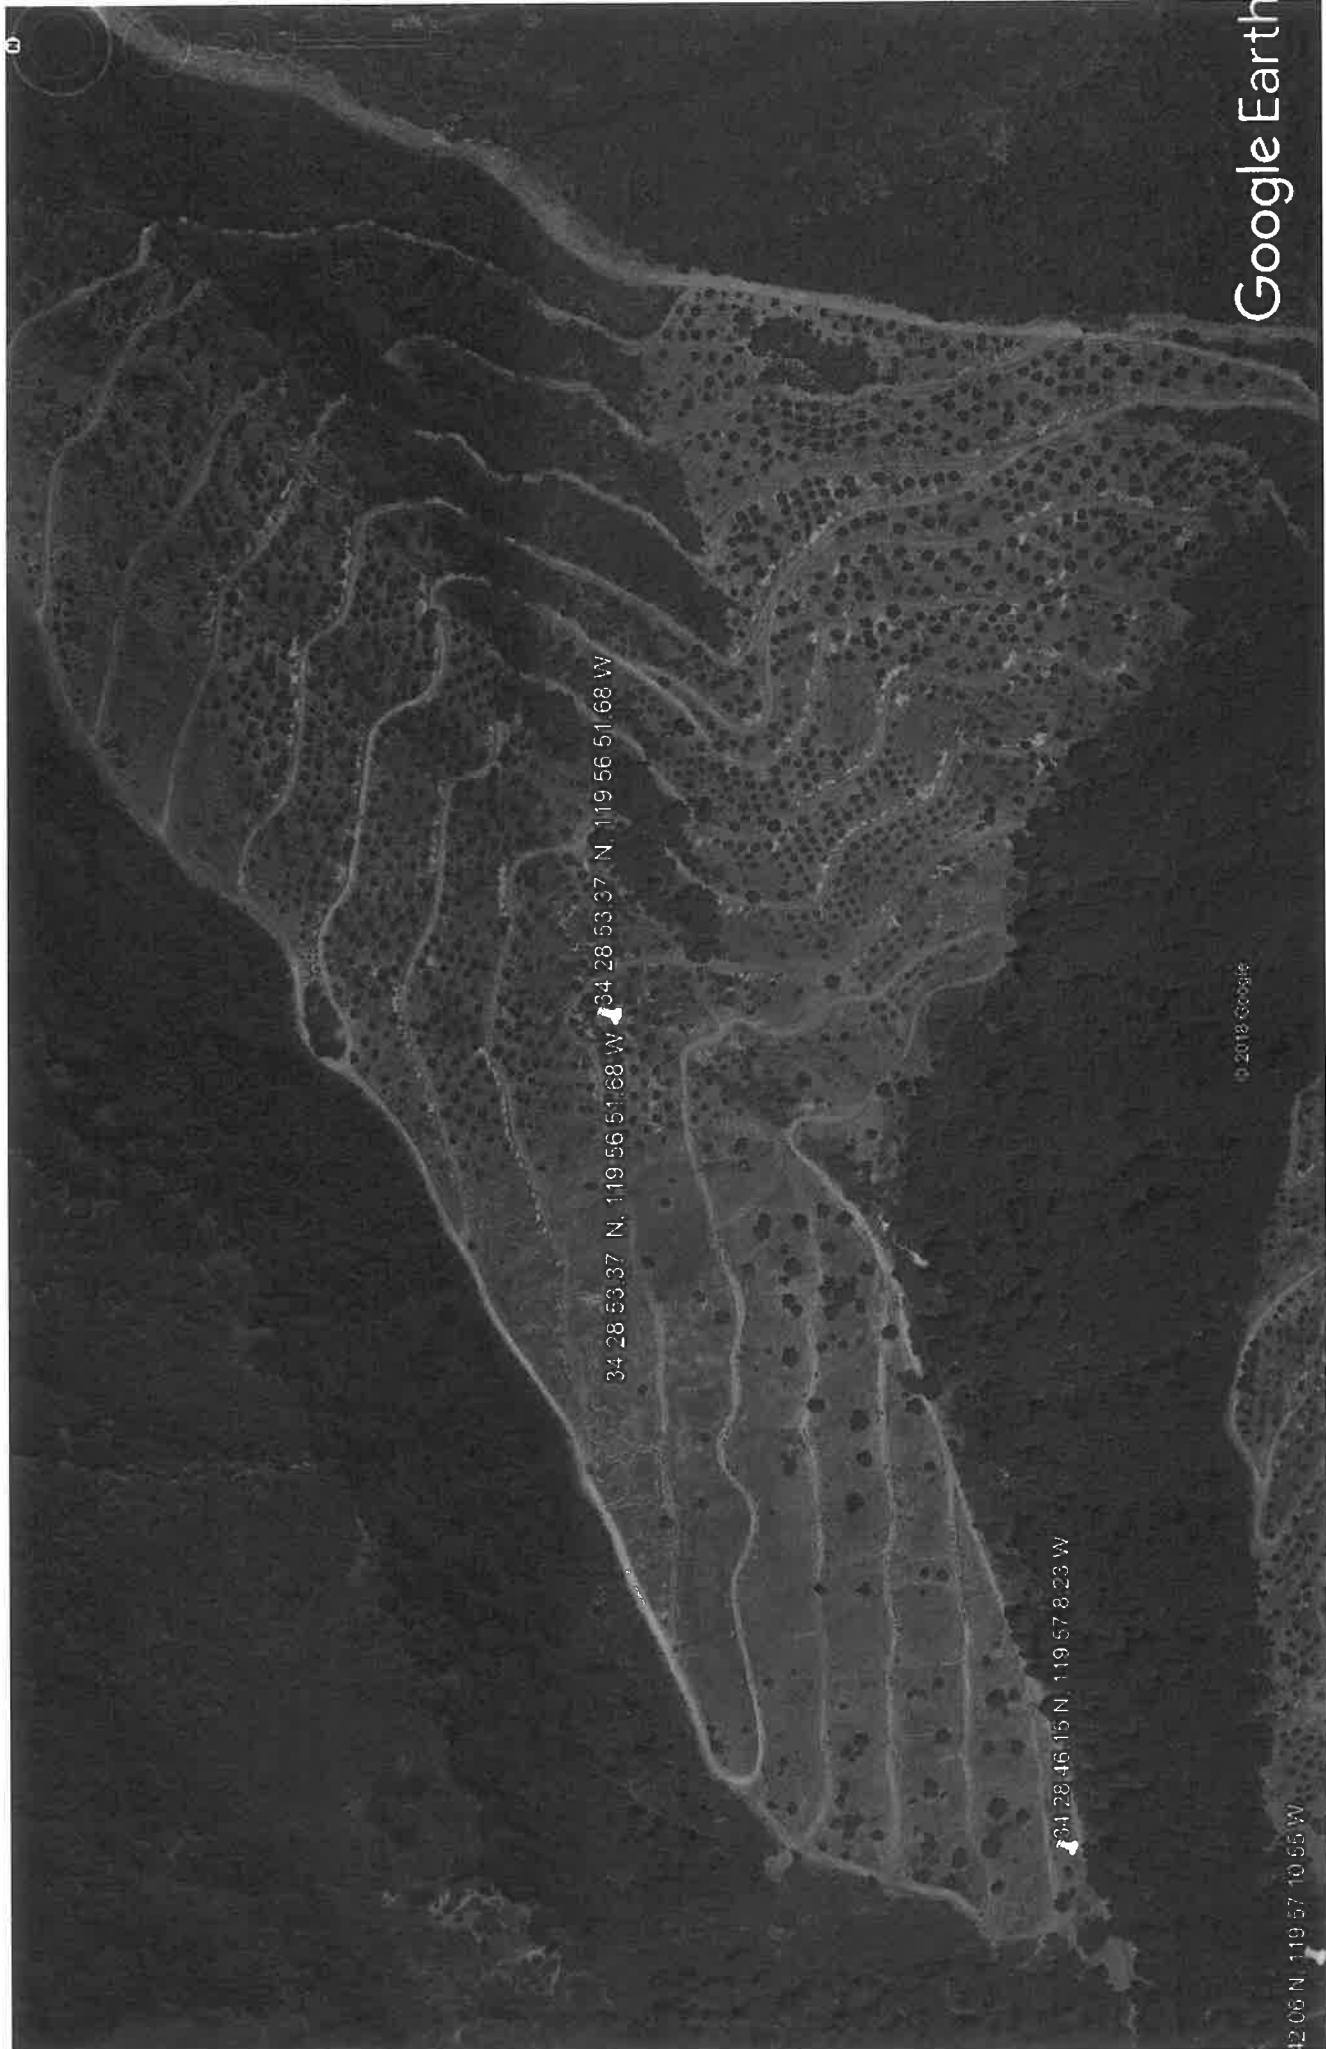

34 28 53.37 N, 119 56 51.68 W

34 28 46.15 N, 119 57 8.23 W

34 28 06 N, 119 57 10.55 W

© 2012 Google

Google Earth

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	CHRIS BROWN
Department:*	HOTLINE CONSTRUCTION INC
Pax:*	N/A
Cell Number:*	951-282-1467
Email Address:*	CBROWN@hotlineconstructioninc.com

SAP Accounting Number*	TD1485929
-------------------------------	-----------

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☒ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☒ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

R&R 2134291E - RM 45' CL4 WD, IN 45' CL1 CMP SEC

34 28 53.37N, 119 56 51.68W

APPROX HEAVIEST POLE WEIGHT : 1500 LBS

General Operating Location	DOS PUEBLOS CANYON RD
District	49 SANTA BARBARA
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	12-13-19
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

[Click to e-mail form](#)

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

- NOTES:
- SEE TO PTD.
 - SET LOCATION: HARD SET SOUTH WEST.
 - EAGLE ZONE.
 - HAND SET.
 - BULLETIN 322 AREA.

TRANSFER:

- 3-#ACSR 18KV
- 1-1/0AT SVC 120/240V



T.L.M. DATA:

EXIST.	SIZE	KVA	CUST	% LOAD
45	26.7	1	59.33%	
PROP.	75	26.7	1	35.6%

VOLTAGE DROP: _____

FLICKER FACTOR: _____

PRI. CIRCUIT: MIST 18KV

SECTIONAL COMPOSITE

1 RM 45'


2134291E Class C4

- RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
- RM: 1- XA DBLE FB 10' STEEL PINS
- RM: 3- INS GLASS/POLY 35KV & LESS
- RM: 1- XA SINGL FB 10' STEEL PINS
- RM: 3- FE FH CO ALL SIZES 200A OR LESS 18KV
- RM: 1- TR OH 3-15KVA 18KV 277/480Y 3P
- SN: _____
- SN: _____
- RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
- RM: 2- SEC ROLLER (166-CLEVIS & SPOOL)
- RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
- RM: 1- MISC RAPTOR GUARD TWO-PIECE

POLE 45'

2134291E 2 Class C1

- IN: 1- POLE 45' CLASS 1 COMP SEC POLE
- IN: 1- XA SINGL DE HD COMP 10' W/BKT
- IN: 3- INS POLY DE 18KV HOT SHOE #4 & 1/0 ACSR
- IN: 1- XA SINGL TAN HD COMP 10' W/BKT
- IN: 3- FE CO MNT FOR ELF 100A 18KV 1-EA
- IN: 3- FE FUSE ELF 15KV 8A
- IN: 1- TR OH 3-25KVA 16KV 277/480Y 3P
- SN: _____
- SN: _____
- IN: 1- GR OH #6 SOL WP SECONDARY W/ROD
- IN: 2- SEC ROLLER (166-CLEVIS & SPOOL)
- IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

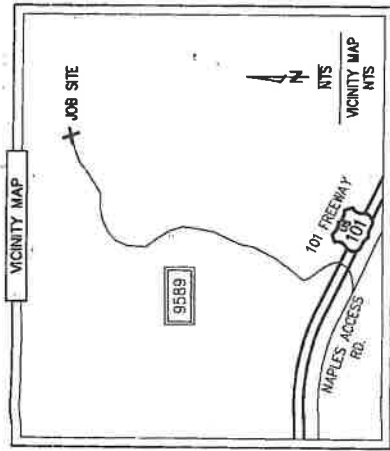

SOUTHERN CALIFORNIA
EDISON
AN EDISON INTERNATIONAL COMPANY

NOT TO SCALE


PROJECT REQUIREMENTS (Y/N)		DISTRICT 49 - SANTA BARBARA		PROJ. MGR. TOLMASOFF, LAURA		DESIGNER TIDWELL DESIGN	
DESIGN REQUEST	Y	PROJECT NO. 1704244	SERVICE REQUEST	USR NO. 2610491	PHONE 714-798-9811	PHONE 805-847-4707	DESIGNER TIDWELL DESIGN
FIELD NO. REQUIRED	Y	CIRCUIT / VOLTAGE	MIST 18KV	THOMAS GUIDE	1485929	INTRA REPLAC - DET POLE REPLACEMENT	ASSOC DESIGN
US ONLY WORK ORDER	Y	SUB / PG NO.	CAPITAN	CIRCUIT CODE	PRODUCT-3	ASSOC DESIGN	ASSOC DESIGN
POINT REQUIRED	Y	INVENTORY MAP	22-44	J.P.A. NO.	N/A	PROPOSED CONSTRUCTION (LOCATION)	ASSOC DESIGN
OUTLINE REQUIRED	Y	DATE:				2134291E	
TRAFFIC CONTROL REQUIRED	Y	PERMITS REQUIRED				9589 DON PUEBLOS CYN RD.,	
PERMITS REQUIRED	Y	CONFORMANCE LETTER REQD				GOLETA	
ENVIRONMENTAL CLEARANCE REQD	Y	ENVIRONMENTAL CLEARANCE REQD					
CSD 140 (RM) REQD	Y						
TYPE DATE		APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET	DESIGN/DRWG NO.
				TIDWELL		1102379	0.01

Southern California Edison Company

2134291E



Dist. 49 Deteriorated Pole
L / NE

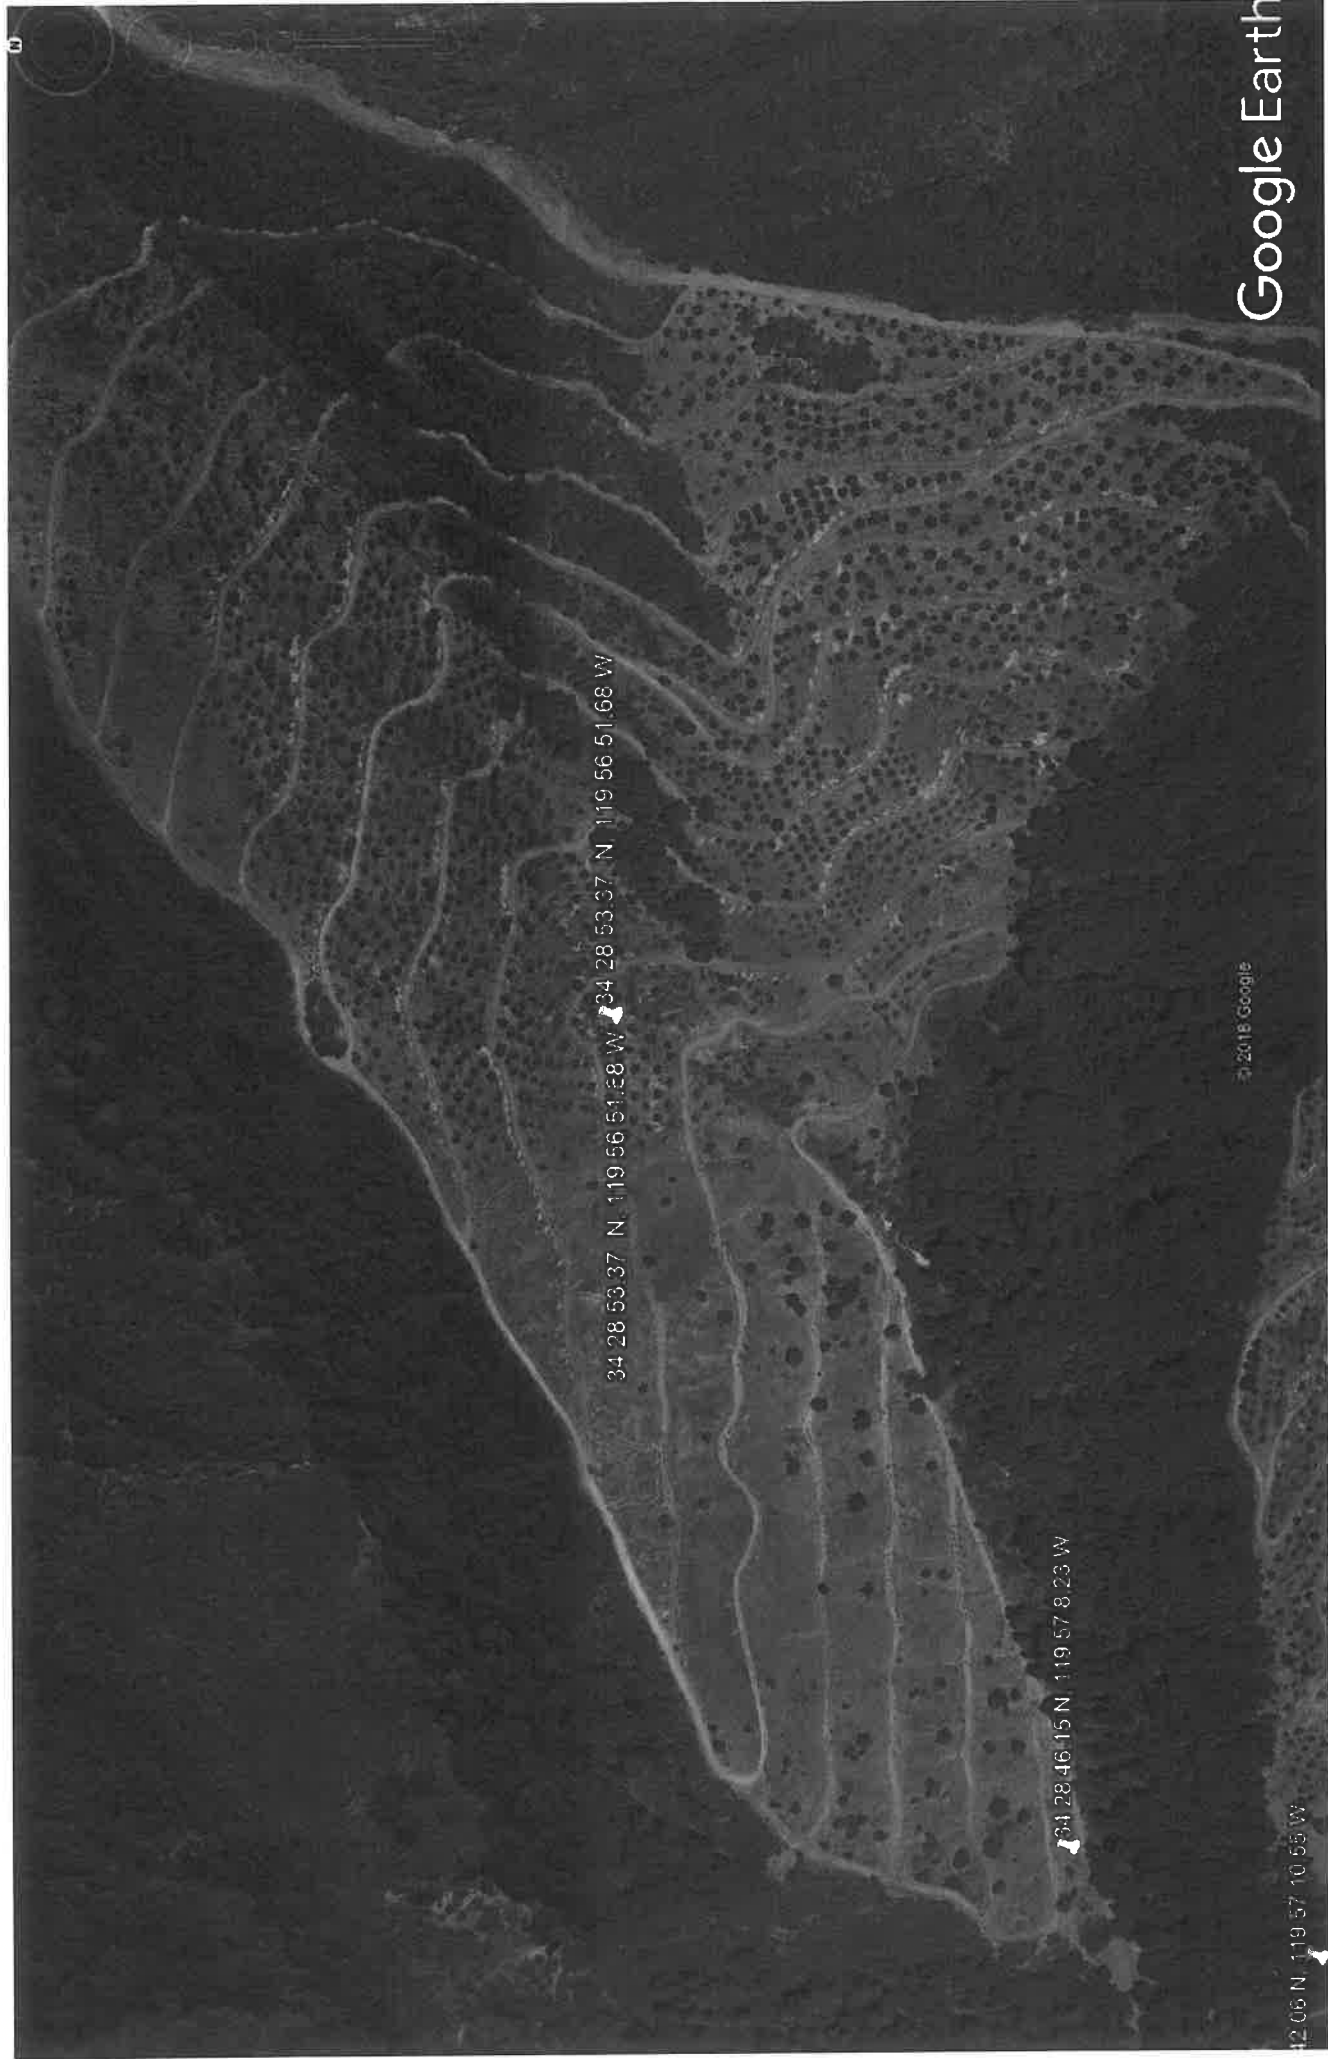

2

34 28 53.37 N 119 56 51.88 W 34 28 53.37 N 119 56 51.68 W

34 28 46.15 N 119 57 8.23 W

42 06 N 119 57 10 55 W

© 2018 Google

Google Earth