

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

APPROVED

By Omar Sharif at 8:09 am, Dec 20, 2019

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____


Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____



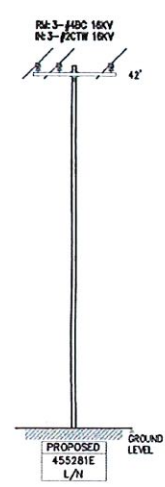


- 3 RM** 455281E
 50' Class C4
 RM: 1- POLE 50' CLASS 4 WOOD FULL TREAT
 RM: 1140- CD #4 SOLID BARE CU (3/C TO 5282E)
 RM: 1- XA SVGL FB 10' STEEL PINS
 RM: 3- INS GLASS & PIN 16KV
- 4 POLE** 455281E
 50' Class C1
 RM: 1- POLE 50' CLASS 1 RS COMP SEC POLE
 RM: 1140- #2 CTW XLHOPE INS CABLE 17KV (3/C TO 5282E)
 RM: 3- INS POLY PIN 16KV VRT VCE NYLON
 RM: 1- XA SVGL VB 10' COMP W/BKRT STEEL PINS

- NOTES:
 • SEE TO PTD.
 • HARD SET NORTH.
 • EAGLE ZONE.
 • HAND DIG.
 • HAND SET.
 • BULLETIN 322 AREA.
 • LIMITED TRUCK ACCESS.
 • FOOT ACCESS.
 • POLE REPLACED DUE TO SET DEPTH OOPS INFRACTION.
 • NO PTC REQUIRED.
 • NO TRAFFIC CONTROL REQUIRED.


MATCH LINE "A"
 SEE SHEET 1

- EXISTING** 4574289E 5
 40' (2004) Class C5
 RM: 705- CD #4 SOLID BARE CU (3/C TO 5281E)
 RM: 1- XA DELE VB 10' STEEL PINS
 RM: 6- INS GLASS & PIN 16KV
 RM: 705- #2 CTW XLHOPE INS CABLE 17KV (3/C TO 5281E)
 RM: 1- XA SVGL DE HD COMP 10' W/BKRT
 RM: 3- INS POLY PIN 16KV VRT VCE NYLON
- NOTES:
 • EAGLE ZONE.
 • BULLETIN 322 AREA.
 • FOOT ACCESS ONLY.
 • NO PTC REQUIRED.
 • NO TRAFFIC CONTROL REQUIRED.
 • PREVIOUS INTRUSIVE INSPECTION (02/24/2016) NO IN REQ'D

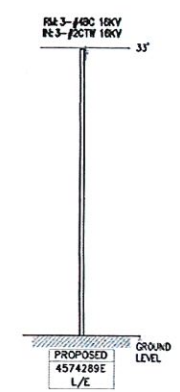

- EXISTING** 4574294E 6
 60' (2004) Class C2
 RM: 1371- CD #4 SOLID BARE CU (3/C TO 4289E)
 RM: 1- XA DBLE VB 12' STEEL PINS
 RM: 3- INS GLASS & PIN 16KV
 RM: 2- MISC RAPTOR GUARD TWO-PIECE
 RM: 6- INS POLY DE 16KV RIG #4
 RM: 1371- #2 CTW XLHOPE INS CABLE 17KV (3/C TO 4289E)
 RM: 1- XA DBL HD DE COMP 10'
 RM: 3- INS POLY DE 16KV RIG #2
 RM: 3- INS POLY DE 16KV RIG #4
 RM: 3- INS POLY PIN 16KV VRT VCE NYLON
 RM: 3- KADDAAS WILDFIRE CVD CND DEAD END COVER
 RM: 1- AG ANCHOR ROD 1" X 10' 3-EYE W/PLATE
 RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV
- NOTES:
 • EAGLE ZONE.
 • BULLETIN 322 AREA.
 • FOOT ACCESS ONLY.
 • GRADING REQUIRED TO GAIN ACCESS TO POLE LOCATION.
 • NO PTC REQUIRED.
 • NO TRAFFIC CONTROL REQUIRED.
 • PREVIOUS INTRUSIVE INSPECTION (02/24/2016) NO IN REQ'D



TRANSFER:
 3-#43C 15KV (SOUTH) TO NEW ARM

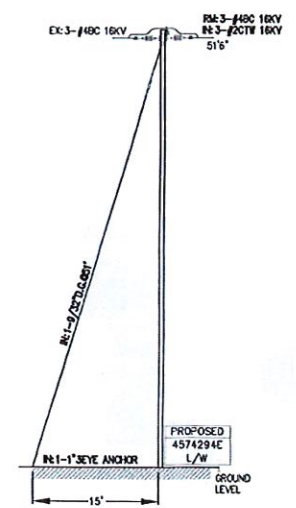

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☒
PARO B8 REQUIRED	☒
UG CIVIL ONLY WORK ORDER	☒
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☒
OUTAGE DATE:	TIME:
TRAFFIC CONTROL REQUIRED	☒
PED. TRAFFIC CONTROL REQ'D	☒
CONVEYANCE LETTER REQ'D	☒
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (ILM) REQ'D	☒

UNDERGROUND SERVICE ALERT
 Dial 811
 Call USA
 For Underground Locating
 2 Working Days Before You Dig

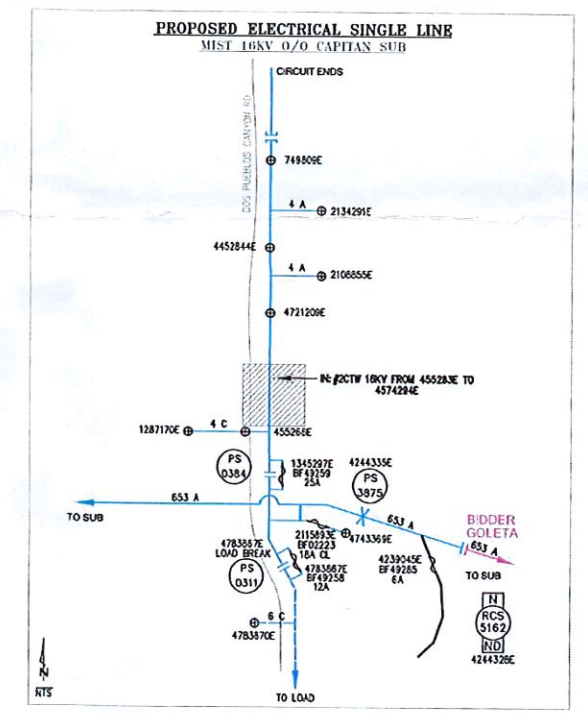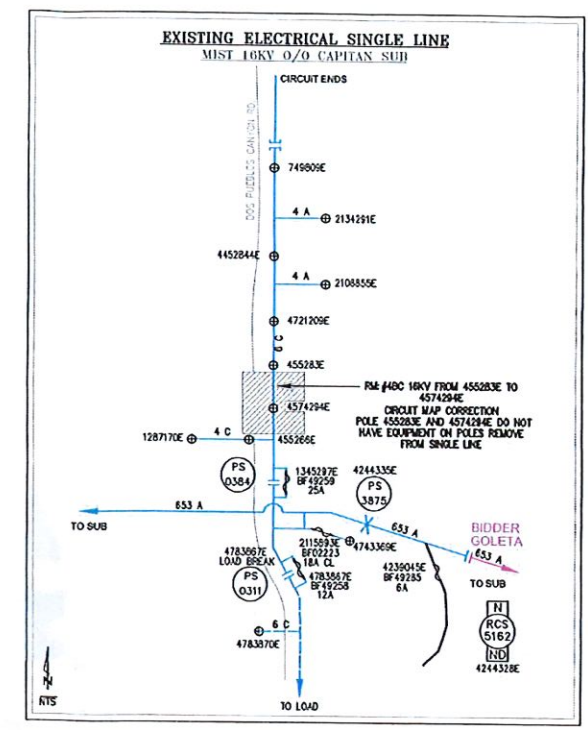


SINGLE LINE LEGEND
 - 15KV 15KV 4/0 CAPTAIN SUB
 - 15KV 15KV 4/0 CAPTAIN SUB

FINAL DESIGN
 APPROVED FOR CONSTRUCTION NOT TO SCALE

DISTRICT 49 - SANTA BARBARA	PROJECT NO. 1731395	SERVICE REQUEST 1731395	WGR NO. 1731395	PROJECT-1 15KV 15KV 4/0 CAPTAIN SUB	ASSOC DESIGN
DATE 04/18/19	APPROVED BY F. Morris	CHECKED BY N. Morris	DRAWN BY TOWELL	PROJECT-2 15KV 15KV 4/0 CAPTAIN SUB	ASSOC DESIGN
INVENTORY MAP 21-44			APPA NO. N/A	PROJECT-3 15KV 15KV 4/0 CAPTAIN SUB	ASSOC DESIGN
PROPOSED CONSTRUCTION (LOCATION) MIST 16KV OCP DOS PUEBLOS CYN RD GOLETA			SHEET 2 of 2		
DESIGN/DRWG NO. 1118736_0.01			SOUTHERN CALIFORNIA EDISON AN EDISON INTERNATIONAL COMPANY		

34°28'18.6"N 119°57'14.6"W

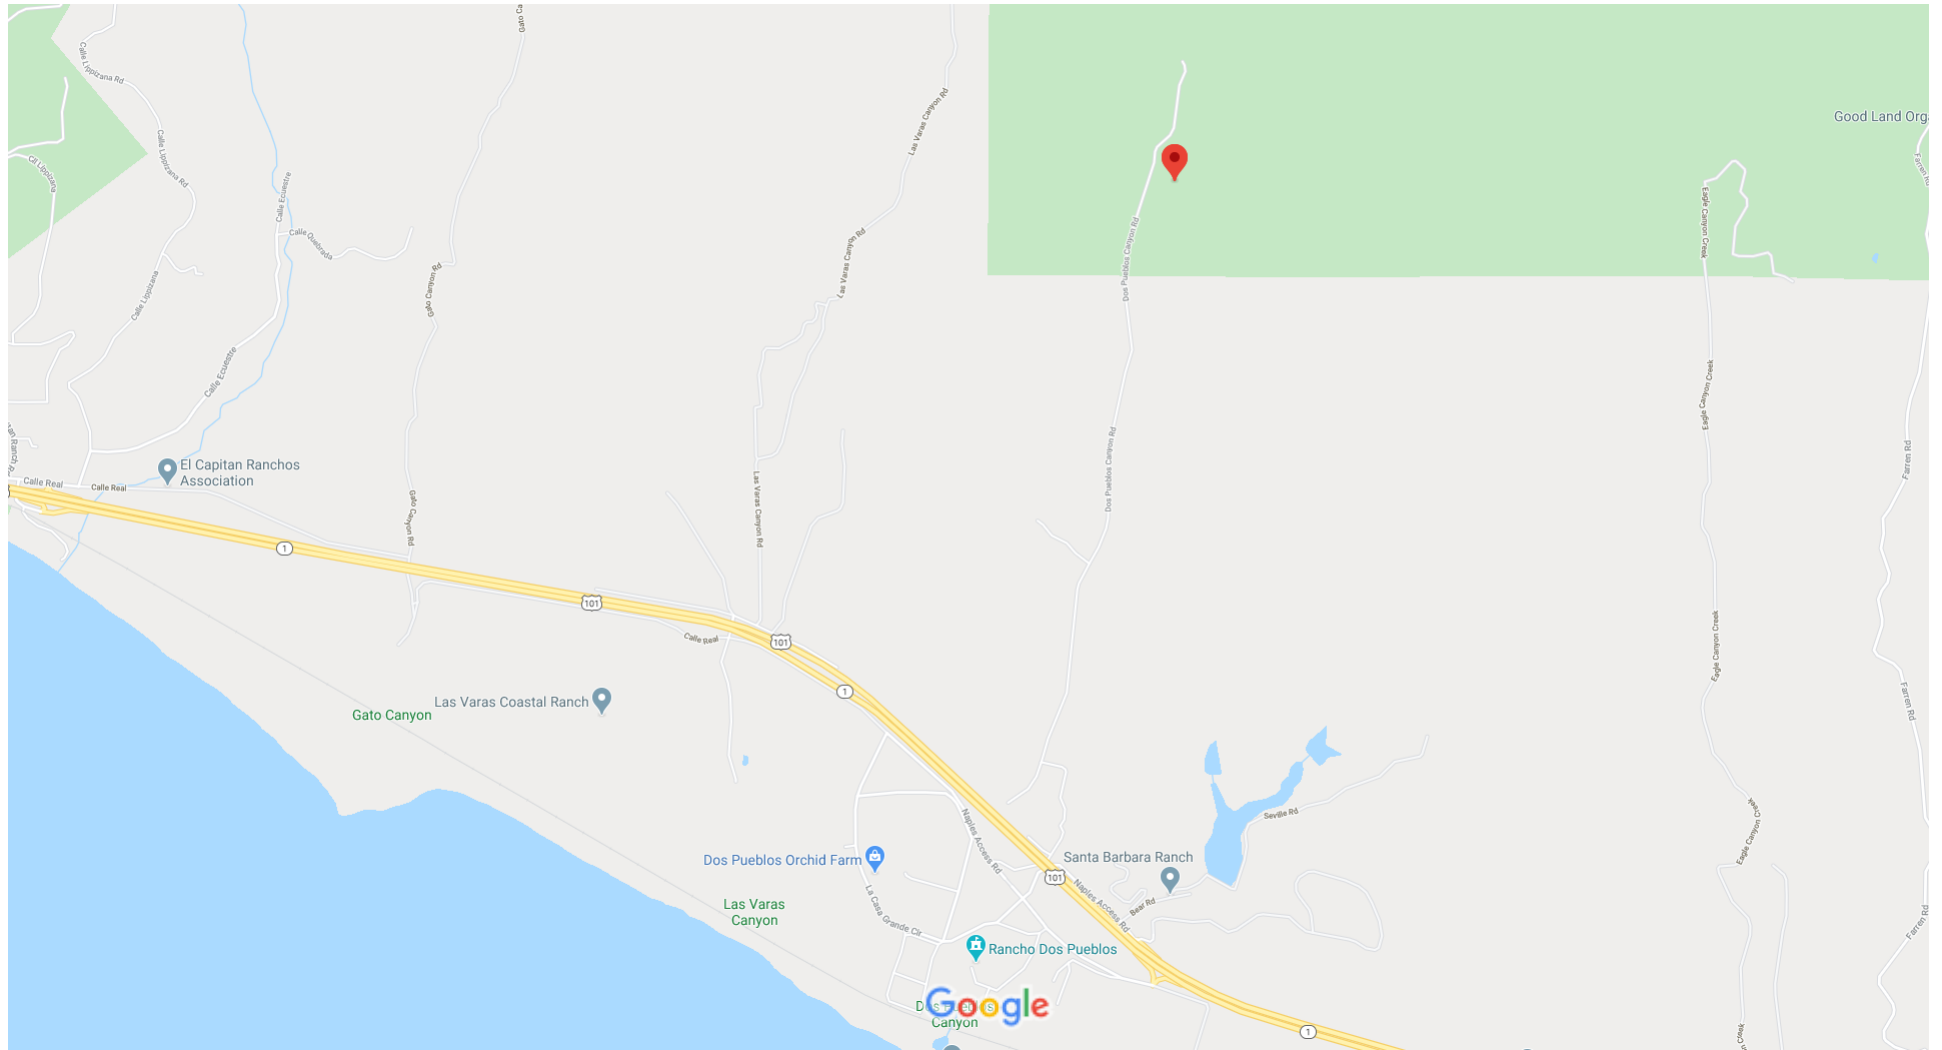

Map data ©2020 Google 1000 ft



34°28'18.6"N 119°57'14.6"W

34.471842, -119.954061



Directions



Save



Nearby



Send to your
phone



Share



Goleta Union School District, CA



F2CW+P9 Goleta, California

Photos



Photos