



An *EDISON INTERNATIONAL*® Company

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | | | | |
|--------------------------|-----------------------|--------------------------|--------------------|--------------------------|---------------------------------------|
| ☐ | Camera – HD/IR | ☐ | Line String | ☐ | Pole-set |
| ☐ | Crew support | ☐ | Passenger | ☐ | Recon |
| ☐ | External Load | ☐ | Patrol | ☐ | Training |
| ☐ | HEC | ☐ | Photo | ☐ | Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____


Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1

□ Week 2

□ Week 3

TRANSFER (S):
2/C 1/0A-16KV (NW)(SE)

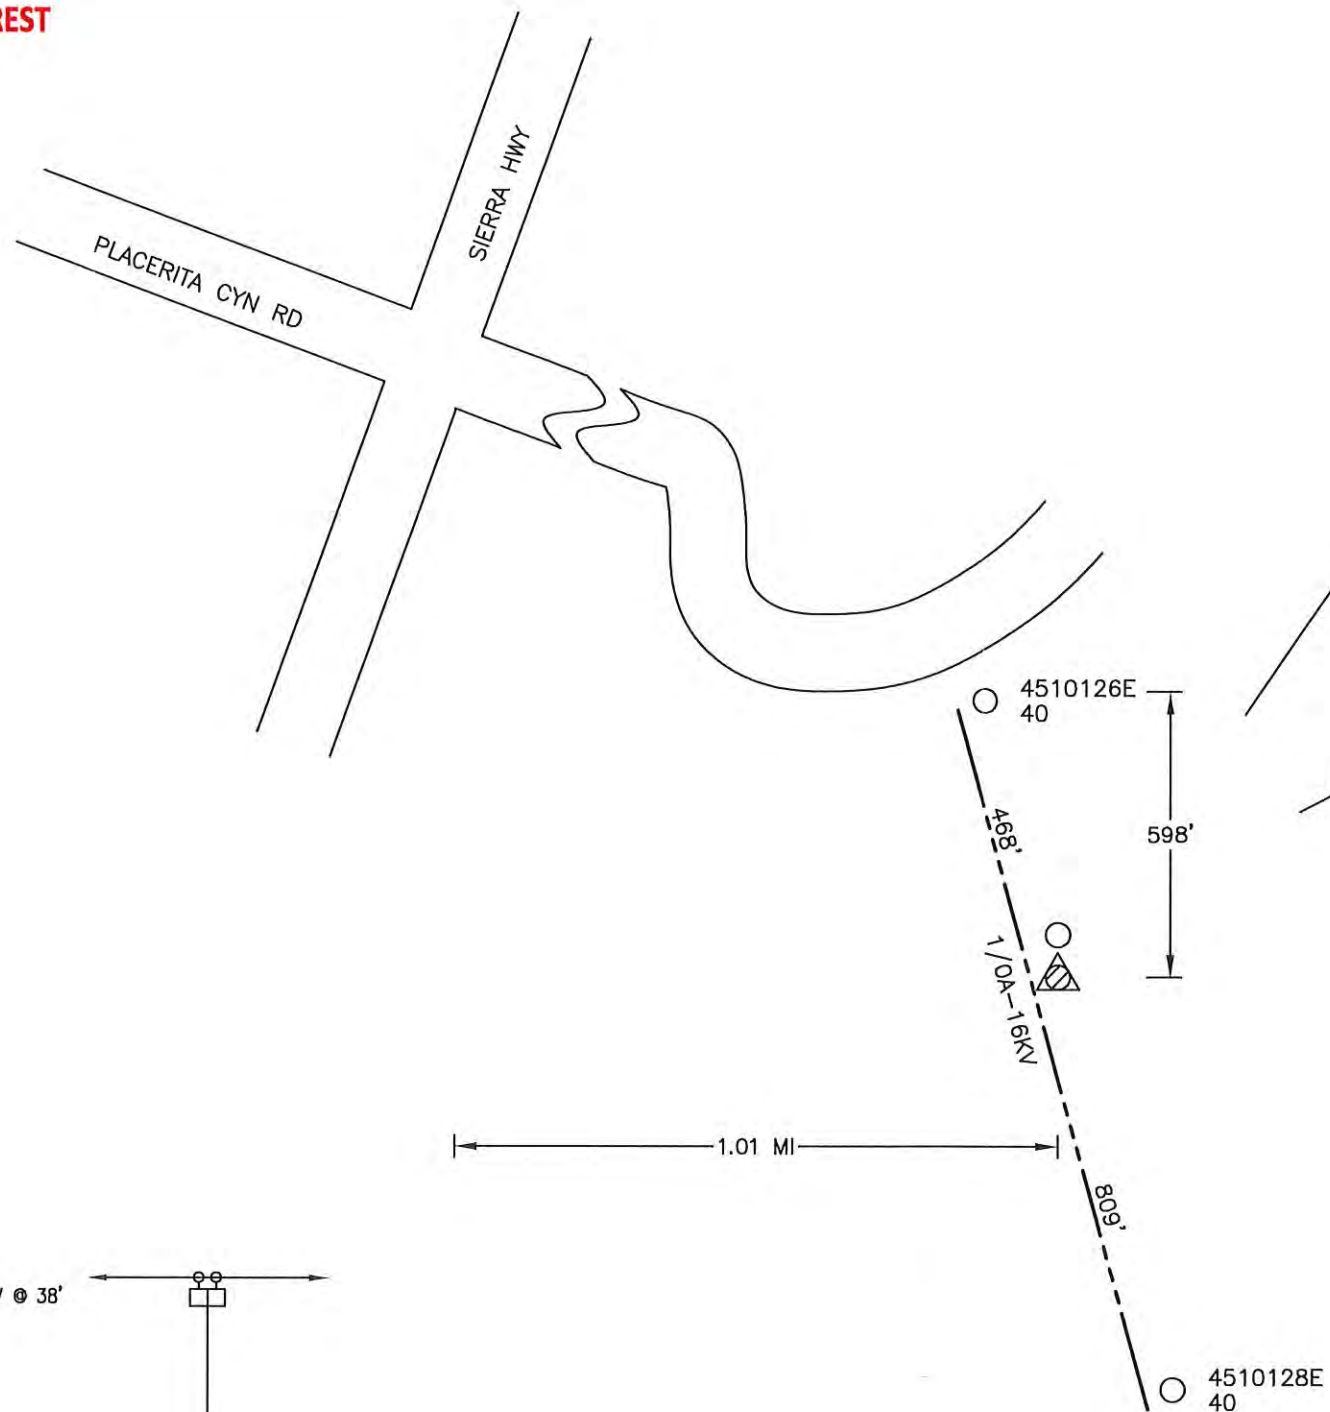


POLE **4510127E** **6**

45' Class C1

IN: 1- POLE 45' CLASS 1 WOOD FULL TREAT

IN: 1- XA DBLE FB 10' STEEL PINS

IN: 4- INS POLY W/PIN 16KV CLMP #4-653 ACSR

D124: Rev. 02/08/18

4510127E



LOOKING TO WEP #2 @ 809' →




* NOTES: E-ALL POLE
ENVIRO POLE - NATIONAL FOREST
RIGHTS CHECK REQ'D
REAL PROP. REVIEW
EAGLE ZONE
HELICOPTER SET
SET SAME HOLE

1 RM 4510137E Class C5
40'
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA SNGL VB 10' STEEL PINS
RM: 2- INS GLASS & PIN 16KV
RM: 4- INS POLY DE 16KV HOT SHOE #4 & 1/0 ACSR
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

USFS #Spec Use
SCECO DOC #98827
NO PHYSICAL CHANGES
ON THESE FACILITIES
WITHOUT PRIOR GOV'T
OR MANAGEMENT APPROVAL

TRANSFER (S):
2/C 1/0A-16KV (NW)(SE)

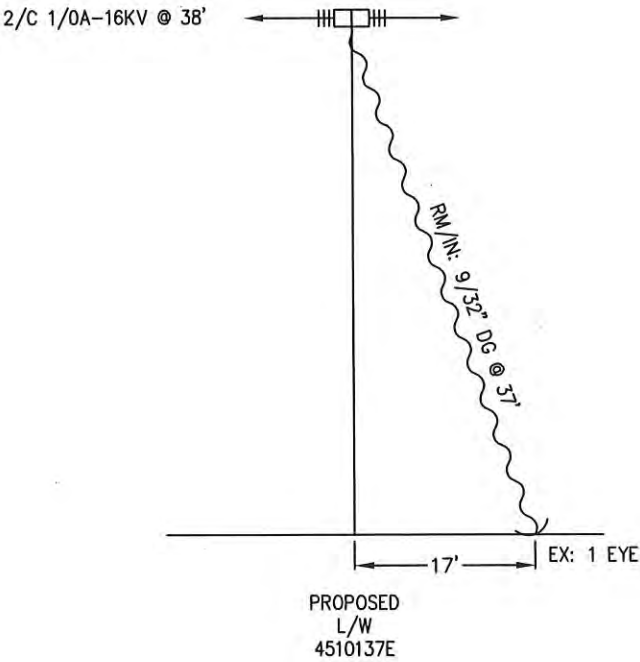

LOS ANGELES NATIONAL FOREST


PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☐
OUTAGE DATE:	TIME:
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 59 – VALENCIA				PROJ. MGR. PARK, JU PHONE 909-222-9350				PLANNER ASP PHONE 714-893-2405				DESIGNER ASP					
PROJECT NO. 1574370				SERVICE REQUEST 2484259				MSR NO.				PRODUCT-1 1382320-INFRA REPLAC – DET POLE REPLACEMENT				ASSOC DESGN	
CIRCUIT / VOLTAGE MAMBA 16KV								THOMAS GUIDE				PRODUCT-2				ASSOC DESGN	
SUB / PG NO. NORTH OAKS SUB								CIRCUIT CODE				PRODUCT-3				ASSOC DESGN	
INVENTORY MAP 101-59						J.P.A. NO.						PROPOSED CONSTRUCTION (LOCATION) 4510137E SANTA CLARA TRUCK RD 263' S, 1.89 MI E/O NEWHALL & WHITNEY CYN RD SANTA CLARITA, CA					

4510137E



* NOTES: E-ALL POLE
ENVIRO POLE - NATIONAL FOREST
RIGHTS CHECK REQ'D
REAL PROP. REVIEW
EAGLE ZONE
HARD ACCESS: OVERLAND TRAVEL
HELICOPTER SET
SET 1' WEST

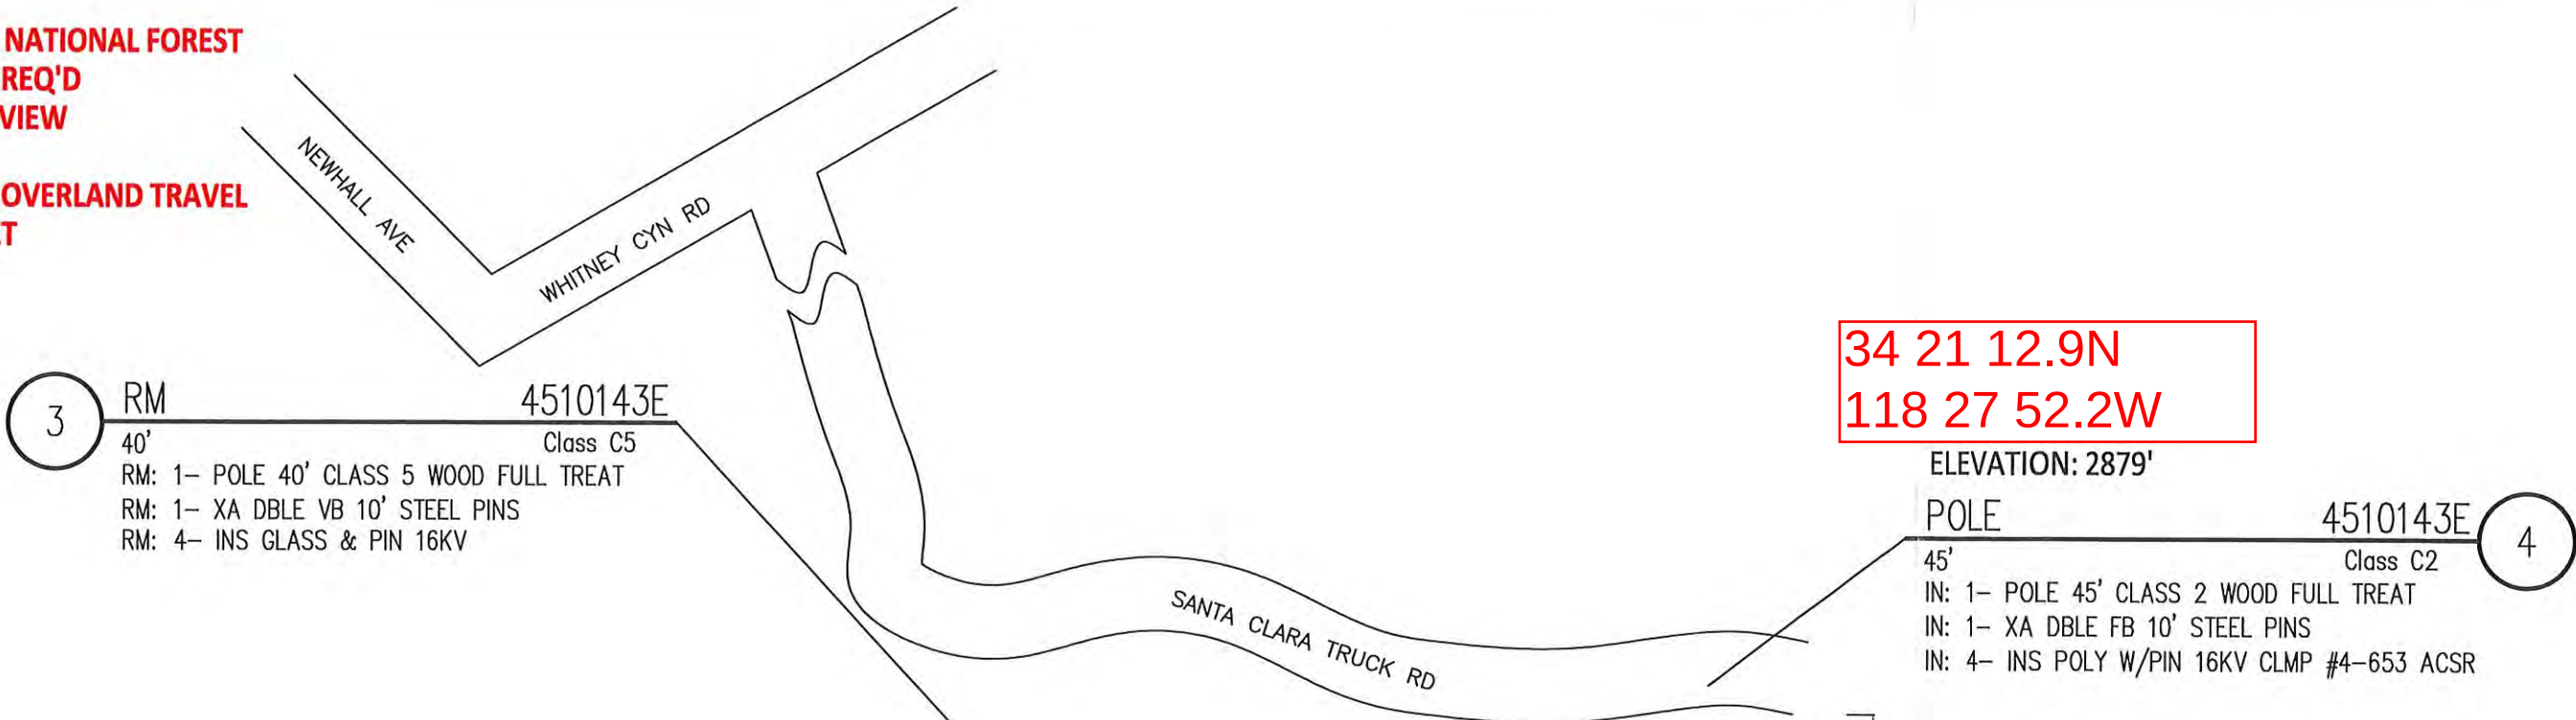

34 21 12.9N
118 27 52.2W

ELEVATION: 2879'


POLE 4510143E 4
45'
IN: 1- POLE 45' CLASS 2 WOOD FULL TREAT
IN: 1- XA DBLE FB 10' STEEL PINS
IN: 4- INS POLY W/PIN 16KV CLMP #4-653 ACSR

TRANSFER (S):
2/C 1/0A-16KV

LOS ANGELES NATIONAL FOREST

2/C 1/0A-16KV @ 38'

2.34 MI

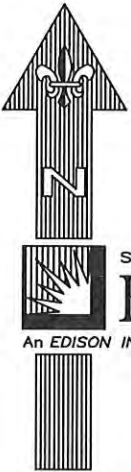

SOUTHERN CALIFORNIA
EDISON
An EDISON INTERNATIONAL Company

NOT TO SCALE

PROJECT REQUIREMENTS (Y/N)	
EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED	☒
PERMIT TYPE:	
OUTAGE REQUIRED	☐
OUTAGE DATE:	TIME:
TRAFFIC CONTROL REQUIRED	☐
PED. TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☒
CSD 140 (TLM) REQ'D	☐

DISTRICT 59 — VALENCIA			PROJ. MGR. PARK, JU PHONE 909-222-9350			PLANNER ASP PHONE 714-893-2405			DESIGNER ASP		
PROJECT NO. 1574370		SERVICE REQUEST 2484259		MSR NO.		PRODUCT-1 1382320-INFRA REPLAC — DET POLE REPLACEMENT				ASSOC DESGN	
CIRCUIT / VOLTAGE MAMBA 16KV				THOMAS GUIDE		PRODUCT-2				ASSOC DESGN	
SUB / PG NO. NORTH OAKS SUB				CIRCUIT CODE		PRODUCT-3				ASSOC DESGN	
INVENTORY MAP 101-60			J.P.A. NO.			PROPOSED CONSTRUCTION (LOCATION) 4510143E SANTA CLARA TRUCK RD S/S 1940' W/O NEWHALL & WHITNEY CYN RD 2.34 MI NEWHALL, CA					
					ASP						
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET			DESIGN\DRWG NO.		
Southern California Edison Company						_____ OF _____			1020628_0.01		

4510143E

District: SECT-9 800' W/O C/L, 625' N/O T3N R15W NEWHALL
 59 VALENCIA FIM: 101-60
 Circuit: MAMBA 16KV Latitude: N
 Substation: NORTH OAKS Longitude: W
 W.O. #: 1382320 T.G. Page: NA 270°

Load Case:

Loading: Wind: Grade

Pole #: 4510143E New pole # 4510143E ☐ In Service ☐ New
 Type: Pole Ht
 Class: Yr In
 AG GLC (In.)
 In Ground: Brand Height

Poles
 # Bldg
 # Anchor
 E Equipment

CST____
 MF-____
 EZ-____
 B322-____
 MOD-____

Next Direct Incl Prev Direct Incl

EQUIPMENT SECTION (*) = N/A						
WEP# Revised	Wire End Points	*Distance/Span Direction	Owner	*Group	Quantity Attach Height	*Wire Selection (i.e. 1/0 ACSR) Equipment Type/Size/POA
☐ Rm	☐ Next ☐ Prev ☐ Other ☐ Bldg ☐ Equip		☐ T ☐ B ☐ ECS ☐ CATV ☐ Telco	☐ Pri. ☐ Sec. ☐ Srvc ☐ Guy		

