


CREW NOTES:

- POLE# 1624019E IS LOCATED NORTHEAST CORNER OF 14701 BLUE SKY RD.
- POLE IS LOCATED 185' UP ON STEEP HILL AT 900' ELEVATION.
- CRANE NEEDED.
- VEGETATION NEEDED.
- SET NEW POLE 1' EAST OF CURRENT LOCATION.
- TRANSFER EXISTING SCE PRIMARY, SERVICE & DOWN GUY TO NEW POLE.
- SCE CREW TO TRANSFER CATV/COMM CABLE & DOWN GUY TO NEW POLE.



PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED	☐
PWRD 88 REQUIRED	☐
UG CIVIL ONLY WORK ORDER	☐
PERMIT REQUIRED: ☐ TYPE: ☐	
OUTAGE DATE: ☐ TIME: ☐	OUTAGE REQ'D ☐
TRAFFIC CONTROL REQ'D	☐
PEDESTRIAN TRAFFIC CONTROL REQ'D	☐
CONVEYANCE LETTER REQ'D	☐
ENVIRONMENTAL CLEARANCE REQ'D	☐
CSD 140 (TLM) REQ'D	☐



NOTIFICATIONS:

410117804, 400372707 &
400480676

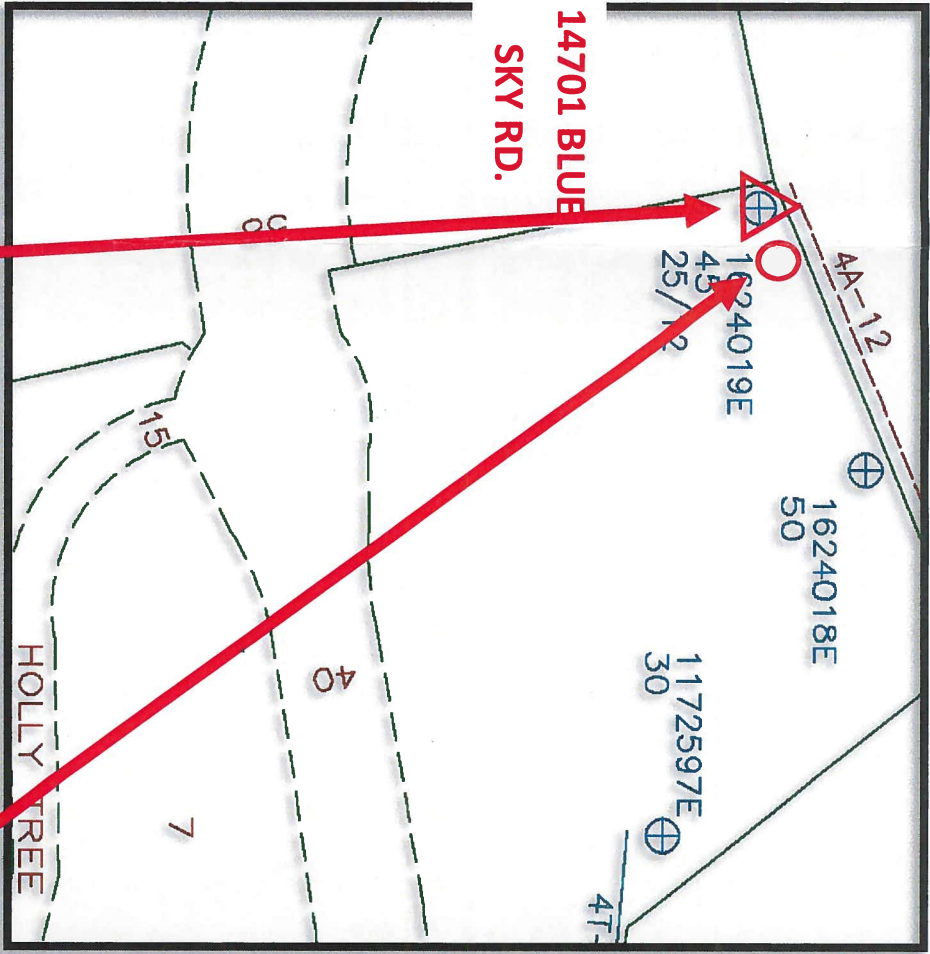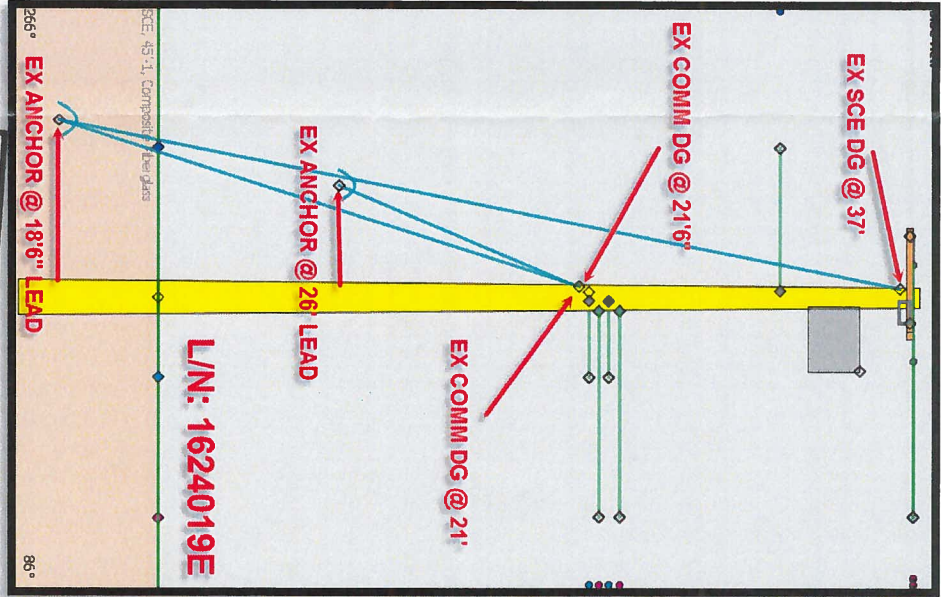

SHOPPER 12KV O/O WALNUT

PLANNER: DRE MIRANDA	JOB NAME: OCI	FOREMAN:	DISTRICT: 26 - COVINA
TD1601286	JOB LOCATION: NORTHEAST CORNER OF 14701 BLUE SKY RD., HACIENDA HEIGHTS (ON TOP OF HILL)	TRUCK: P/E:	DATE SENT TO RM: DIST. SKETCH # 1194732_0.01
AL NO.:	TLM-CSD 140 REQUIRED YES ☐ NO ☒	DRAWN BY: DRE MIRANDA	INV. MAP NO. S 110-4287-1
J.P.A. NO.:	GRID NO. THOMAS MAP	WORKED BY:	INV. MAP NO. S
E6026-410436492	EXST. SIZE KVA CUST. LOAD 25 16.4 1 65%	PROG. 25 16.4 1 65%	VERIFIED: (V)
RELATED W.O.:	VOLTAGE DROP PRI. CIRCUIT: WALNUT 12KV		

STATION 1

RM: 1624019E

45' C5 (DF)

RM: (1) 45' C4 WD POLE

RM: (1) 10' SINGLE WD XARM

RM: (2) 12KV DE INSULATORS

RM: (2) OPEN STYLE CUTOUTS

RM: (1) 25KVA TRANSFORMER

RM: (1) SECONDARY GROUND

RM: (1) SECONDARY ROLLER

STATION 2

IN: 1624019E

45' C1 (COMP)

IN: (1) 45' C1 COMP POLE

IN: (1) 10' SINGLE DE COMP XARM

IN: (2) 12KV DE INSULATORS

IN: (2) FAULT TAMERS

IN: (2) SMD FUSEHOLDERS

IN: (1) 25KVA TRANSFORMER

IN: (1) SECONDARY GROUND

IN: (1) SECONDARY ROLLER