

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

**required information*

For office use only

Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

CONCEPCION 16KV GAVIOTA SUB

PROJECT REQUIREMENTS (Y/N)EDISON EASEMENT REQUIRED PWRD 88 REQUIRED UG CIVIL ONLY WORK ORDER NPERMIT REQUIRED PERMIT TYPE: N/AOUTAGE REQUIRED ☒ Y

OUTAGE DATE: _____ TIME: _____

TRAFFIC CONTROL REQUIRED ☒ N

PED. TRAFFIC CONTROL REQ'D ☒ N

CONVEYANCE LETTER REQ'D ☒ N

ENVIRONMENTAL CLEARANCE REQ'D ☒ YCSD 140 (TLM) REQ'D ☒ N

0124 Rev 02/08/13

T.L.M. DATA: 712122E

SIZE	KVA	CUST	% LOAD
------	-----	------	--------

EXIST.	<u>-10</u>	<u>-2.2</u>	<u>-1</u>	<u>-22</u> %
--------	------------	-------------	-----------	--------------

PROP. -25 -2.2 -1 -.08 %

VOLTAGE DROP: N/AFLICKER FACTOR: N/A

PRI. CIRCUIT: CONCEPCION 16KV



NOT TO SCALE

NOTES:

TRUCK ACCESS - NO

HARDSET NORTH (BOTH PALES)

HELICOPTER SETS - HAND DIG

TIER 2 ELEVATED HFA

JPA NOTES FOR 712122E:

FTR (22')

E TO PTD
E TO TOON

E TO TRANSFER COMM

NEEDS TO BE A 50'
712122E POLE (1)

712122E *POLE*
NOTIFICATIONS:

410073808

403939948

712121E

NOTIFICATIONS:

410164250

1 RM: 712122E POLE
40' CLASS 5
RM: 1- 20' VB DBL XARM
RM: 4- POLY DE 16KV
RM: 2- OPEN CUTOUTS 16KV
RM: 1- 10KVA XFMR 120/240V 16KV 1P
SN: _____
RM: 2- 9/32" DOWN GUYS
RM: 2- 2 EYE ANCHDRS
RM: 1- 5' SNGL FB XARM
RM: 1- SEC GROUND

2 IN: 7/2/22E POLE

45' CLASS 1 COMPOSITE
IN: 1- 20' COMPOSITE DE HFRAME
IN: 4- 16KV DE INSULATOR 4/0 STR CU D.E.
IN: 2- INS POLY W/ PIN 16KV CLMP #16-4/0 CU
IN: 1- 8' COMPOSITE XARM TANGENT
IN: 2- ELF CUTDUTS 16KV
IN: 2- 60A ELF FUSE LINKS
IN: 1- 25KVA XFMR 12D/24DV 16KV 1P
SN: _____

IN: 1- UNISTRUT
IN: 1- SEC GROUND
IN: 1- 5' COMPOSITE XARM TANGENT
IN: 2- 9/32" D.G. (@ 37' - EAST & WEST)
IN: 2- 1 1/4" ANCHOR (32' LEAD, WEST & 24' LEAD, EAST)


584' 3-4
O 453847
O 453847

3 RM: 712121E POLE
40' CLASS 5
RM: 2- POLY DE 110KV
RM: 1- 8' SNGL FB XARM
RM: 2- ELF DBL FUSES
RM: 1- #2 BRACKET NO FUSE HOLDERS 110KV
RM: 1- PRI GROUND
RM: 2- 9/32" DOWN GUYS
RM: 2- 2 EYE ANCHORS


4 IN: 712121E POLE

45' CLASS 1 COMPOSITE
IN: 2- 16KV DE INSULATOR 4/0 STR CU D.E.
IN: 1- INS POLY W/ PIN 16KV CLMP #6-4/0 CU
IN: 1- 8' COMPOSITE XARM TANGENT
IN: 2- SMD-20 17" 200A (FD49336)
IN: 2- 15E FUSE LINKS
IN: 1- #2 POTHEADS W/ LA'S 16KV
IN: 1- PRI GROUND
IN: 1- UNISTRUT
IN: 2- 9/32" DOWN GUYS (@37' - EAST & WEST)
IN: 2- 1 1/4" ANCHDR (32' LEAD, WEST & 24' LEAD, EAST)

GPS LOCATION
N 34° 28' 03.79"
W 120° 21' 35.42"

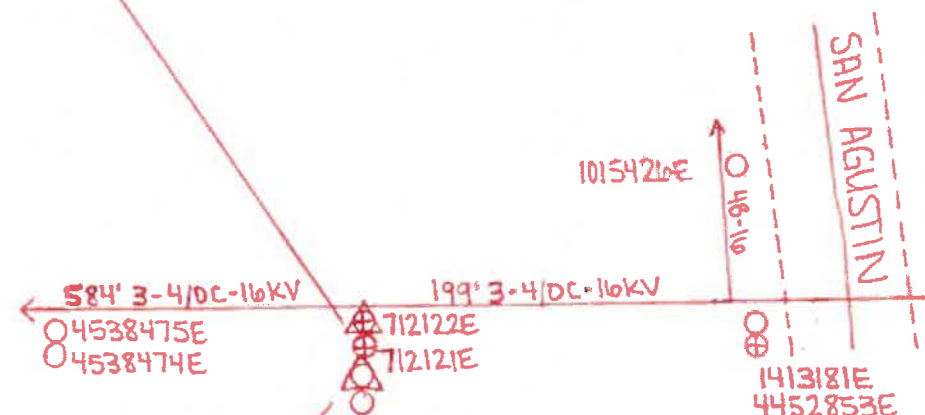

SINGLE LINE
CONCEPCION 110KV % GAVIOTA SUB

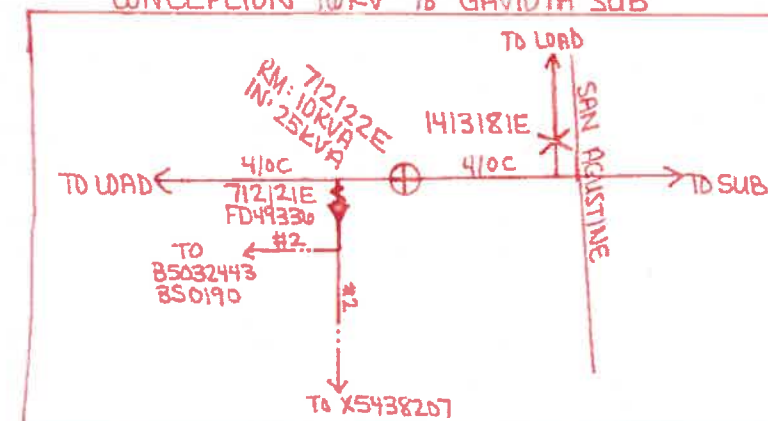

DISTRICT 49-SANTA BARBARA		PROJ. MGR. MIKE DIAZ PHONE 805-338-4089		PLANNER PHONE JEFF AZAULA		DESIGNER	
PROJECT NO.		SERVICE REQUEST		MSR NO.		PRODUCT-1 TD1572100	
CIRCUIT / VOLTAGE CONCEPCION 16KV		THOMAS GUIDE		PRODUCT-2		ASSOC DESGN 1171087	
SUB / PG NO. GAVIOTA SUB		CIRCUIT CODE		PRODUCT-3		ASSOC DESGN	
INVENTORY MAP 360-1284-2		J.P.A. NO. E10049-410397692		PROPOSED CONSTRUCTION (LOCATION)			
				29 HOLLISTER RANCH RD			
				GOLETA			
		M.DIAZ	H.JORDAN	H.JORDAN			
TYPE	DATE	APPROVED BY	CHECKED BY	DRAWN BY	PAX #	SHEET	DESIGN\DRWG NO.
Southern California Edison Company						1 OF 1	1171087

