

SCE Aircraft Operations Flight Request Form

Instructions: Please complete this form in its entirety and email to: airops@sce.com or fax to 909-974-4678. Once this form is received by Aircraft Operations, you will receive a response within 24 hours. For questions call SCE Aircraft Operations Dispatch at PAX 11676.

Requestor Information

Flight requested by:*	
Department:*	
Pax:*	
Cell Number:*	
Email Address:*	

SAP Accounting Number*	
-------------------------------	--

Flight Description

Please choose a mission type:

- | | | |
|---|--------------------------------------|---|
| ☐ Camera – HD/IR | ☐ Line String | ☐ Pole-set |
| ☐ Crew support | ☐ Passenger | ☐ Recon |
| ☐ External Load | ☐ Patrol | ☐ Training |
| ☐ HEC | ☐ Photo | ☐ Need more info, please contact |

Mission specific details (ex: Passenger name, pole size/weight, external load type, etc):

General Operating Location	
District	
LZ Coordinates (if known)	
Pick-up location for passenger flights	
Drop-off location for passenger flights	

Date(s) for which service is requested	
Time of Pick-up	
Approx. mission duration (if known)	
Back-up date for mission (if known)	

Authorizer	
Authorizer PAX and cell number	

APPROVED

By Omar Sharif at 10:07 am, Jun 16, 2020

**required information*

For office use only



Date Received by Aircraft Operations: _____ Date Initial Contact Made: _____

Referred to contractor: ☐ No ☐ Yes, Date: _____ Company: _____

Follow up status: ☐ Week 1 _____

☐ Week 2 _____

☐ Week 3 _____

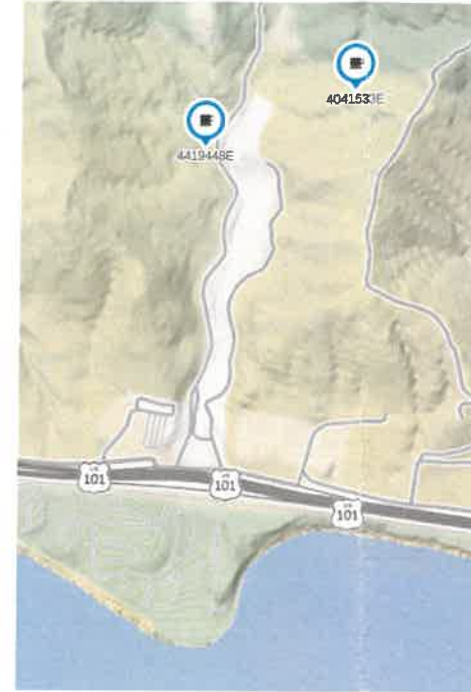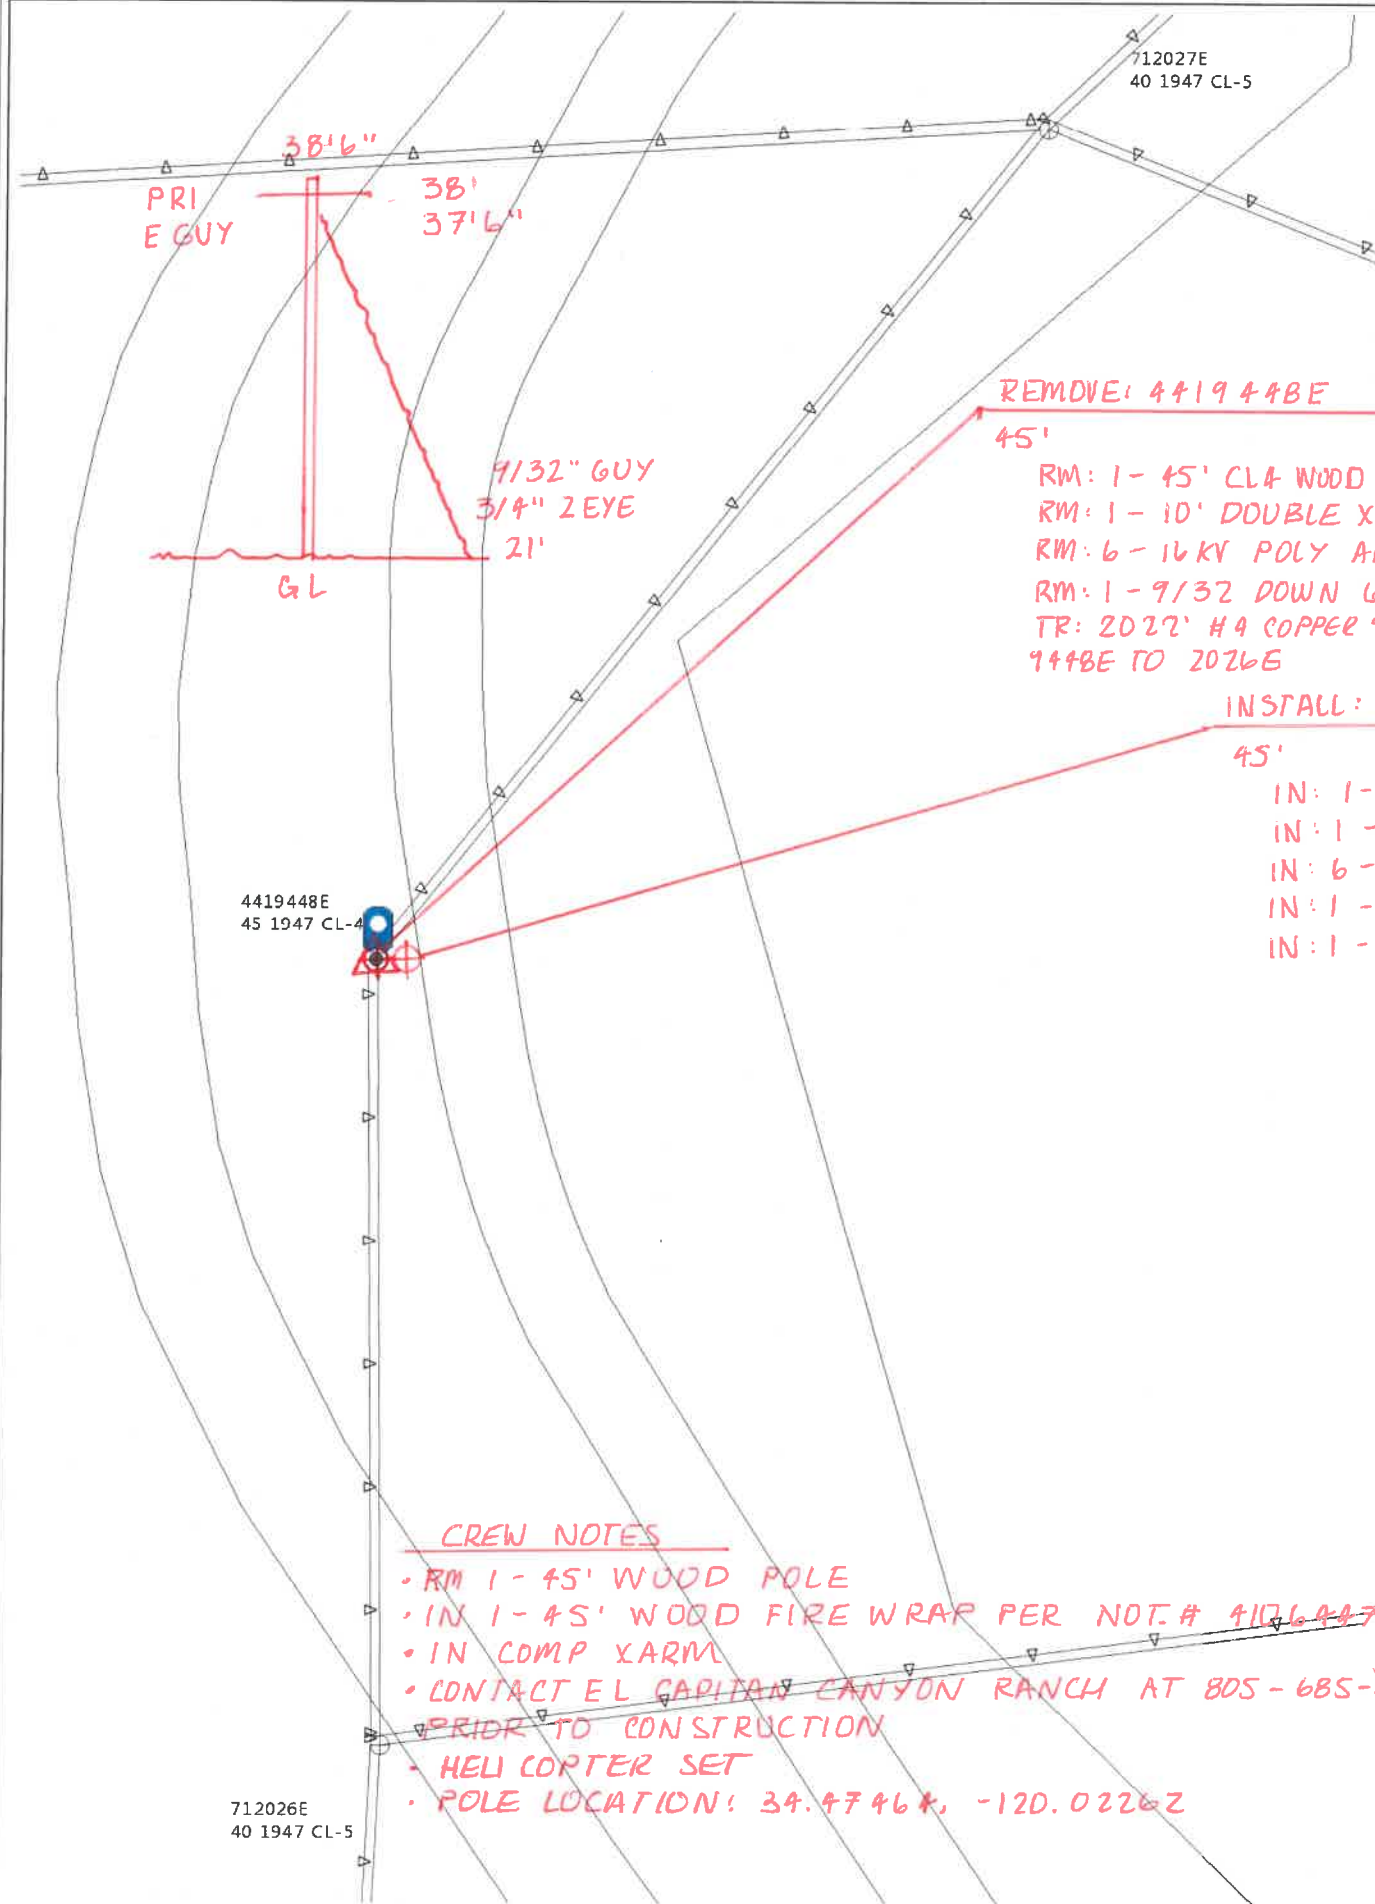

PROJECT REQUIREMENTS (Y/N)

EDISON EASEMENT REQUIRED ☐

PWRD 88 REQUIRED ☒

UG CIVIL ONLY WORK ORDER ☐

PERMIT REQUIRED ☐

PERMIT TYPE: P/P

OUTAGE REQUIRED ☒

OUTAGE DATE: TBD TIME: TBD

TRAFFIC CONTROL REQUIRED ☒

PED. TRAFFIC CONTROL REQ'D ☐



CONVEYANCE LETTER REQ'D ☐

ENVIRONMENTAL CLEARANCE REQ'D ☒

CSD 140 (TLM) REQ'D ☐

D124: Rev. 02/08/18

- REMOVE: 441944BE POLE 1**
 45' CL4
 RM: 1- 45' CL4 WOOD POLE
 RM: 1- 10' DOUBLE XARM WOOD
 RM: 6- 16KV POLY ANGLE PIN INS #4 COPPER
 RM: 1- 9/32 DOWN GUY
 TR: 2022' #4 COPPER 944BE TO 2027E, 1512' #4 COPPER 944BE TO 2026E
- HELI COPTER SET**
INSTALL: 441944BE POLE 2
 45' CL1
 IN: 1- 45' CL1 WOOD FIRE WRAP POLE
 IN: 1- 10' COMPOSITE WOOD XARM TANGENT BKT
 IN: 6- 16KV POLY ANGLE PIN INS #4 COPPER
 IN: 1- 9/32 DOWN GUY
 IN: 1- METAL GUY GUARD

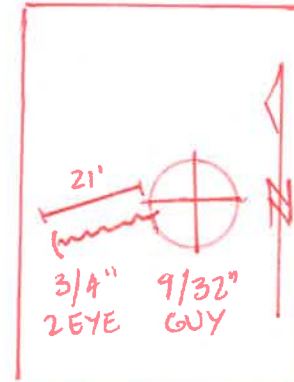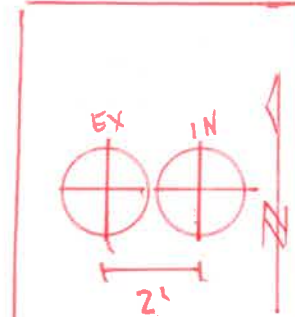

T.L.M. DATA:

	SIZE	KVA	CUST	% LOAD
EXIST.	NA			%
PROP.	NA			%
VOLTAGE DROP: <u>NA</u>				
FLICKER FACTOR: <u>NA</u>				
PRI. CIRCUIT:				

CREW NOTES

- RM 1- 45' WOOD POLE
- IN 1- 45' WOOD FIRE WRAP PER NOT.# 410644780 ROTTEN
- IN COMP XARM
- CONTACT EL CAPITAN CANYON RANCH AT 805-685-3887
- PRIOR TO CONSTRUCTION
- HELI COPTER SET
- POLE LOCATION: 34.4746N, -120.0226W

NOTIFICATION #: 410644780 DUE DATE: 6-17-20 NOT TO SCALE

DISTRICT SANTA BARBARA-49		PROJ. MGR. PHONE		PLANNER PHONE BOS-276-1614		DESIGNER	
PROJECT NO. 1931139		SERVICE REQUEST 2832167		MSR NO.		PRODUCT-1 TD1662540 - DC1 POLE REPL	
CIRCUIT / VOLTAGE MIST 16KV		THOMAS GUIDE		PRODUCT-2		ASSOC DESGN	
SUB / PG NO. CAPITAN SUB		CIRCUIT CODE		PRODUCT-3		ASSOC DESGN	
INVENTORY MAP 21-40		J.P.A. NO.		PROPOSED CONSTRUCTION (LOCATION) APPROXIMATE: 11560 CALLE REAL GOLETA 93117			
DATE 3/3/20		APPROVED BY WRIECL		SHEET 1 OF 1		DESIGN\DRWG NO.	



